











We reserve all rights in this document and in the information contained therein. Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © Copyright 2003 ABB

LEGEND SYMBOLER		SHEET BLAD	CONTENT INNEHÅLL
	Motor Motor	101	List of contents Innehållsförteckning
	Brake Broms	102	Location of connection points Översikt över delningspunkter
	Temp. sensor (PTC-resistor) Temp. givare (PTC-motstånd)	103	Breake release unit, Serial measuring board Bromslossningsenhet, seriemätkort
	Resolver Resolver	104	Motor axis 1-3 Motor axel 1-3
	Protective earth Skyddsjord	105	Feed-back axis 1-3 Återföringsdon axel 1-3
	Twisted cables Tvinnade kablar	106	Motor axis 4-6, 1,5-10/16 Motor axel 4-6, 1,5-10/16
	Screened cables Skärmade kablar	107	Feed-back axis 4-6, 1,5-10/16 Återföringsdon axel 4-6, 1,5-10/16
	Location pin to avoid mismatch of connector Nyckelstift för att förhindra felanslutning	108	Motor axis 4-6, 1,8-5 Motor axel 4-6, 1,8-5
		109	Feed-back axis 4-6, 1,8-5 Återföringsdon axel 4-6, 1,8-5
		110	Customer connection Kundanslutning
		111	Integrated wirefeed cabling; OPTION Integrerat kablage F. trådmatarverk; OPTION
		112	Position indicator axis 1; OPTION Lägesindikering axel 1; OPTION
		113	External connections; OPTION Yttre anslutningar; OPTION

Latest revision: ECO 69647, WI 75550 Sh.113: Loop "PTC" was "PTC M" and "0V PTC".				Lab/Office: DMRO SE/ PRIM	Manipulator IRB 2400 circuit diagram	Status: 2015-02-11	Plant: =	
						APPROVED	Location: +	
Prepared by, date: Erik Mesaros					Legend/Table of contents	Document no.	Rev. Ind	101
						3HAC6670-3	03	Next 102
							Total 13	

We reserve all rights in this document and in the information contained therein. Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © Copyright 2003 ABB

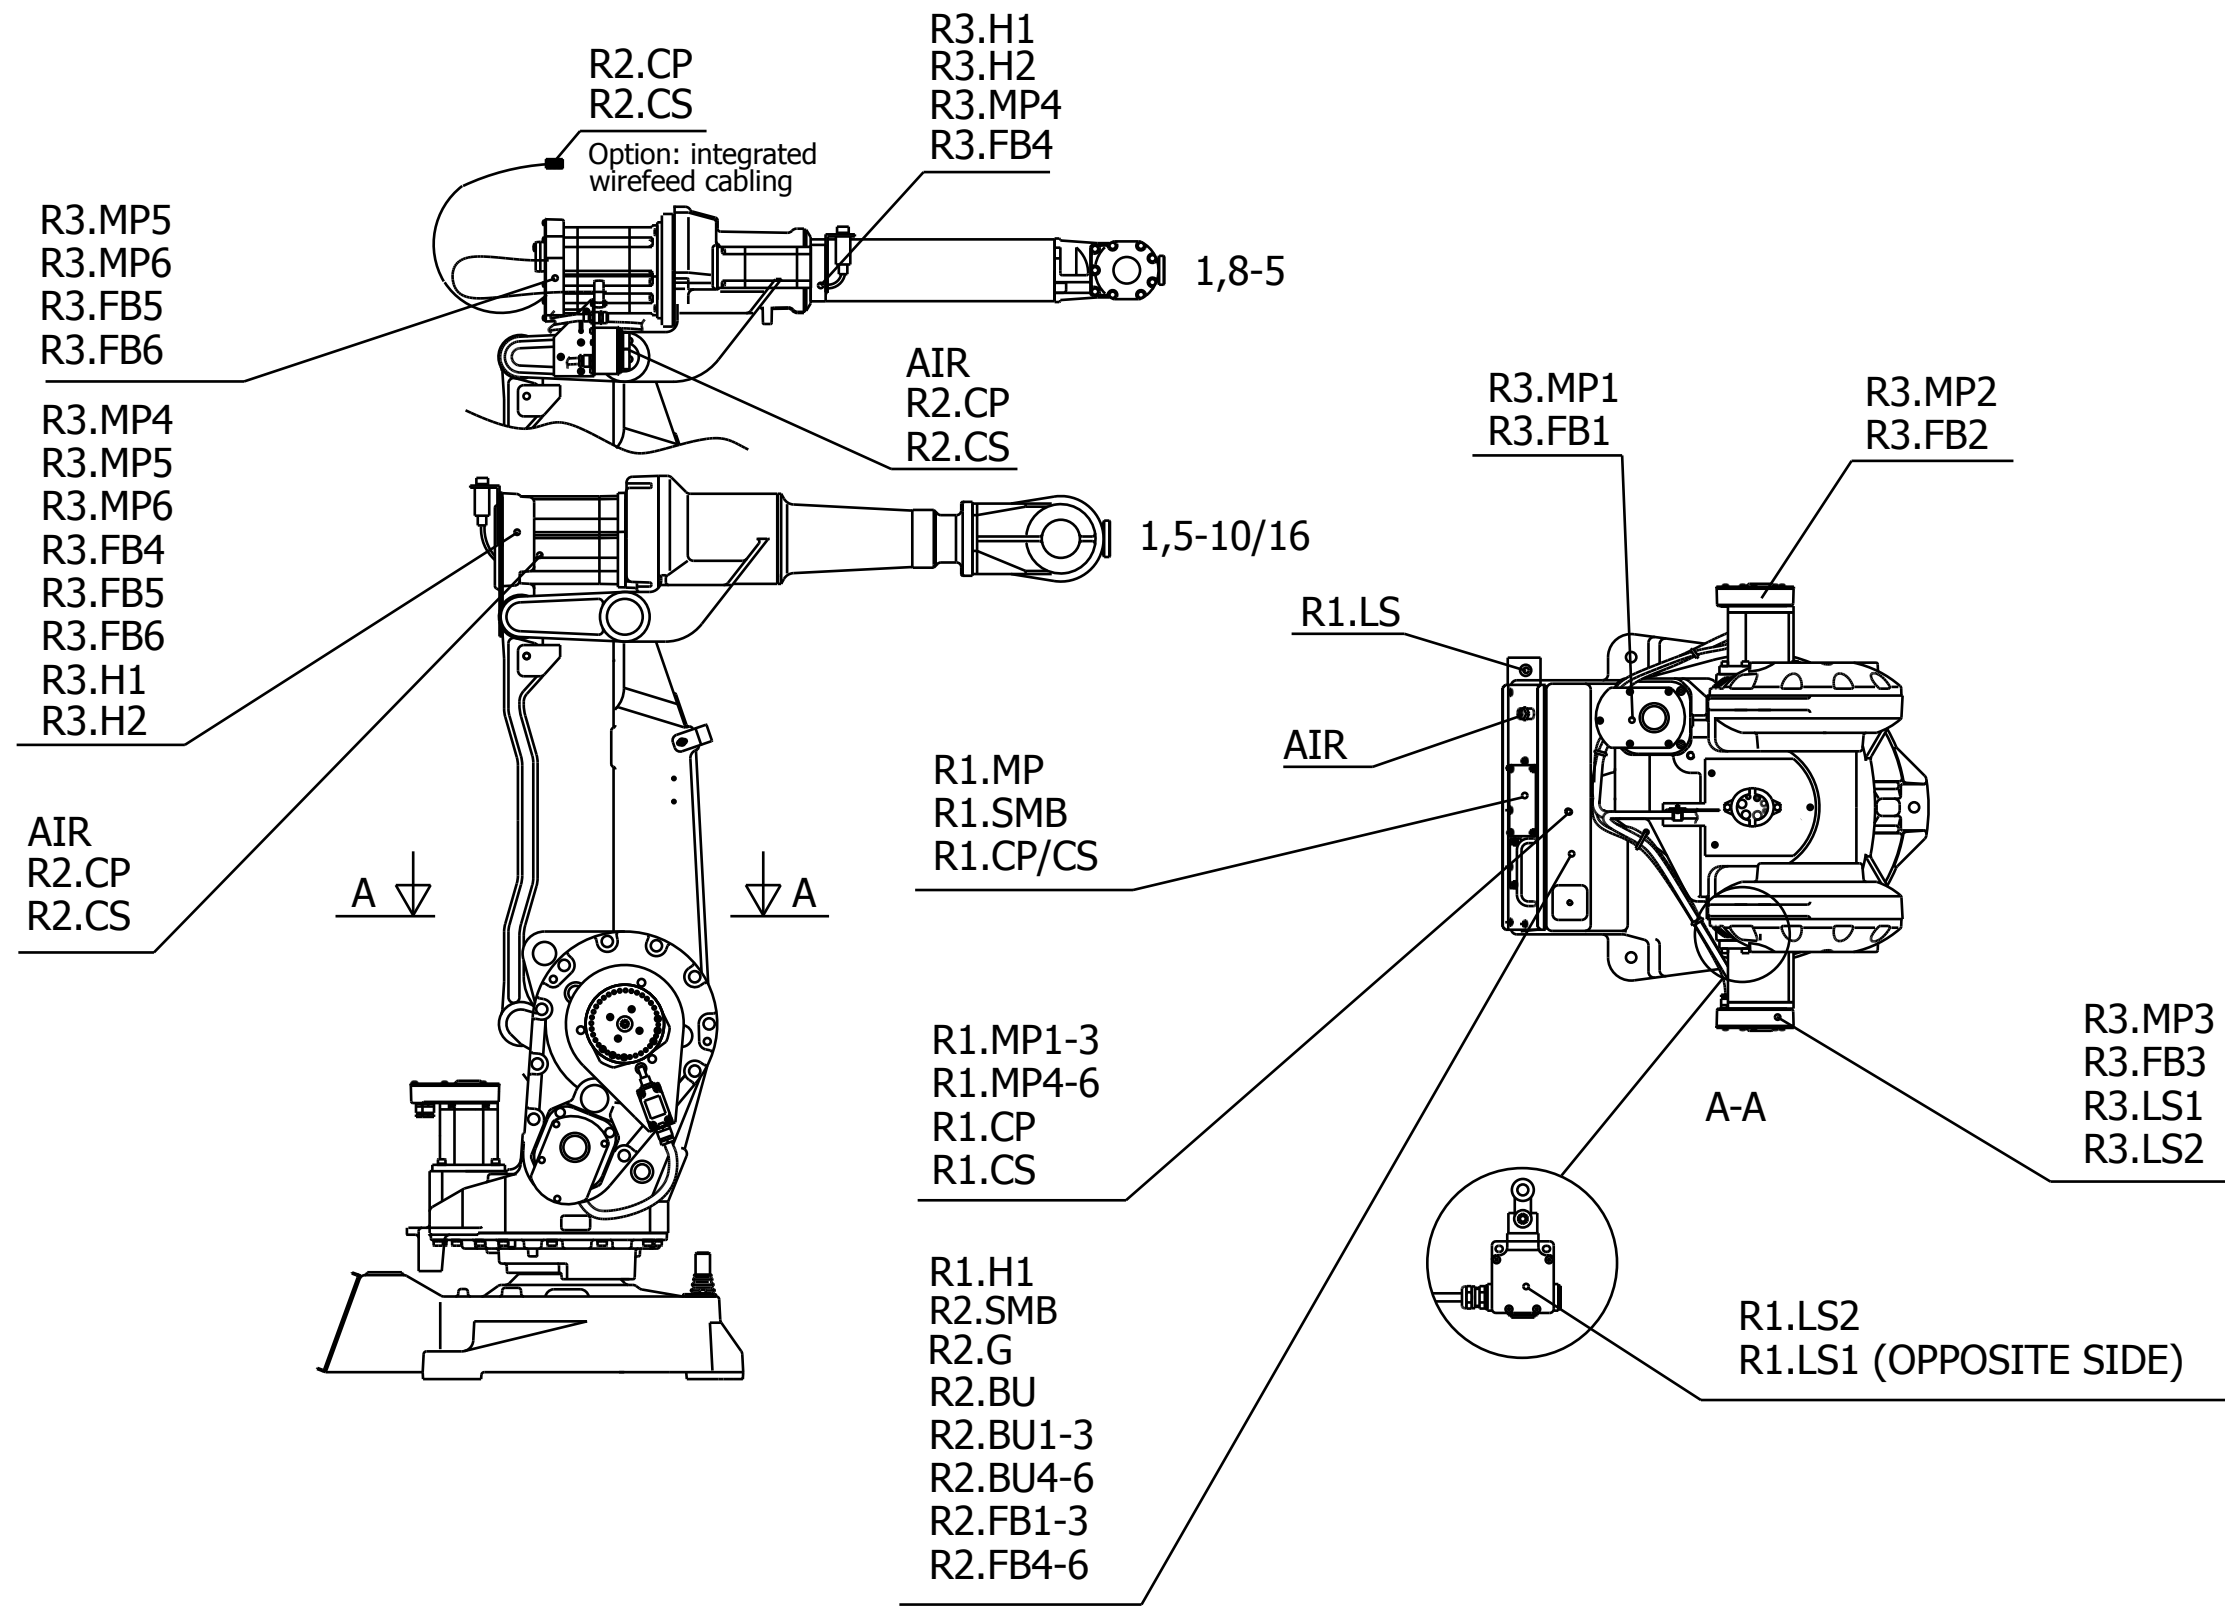

Latest revision: ECO 69647, WI 75550
Sh.113: Loop "PTC" was "PTC M" and "0V PTC".

ABB

Lab/Office:
DMRO SE/
PRIM

Manipulator IRB 2400 circuit diagram

Location of connection points

Status: 2015-02-11

APPROVED

Document no.

3HAC6670-3

Plant: =
Location: +
Sublocation: +

Rev. Ind

03


102

Next 103

Total 13

Prepared by, date: Erik Mesaros Approved by, date: Jan-Erik N hls

We reserve all rights in this document and in the information contained therein. Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © Copyright 2003 ABB

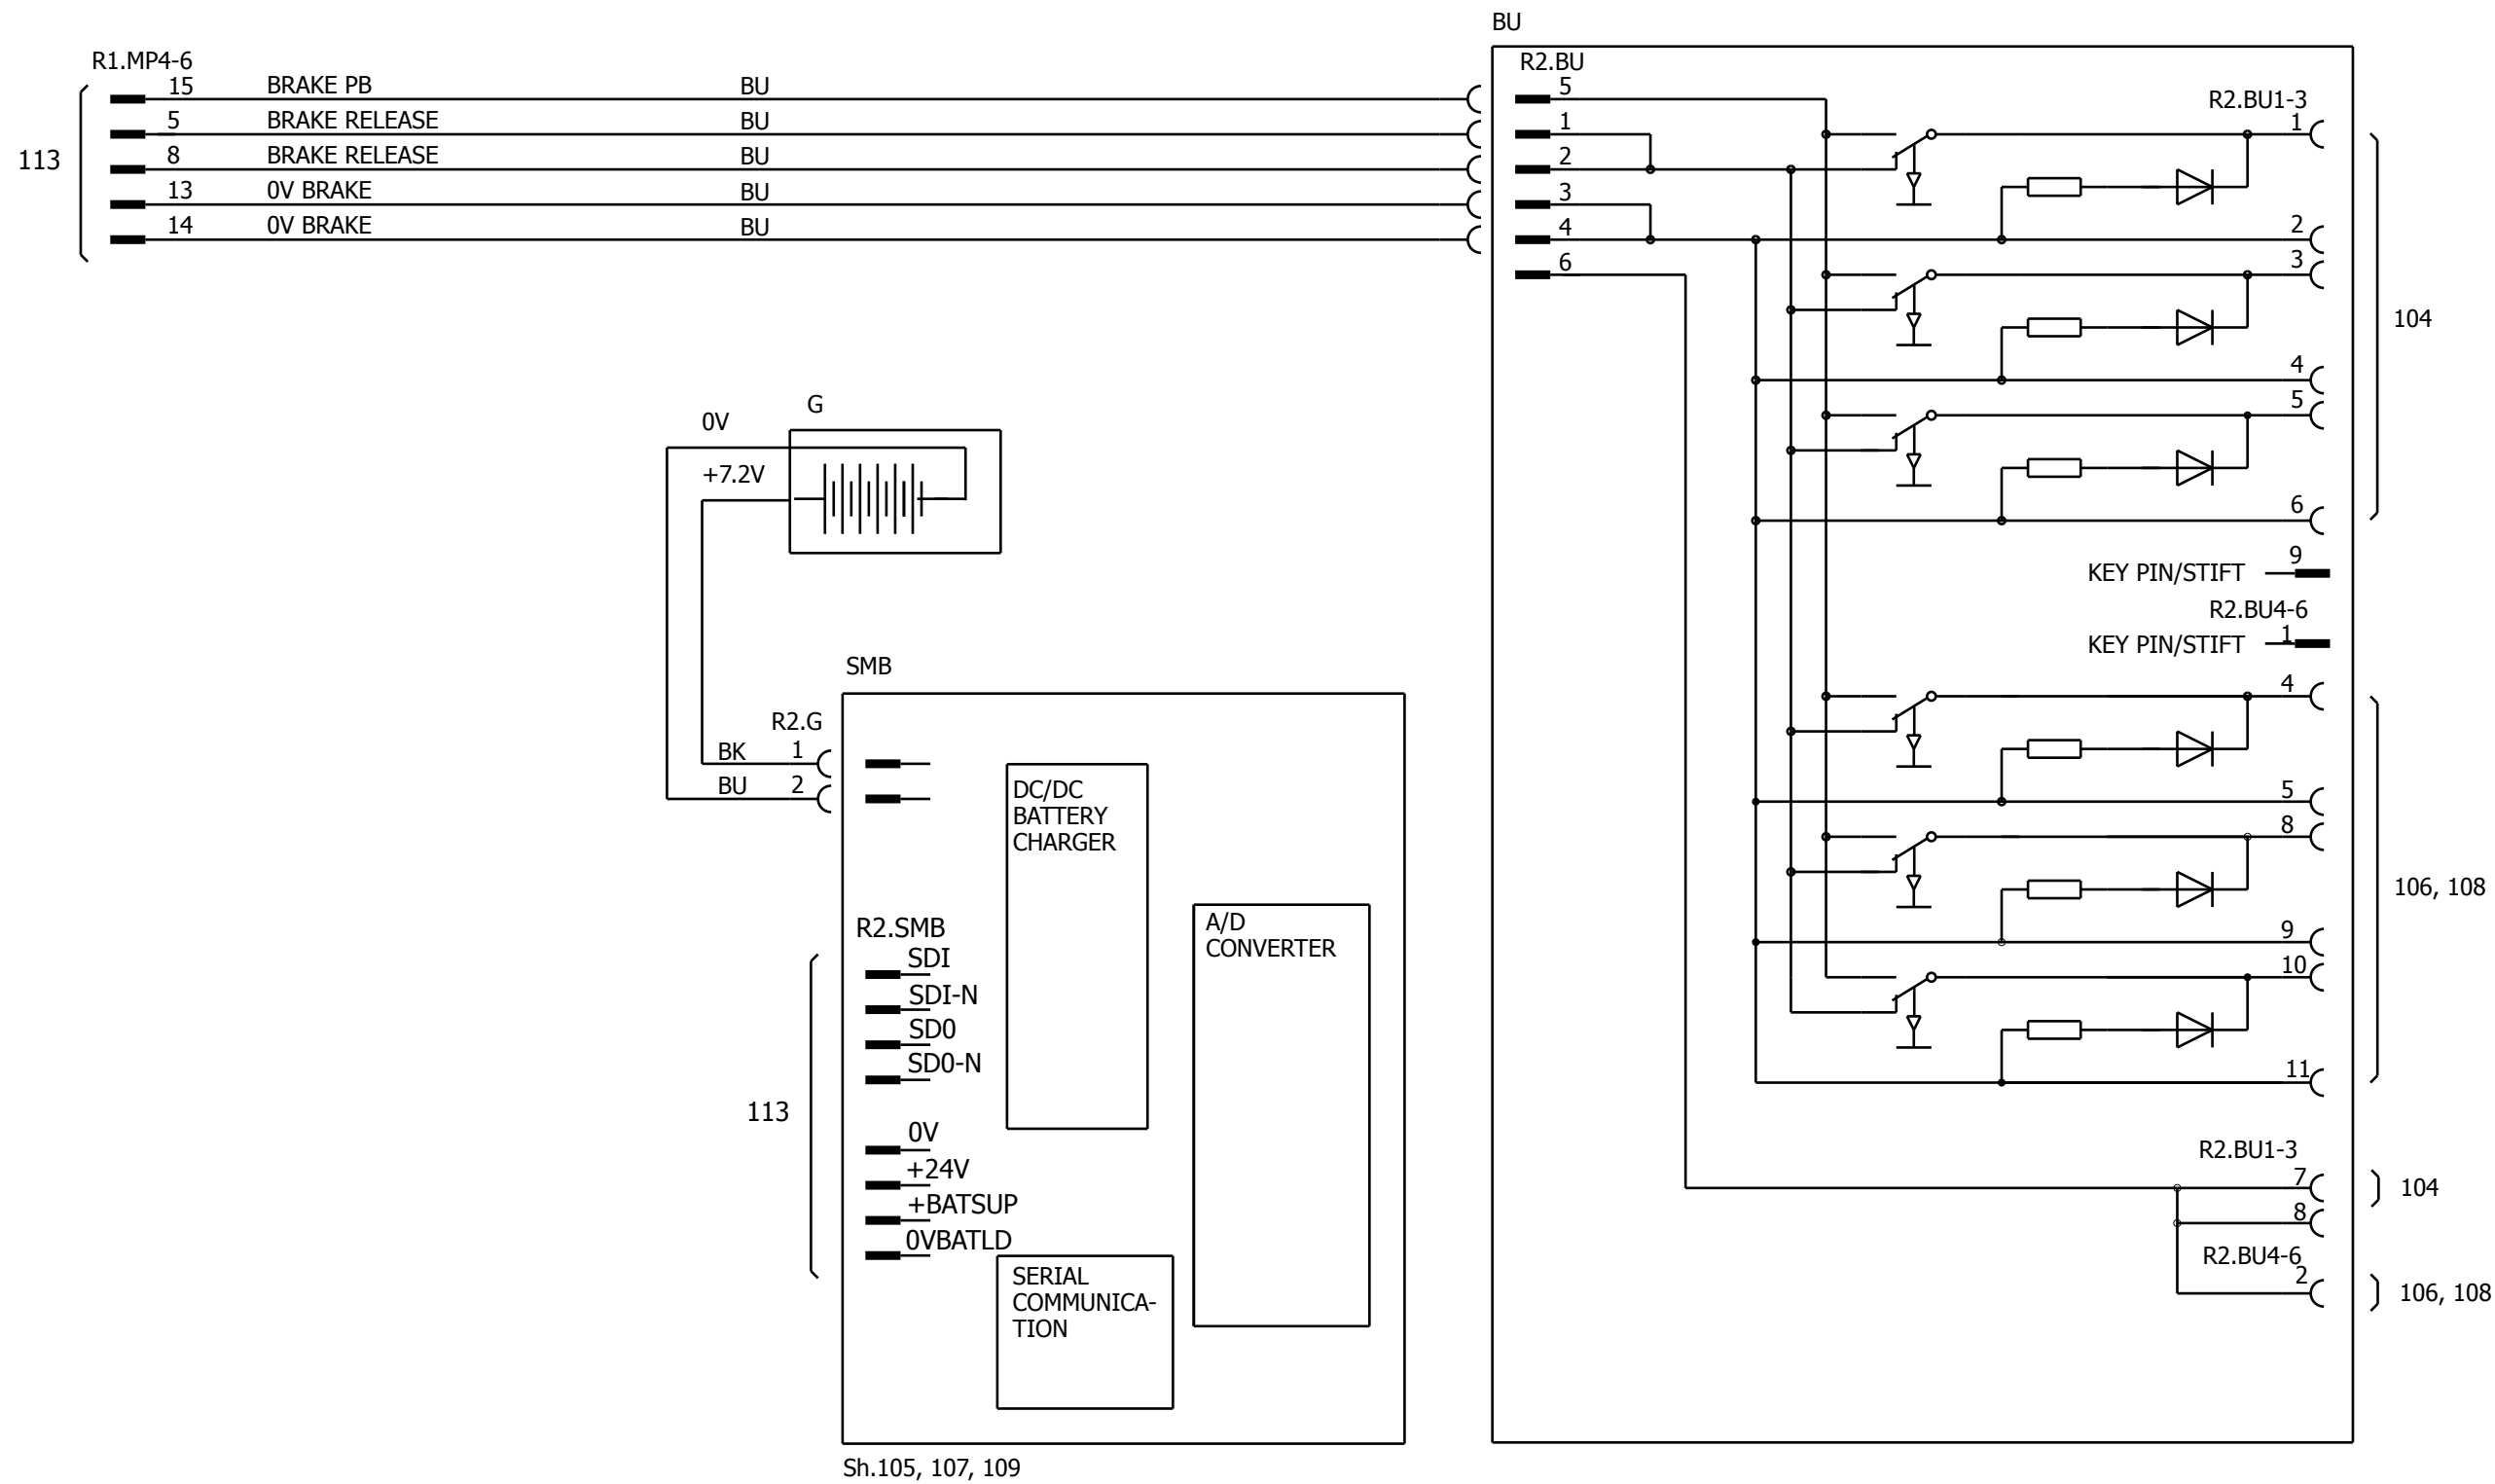

Latest revision: ECO 69647, WI 75550
Sh.113: Loop "PTC" was "PTC M" and "0V PTC".



Lab/Office:
DMRO SE/
PRIM

Manipulator IRB 2400 circuit diagram

Brake release unit

Status: 2015-02-11

APPROVED

Document no.

3HAC6670-3

Plant: =
Location: +
Sublocation: +

Rev. Ind

03


103

Next 104

Total 13

Prepared by, date: Erik Mesaros Approved by, date: Jan-Erik Nähls

We reserve all rights in this document and in the information contained therein.Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © Copyright 2003 ABB

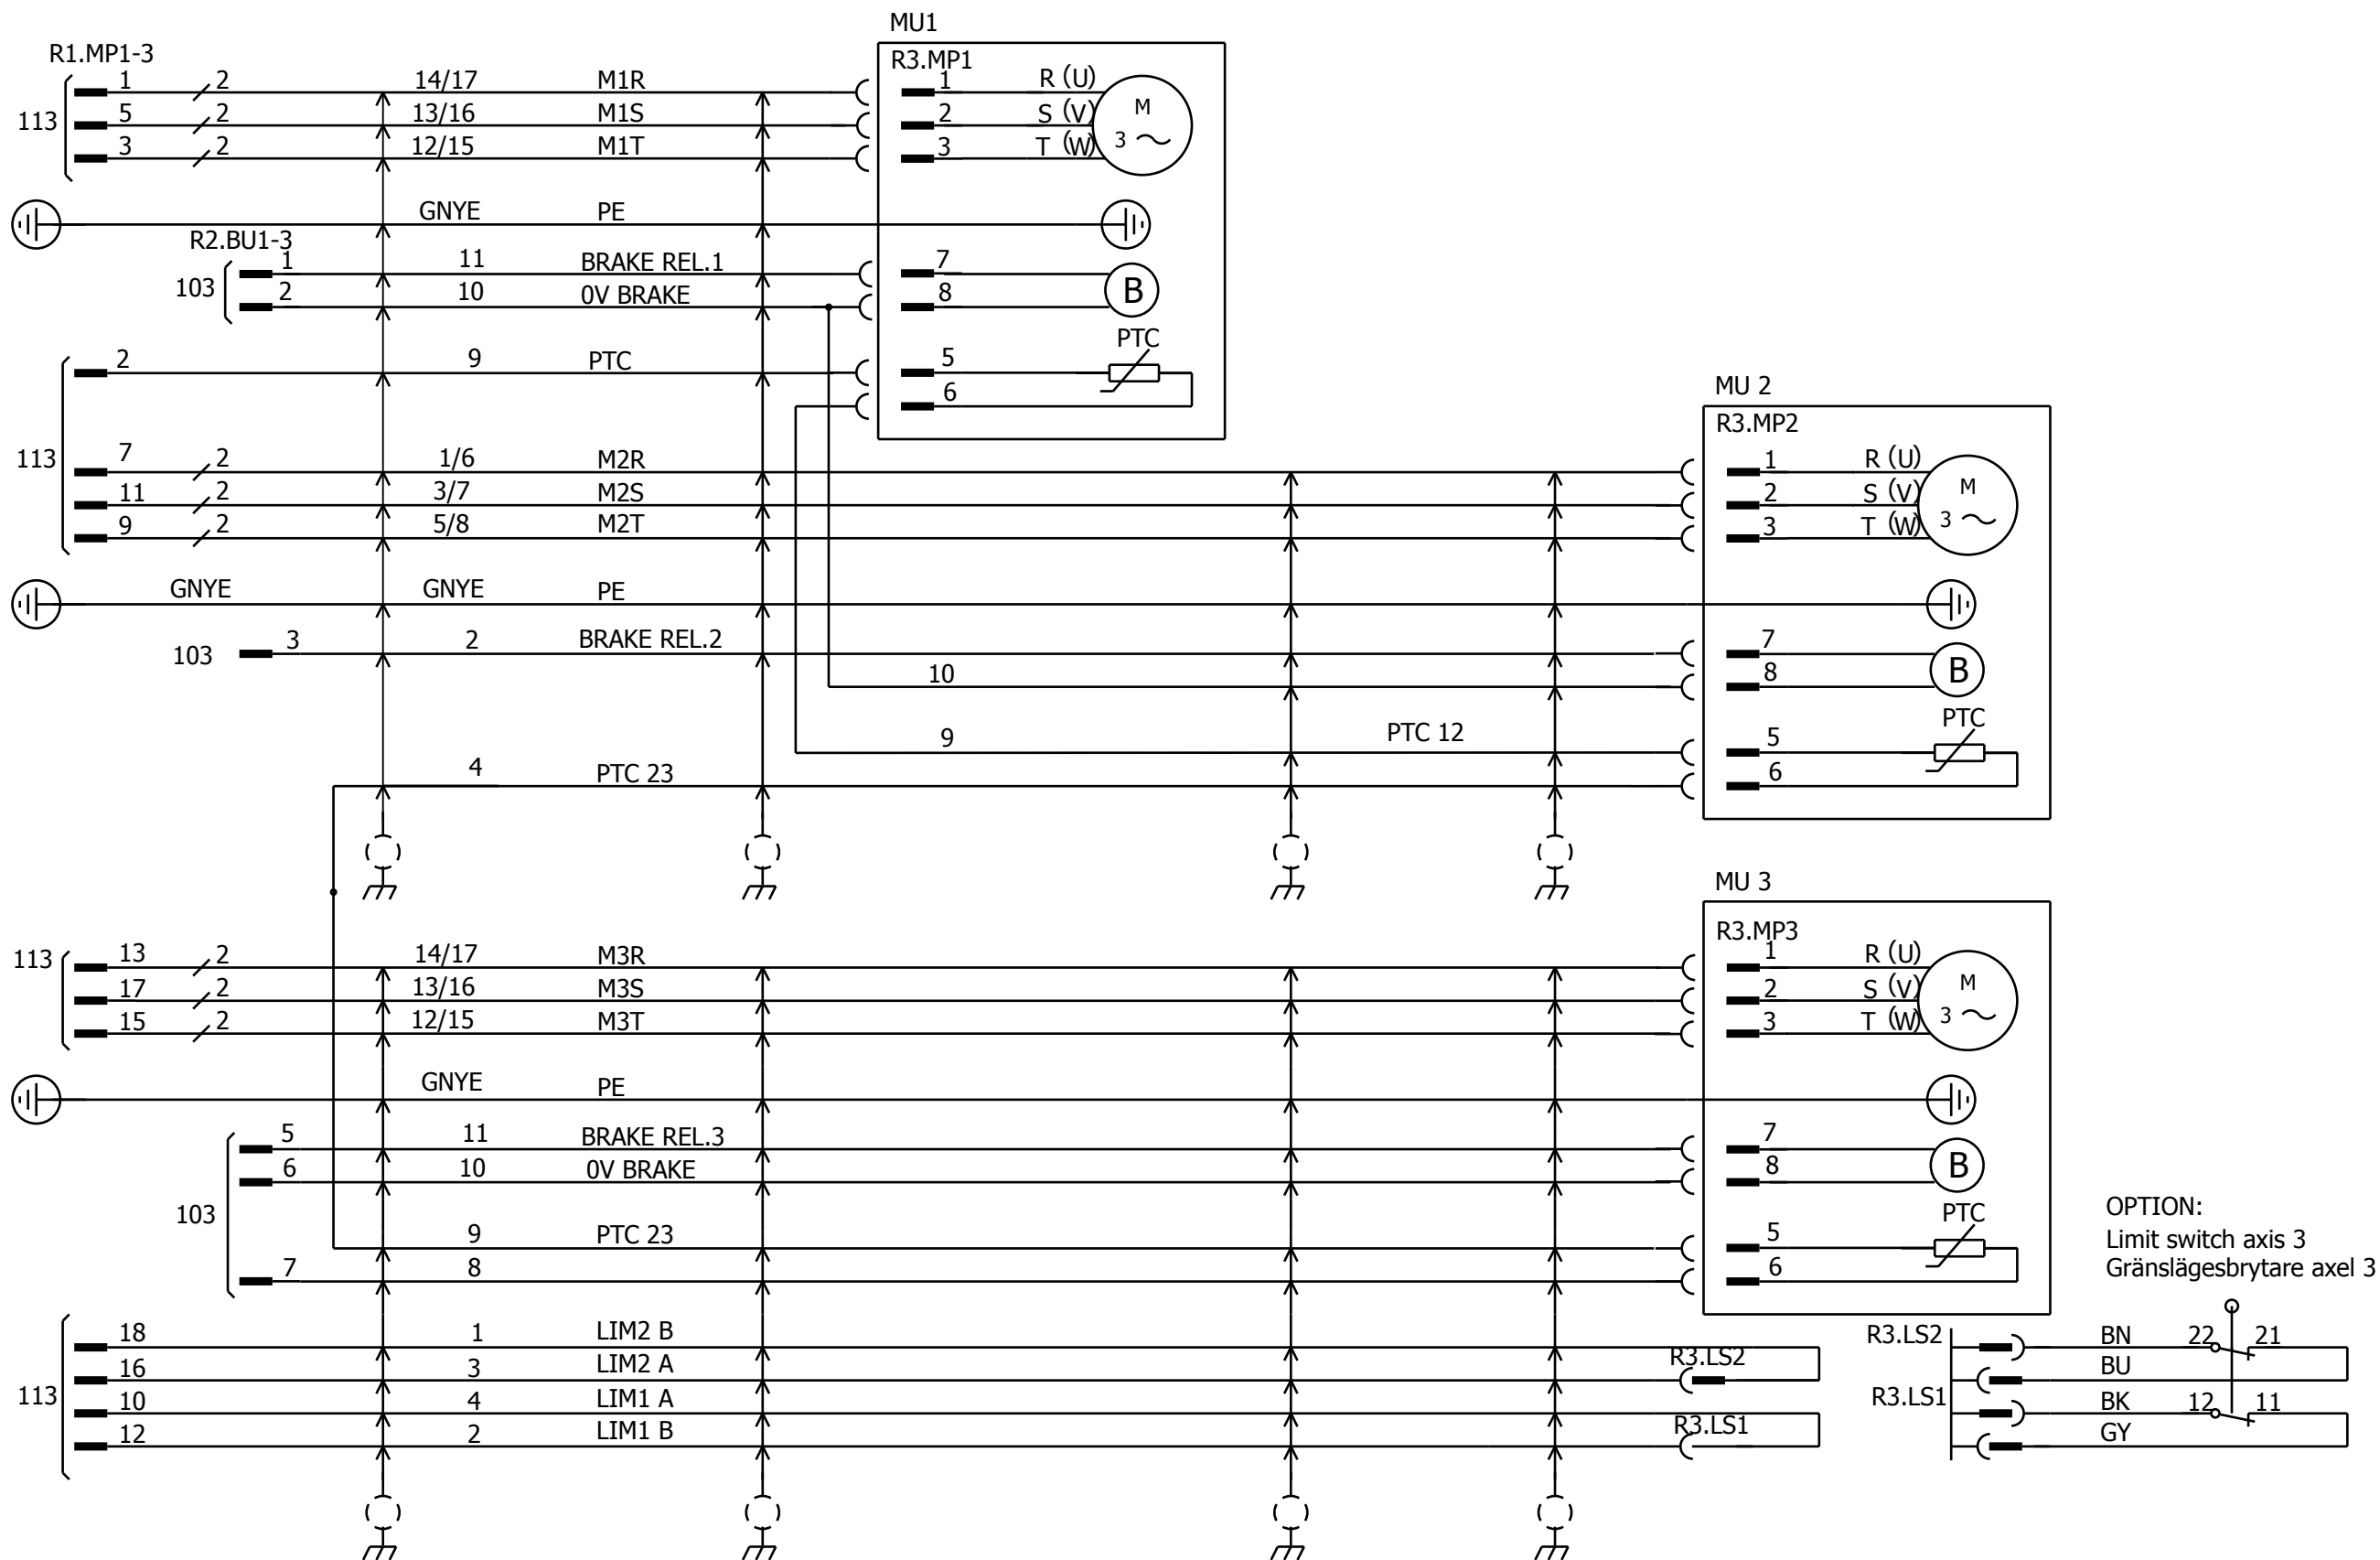

OPTION:
Limit switch axis 3
Gränslägesbrytare axel 3

Latest revision: ECO 69647, WI 75550
Sh.113: Loop "PTC" was "PTC M" and "0V PTC".

ABB

Lab/Office:
DMRO SE/
PRIM

Manipulator IRB 2400 circuit diagram

Motor axis 1-3

Status: 2015-02-11

APPROVED

Document no.

3HAC6670-3

Plant: =
Location: +
Sublocation: +

Rev. Ind

03

104


Next 105

Total 13

Prepared by, date: Erik Mesaros Approved by, date: Jan-Erik Nähls



We reserve all rights in this document and in the information contained therein. Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © Copyright 2003 ABB

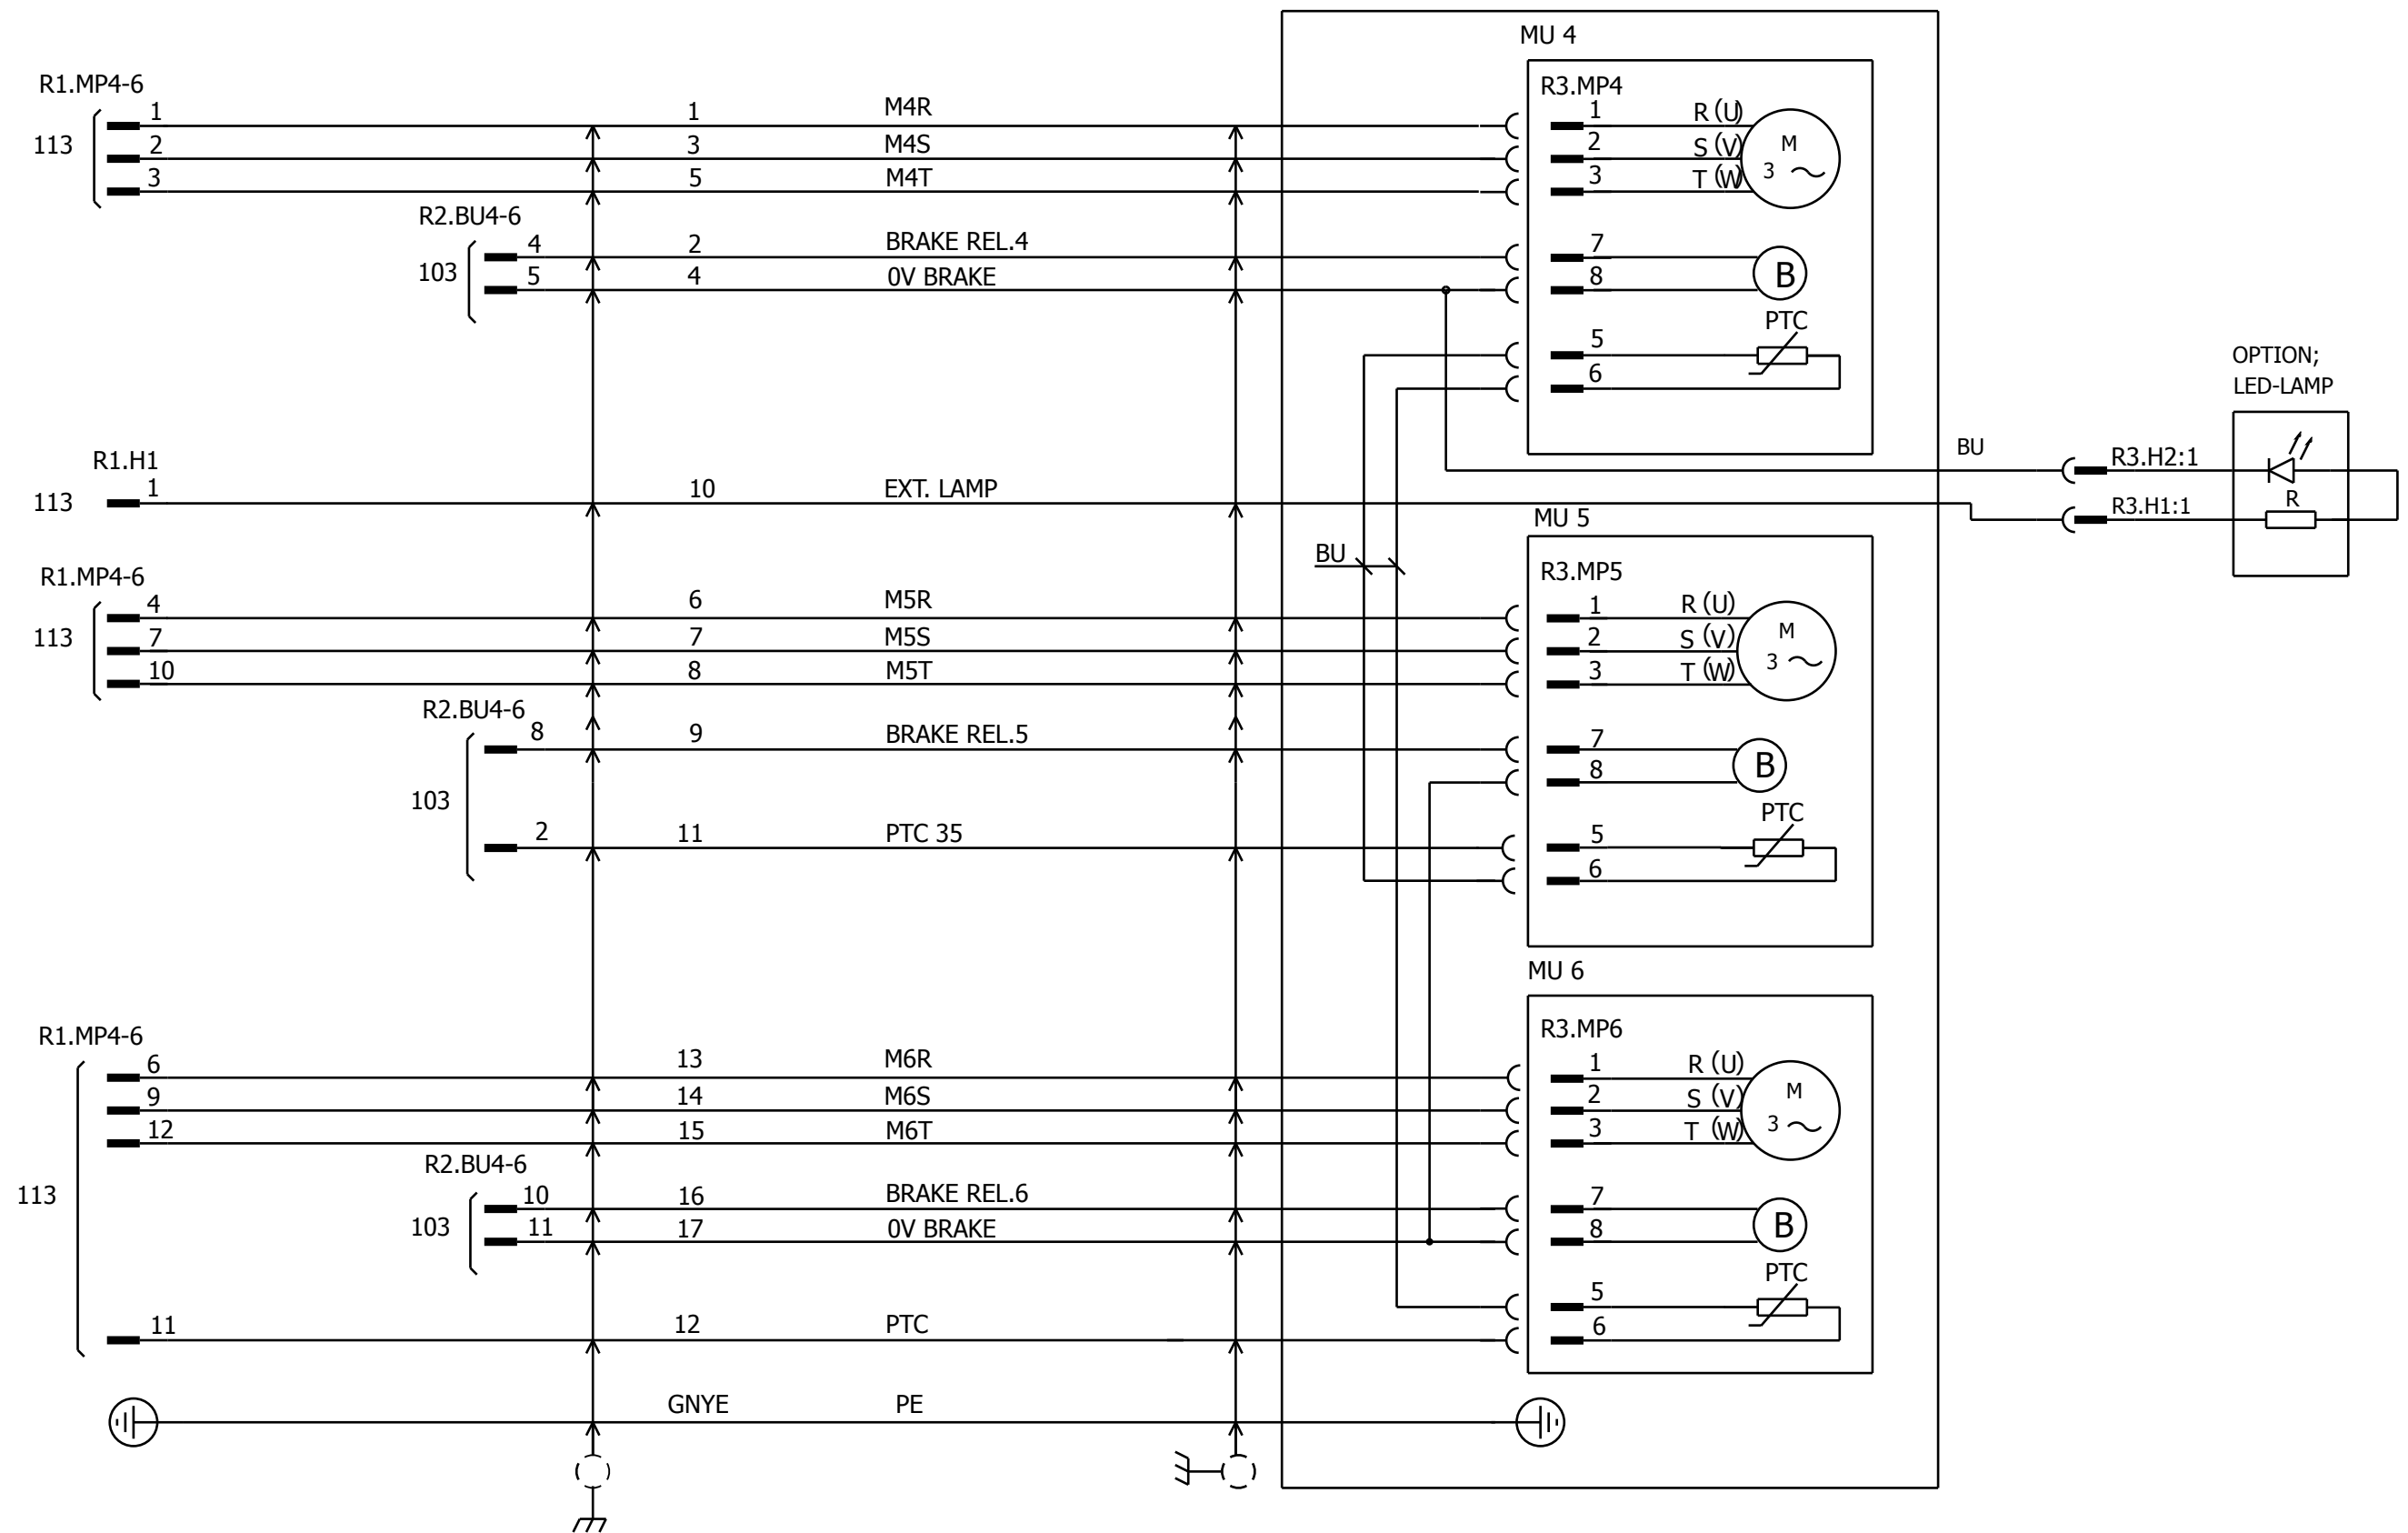

Latest revision: ECO 69647, WI 75550
Sh.113: Loop "PTC" was "PTC M" and "0V PTC".



Lab/Office:
DMRO SE/
PRIM

Manipulator IRB 2400 circuit diagram

Motor axis 4-6, 1,5-10/16

Status: 2015-02-11

APPROVED

Document no.

3HAC6670-3

Plant: =
Location: +
Sublocation: +

Rev. Ind

03


106

Next 107

Total 13

Prepared by, date: Erik Mesaros Approved by, date: Jan-Erik Nähls

We reserve all rights in this document and in the information contained therein.Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © Copyright 2003 ABB

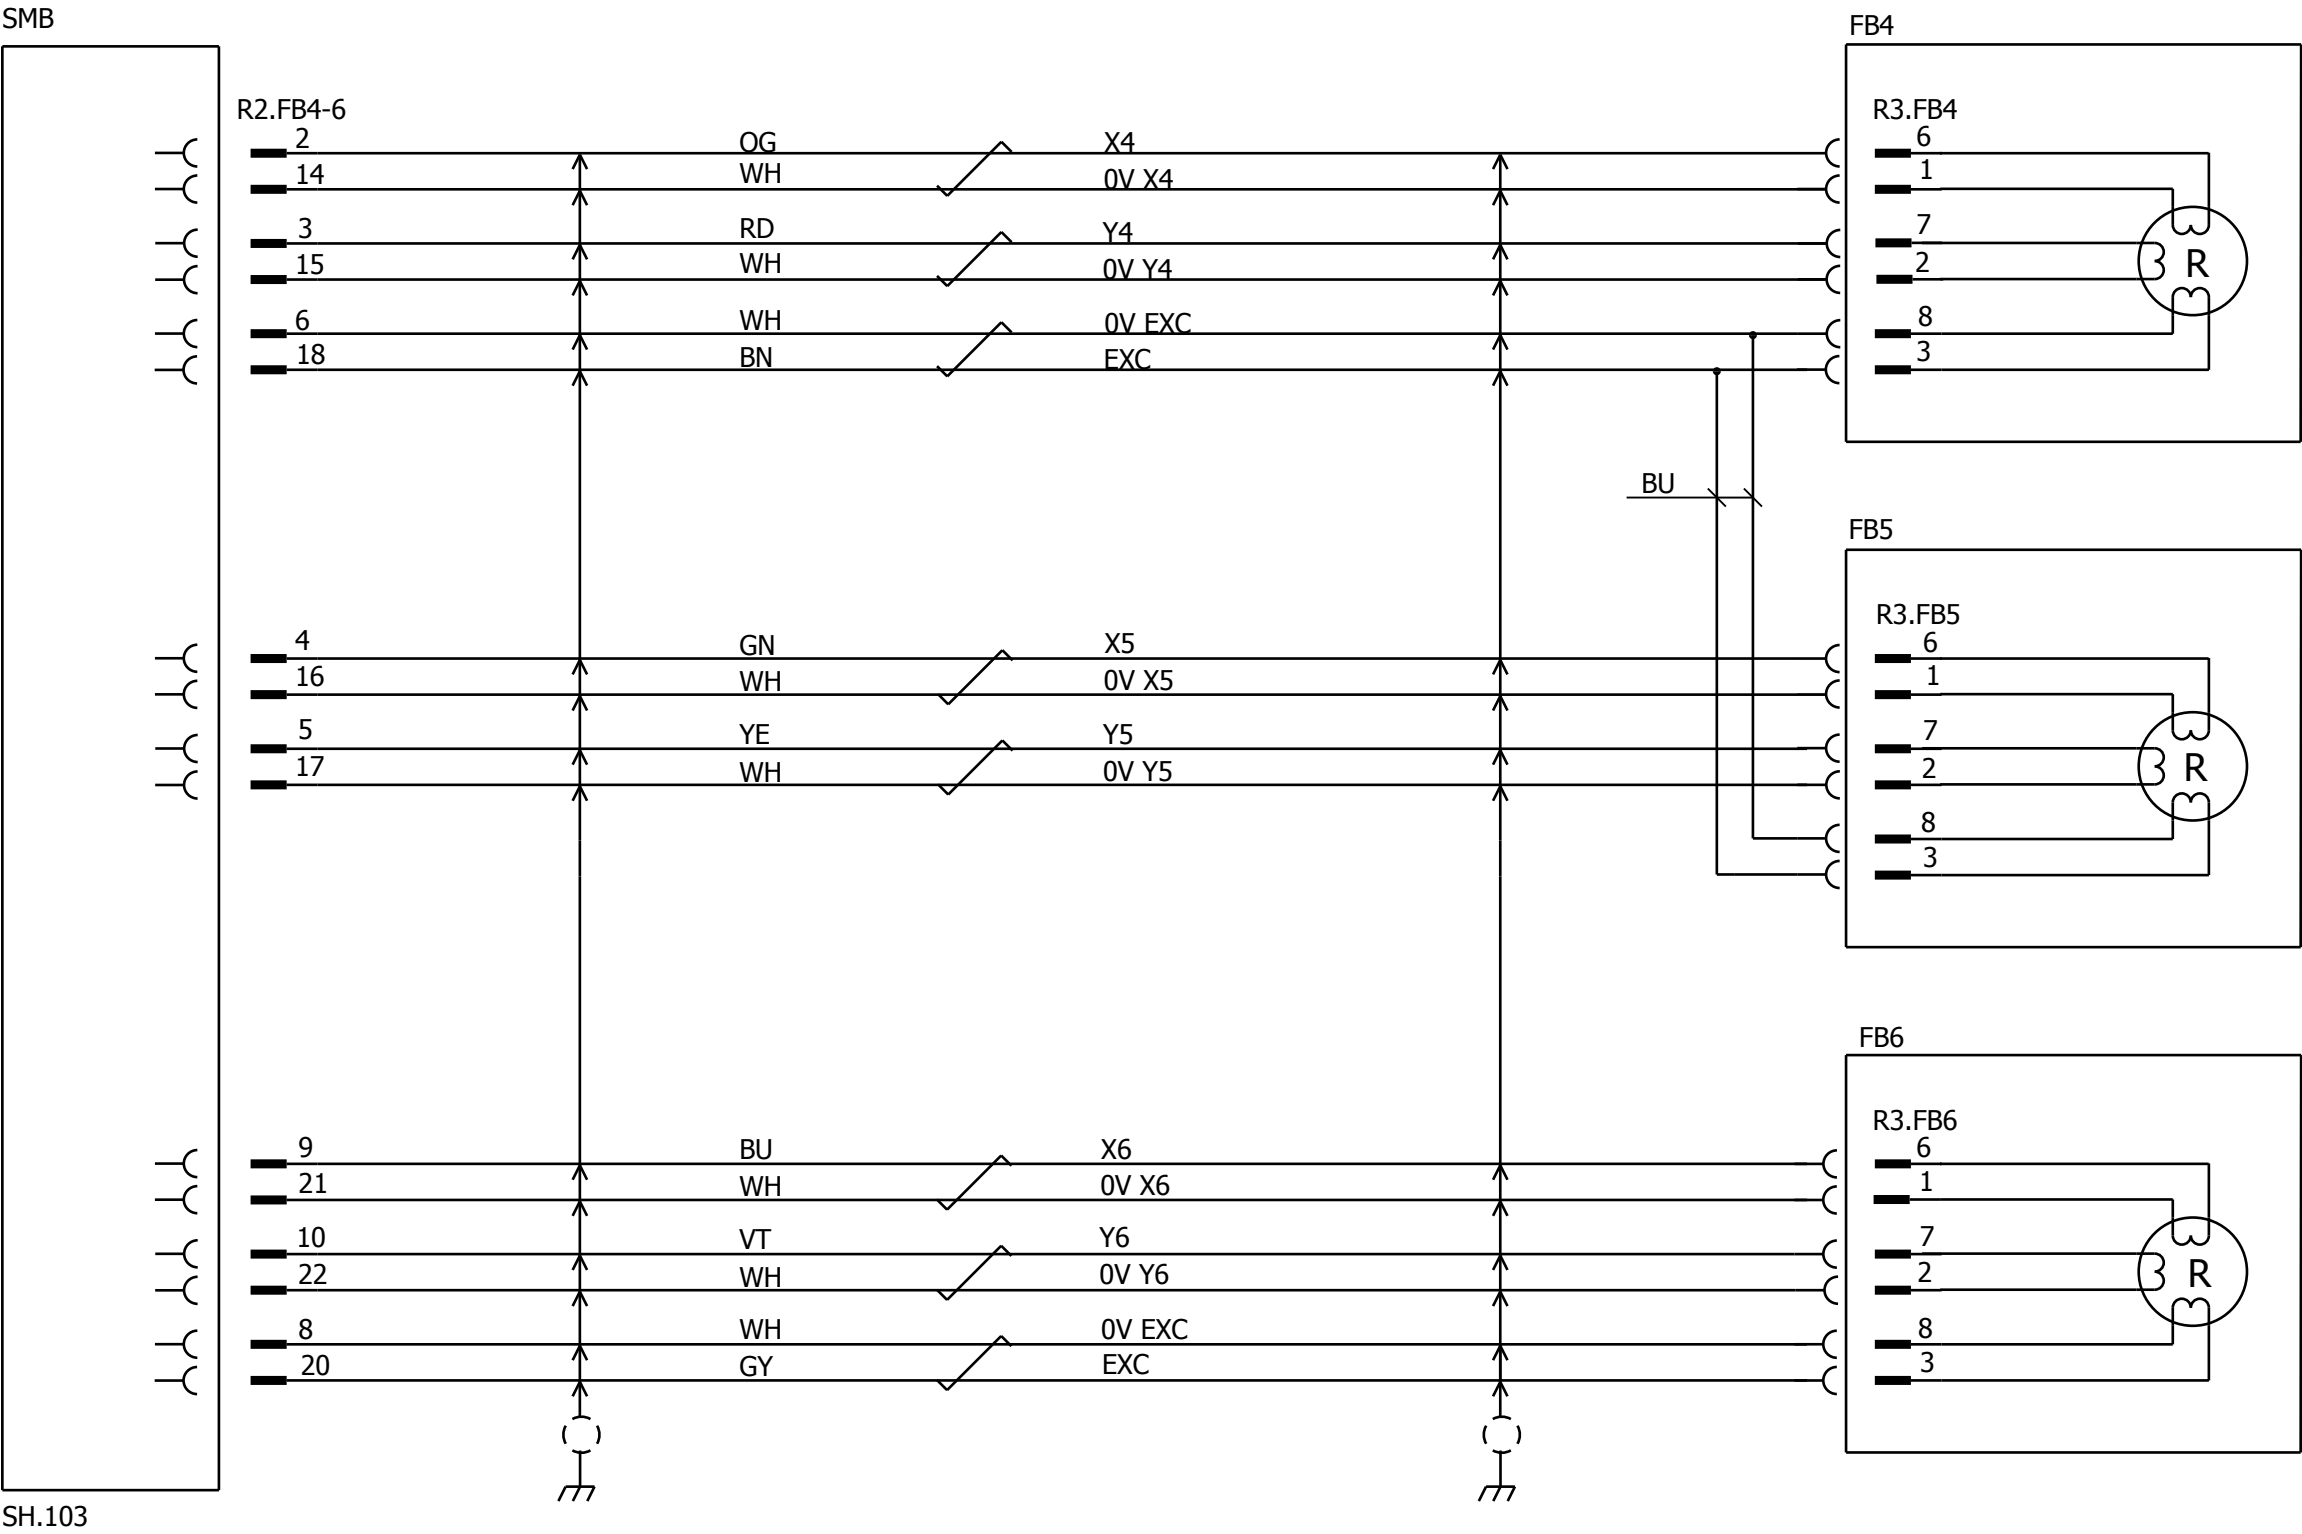

Latest revision: ECO 69647, WI 75550
Sh.113: Loop "PTC" was "PTC M" and "0V PTC".



Lab/Office:
DMRO SE/
PRIM

Manipulator IRB 2400 circuit diagram
Feed back axis 4-6, 1,5-10/16

Status: 2015-02-11

APPROVED

Document no.

3HAC6670-3

Plant: =
Location: +
Sublocation: +

Rev. Ind

03


107

Next 108

Total 13

Prepared by, date: Erik Mesaros Approved by, date: Jan-Erik Nähls

We reserve all rights in this document and in the information contained therein. Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © Copyright 2003 ABB

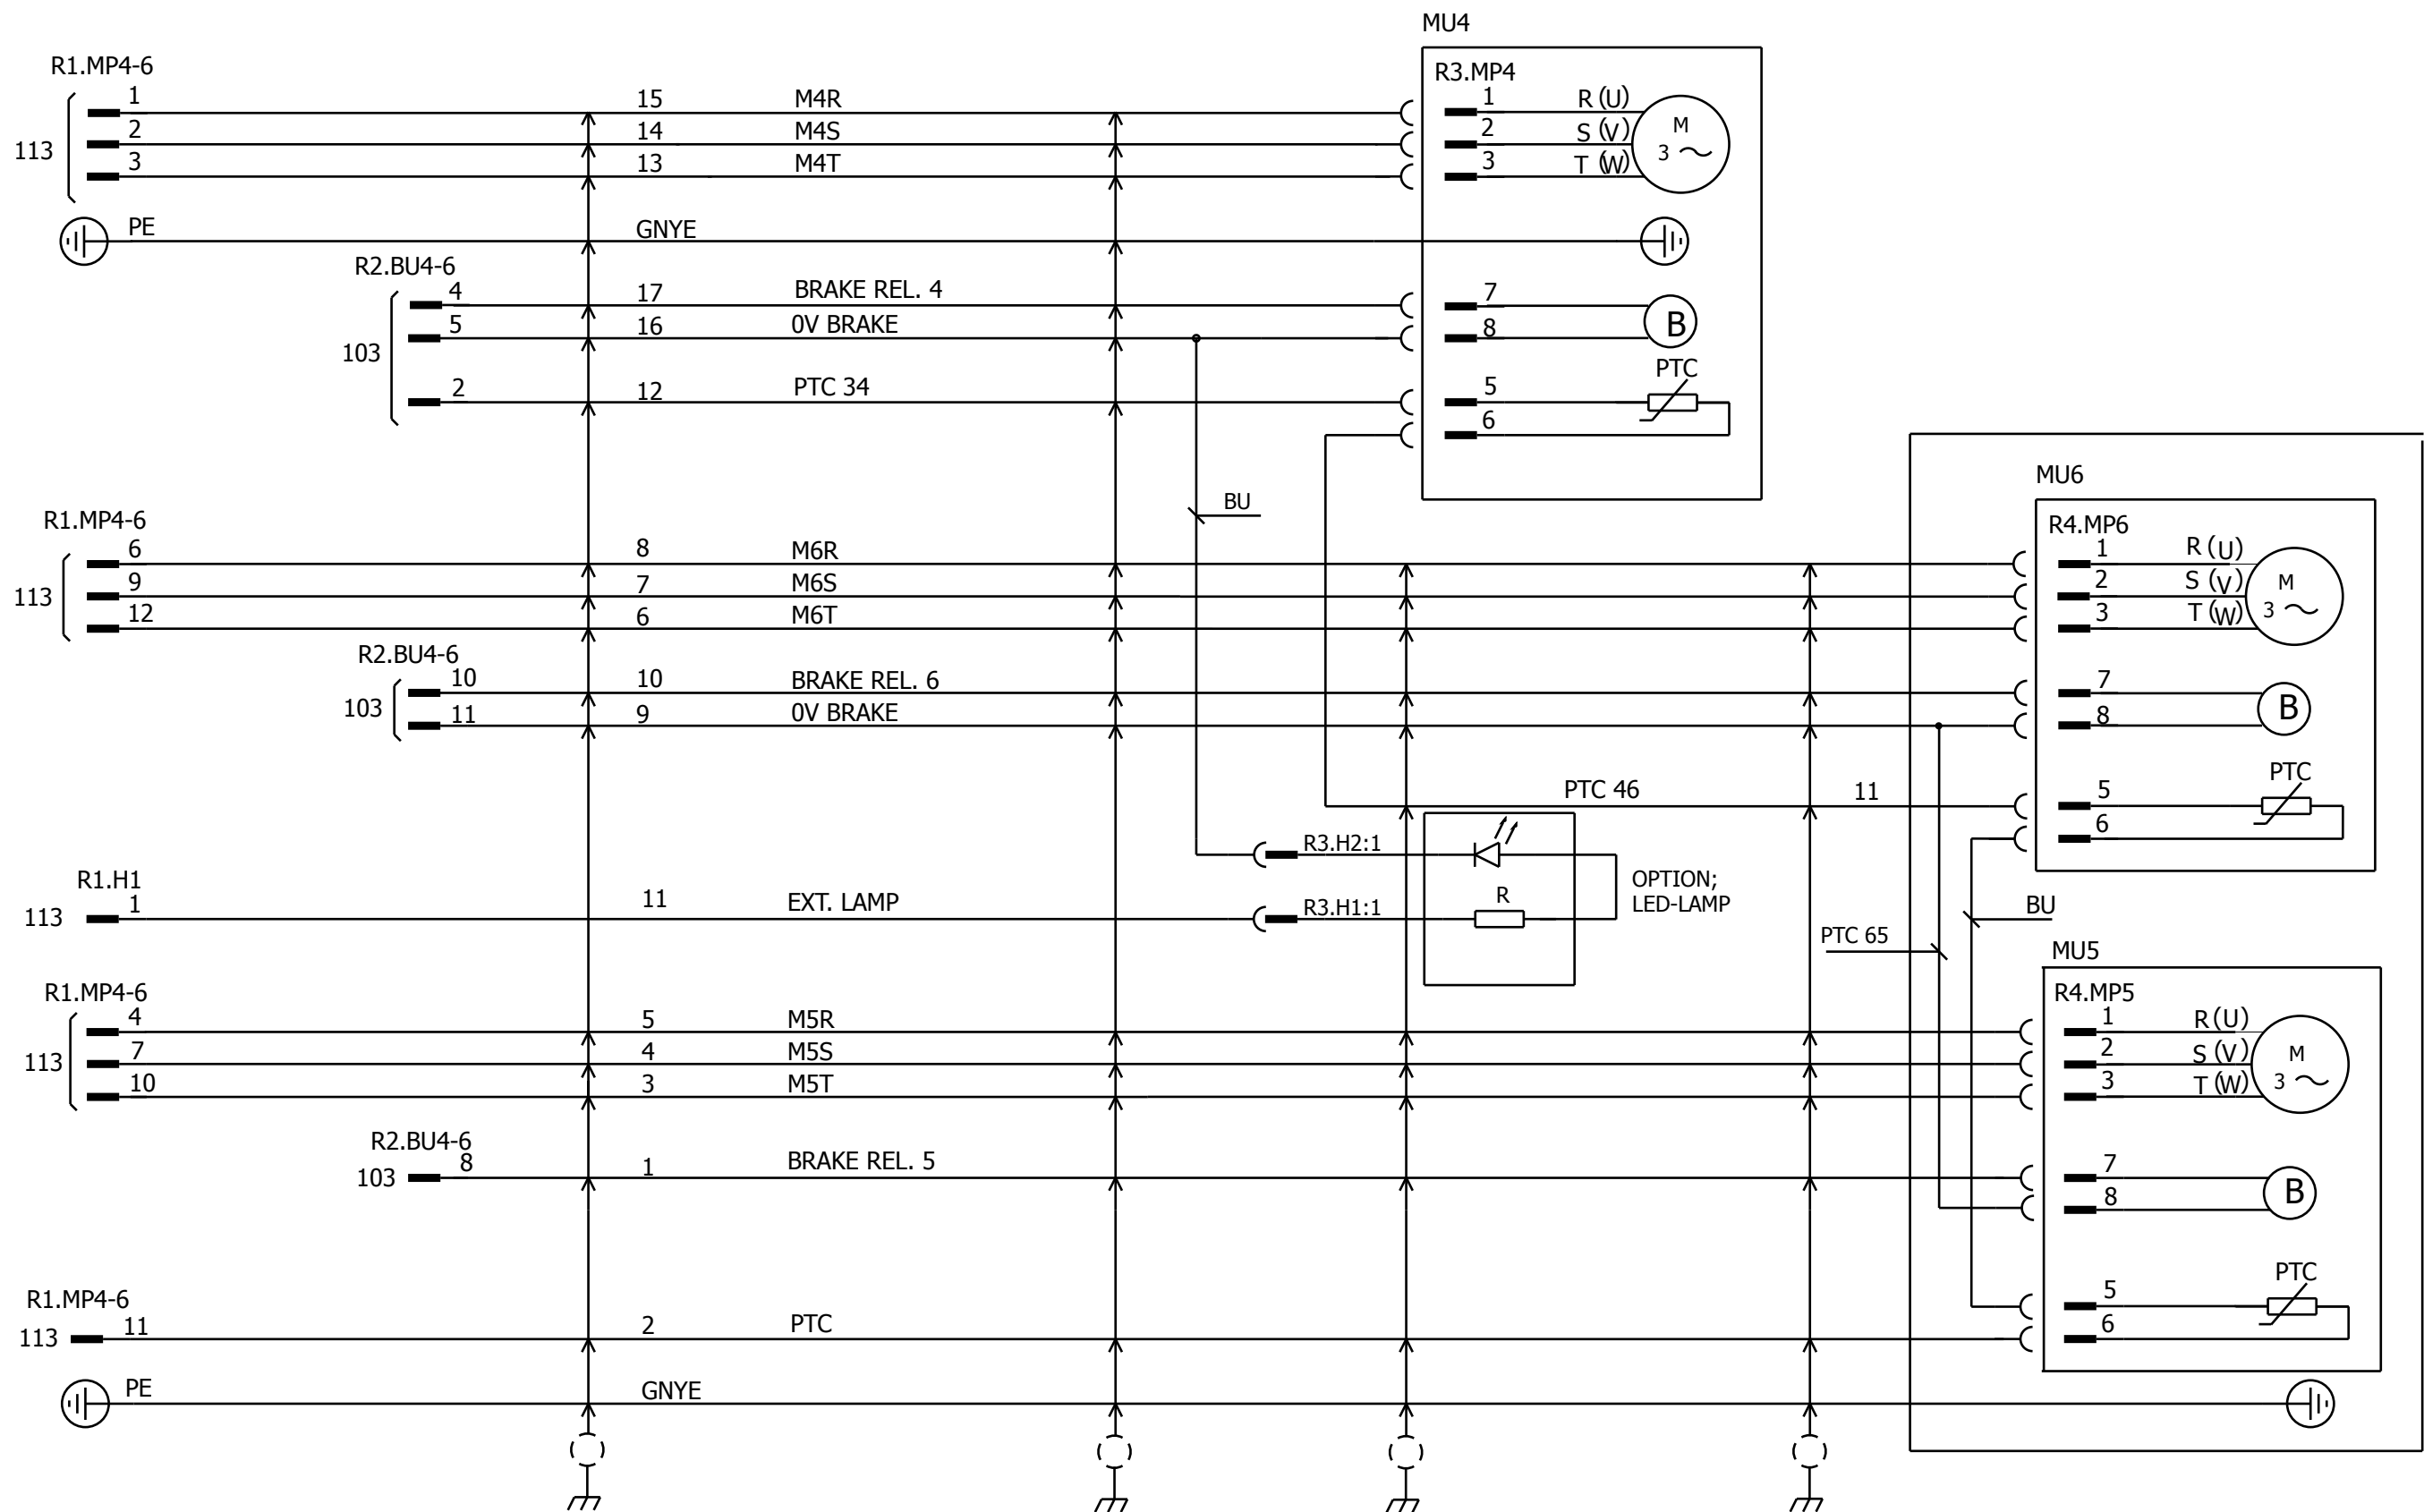

Latest revision: ECO 69647, WI 75550
Sh.113: Loop "PTC" was "PTC M" and "0V PTC".

ABB

Lab/Office:
DMRO SE/
PRIM

Manipulator IRB 2400 circuit diagram

Motor axis 4-6, 1, 8-5

Status: 2015-02-11

APPROVED

Document no.

3HAC6670-3

Plant: =

Location: +

Sublocation: +

Rev. Ind

03


108

Next 109

Total 13

Prepared by, date: Erik Mesaros Approved by, date: Jan-Erik N hls

We reserve all rights in this document and in the information contained therein. Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © Copyright 2003 ABB

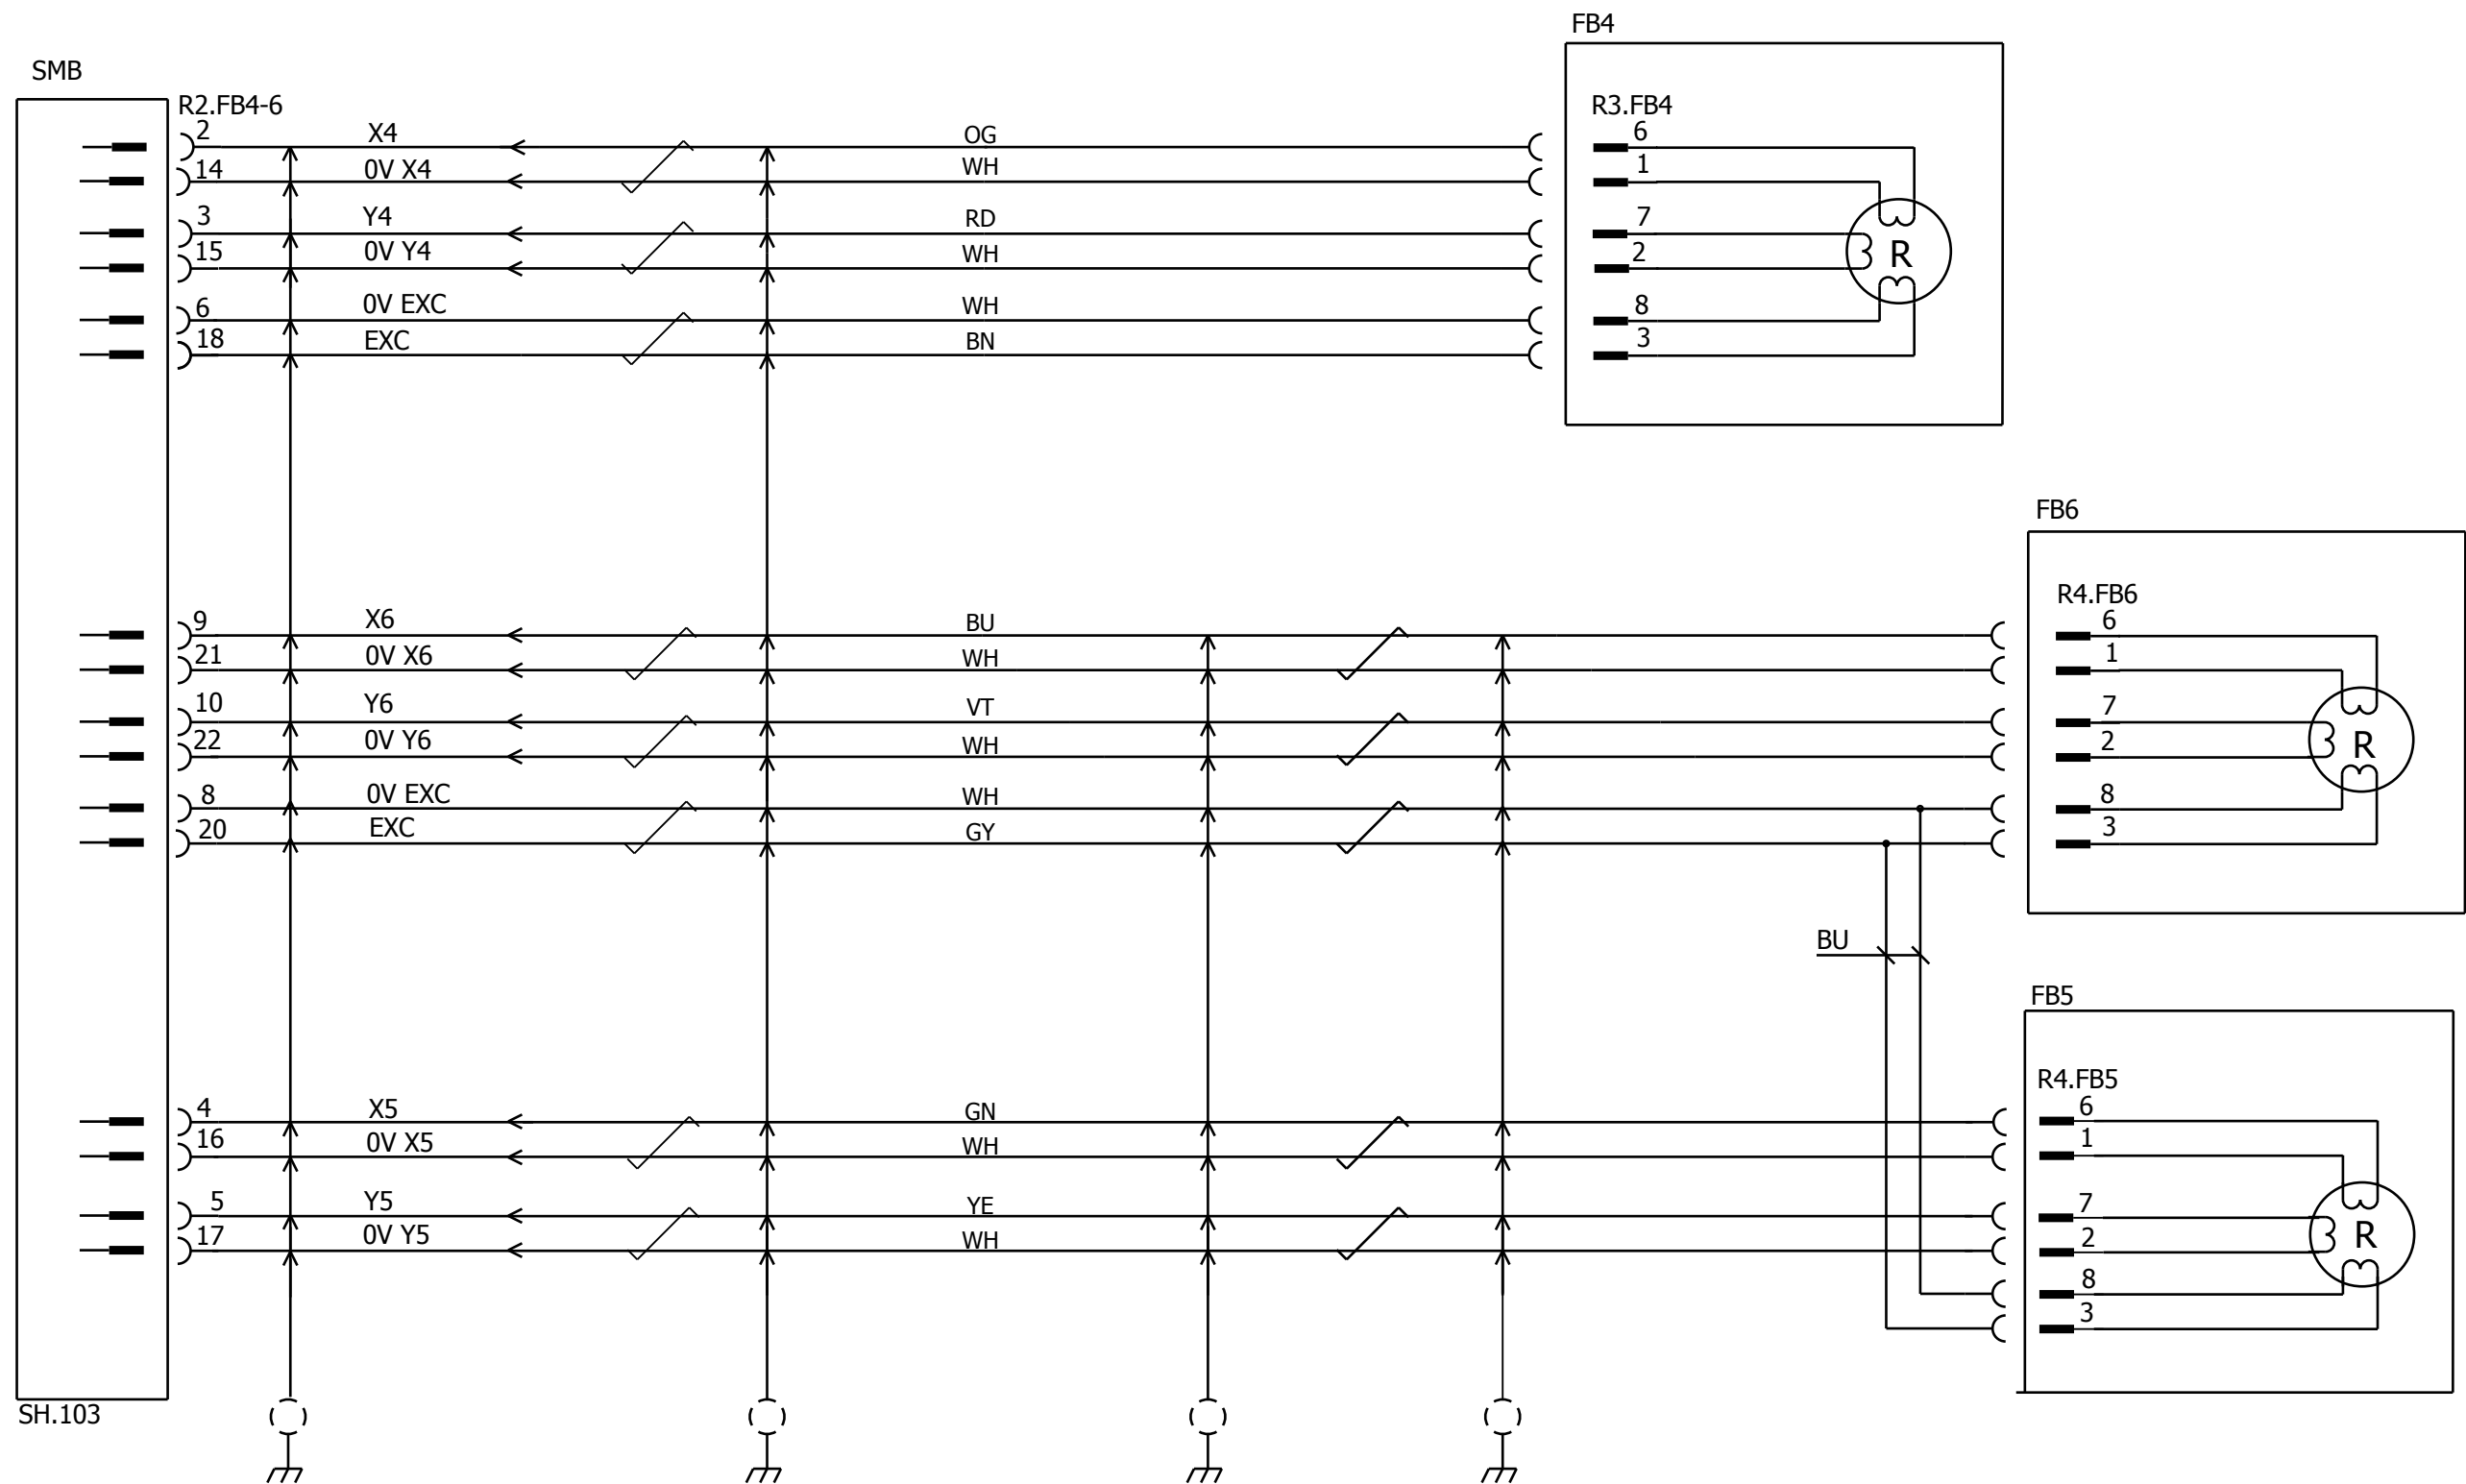

Latest revision: ECO 69647, WI 75550
Sh.113: Loop "PTC" was "PTC M" and "0V PTC".



Lab/Office:
DMRO SE/
PRIM

Manipulator IRB 2400 circuit diagram
Feed back axis 4-6, 1, 8-5

Status: 2015-02-11

APPROVED

Document no.

3HAC6670-3

Plant: =
Location: +
Sublocation: +

Rev. Ind

03

109


Next 110

Total 13

Prepared by, date: Erik Mesaros Approved by, date: Jan-Erik Nähls

We reserve all rights in this document and in the information contained therein.Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © Copyright 2003 ABB


113

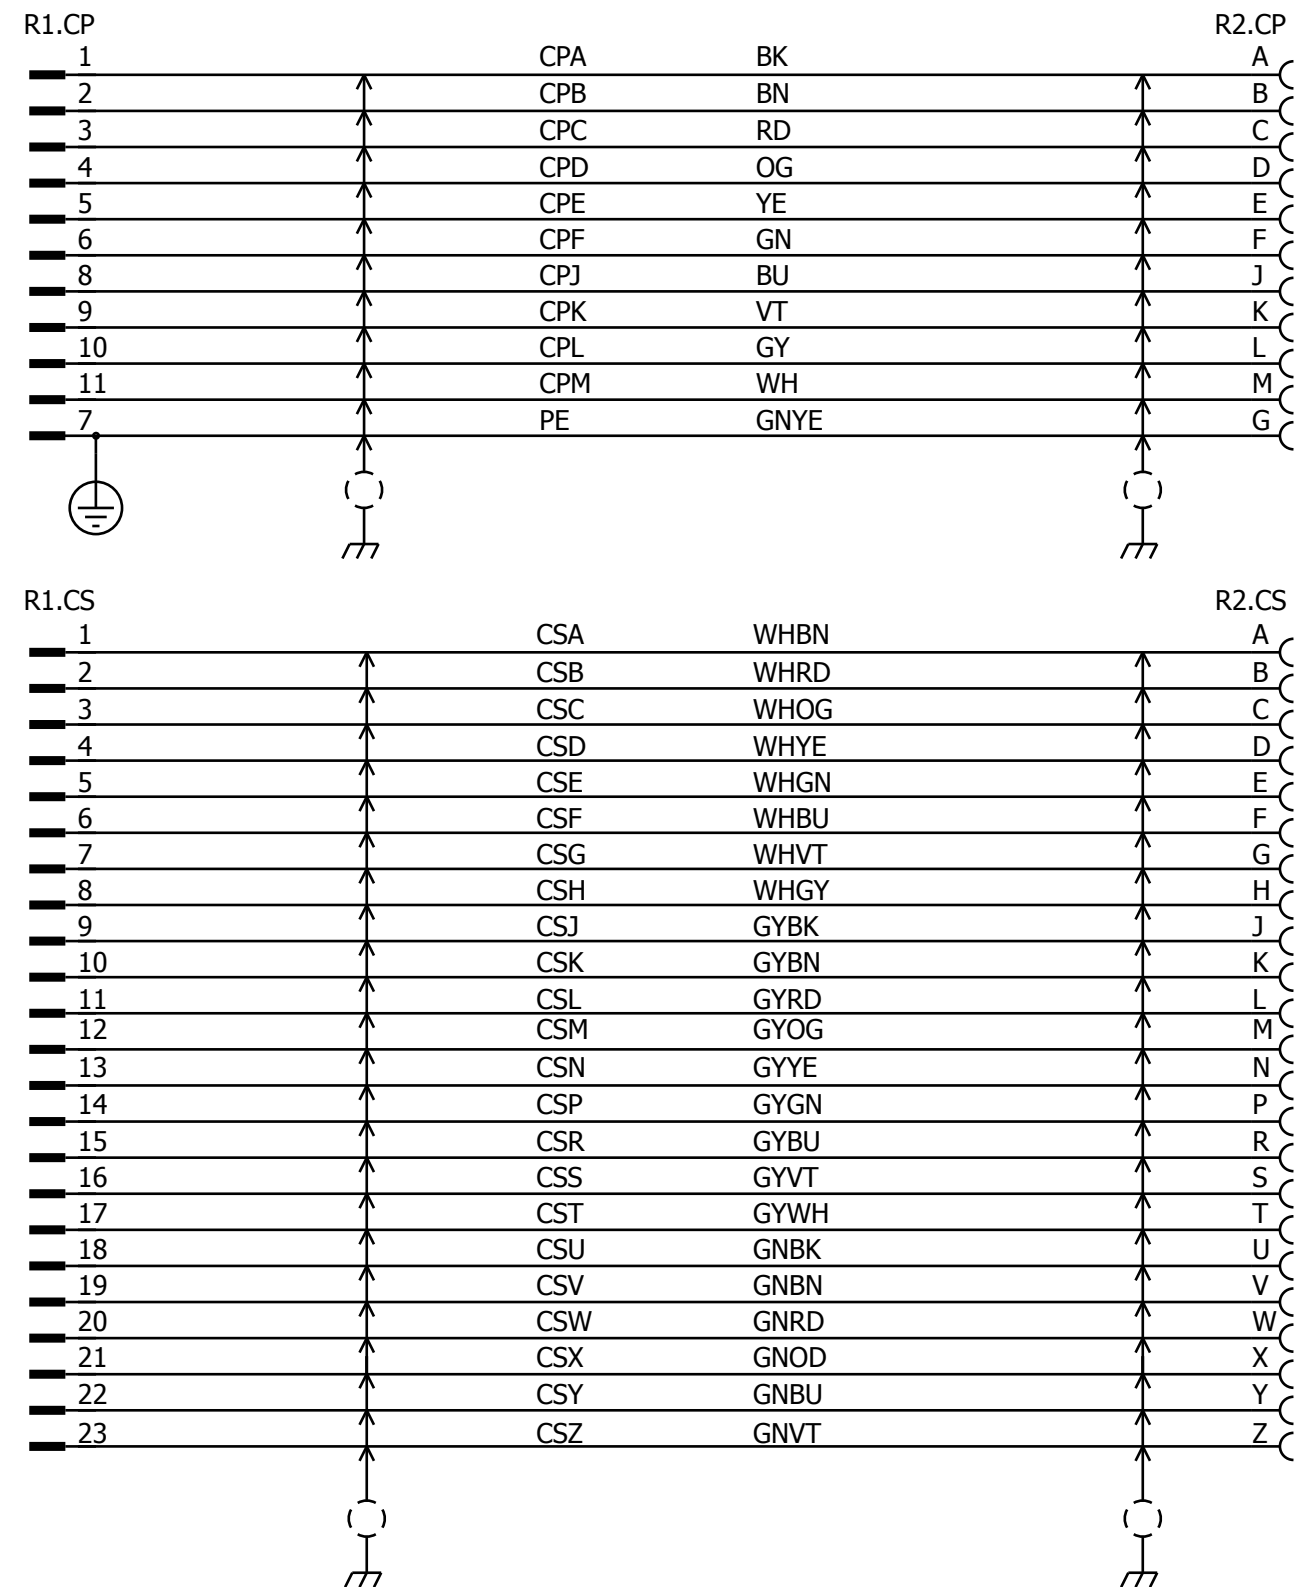


CUSTOMER CONNECTION
POWER
KUNDANSLUTNING
KRAFT

CUSTOMER CONNECTION
SIGNAL
KUNDANSLUTNING
SIGNAL

We reserve all rights in this document and in the information contained therein.Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © Copyright 2003 ABB

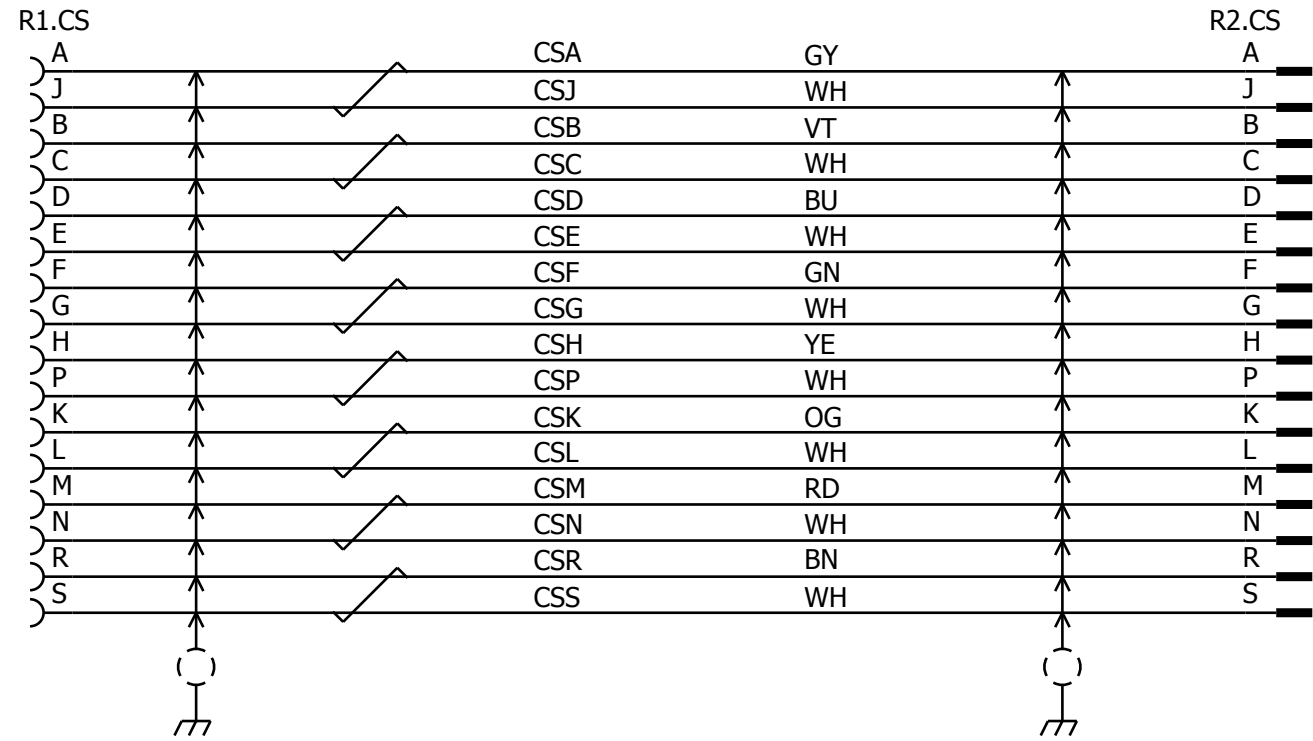


CUSTOMER CONNECTION
SIGNAL
KUNDANSLUTNING
SIGNAL

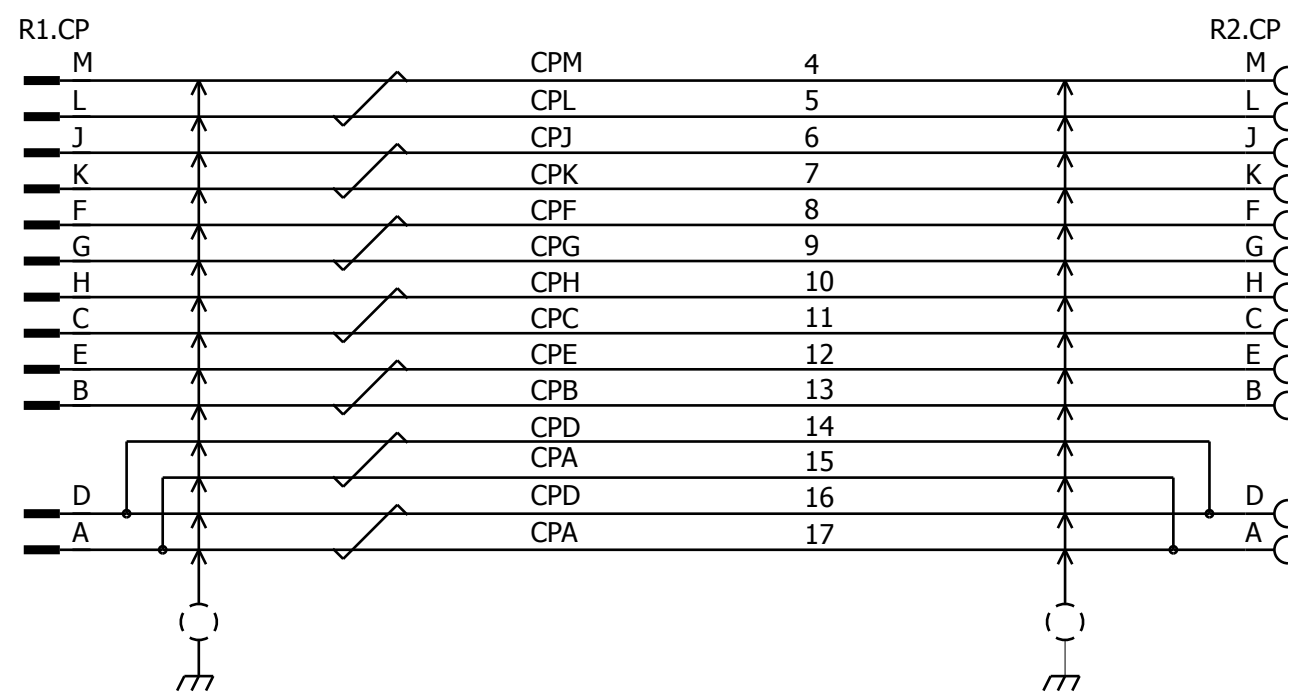

CUSTOMER CONNECTION
POWER
KUNDANSLUTNING
KRAFT

We reserve all rights in this document and in the information contained therein.Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © Copyright 2003 ABB

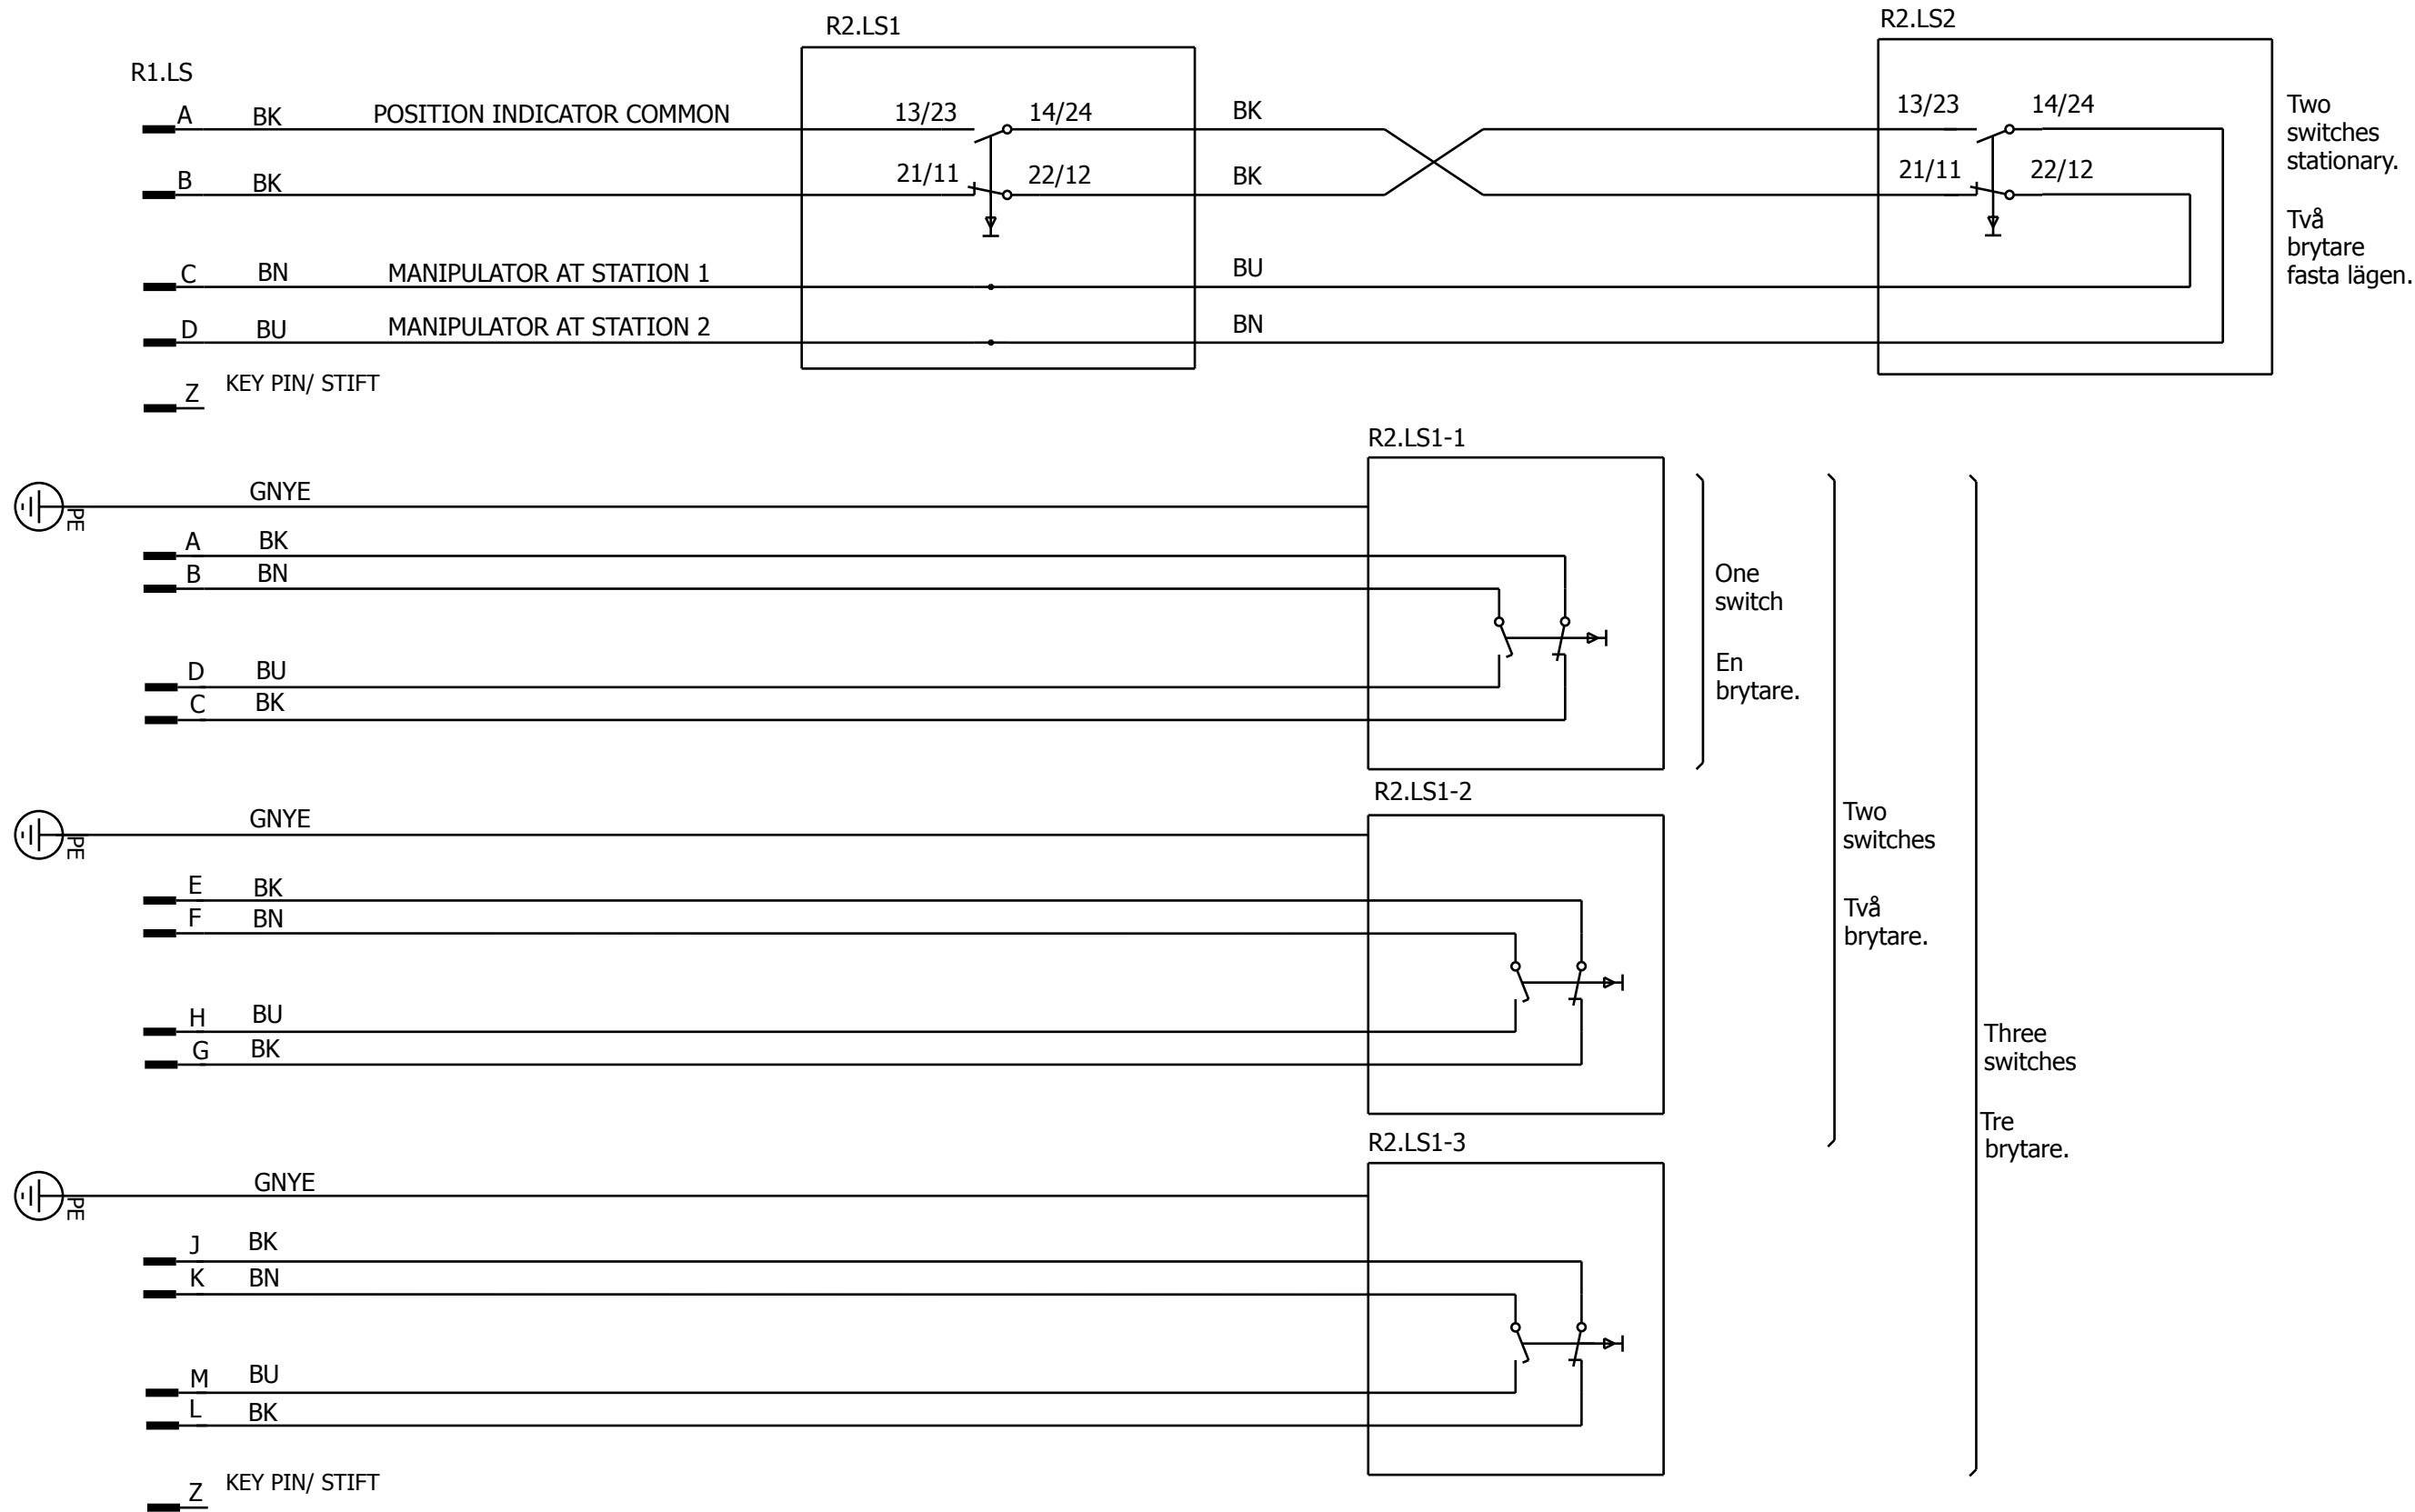

Latest revision: ECO 69647, WI 75550
Sh.113: Loop "PTC" was "PTC M" and "0V PTC".



Lab/Office:
DMRO SE/
PRIM

Manipulator IRB 2400 circuit diagram

Position indicator axis 1; OPTION

Status: 2015-02-11

APPROVED

Document no.

3HAC6670-3

Plant: =
Location: +
Sublocation: +

Rev. Ind

03


112

Next 113

Total 13

Prepared by, date: Erik Mesaros Approved by, date: Jan-Erik Nähls

We reserve all rights in this document and in the information contained therein. Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © Copyright 2003 ABB

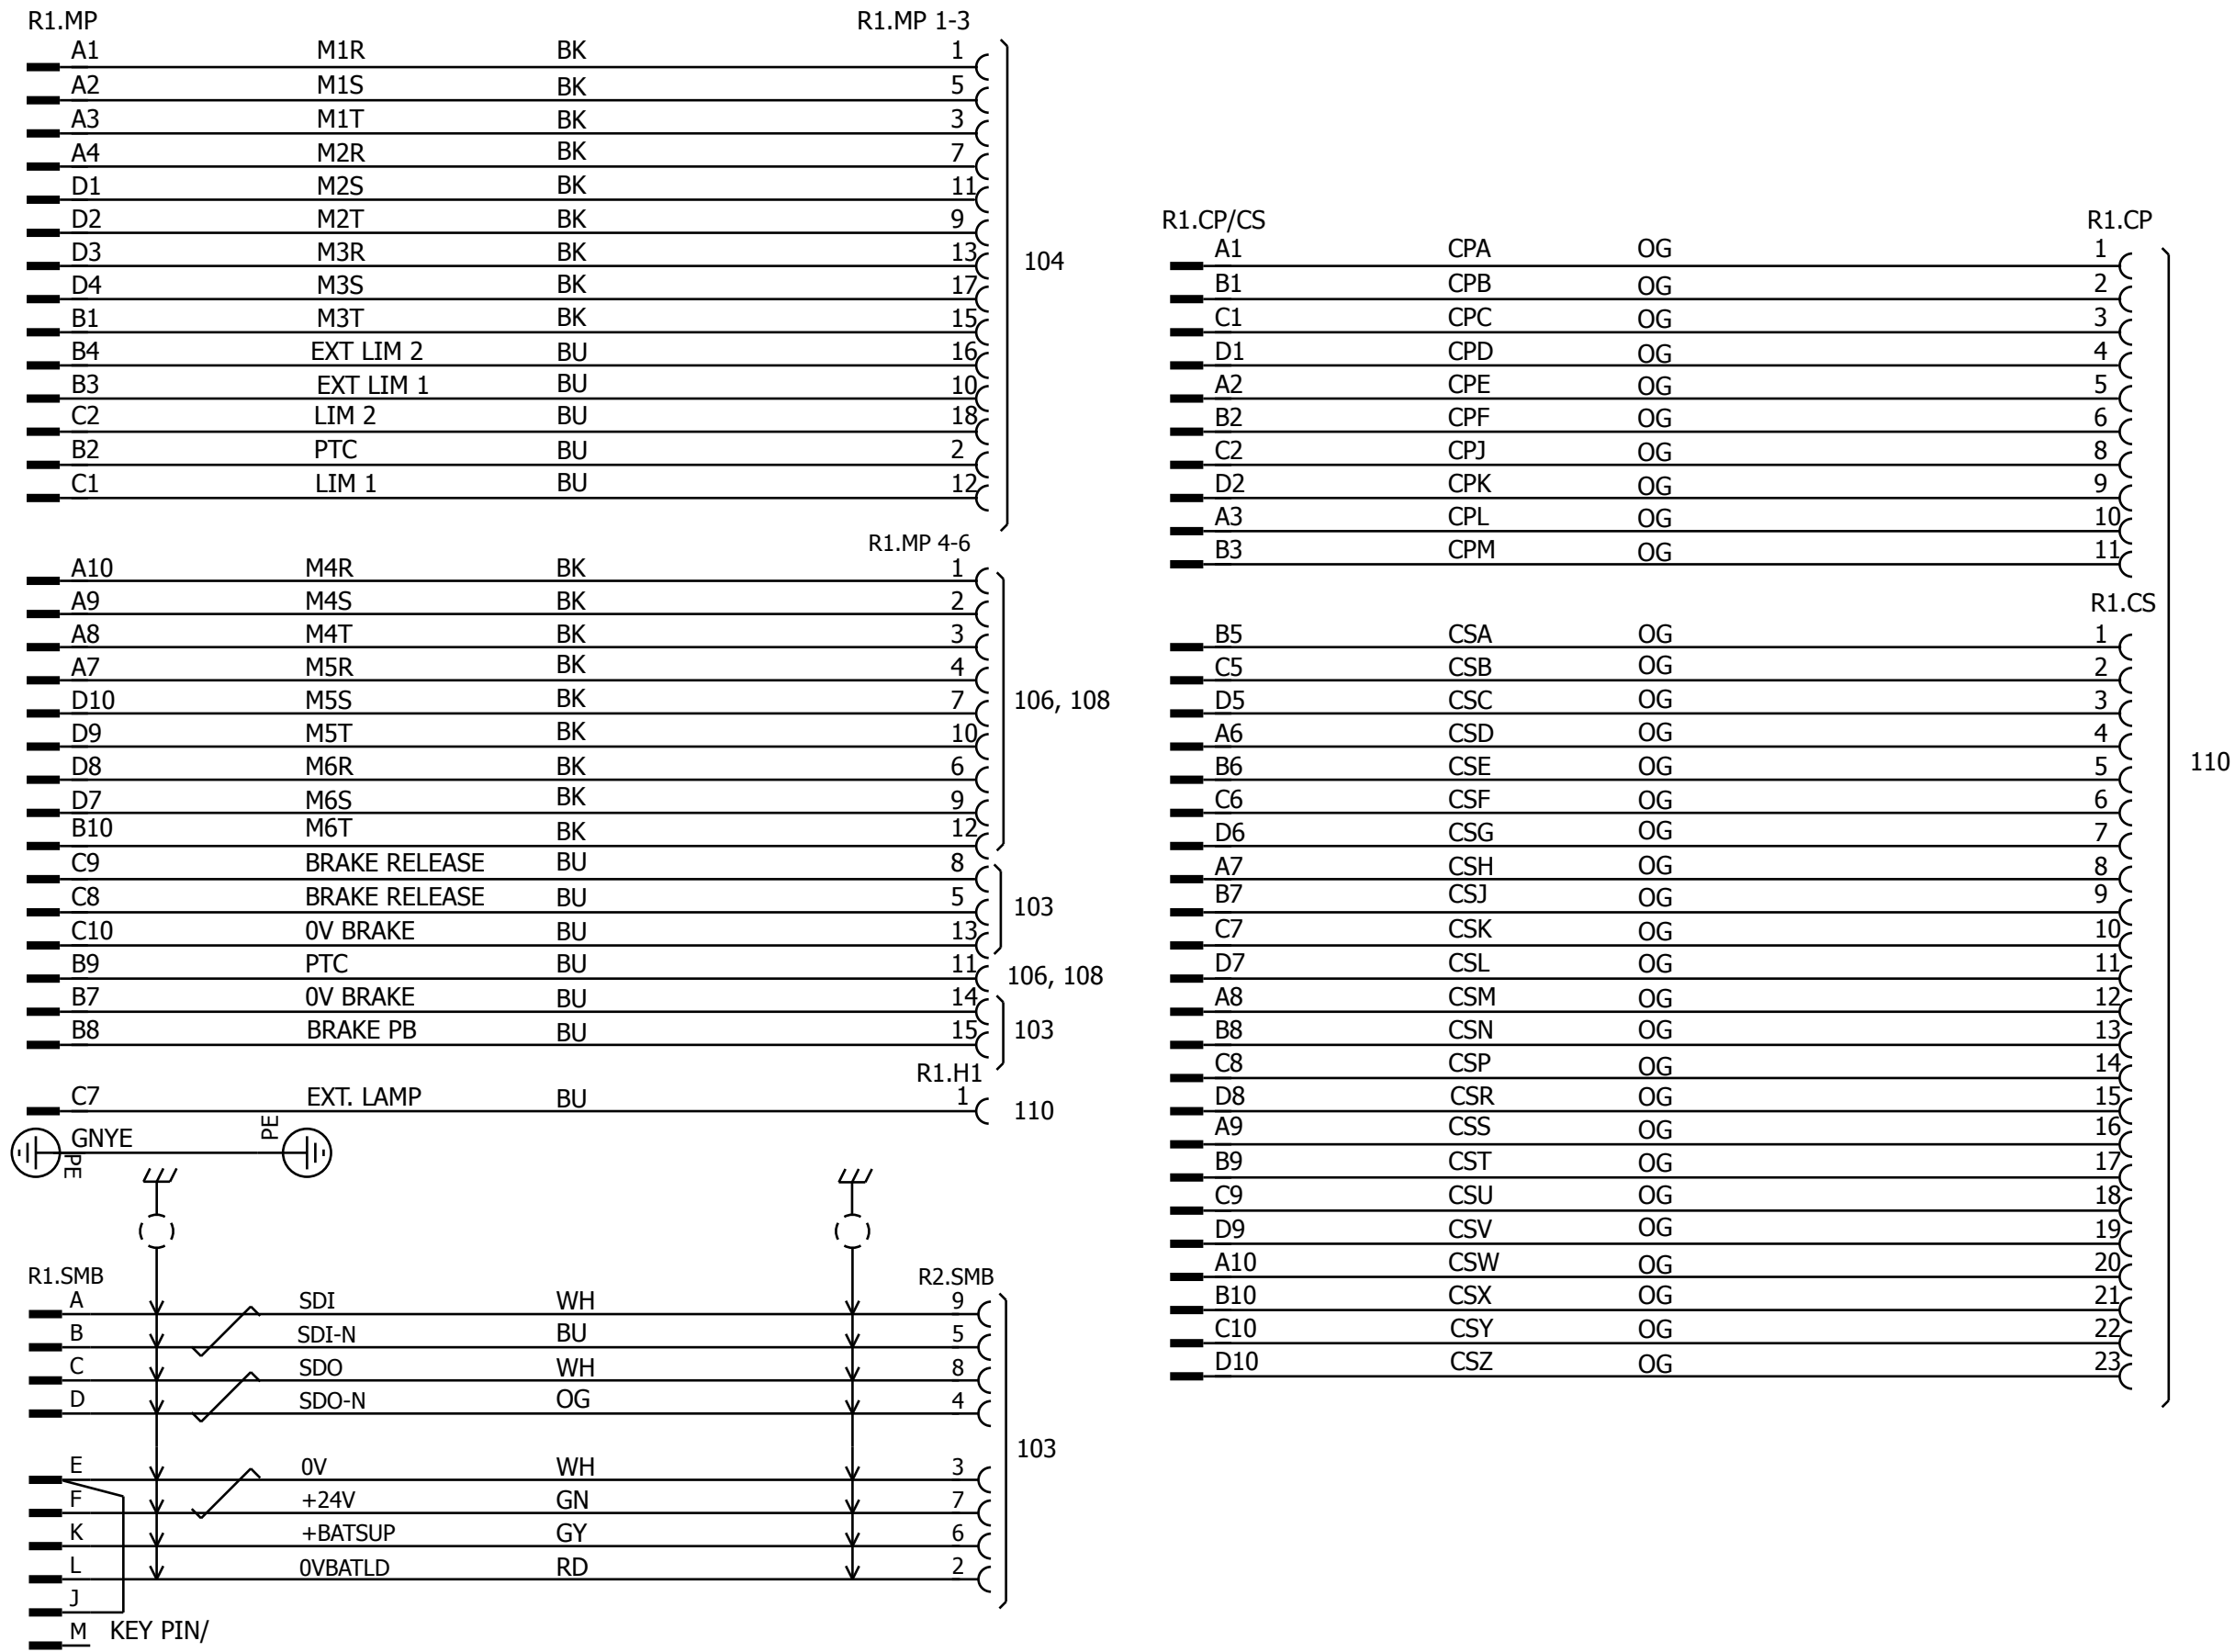

Latest revision: ECO 69647, WI 75550
Sh.113: Loop "PTC" was "PTC M" and "0V PTC".



Lab/Office:
DMRO SE/
PRIM

Manipulator IRB 2400 circuit diagram

External connections; OPTION

Status: 2015-02-11

APPROVED

Document no.

3HAC6670-3

Plant: =
Location: +
Sublocation: +

Rev. Ind 113

03
Next
Total 13

Prepared by, date: Erik Mesaros Approved by, date: Jan-Erik Nähls