

Architectural Particular Specification

TACTILE WARNING ACCESSORIES

SECTION 8.12


Rev	Date	Description
0	14 APR 2020	First Issue

SECTION 8.12 TACTILE WARNING SURFACING


PART 1 GENERAL

1.01 SUMMARY OF WORK


- A. Unless otherwise stated, tactile warning strip shall be provided to the top, middle and bottom landings for all staircases, ramps & steps, disabled lift door landings and at main entrance lobbies as per the statutory requirement and as shown on Drawings.
- B. Tactile guide path shall be provided as per the statutory requirement and as shown on Drawings.
- C. Tactile warning provisions described in this Specification shall include the provision of any or all three (3) kinds of tactile warning tiles (or blocks)
 1. Directional Tile/Block

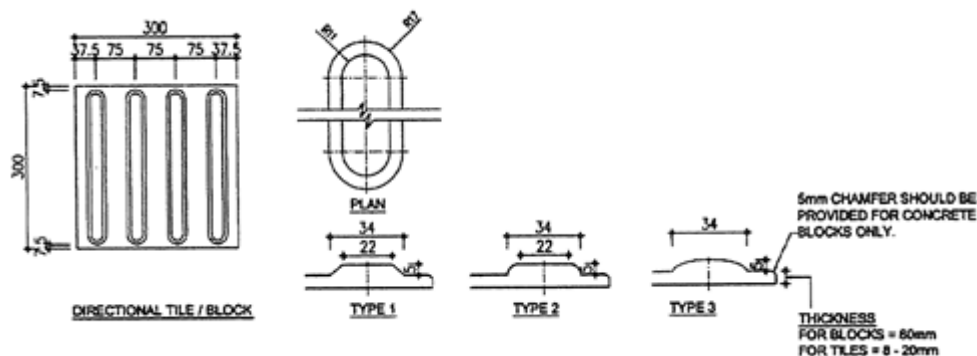

2. Hazard Warning Tile/Block

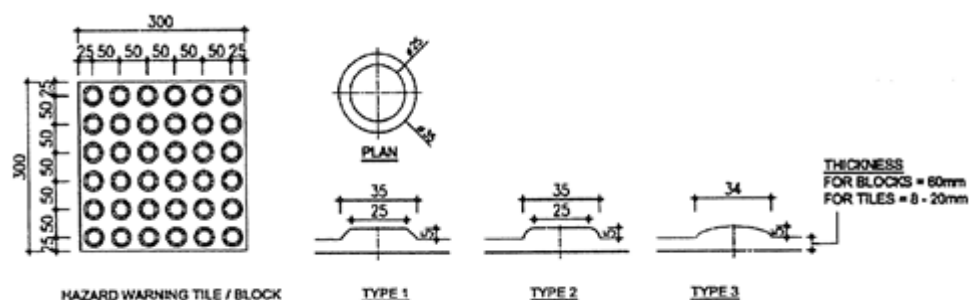

3. Positional Tile/ Block

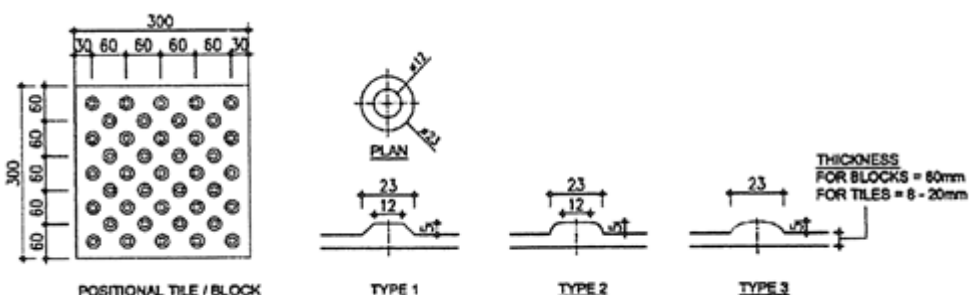

4. Only Type 1 or Type 2 of the above tiles / blocks would be accepted.

1.02 REFERENCES

1. Design Manual - Barrier Free Access 2008

1.03 QUALITY ASSURANCE

- A. The work shall be performed by a firm having 5 years experience in the installation of materials specified herein on projects comparable to this Project. The firm shall have the approval of the materials manufacturer.
- B. Single-source Responsibility: Obtain the material from a single source with resources to provide products of consistent quality in appearance and physical properties without delaying progress of the Work.
- C. Qualification of Manufacturers: Company specializing in the manufacturer of commercial grade panel ceiling and suspension systems with minimum of ten years documented experience.

1.04 PERFORMANCE REQUIREMENTS

- A. The tactile warning strip shall be tested to allow for high traffic and high-profile performance and elegance and to be designed to
 1. withstand continuous and high volume of pedestrian traffic;
 2. be grease, dilute acids and chemical product-resistant;
 3. be slip-resistant;
 4. be cigarette burn-resistant;
 5. be non-electrical conductive.
- B. Comply with the relevant statutory requirements and the Design Manual: Barrier Free Access 2008 issued by the Building Department.
- C. Tactile warning tiles within protected means of escape and smoke lobbies shall be of Class 1 or 2 Rate of Surface Spread of Flame in accordance with BS 476: Part 7 or its international equivalent, or be brought up to that standard by use of an approved fire retardant product, provided that there would be no adverse impact to cost or works programme and shall be subject to Architect's approval.
- D. The tactile warning strip shall be of a non-combustible material and shall not emit toxic or poisonous gas when exposed to fire. The material shall be of class 1 or 2 Rate of Surface Spread of Flame as per British Standard 476: Part 7 with relevant test report or certificate to the satisfaction of the Architect. The adhesive shall be water resistant.
- E. Loading capacity of the tactile warning tiles or blocks of each particular room / location shall comply with that required for the particular room / location.

1.05 ENVIRONMENTAL REQUIREMENTS

(NOT USED)

1.06 ENVIRONMENTAL, CLIMATIC & PSYCHOMETRIC CONDITIONS

(NOT USED)

1.07 SUBMITTALS

- A. Shop Drawings: Submit details and layout plans of tactile guide path before proceeding with Work.

B. Samples:

1. Provide a full range of colour, profile, and texture samples for Architect's Selection.
2. The contractor shall allow at a minimum of four (4) colours for each type of tile/block for Architect's selection, namely, Black, Light Grey, Dark Grey and Yellow.
3. Sample submittal and Architect's acceptance will be for color and texture only. Compliance with all other requirements is the responsibility of the Contractor.

C. Product Data: Submit manufacturer's specifications and installation instructions for each acoustical material, suspension system and other products required, including certified laboratory test reports and other data as may be required to show compliance with the Contract Documents.

1.08 DELIVERY STORAGE AND HANDLING

- A. Deliver materials to the Project site in manufacturer's unopened containers, clearly indicating manufacturer's name, brand, type, style, size, color, texture and other identifying information.
- B. Store materials in a dry location, off the ground and in a manner to prevent damage, deterioration and intrusion of foreign matter. Replace materials which have been damaged or are otherwise unfit for use.

1.09 MOCK-UPS

This part shall be read in conjunction with Clause 8.03 of Specification Preliminaries for the requirements for prototypes and trial areas.

1.10 TESTING

(NOT USED)

1.11 WARRANTY

This part shall be read in conjunction with Clause 8.04 of Specification Preliminaries for the list of material/ system requiring joint written guarantees.

1.12 SPARE PARTS

- A. This part shall be read in conjunction with Clause 8.05 of Specification Preliminaries for the list of spares and spare parts.
- B. Furnish to the Employer and store all the site where directed 3% of each type of each colour and each model or product installed in the Project, packaged in manufacturer's unopened cartons and identified as to contents.

PART 2 PRODUCT

2.01 APPROVED MANUFACTURERS/SUPPLIERS

- A. Subject to compliance with the Project Contract Documents, provide paint systems from the following approved paint manufacturer/ suppliers or equivalent approved by the Architect:

1. Candace Guidance Signage Ltd
Tel: (852) 28611151
Email: info@candace.com.hk

2.02 MATERIAL

- A. PVC Tactile Tile

1. 600mmx300mmx(2+5)mm PVC tactile,
2. Surface finishing: Non-slip mat surface
3. Standard colour: Charcoal Grey, Charcoal Black, Mud Yellow
4. Slip resistance class P3 of Wet Pendulum Test (AS 4586:2013)
5. Fire retardant: UL 94-1996 REV.9:2006 SECTION 8 – RESULT V-0


- B. Stainless steel (grade 316) round and truncated shape studs/groove lines bars fixed on floor with “bolt line with adhesive method”. Depth of anchorage of the studs should be equal or more than 2.5mm.

With BS standard friction test (tactile stub) 0.80 average for dry condition and B.S standard luminance contrast of tactile test average over 30%


1. The tactile product shall have following features –
 - a. Warning, positional and directional tactile with a curved shape >34mm radius,
 - b. Stainless steel grade 316 for external area, grade 304 for internal area,
 - c. Irregular rough textures at all exposed surface,
 - d. A circular groove with thin edge <0.2mm,
 - e. Cone-shaped structure with dovetailed joint >20mm diameter,
 - f. 2mm thick of foam template adhesive tape shall be applied during adhesive fixing,
 - g. Slip Resistance Average Value 47 classified P5 of Wet Pendulum Test (AS 4586:2013),
 - h. Indented color to be anti-acid, anti-UV, Resistance of Separation and Effects of Deformation, ASTM D2794, ISO 2409
 - i. Reference image of the shape and texture shown below,



2. Reference figure of the section and dimension shown below,

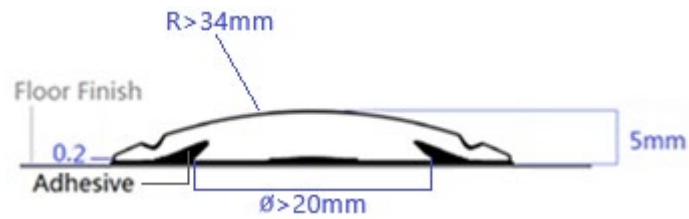

3. The tactile shall be equipped with stainless steel accessory to form a reinforced footing for installing on Brick, Concrete, Washed Granitic, Carpet, Floor Mat, Rubber, or Wood.
4. Reference figure of the section and dimension shown below,

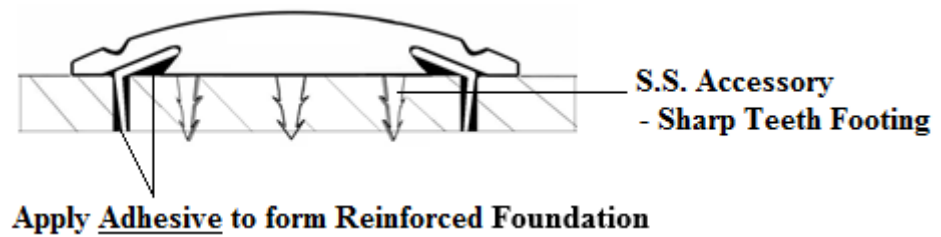

PART 3 EXECUTION

3.01 EXAMINATION / INSPECTION

(NOT USED)

3.02 PREPARATION

(NOT USED)

3.03 INSTALLATION / APPLICATION

A. PVC Tactile Tile

1. Apply specified adhesive completely at the back of the sheet
2. Apply pressure on the tile surface
3. Protecting for 24 hours after adhesion

B. Stainless Steel Tactile

1. The tactile shall be fixed by the method of Adhesive-Interlocking.
2. Drilling through the floor tile or breaking the other side is not allowed.
3. Foam template adhesive tape shall protect the floor surface and to prevent insufficient or excessive adhesive during installation.
4. The tactile shall be fixed by the approved adhesive with bond strength over 5000N between Metal and Floor Tile, ASTM C1583.
5. Uneven floor surface or floor surface covered with a coating shall be flattened and smoothed out.
6. The tactile shall be equipped with stainless steel accessory to form a reinforced footing for installing on Brick, Concrete, Washed Granitic, Carpet, Floor Mat, Rubber, or Wood.
7. Adhesive-Interlocking installation method is environmentally friendly: No dust, No noise, No smell & No damage on floor tile.
8. Adhesive-Interlocking installation method is suitable for all kinds of hard flooring such as Granite, Ceramic, Artificial Tiles.
9. S.S. Accessories shall be applied if installing on soft flooring or mixed flooring, e.g. Carpet/Rubber/Wood; Concrete/ Washed Granitic/Brick.

3.04 CLEANING

(NOT USED)

3.05 PROTECTION

(NOT USED)

END OF SECTION