
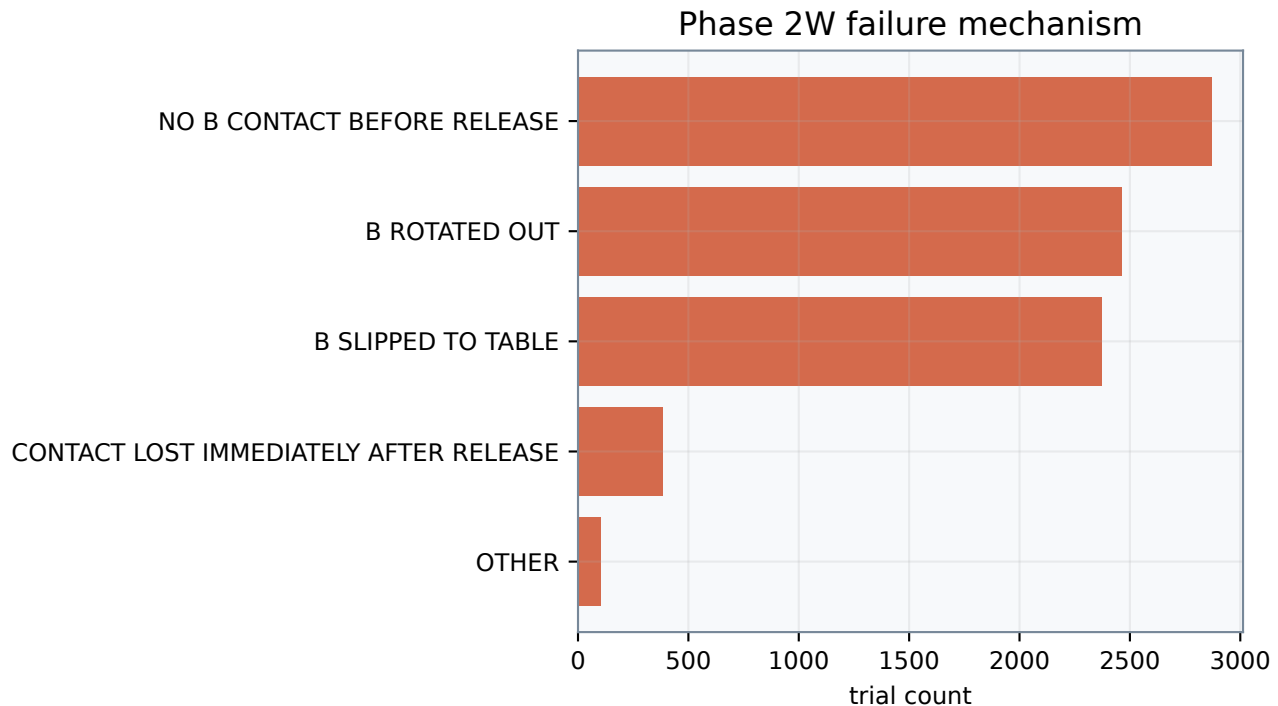


# No Phase 2W B-only positive control at a common static wrist region

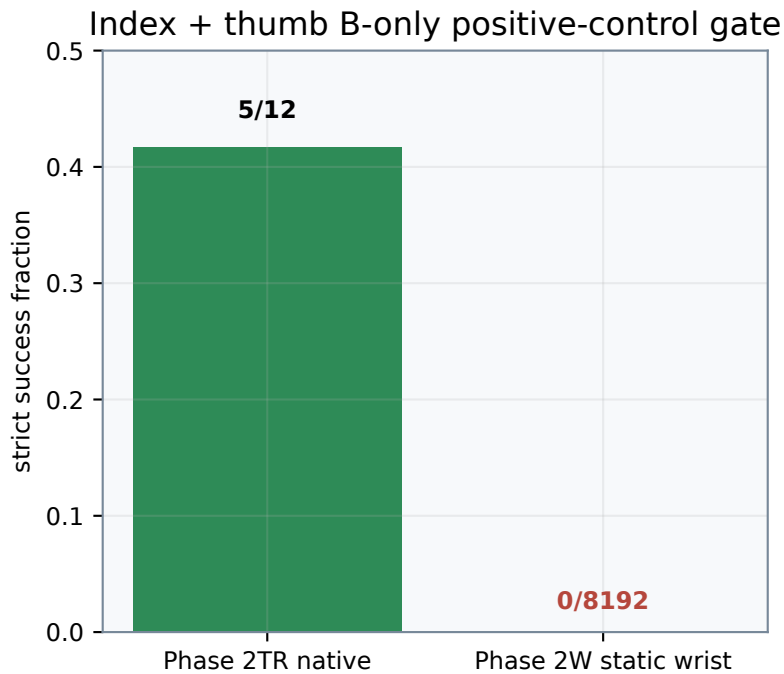

Geometry anchors established pre-release contact, but no trial met the unchanged 500-step strict hold gate.