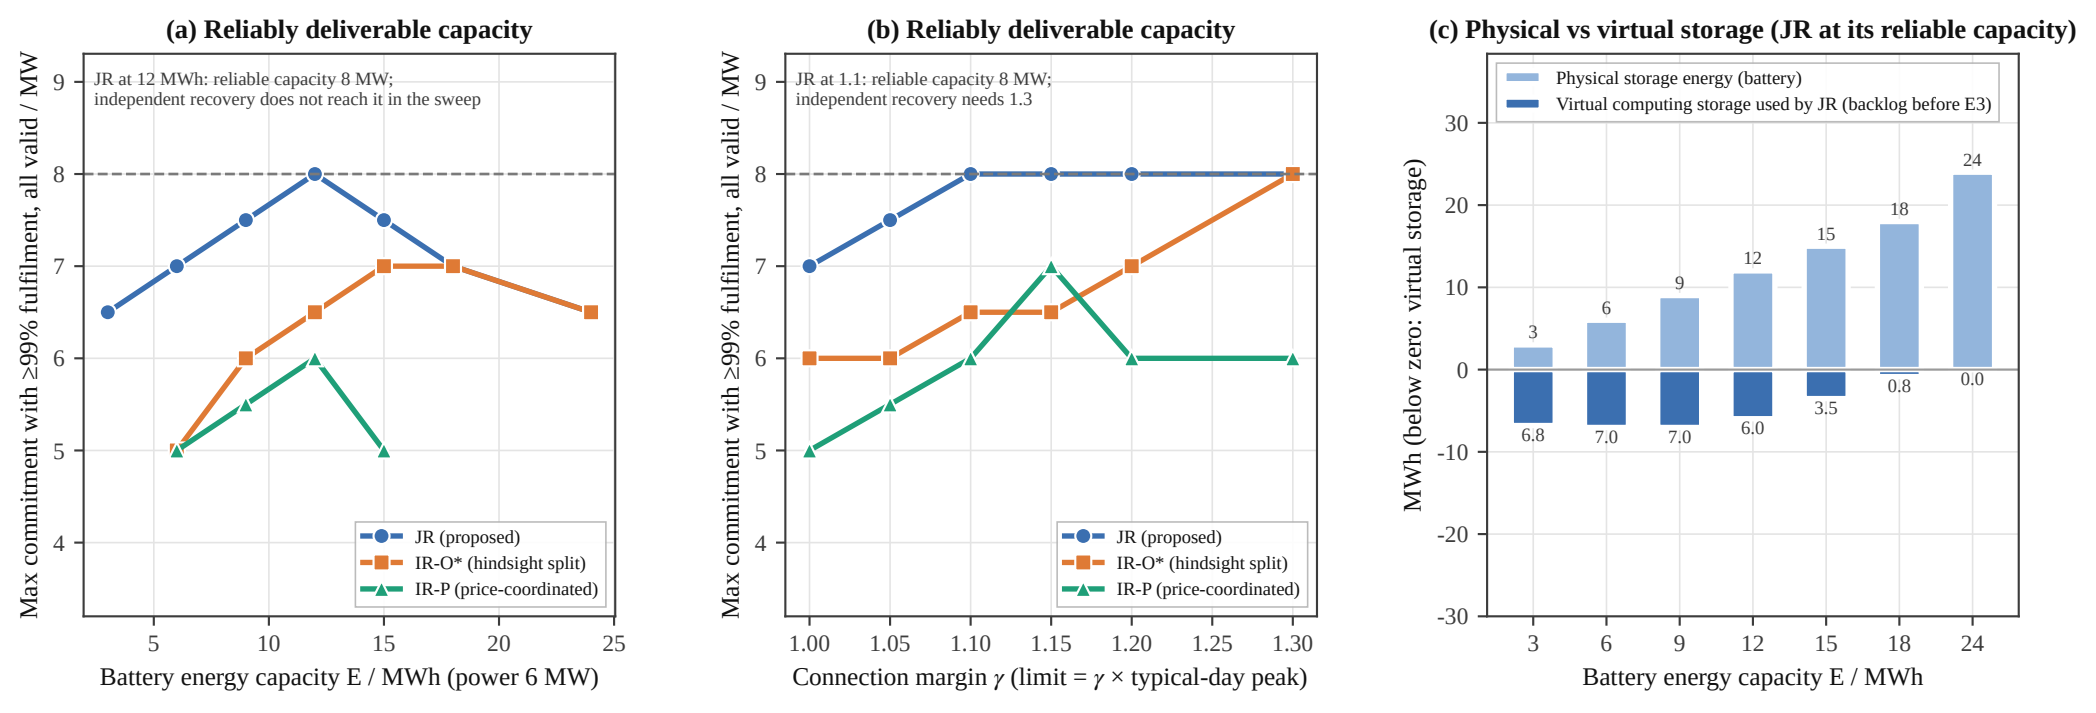
(a) Reliably deliverable capacity
JR at 12 MWh: reliable capacity 8 MW;
independent recovery does not reach it in the sweep
Max commitment with ≥99% fulfilment, all valid / MW
Battery energy capacity E / MWh (power 6 MW)
JR (proposed)
IR-O* (hindsight split)
IR-P (price-coordinated)
(b) Reliably deliverable capacity
JR at 1.1: reliable capacity 8 MW;
independent recovery needs 1.3
Max commitment with ≥99% fulfilment, all valid / MW
Connection margin γ (limit = γ × typical-day peak)
JR (proposed)
IR-O* (hindsight split)
IR-P (price-coordinated)
(c) Physical vs virtual storage (JR at its reliable capacity)
Physical storage energy (battery)
Virtual computing storage used by JR (backlog before E3)
MWh (below zero: virtual storage)
Battery energy capacity E / MWh
3
6
9
12
15
18
24
6.8
7.0
7.0
6.0
3.5
0.8
0.0