

Reinforcing
(3)-#5 BARS x CONT.
#5 @ 8" O.C. E.W.
(4)-#5 BARS E.W.
(6)-#5 BARS E.W.
#5 @ 8" O.C. E.W. TOP & BOT
#5 @ 8" O.C. E.W. TOP & BOT
#5 @ 8" O.C. E.W. TOB & BOT

[illegible]

MARK	LINTEL	ROW 1 REINF.	ROW 2 REINF.	ROW 3 REINF.	ROW 4 REINF.	STIRRUPS
ML01	24" SOLID GROUTED	(2)- #5	N/A	N/A	(2)- #5	#3 @ 10" O.C.

TENSION DEVELOPMENT LENGTH SCHEDULE																	
BAR NO.	LAP LENGTH	fc = 3000 psi				fc = 4000 psi				fc = 4500 psi				fc = 5000 psi			
		TOP BARS		OTHER BARS		TOP BARS		OTHER BARS		TOP BARS		OTHER BARS		TOP BARS		OTHER BARS	
		CASE 1	CASE 2	CASE 1	CASE 2	CASE 1	CASE 2	CASE 1	CASE 2	CASE 1	CASE 2	CASE 1	CASE 2	CASE 1	CASE 2	CASE 1	CASE 2
#3	A	28	42	22	32	19	28	19	28	23	31	23	31	23	31	23	31
	B	29	43	22	32	25	37	26	39	28	34	28	34	27	32	33	37
	C	37	56	29	43	32	48	25	37	31	46	24	35	29	43	32	43
	D	A	36	54	28	41	31	47	24	36	29	44	23	34	28	42	22
#4	A	26	40	20	30	18	26	18	26	21	29	21	29	21	29	21	29
	B	28	43	22	32	25	37	26	39	28	34	28	34	27	32	33	37
	C	37	56	29	43	32	48	25	37	31	46	24	35	29	43	32	43
	D	A	36	54	28	41	31	47	24	36	29	44	23	34	28	42	22
#5	A	26	40	20	30	18	26	18	26	21	29	21	29	21	29	21	29
	B	28	43	22	32	25	37	26	39	28	34	28	34	27	32	33	37
	C	37	56	29	43	32	48	25	37	31	46	24	35	29	43	32	43
	D	A	36	54	28	41	31	47	24	36	29	44	23	34	28	42	22
#6	A	26	40	20	30	18	26	18	26	21	29	21	29	21	29	21	29
	B	28	43	22	32	25	37	26	39	28	34	28	34	27	32	33	37
	C	37	56	29	43	32	48	25	37	31	46	24	35	29	43	32	43
	D	A	36	54	28	41	31	47	24	36	29	44	23	34	28	42	22
#7	A	26	40	20	30	18	26	18	26	21	29	21	29	21	29	21	29
	B	28	43	22	32	25	37	26	39	28	34	28	34	27	32	33	37
	C	37	56	29	43	32	48	25	37	31	46	24	35	29	43	32	43
	D	A	36	54	28	41	31	47	24	36	29	44	23	34	28	42	22
#8	A	26	40	20	30	18	26	18	26	21	29	21	29	21	29	21	29
	B	28	43	22	32	25	37	26	39	28	34	28	34	27	32	33	37
	C	37	56	29	43	32	48	25	37	31	46	24	35	29	43	32	43
	D	A	36	54	28	41	31	47	24	36	29	44	23	34	28	42	22
#9	A	26	40	20	30	18	26	18	26	21	29	21	29	21	29	21	29
	B	28	43	22	32	25	37	26	39	28	34	28	34	27	32	33	37
	C	37	56	29	43	32	48	25	37	31	46	24	35	29	43	32	43
	D	A	36	54	28	41	31	47	24	36	29	44	23	34	28	42	22
#10	A	26	40	20	30	18	26	18	26	21	29	21	29	21	29	21	29
	B	28	43	22	32	25	37	26	39	28	34	28	34	27	32	33	37
	C	37	56	29	43	32	48	25	37	31	46	24	35	29	43	32	43
	D	A	36	54	28	41	31	47	24	36	29	44	23	34	28	42	22
#11	A	101	151	78	116	87	131	67	101	80	120	62	93	78	117	60	90
	B	118	196	101	151	113	170	87	131	104	156	80	120	101	152	78	117
	C	151	251	128	196	146	224	104	170	146	224	104	170	128	196	101	152
	D	A	136	224	113	170	104	170	104	170	104	170	104	170	113	170	87

NOTES:

1. TABLE FOR USE WITH NORMAL WEIGHT HARDCORE CONCRETE AND GRADE 40 UNCOATED REINFORCING BARS. FOR LIGHTWEIGHT AGGREGATE USE 1.5X.
2. TABLE FOR USE WITH 1/2" OR MORE OF THE BARS ARE SPACED WITHIN A REQUIRED LAP LENGTH.
3. 4. CLEARANCE OF 1/4" OF THE BARS IS SPACED WITHIN A REQUIRED LAP LENGTH.
4. 5. FOR 1/2" OR MORE OF THE BARS WITH 12" OR MORE OF CONCRETE CAST IN THE MEMBER BELOW THAT THEY DO NOT OVERLAP.
5. 6. BARS EMBEDDED IN STANDARD COLUMN SPIRALS USE 0.75X 12" MIN.
6. 7. LAP SPACES OF INDIVIDUAL BARS WITH A BUNDLE SHALL BE 12" FOR 1/2" OR MORE OF THE BARS BUNDLE WITH 12" OR MORE BUNDLE. ENTIRE BUNDLES SHALL NOT BE STAGGERED SUCH THAT THEY DO NOT OVERLAP.
7. 8. I-BASIC LAP LENGTH AS SHOWN IN TABLE BELOW.
8. 9. DIFFERENT SIZE BARS ARE TO BE LAPPEDED BY THE LARGER BAR.
9. 10. DIFFERENT DIAMETER BARS ARE TO BE LAPPEDED PER THE LARGER BAR.

CASE SCHEDULE

- FOR FOUNDATION REINFORCEMENT USE CASE 1 U.N.O.
- FOR COLUMN REINFORCEMENT AND DOWELS USE CASE 1 U.N.O.
- FOR BEAM REINFORCEMENT USE CASE 2 U.N.O.
- FOR STRUCTURAL SLAB REINFORCEMENT USE CASE 2 U.N.O.
- FOR SLAB OVER BEAM REINFORCEMENT USE CASE 2 U.N.O.
- FOR WALL REINFORCEMENT AND DOWELS USE CASE 1 (EXCEPT AS NOTED BELOW)
- FOR WALLS WITH A SINGLE MAT OF STEEL CENTERED IN THE WALL USE CASE 1 U.N.O.
- FOR CHORD STEEL REINFORCEMENT USE CASE 2 U.N.O.


BAR SIZE	fc = 3000 psi				fc = 4000 psi				fc = 4500 psi				fc = 5000 psi			
	TOP BARS		OTHER BARS		TOP BARS		OTHER BARS		TOP BARS		OTHER BARS		TOP BARS		OTHER BARS	
	CASE 1	CASE 2	CASE 1	CASE 2	CASE 1	CASE 2	CASE 1	CASE 2	CASE 1	CASE 2	CASE 1	CASE 2	CASE 1	CASE 2	CASE 1	CASE 2
#3	22	32	17	25	19	28	15	22	18	27	14	21	17	25	13	19
#4	29	43	22	33	25	37	19	29	24	35	18	27	22	33	17	26
#5	36	54	28	41	32	47	24	36	30	44	23	34	26	42	22	34
#6	43	64	34	50	39	57	29	43	35	53	28	41	31	50	26	40
#7	63	94	48	72	54	81	42	63	51	77	40	59	49	73	37	56
#8	72	107	55	82	62	93	48	71	59	88	45	68	55	83	43	64
#9	121	170	90	125	105	154	81	116	97	131	69	88	75	93	48	68
#10	131	136	70	105	79	118	61	91	73	109	56	84	70	105	54	84
#11	101	151	78	116	87	131	67	101	80	120	62	93	78	117	60	90
#12	103	155	86	125	102	157	81	113	144	107	76	114	102	140	72	102
#14	161	241	124	186	139	209	107	167	182	197	115	152	125	167	96	114

NOTES:

1. TABLE FOR USE WITH NORMAL WEIGHT, HANDPOURED CONCRETE AND GRADE 60 UNCOATED REINFORCING BARS. FOR LIGHTWEIGHT AGGREGATE USE 1/2"
2. MINIMUM CONCRETE COVER: 1" FOR ALL BARS; 1 1/2" OR MORE OF CONCRETE CAST IN THE MEMBER BELOW THE BAR.
3. FOR BARS ENCASED IN STANDARD COLUMN SPIRALS, USE 7/54 OR 17/19"
4. FOR BARS ENCASED IN STANDARD COLUMN SPIRALS WITH A BUNDLE SIGNAL, USE 1 1/2" FOR THAT BAR IN A BARS BUNDLE AND 1.33" FOR A 4-BAR BUNDLE.
5. COMPRESSION DEVELOPMENT LENGTH (ONLY WHERE INDICATED ON DRAWINGS)
6. FOR 3-BAR BUNDLE USE 22 BAR
7. F-BASIC LAP LENGTH AS SHOWN AT RIGHT.

CASE SELECTION:

- FOR FOUNDATION REINFORCEMENT USE CASE 1 U.N.O.
- FOR COLUMN REINFORCEMENT AND DOWELS USE CASE 1 U.N.O.
- FOR SLAB REINFORCEMENT USE CASE 2 U.N.O.
- FOR STRUCTURAL SLAB REINFORCEMENT USE CASE 2 U.N.O.
- FOR BEAM OR GIRDER REINFORCEMENT USE CASE 1 U.N.O.
- FOR WALL REINFORCEMENT AND DOWELS USE CASE 1 (EXCEPT AS NOTED BELOW) U.N.O.
- FOR WALL WITH A SINGLE ROW OF STIFFENERS USE CASE 1 U.N.O.
- FOR CHORD STEEL REINFORCEMENT USE CASE 2 U.N.O.

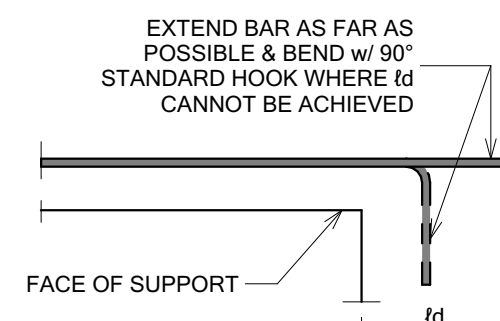
[illegible]

NOTES: NP = NOT PERMITTED

1. ALL DEVELOPMENT AND LAP SPICE LENGTHS ARE IN INCHES.
2. THIS TABLE SHALL BE USED FOR ALL REINFORCED CMU WALLS, PLASTER, AND COLUMNS UNLESS NOTED OTHERWISE IN DETAILS. INCREASE TABULATED VALUES BY 50% FOR EPOXY COATED REIN.
3. WITH APPROVAL BY THE ENGINEER, WELDED SPICES AND MECHANICAL SPICES DEVELOPING AT LEAST 125% OF THE YIELD STRENGTH, F_y , OF THE BAR MAY BE SUBSTITUTED IN SOME LOCATIONS.
4. WHEN LAP SPICING BARS OF DIFFERENT SIZES, THE LAP LENGTH IS DETERMINED BY THE SMALLER BAR.
5. REFER TO "TYPICAL CMU VERTICAL BAR PLACEMENT" FOR BAR POSITIONING IN CELLS.

A vertical strip of various symbols and diagrams, including geometric shapes, a circuit diagram, a cross-section of a road, a compass rose, and a circular diagram with a cross.

MK.	NOTE
①	4" CONCRETE SLAB ON GRADE w/ 6x6 W2, W2x9.9 W.W.F. CENTERED I SLAB
②	SWITCH DENOTES OVERBILL LOCATION. RE: ARCH FOR SLOPE AND DRAINAGE
③	ROOF DECK PER GSN#
④	PRE-MANUFACTURED MECHANICAL SCREEN PER ARCH.
⑤	PIPE SIZE AND SPEC PER PLUMBING, PROVIDE SLEEVE, RE: DETAIL FOR MORE INFO
⑥	STEP FOOTING PER TYP. DET. 001
⑦	PARAPET BRACING SUPPORT PER DETAILS 202 & 203 WHERE CONDITION IS PARALLEL TO JOISTS, PROVIDE SIM HSS SUPPORT AT JOISTS GREATER THAN JOIST TO JOIST SPACING

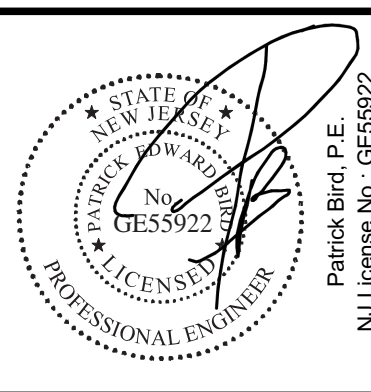[illegible]

The District at
1515 Urban
Renewal, LLC



THE DISTRICT AT 15FIFTEEN - BUILDING C

1525 ROUTE 10
PARSIIPPANY - TROY HILLS,, MORRIS COUNTY NEW JERSEY 07054
BLOCK 200, LOT 1.06



S020.1C

NOTES &
SCHEDULES

© 2023, Thriven Design. All planning and architectural concepts shown on this document are the intellectual property of Thriven Design, Inc.
B:\Midwest_MN\2022\2023\1515-BldgC-AQ04-FOUNDATION PLAN Friday, March 21, 2025 2:32 PM

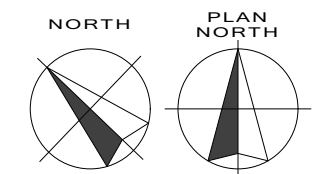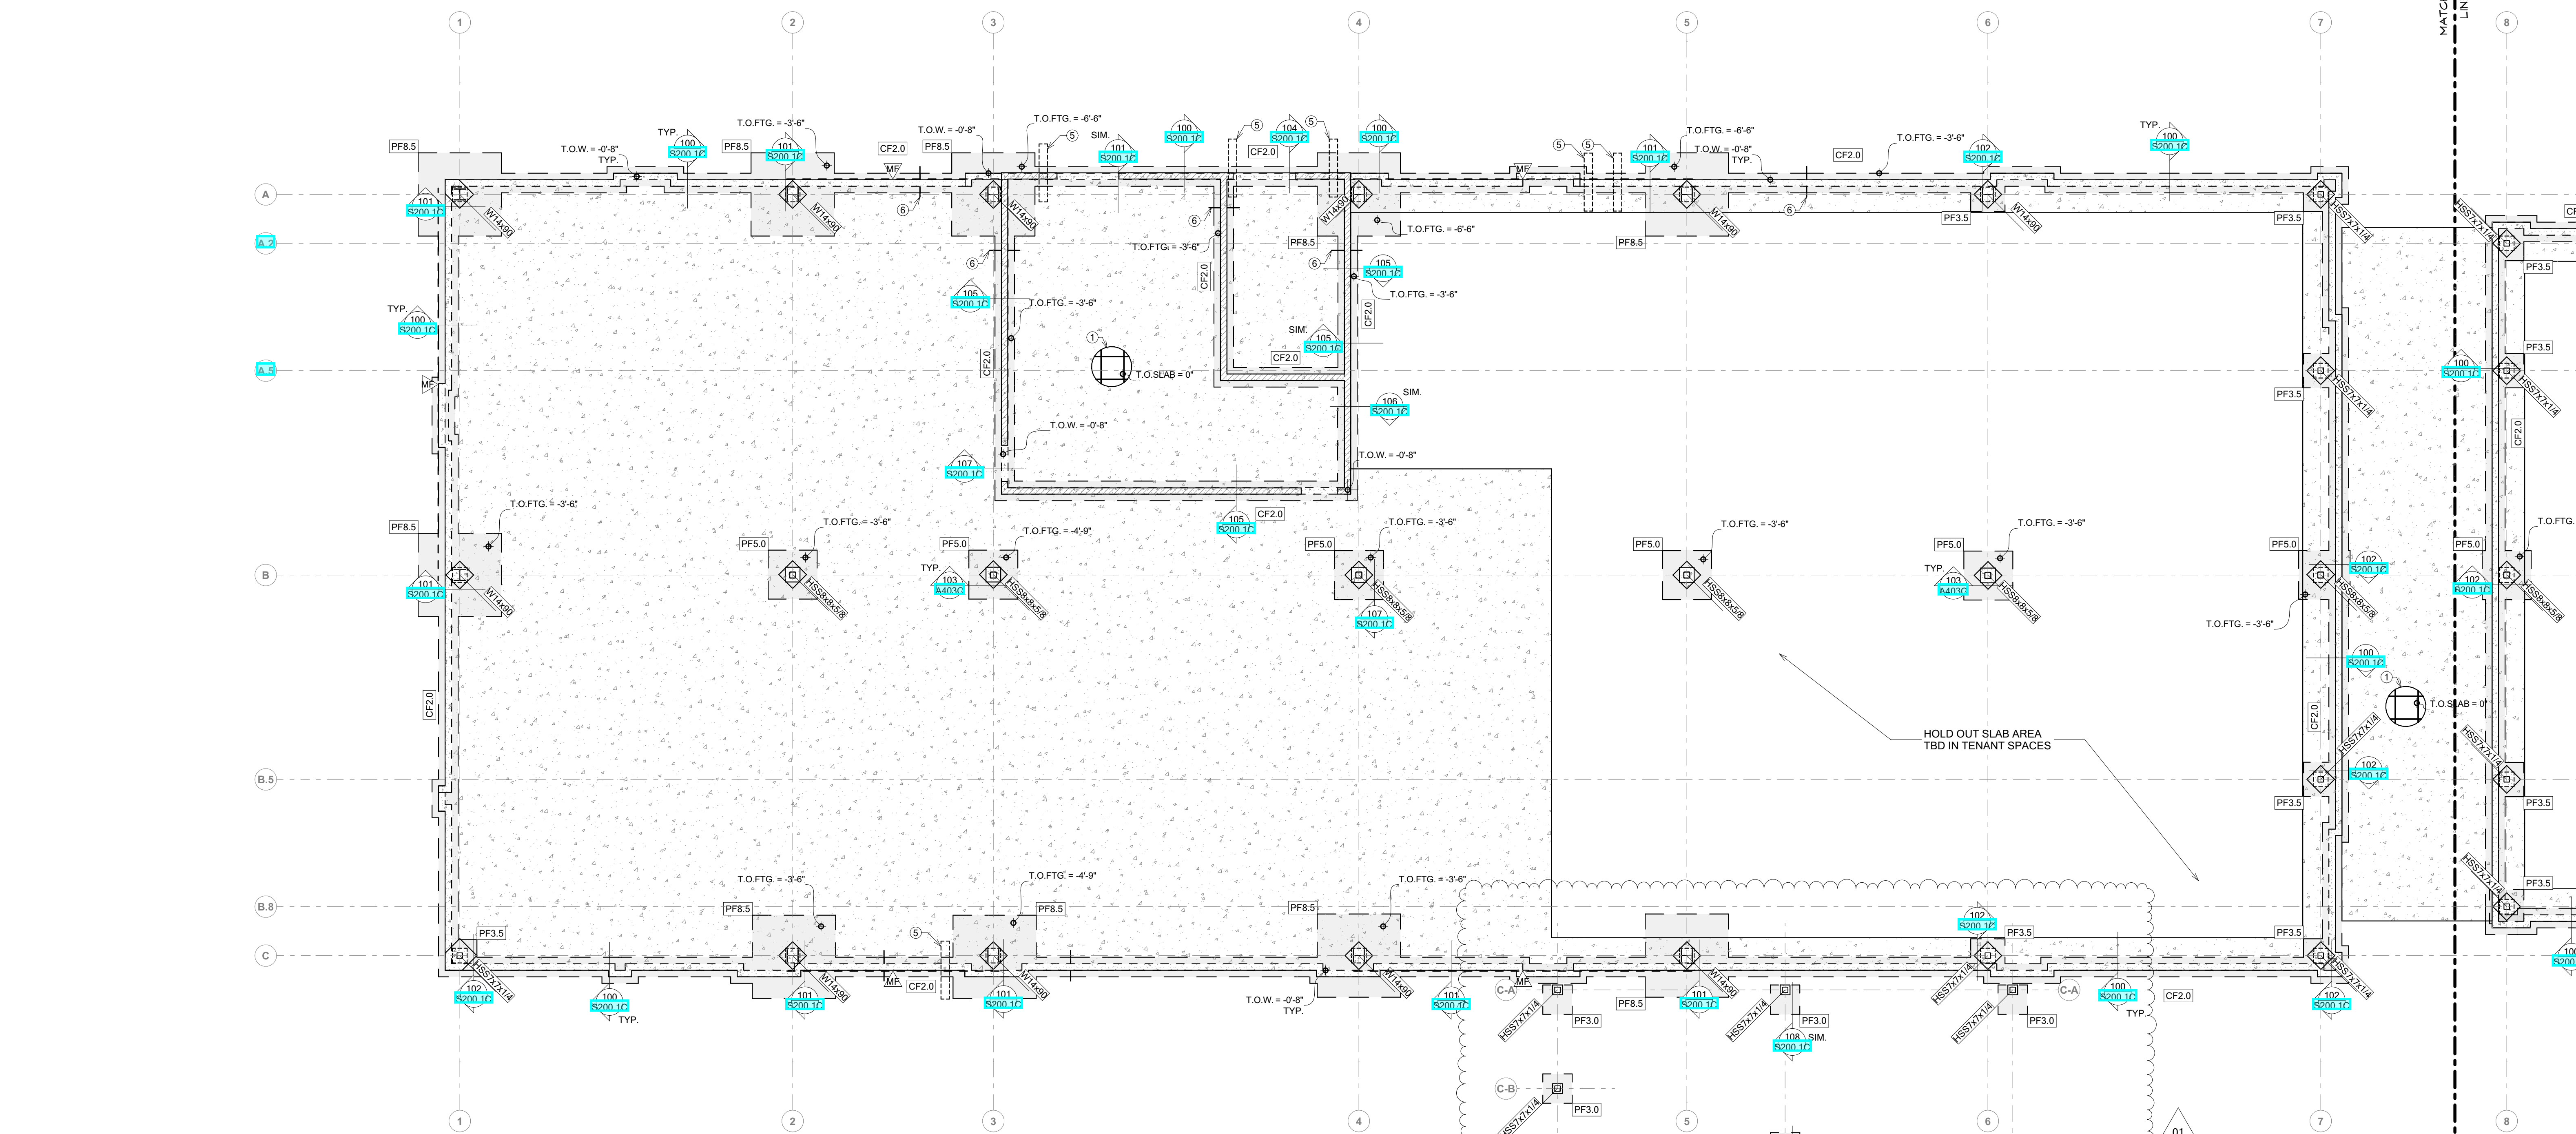

1 FOUNDATION PLAN - WEST
SCALE: 1/8" = 1'-0"

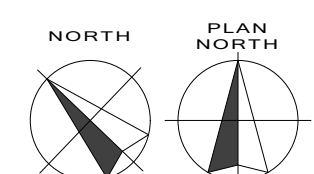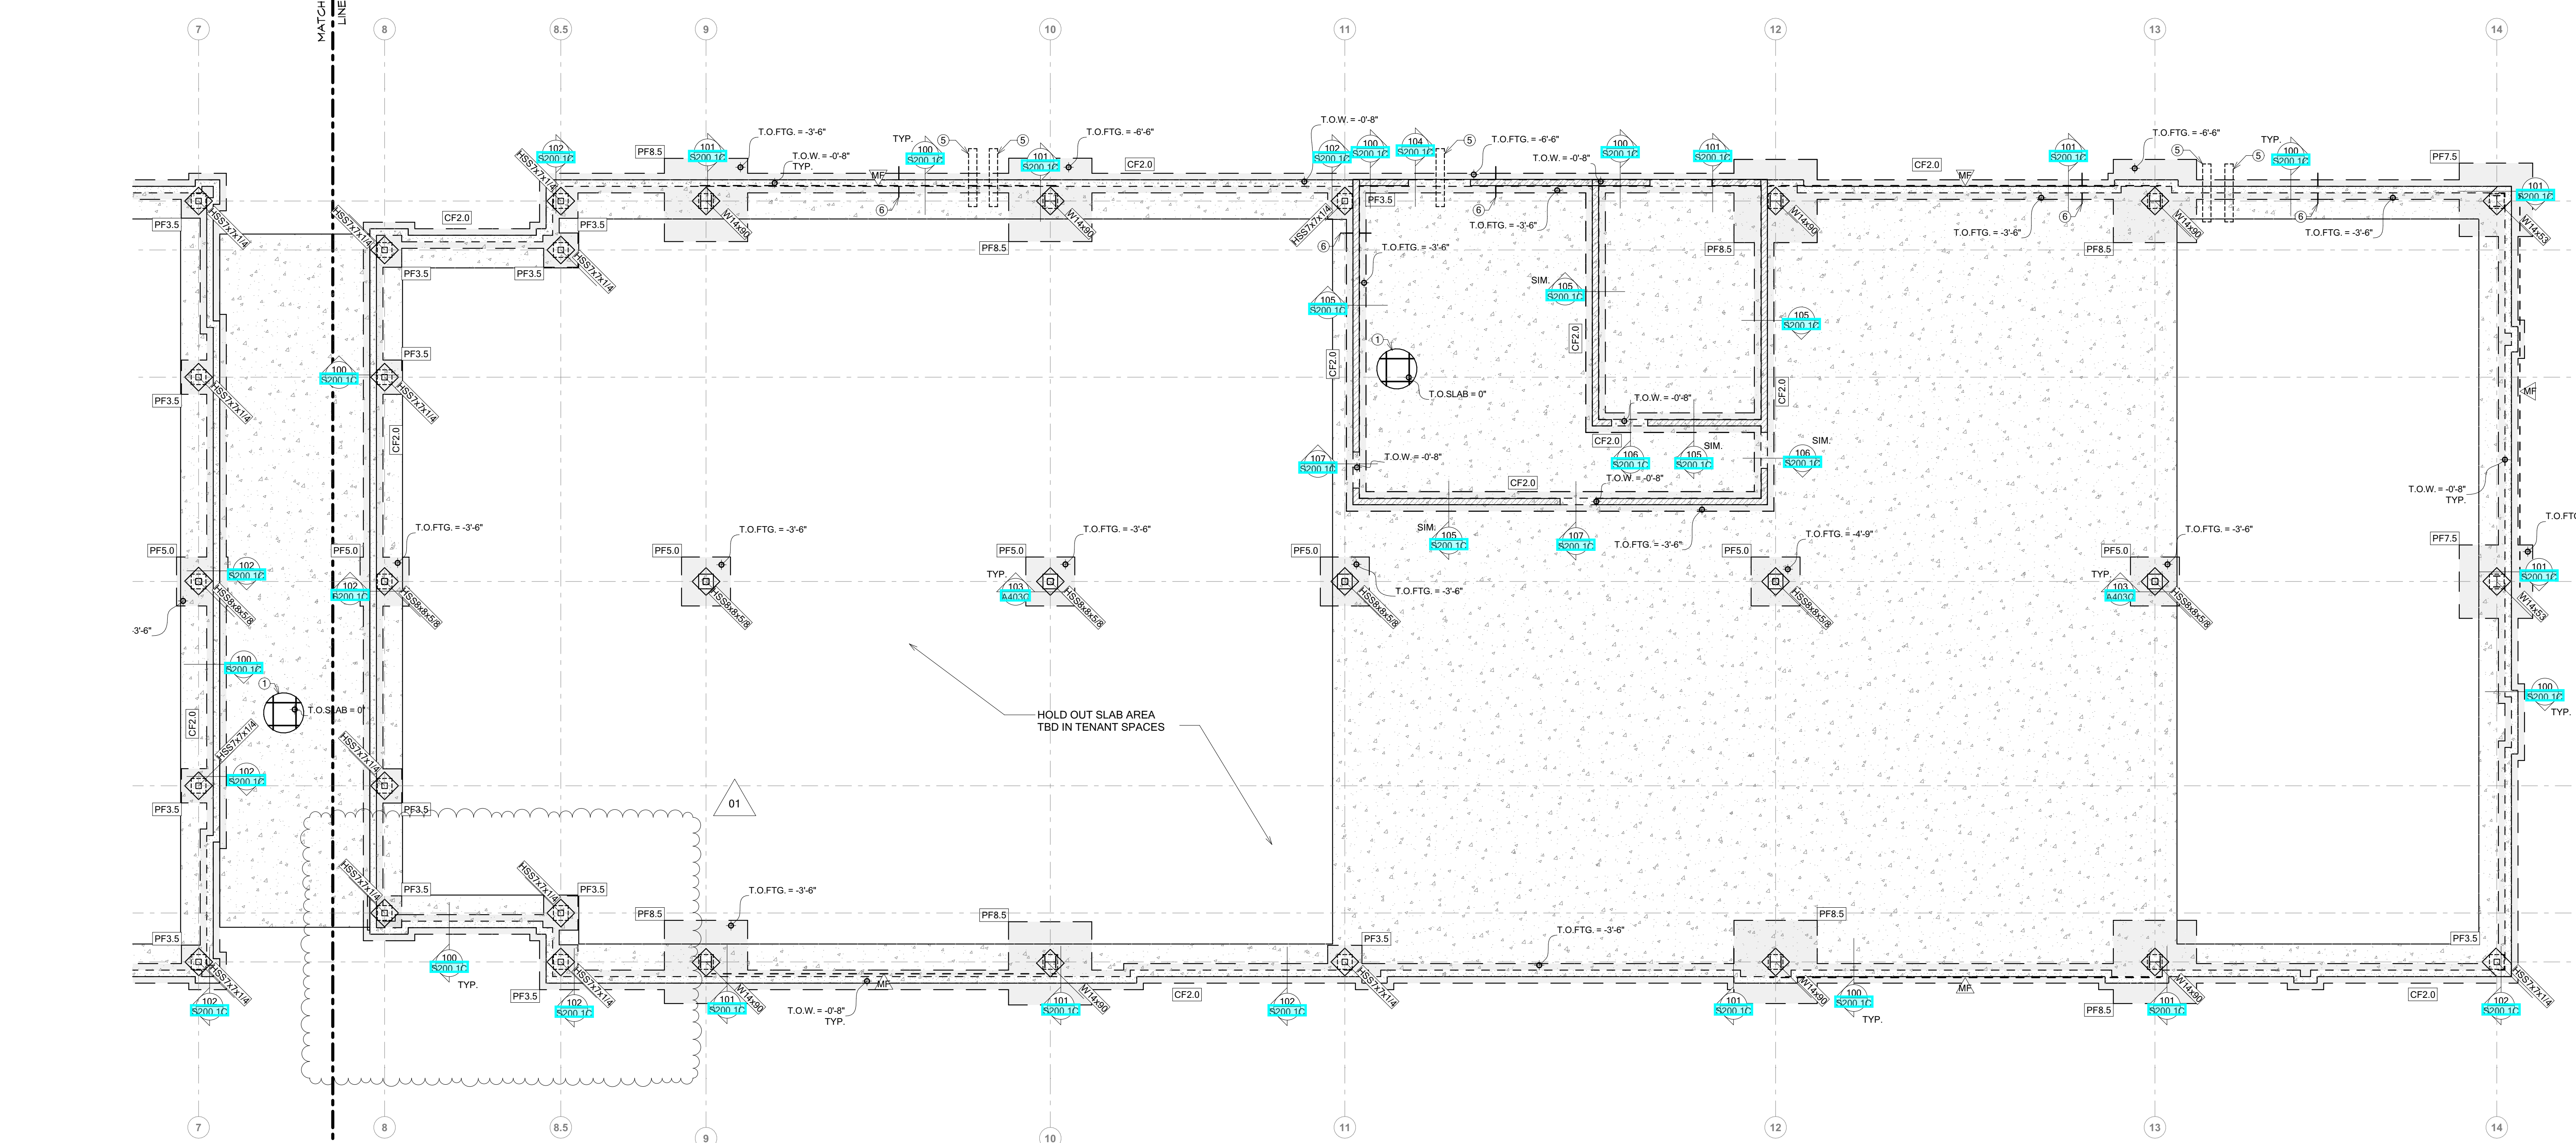

2 FOUNDATION PLAN - EAST
SCALE: 1/8" = 1'-0"

PLAN NOTES

1. RE: SHEET S100.1C FOR GENERAL NOTES.
2. RE: ARCH. FOR SLOPE INFO.
3. DIMENSIONS SHOWN APPLY TO STRUCTURAL ELEMENTS ONLY. RE: ARCH. PLANS FOR ALL DIMS. INFORMATION NOT SHOWN HERE.
4. CONTRACTOR SHALL FIELD VERIFY EXISTING STRUCTURAL CONDITIONS. IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR SHALL CONTACT ARCH. & E.O.R. BEFORE PERFORMING ALTERATION WORK.
5. SCHEDULED MARK DESIGNATIONS ARE TYPICAL TO THE PROJECT AND MAY NOT NECESSARILY BE FOUND ON THIS PLAN.
6. FOR CLARITY, DETAILS MAY SHOW ONLY ONE SIDE OF FOUNDATION CONDITIONS.
7. [PFX.X] DENOTES PAD FOOTING. SEE SCHEDULE BELOW.
8. RE: S100.1D FOR COMPLETE MASTER KEYNOTE LIST
9. RE: S010 SERIES SHEETS FOR ALL TYPICAL DETAILS WHICH MAY NOT BE SPECIFICALLY CALLED OUT IN PLAN.
10. QUANTITIES SHOWN IN STRUCTURAL SCHEDULES ARE INTENDED TO AID CONTRACTOR. CONTRACTOR IS RESPONSIBLE FOR ALL FINAL COUNTS OF STRUCTURAL MEMBERS.
11. [C] DENOTES COLUMN LOC. RE: COLUMN SCHEDULE THIS SHEET
12. [F] DENOTES FRAMING KEYNOTE. RE: KEYNOTE SCHEDULE THIS SHEET
13. [M] DENOTES TOP OF MATERIAL SHOWN. VERIFY WITH ARCH. PLANS.
14. CONTRACTOR TO COORDINATE PLACEMENT OF UTILITIES THROUGH OR ADJACENT TO THE FOOTINGS OR STEM WALLS WITH DET. 004 OR THE FOOTINGS MAY BE STEPPED PER DET. 001 AT CONTRACTOR'S OPTION, TYP.
15. ALL CONTINUOUS FOOTING (CF2.0) U.O.G. RE: DET. 100 FOR MORE INFO.

CONCRETE FOOTING SCHEDULE									
MARK	WIDTH	LENGTH	DEPTH	REINFORCING CROSSWISE			REINFORCING LENGTHWISE		
				NO.	SIZE	SPACING	NO.	SIZE	SPACING
CF2.0	2'-0"	CONT.	12"	-	-	-	3	#4	CONT.
PF3.5	3'-6"	3'-6"	12"	3	#5	3'-0"	EQ.	3	#5
PF5.0	5'-0"	5'-0"	12"	5	#5	4'-0"	EQ.	5	#5
PF7.5	7'-6"	7'-6"	14"	8	#5	7'-0"	EQ.	8	#5
PF8.0	8'-0"	8'-0"	14"	8	#5	7'-6"	EQ.	8	#5
PF8.5	8'-6"	8'-6"	14"	8	#5	8'-0"	EQ.	8	#5

STEEL COLUMN NOTES:


1. PLACE ALL FOOTING REINFORCING IN BOTTOM OF FOOTING WITH 2" CLEAR CONCRETE COVER, UNLESS NOTED OTHERWISE.
2. TOP REINFORCING, WHERE SPECIFIED, SHALL BE PLACED IN THE TOP OF THE FOOTING WITH 2" MINIMUM CONCRETE COVER.
3. IF FOOTINGS ARE EARTH FORMED, FOOTING WIDTH AND LENGTH SHALL BE 6" WIDER AND LONGER THAN SCHEDULED.
4. SEE GENERAL STRUCTURAL NOTES FOR ALL OTHER REQUIREMENTS.
5. NOT ALL FOOTINGS ARE USED. SEE FOUNDATION PLAN FOR FOOTING MARKS.
6. RUN CONTINUOUS BARS IN CF FOOTING THROUGH INTERSECTED WF FOOTINGS.
7. FOOTINGS MARKED 'TYP' ARE THICKENED SLAB FOOTINGS AND ARE TO BE REINFORCED PER THE 'CFX' FOOTING SIZE WHERE 'X' INDICATES THE WIDTH AT THE BOTTOM OF THE FOOTING.

TYPICAL FOOTING SECTION

FOUNDATION KEYNOTE SCHEDULE

- MK. NOTE
1. 4" CONCRETE SLAB ON GRADE w/ 6x6 W2.5xW2.5 W.W.F. CENTERED IN SLAB
 2. PIPE SIZE AND SPEC PER PLUMBING. PROVIDE SLEEVE. RE: DETAIL FOR MORE INFO.
 3. STEP FOOTING PER TYP. DET. 001


KEY PLAN

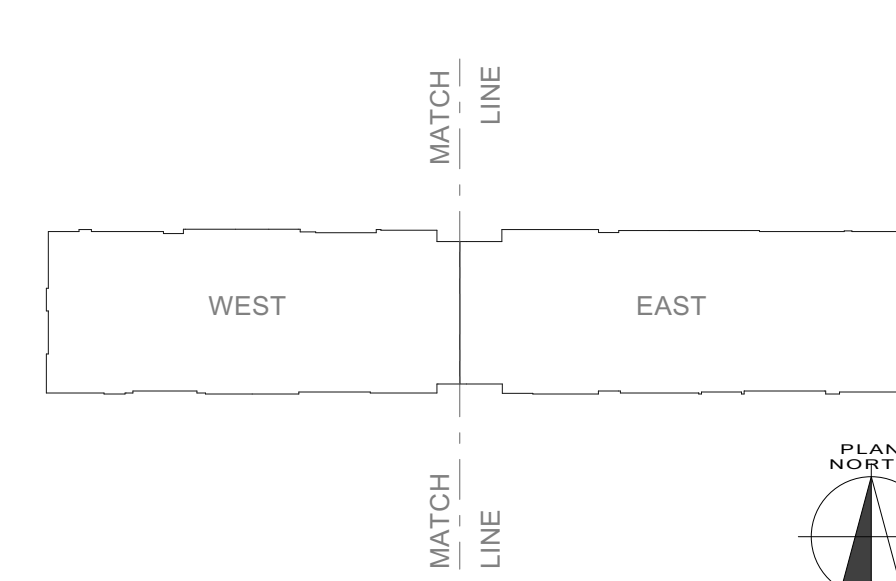

thriven
design

756 Haddon Avenue
Collingswood, NJ 08108

P: 856.854.1880
thriven.design

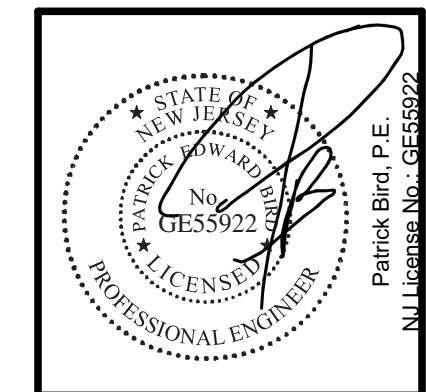

Date: 10-25-2024
Job #: 2020005

Drawn: Mngf:

Rev.	No.	Name	Date
01	REV 1		03.21.2025

20005	1515-BldgC
-------	------------



The District at
1515 Urban
Renewal, LLC


10-25-2024: ISSUED FOR PERMIT
THE DISTRICT AT 15FIFTEEN - BUILDING C
1525 ROUTE 10
PARSIPPANY - TROY HILLS,, MORRIS COUNTY NEW JERSEY 07054
BLOCK 200, LOT 1.06

S100.1C

FOUNDATION PLAN


RCVD by DS 3/24/2025

© 2023, Thriven Design. All planning and architectural concepts shown on this document are the intellectual property of Thriven Design, Inc.
B:\Midwest_MM\2022\2023\1515-BldgC-AQ24-ROOF FRAMING PLAN Friday, March 21, 2025 2:32 PM

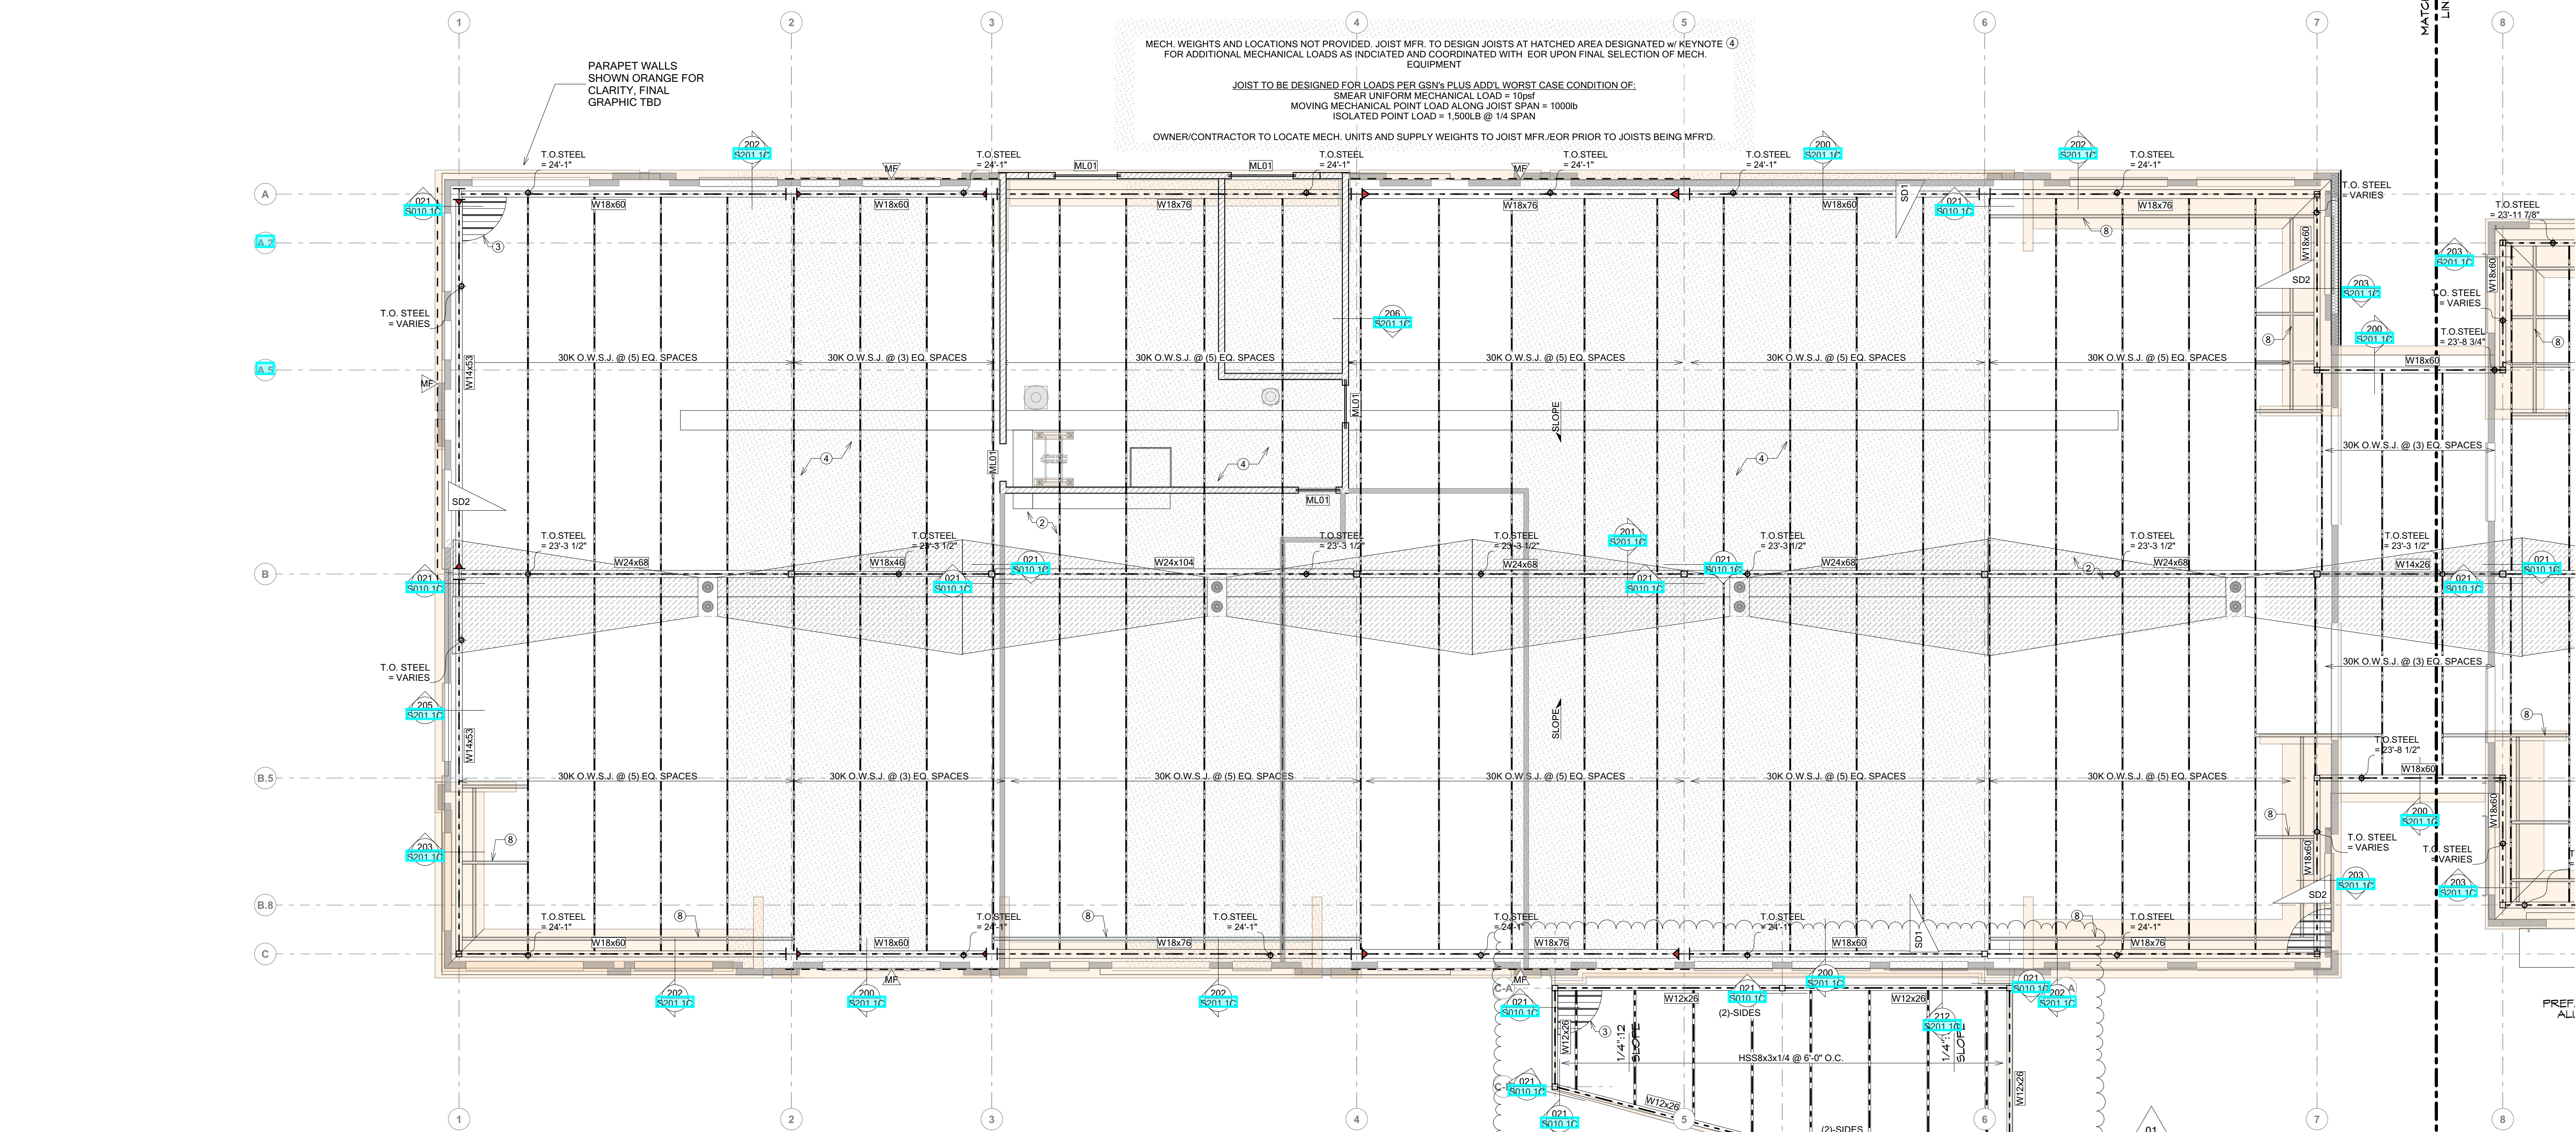

1 ROOF FRAMING PLAN - WEST

SCALE: 1/8" = 1'-0"

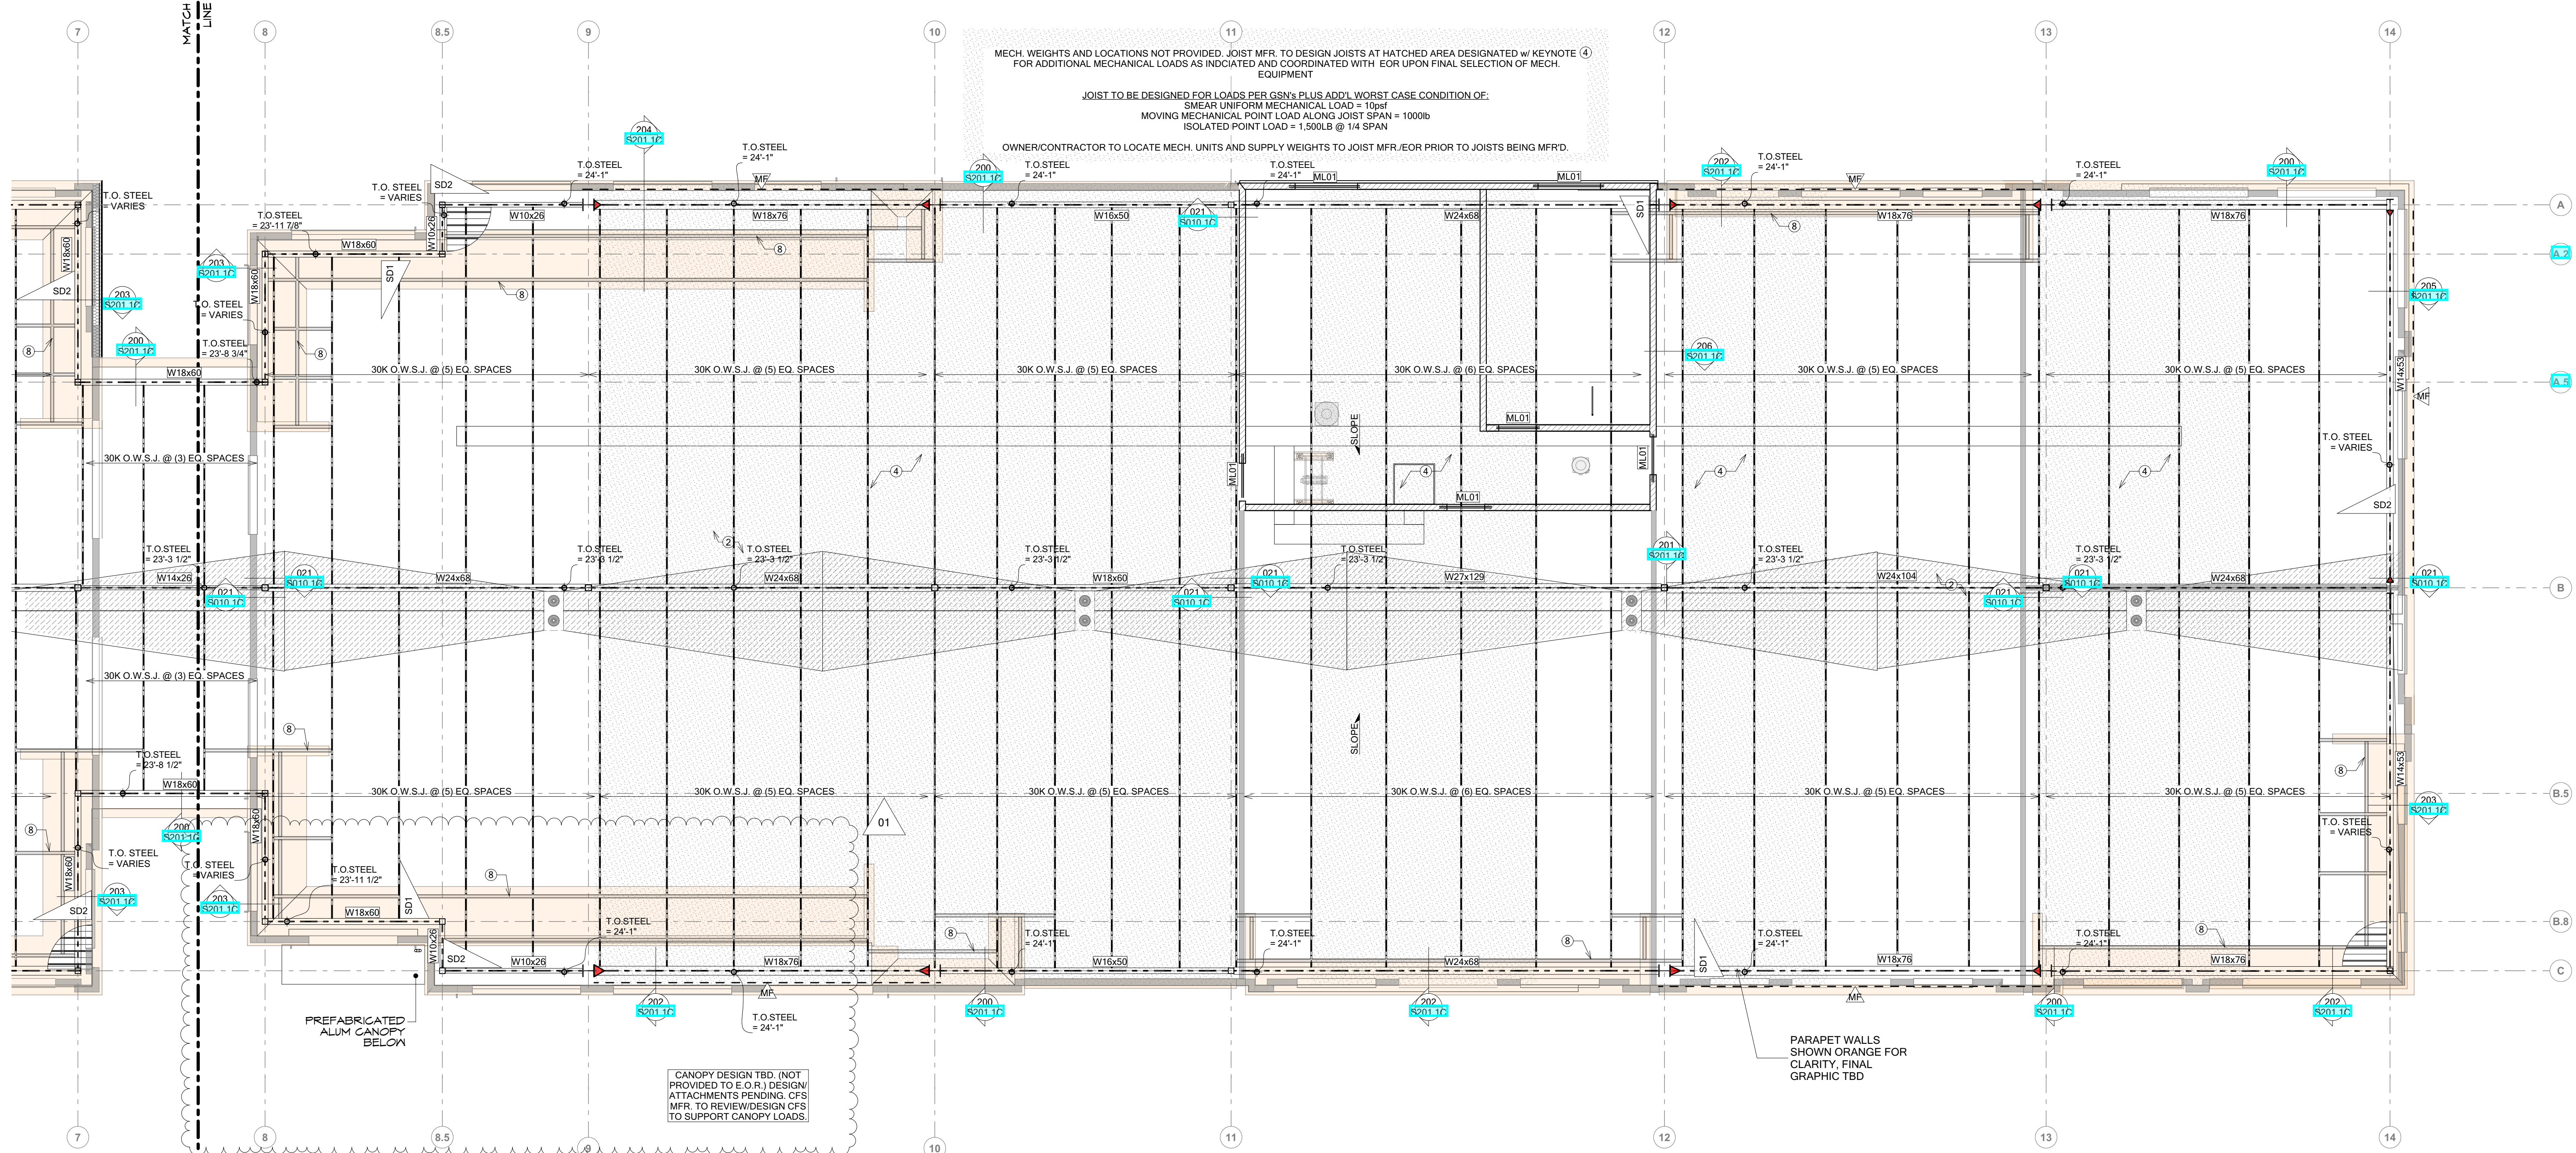

2 ROOF FRAMING PLAN - EAST

SCALE: 1/8" = 1'-0"


PLAN NOTES

1. RE: SHEET **S100.2C** FOR GENERAL NOTES.
2. RE: ARCH. PLANS FOR ROOF SLOPE INFO.
3. RE: ARCH. PLANS FOR ALL DIMS. INFORMATION NOT SHOWN HERE.
4. SCHEDULED MARK DESIGNATIONS ARE TYPICAL TO THE PROJECT AND MAY NOT NECESSARILY BE FOUND ON THIS PLAN.
5. FOR CLARITY, DETAILS MAY SHOW ONLY ONE SIDE OF ROOF FRAMING CONDITIONS.
6. FOR CLARITY, ALL ROOF OPENINGS MAY NOT BE SHOWN ON ROOF FRAMING PLAN. FOR EXACT SIZE, NUMBER AND LOCATION OF OPENINGS, SEE ARCHITECTURAL, MECHANICAL, PLUMBING AND ELECTRICAL DRAWINGS. FOR FRAMING AT OPENINGS, SEE TYPICAL DETAILS.
7. ALL NON-CMU WALLS TO BE CFS FRAMING BY OTHERS.
8. **ML01** INDICATES A MASONRY LINTEL PER SCHEDULE BELOW.
9. RE: SD10 SERIES SHEETS FOR ALL TYPICAL DETAILS WHICH MAY NOT BE SPECIFICALLY CALLED OUT IN PLAN.
10. QUANTITIES SHOWN IN STRUCTURAL SCHEDULES ARE INTENDED TO AID CONTRACTOR. CONTRACTOR IS RESPONSIBLE FOR ALL FINAL COUNTS OF STRUCTURAL MEMBERS.
11. DENOTES COLUMN LOC. RE: COLUMN SCHEDULE THIS SHEET.
12. DENOTES FRAMING KEYNOTE. RE: KEYNOTE SCHEDULE THIS SHEET. RE: **S100.10** FOR COMPLETE MASTER KEYNOTE LIST.
13. CFS CONTRACTOR SHALL DESIGN HEADERS AND COLUMNS AT JOINTS TO SUPPORT RESIST ALL APPLIED LOADS.
14. ROOF JOIST MANUFACTURER TO PLAN FOR RTU WEIGHTS IN MECHANICAL SCREEN AREA. LOCATION AND EXACT WEIGHTS ARE NOT KNOWN AT THIS TIME.
15. JOIST MFR. TO PROVIDE BRACING AS REQUIRED.
16. TOP OF PARAPET WALL ELEVATIONS PER ARCH.
17. DENOTES STEEL MOMENT WELDED CONN. RE: DETAIL SPECIFIED FOR MORE INFO.
18. INDICATES MOMENT FRAME LOC.

ROOF FRAMING KEYNOTE SCHEDULE

MK. NOTE

1. HATCH DENOTES OVERBUILD LOCATION. RE: ARCH FOR SLOPE AND DRAINAGE.
2. ROOF DECK PER GSN'S.
3. PRE-MANUFACTURED MECHANICAL SCREEN PER ARCH.
4. PARAPET BRACING SUPPORT PER DETAILS 202 & 203 WHERE CONDITION IS PARALLEL TO JOISTS. PROVIDE 30M HSS SUPPORT AT SPAN NO GREATER THAN JOIST SPACING.

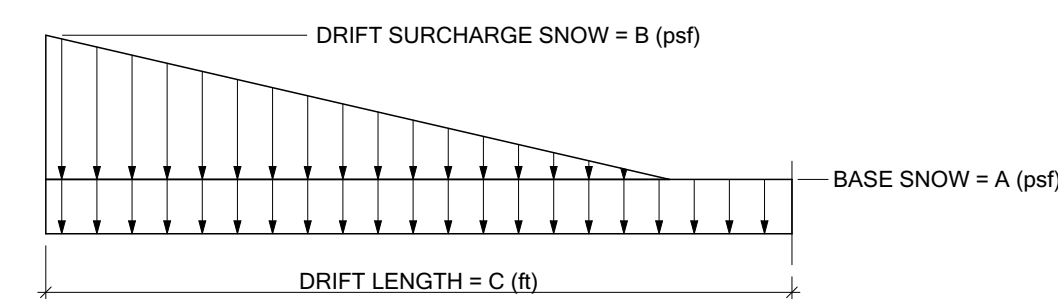


SNOW DRIFT SCHEDULE

MK.	A	B	C
SD1	20	42	14
SD2	20	87	24


NOTE:
NET ROOF UPLIFT = -13.2 PSF

KEY PLAN

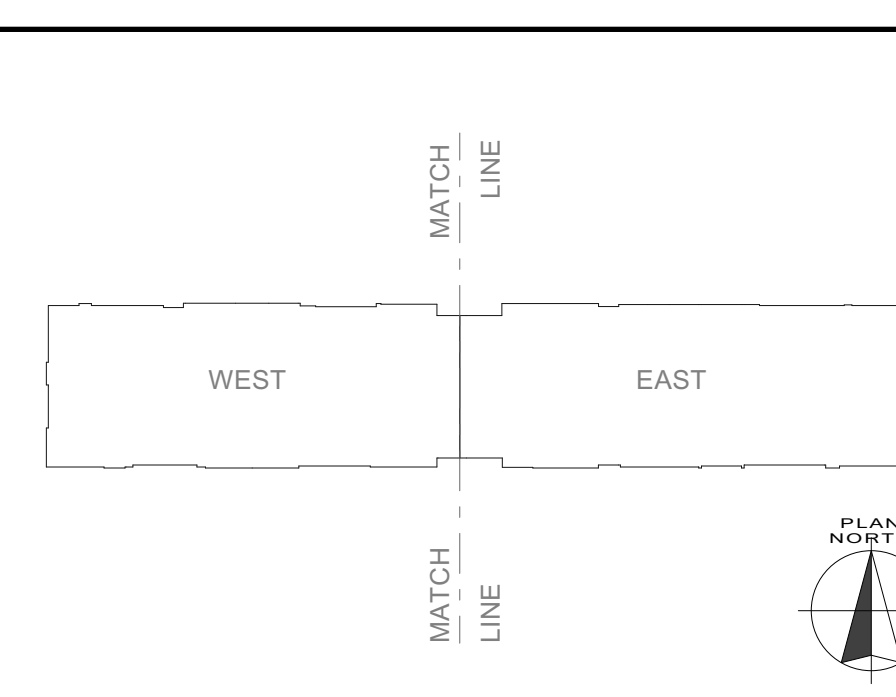

thriven
design

756 Haddon Avenue
Collingswood, NJ 08108
P: 856.854.1880
thriven.design

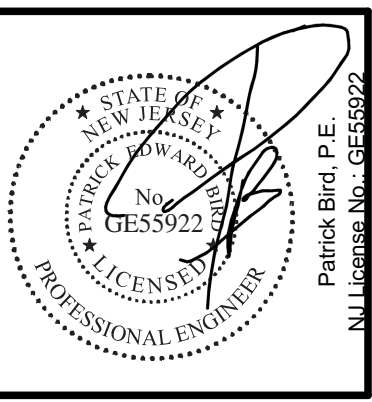

Date: 10-25-2024
Job #: 2020005

Drawn:

Mngr:

Rev. No. Name Date

01 REV 1 03.21.2025

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC

20005-1515-BldgC


20005-1515-BldgC






© 2023, Thriven Design. All planning and architectural concepts shown on this document are the intellectual property of Thriven Design, Inc.


B:\Midwest_MM\2022\20mmgr - Bldg\20200005 - 1515-Bldg-C-A04-2-STEEL FRAMING DETAILS Friday, March 21, 2025 2:33 PM

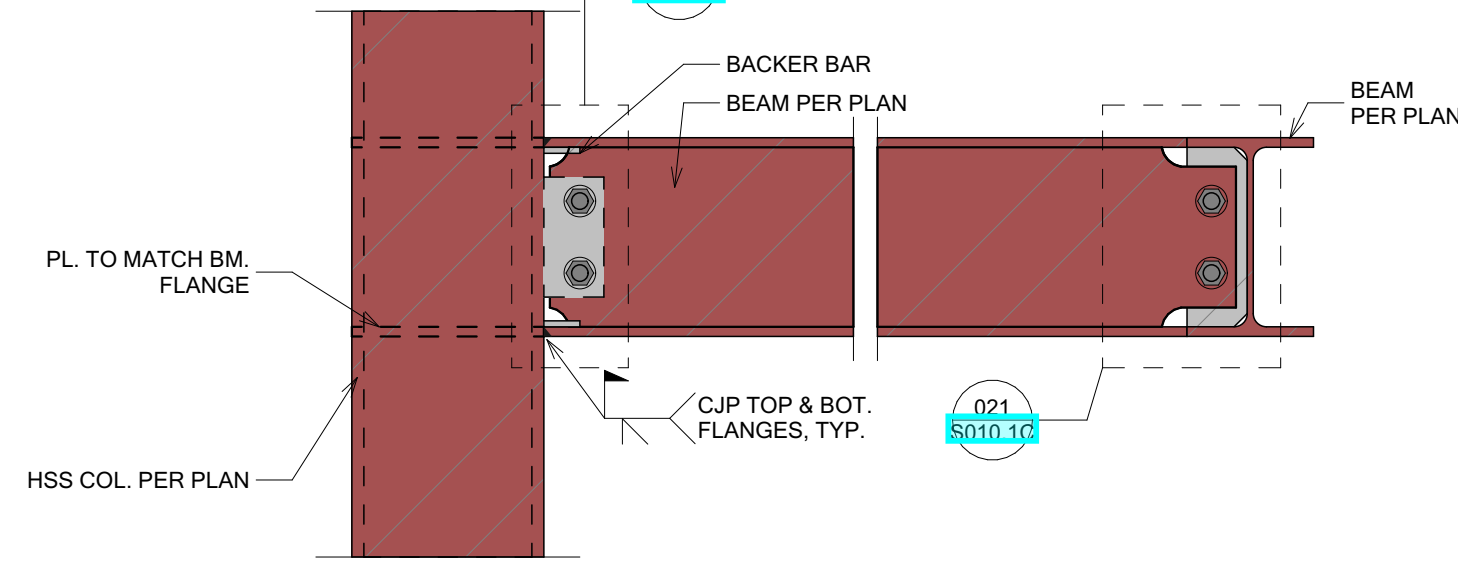


210 STEEL BEAM TO HSS COL. MOMENT CONN. 1 1/2" = 1'-0"

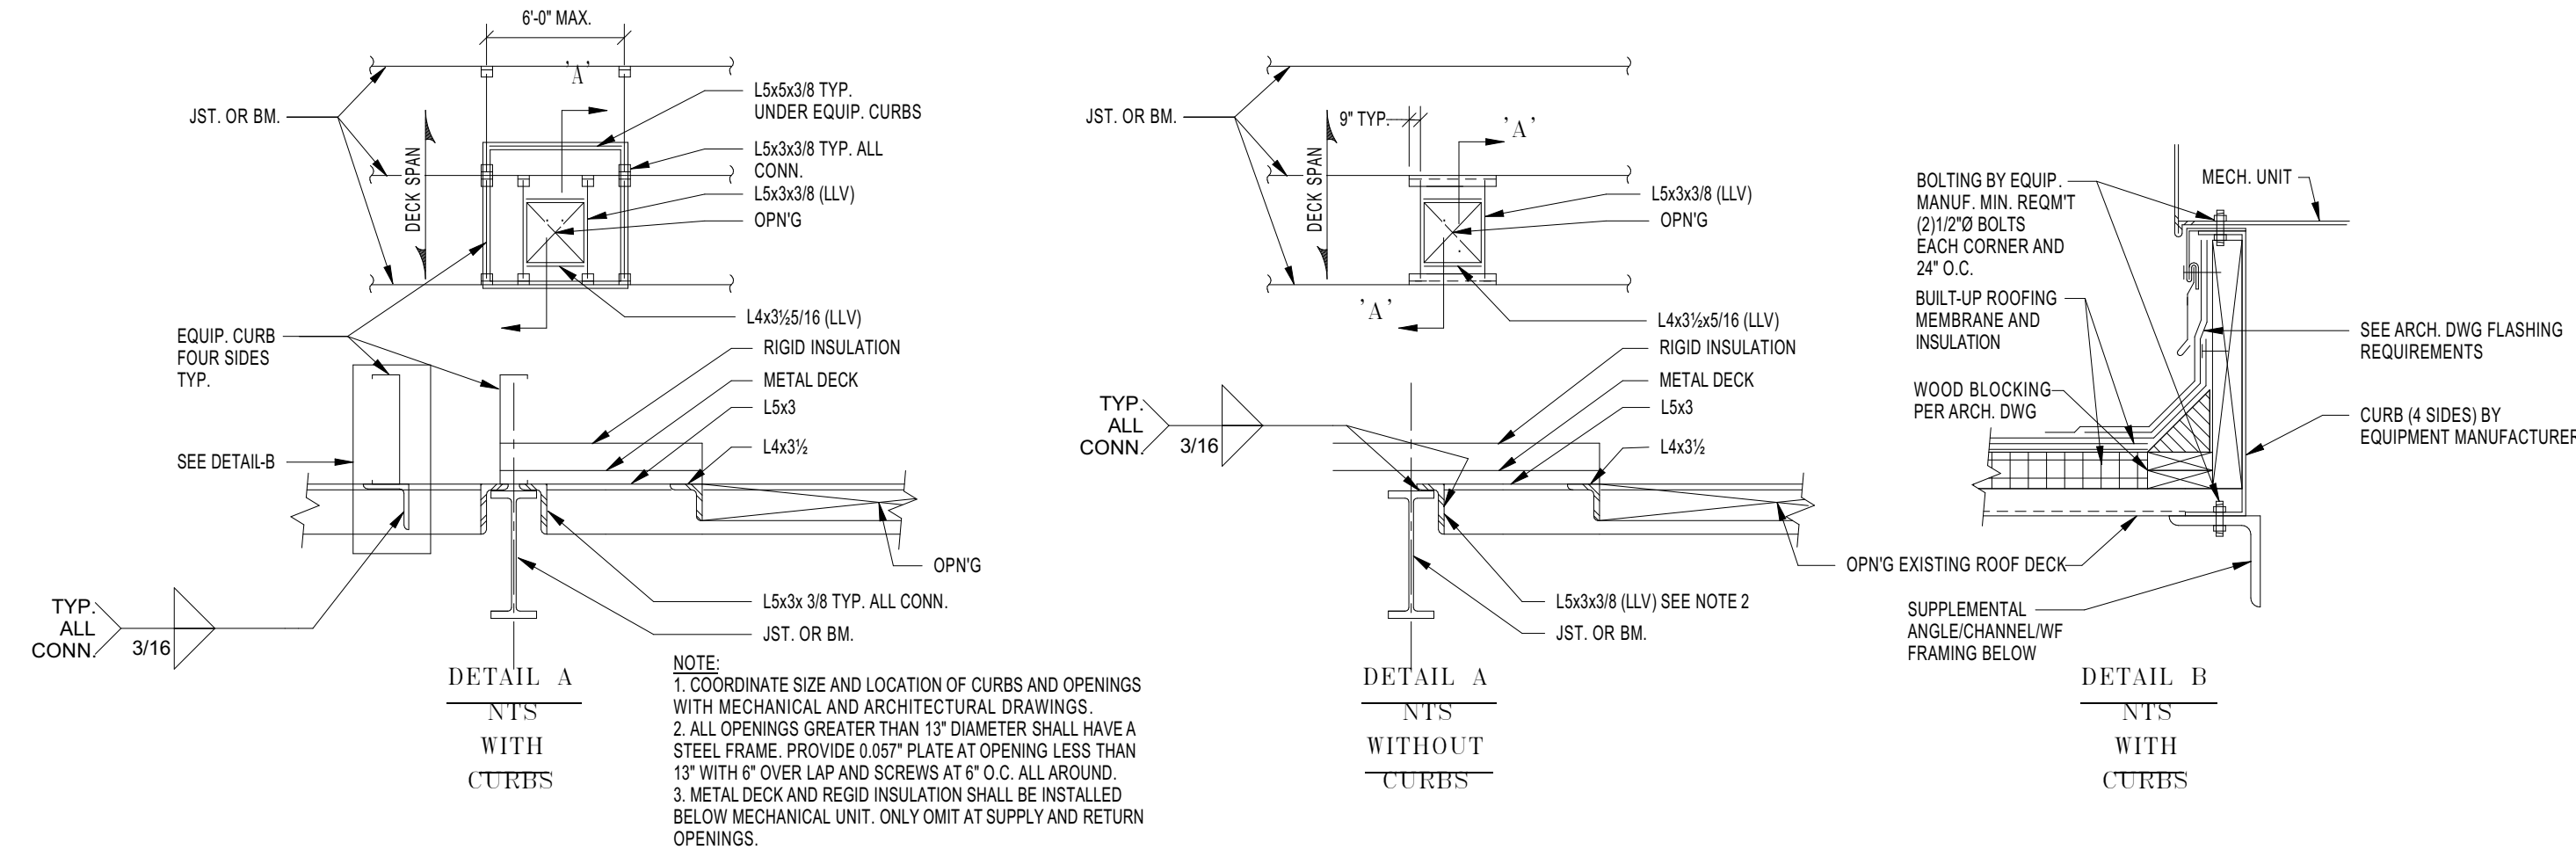


208 OPENING AT MECH 1" = 1'-0"

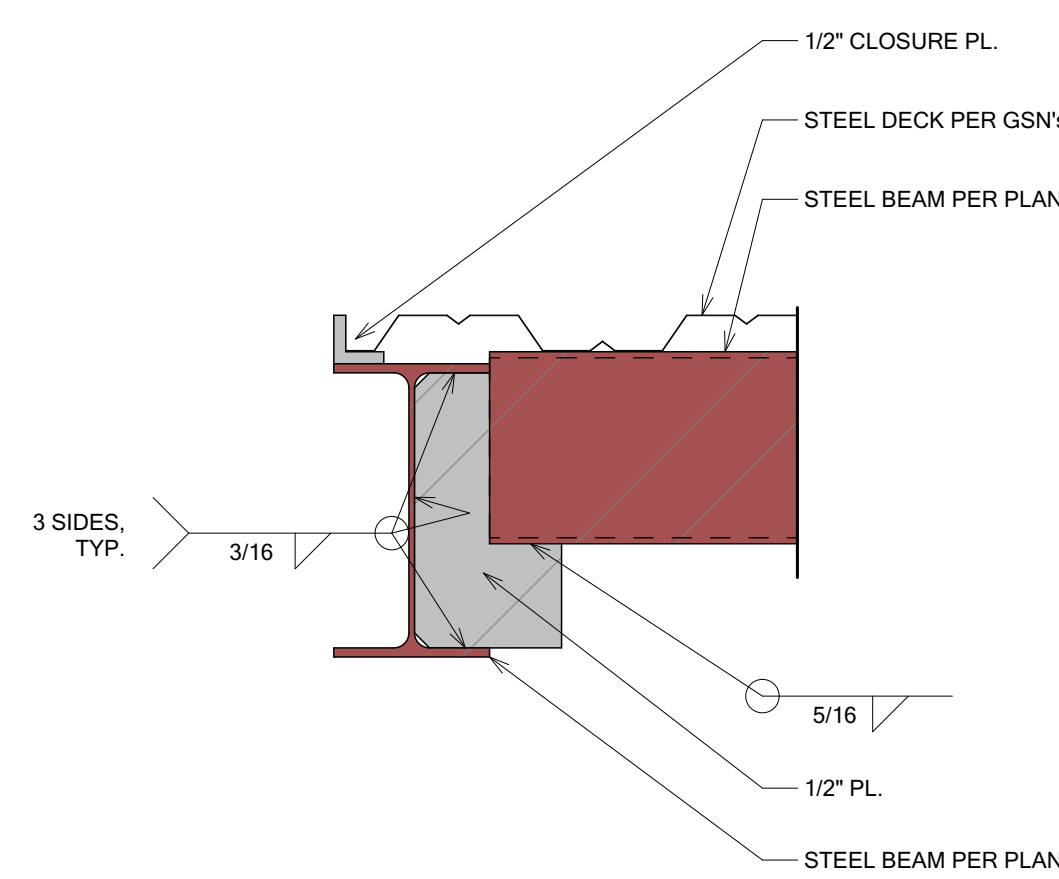


211 CANOPY BEAMS 1 1/2" = 1'-0"

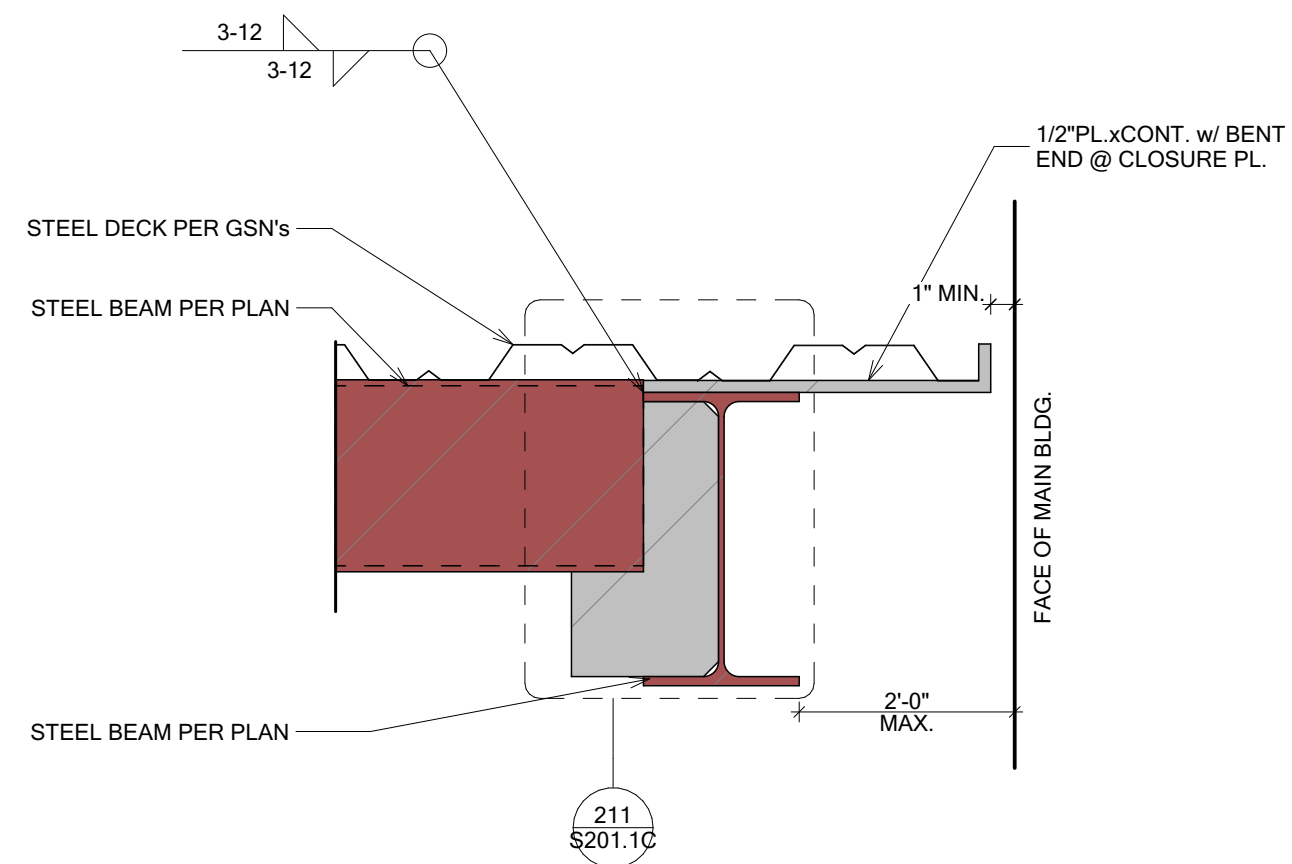


212 CANOPY PLATE @ OVERHANG 1 1/2" = 1'-0"

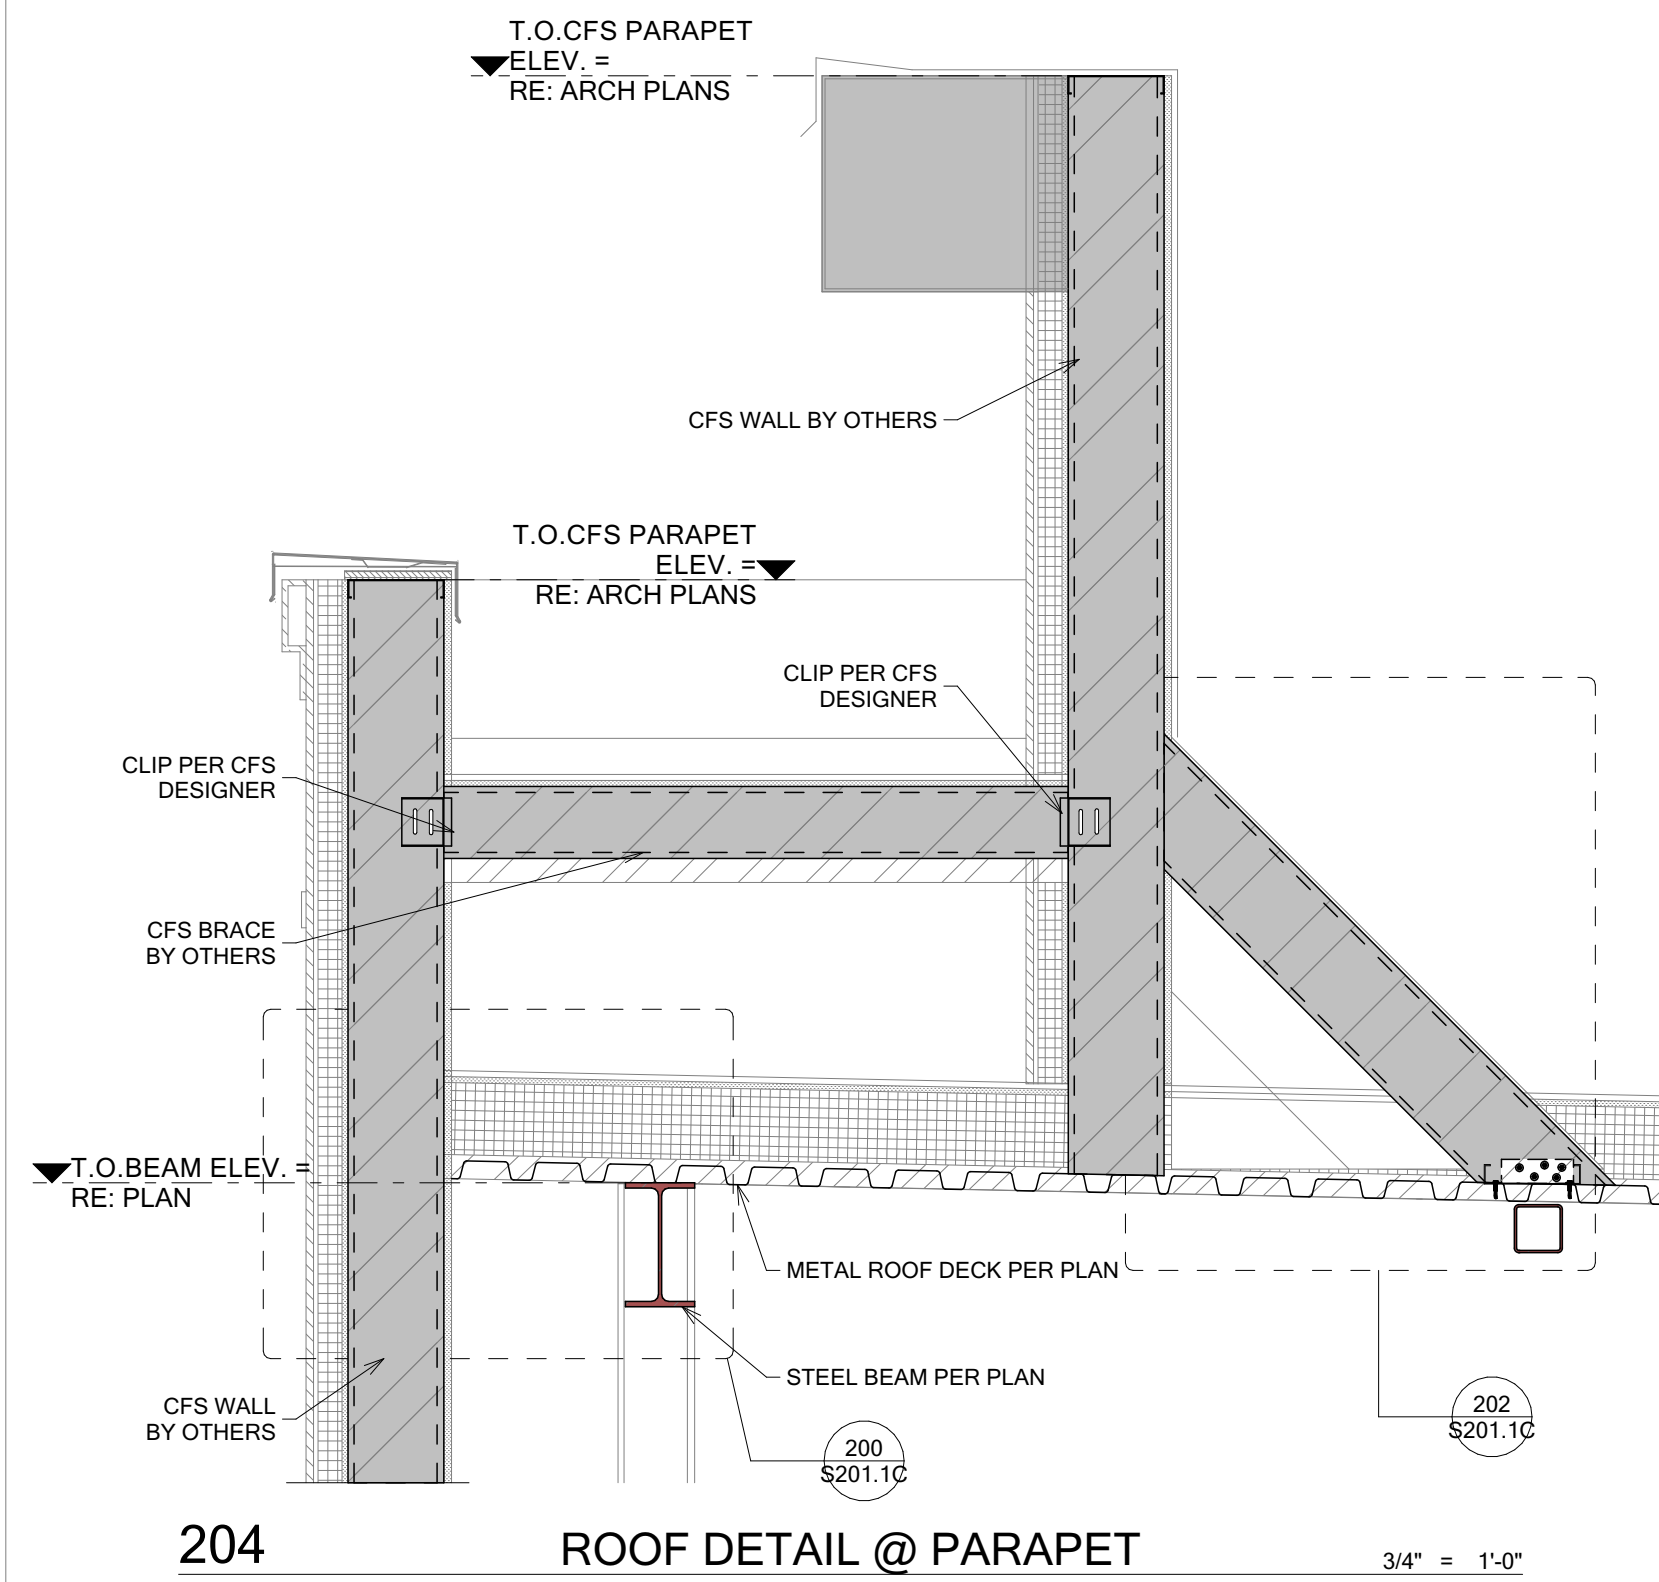


204 ROOF DETAIL @ PARAPET 3/4" = 1'-0"

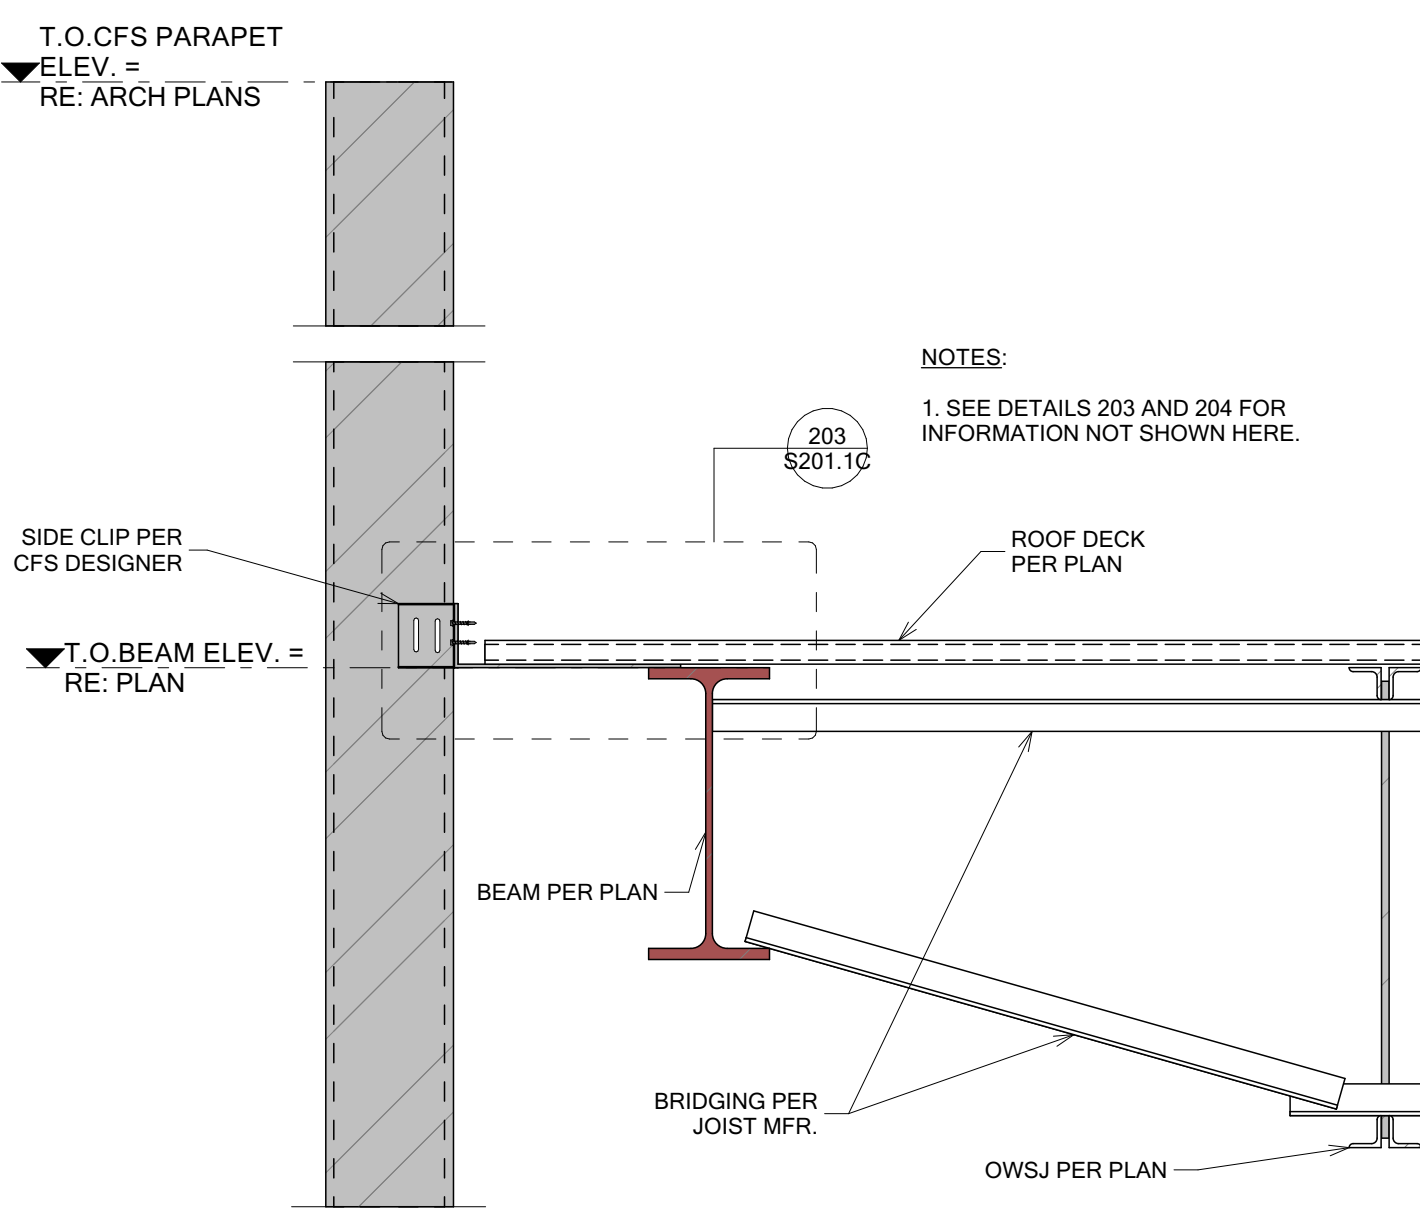


205 JOIST BRIDGING @ END BAY 1" = 1'-0"

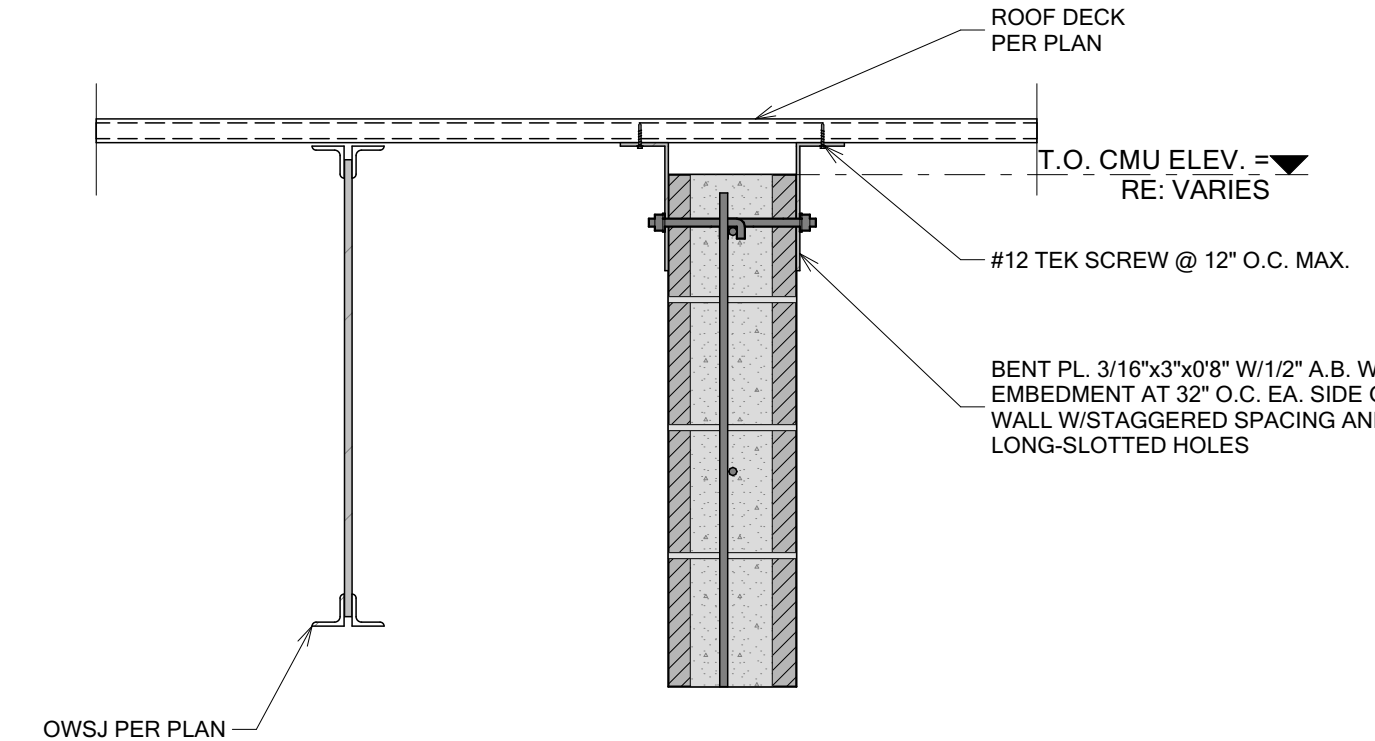


206 CMU SHEAR WALL TRANSFER 1" = 1'-0"

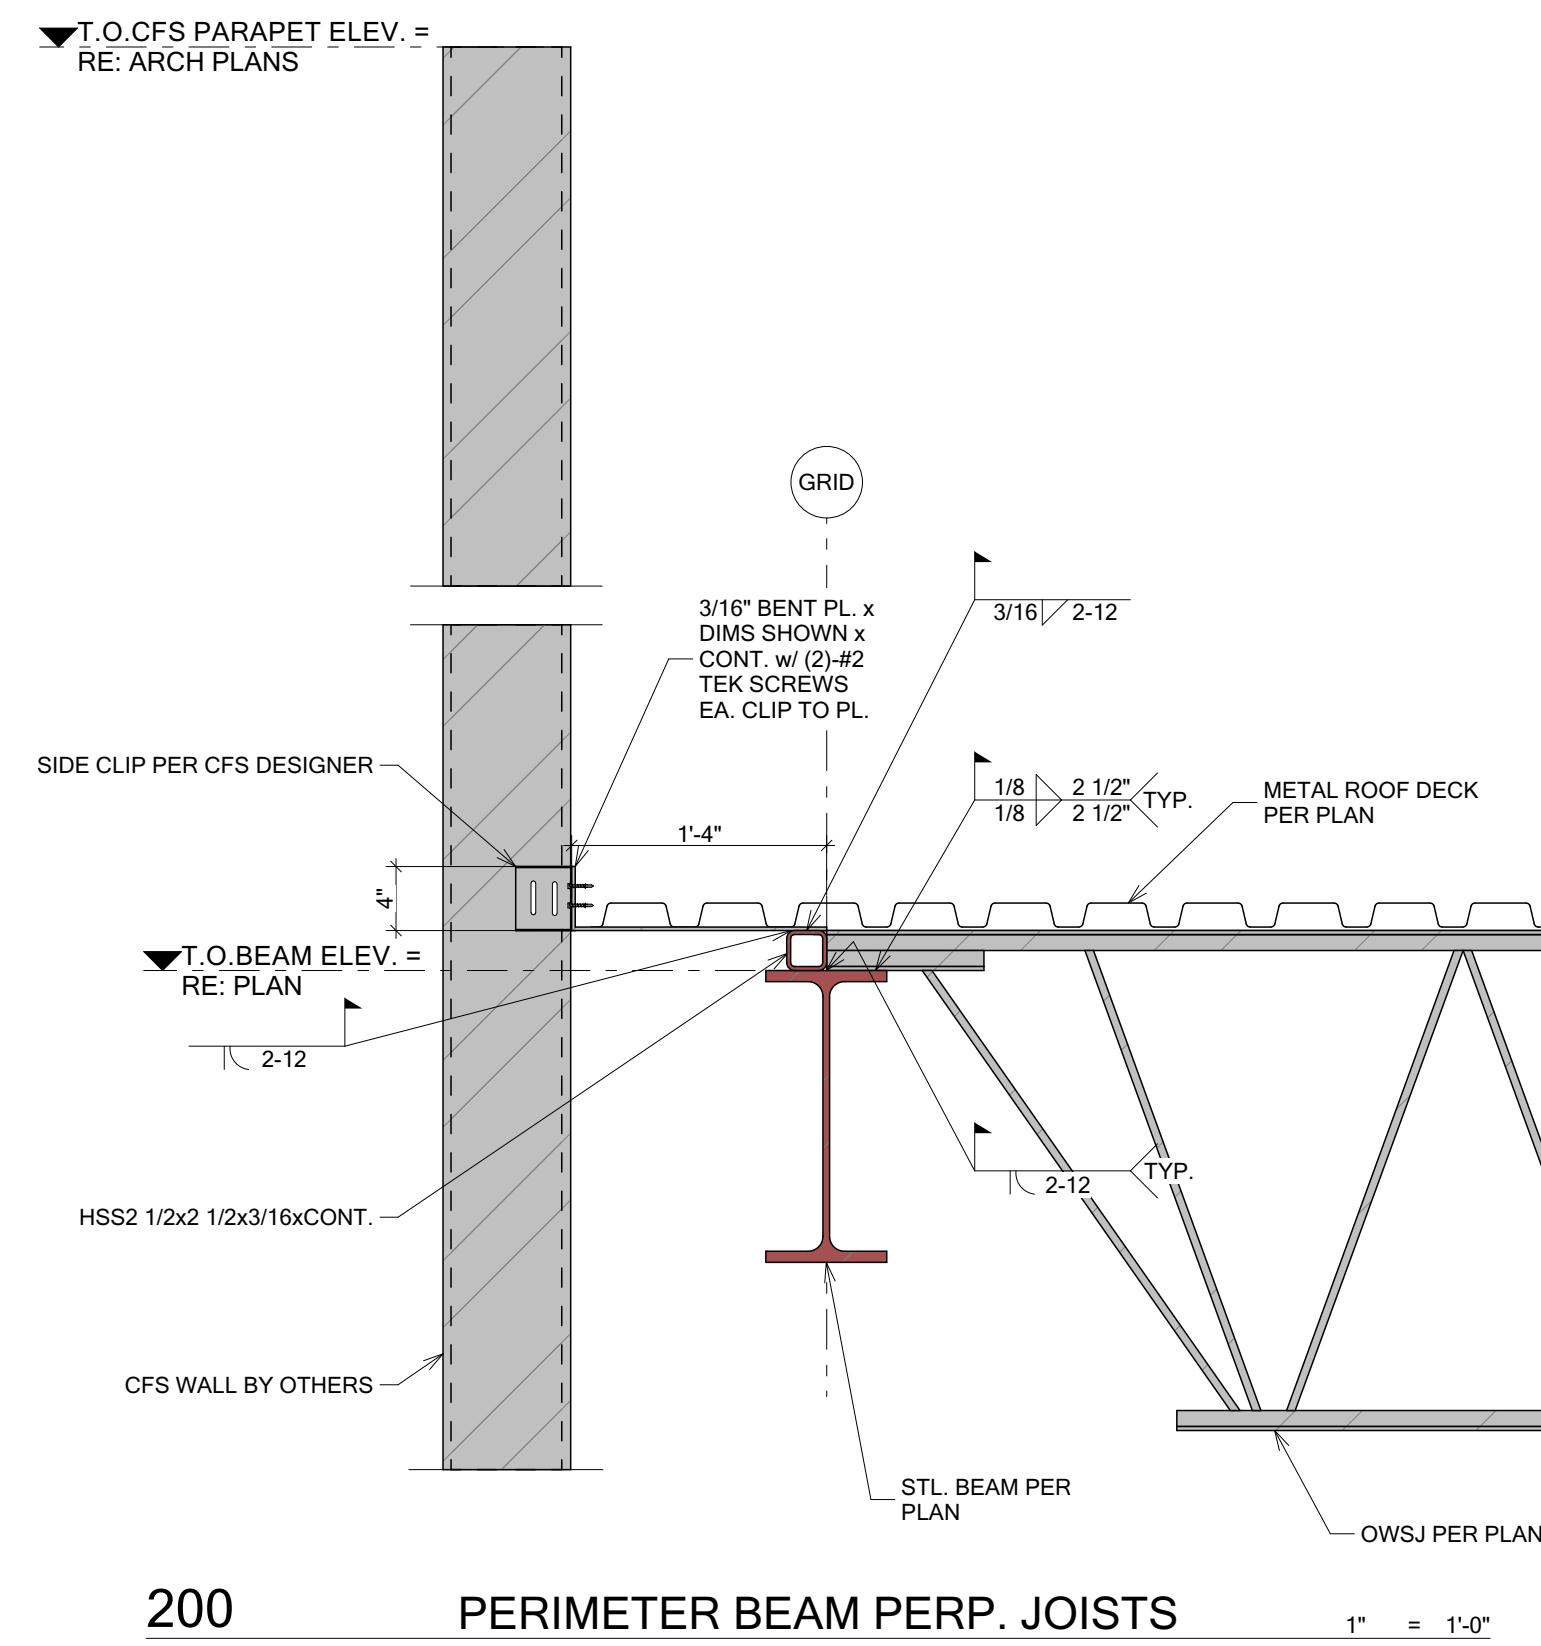


200 PERIMETER BEAM PERP. JOISTS 1" = 1'-0"

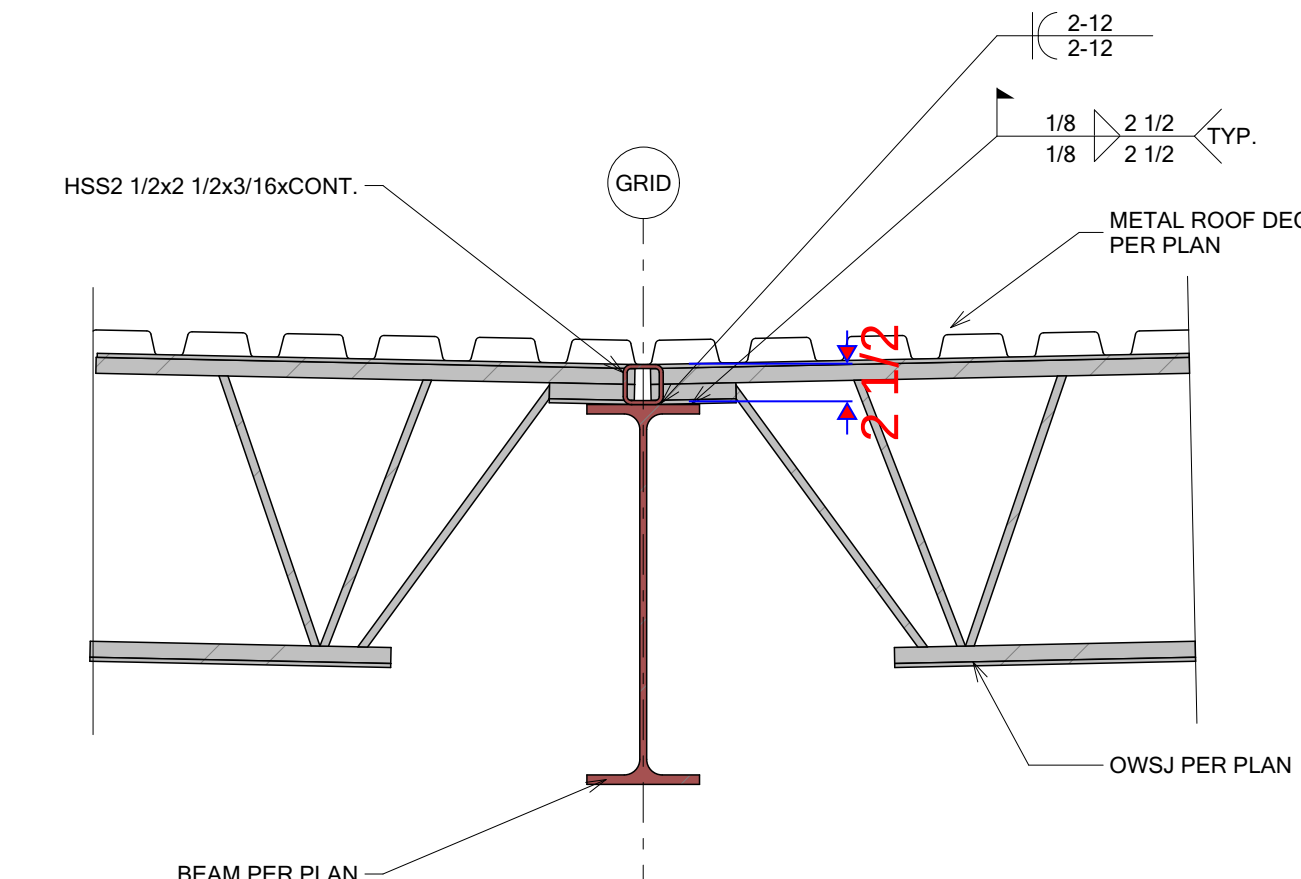

201 STEEL JOIST TO W-FLANGE BEAM 1" = 1'-0"

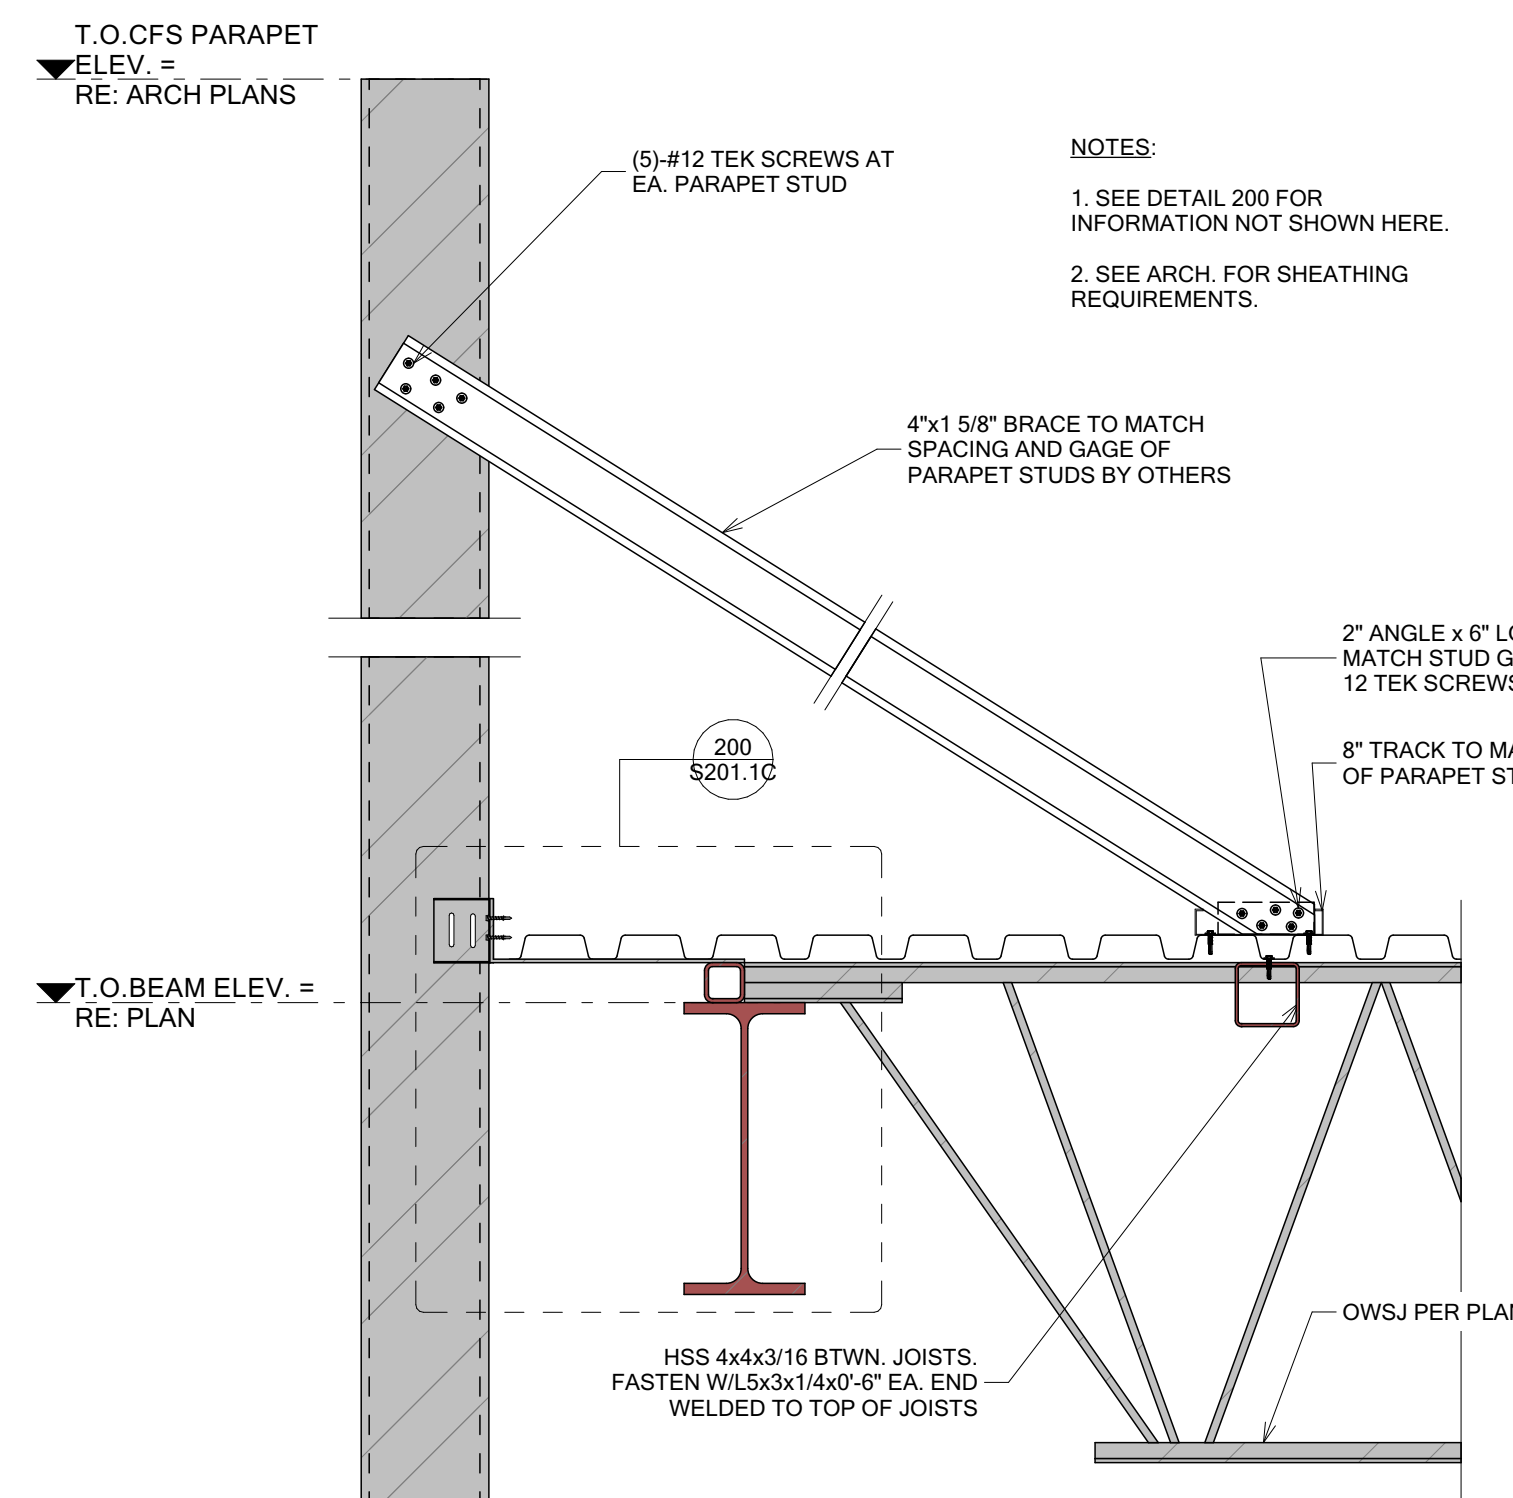

202 PARAPET SUPPORT CONNECTION 1" = 1'-0"

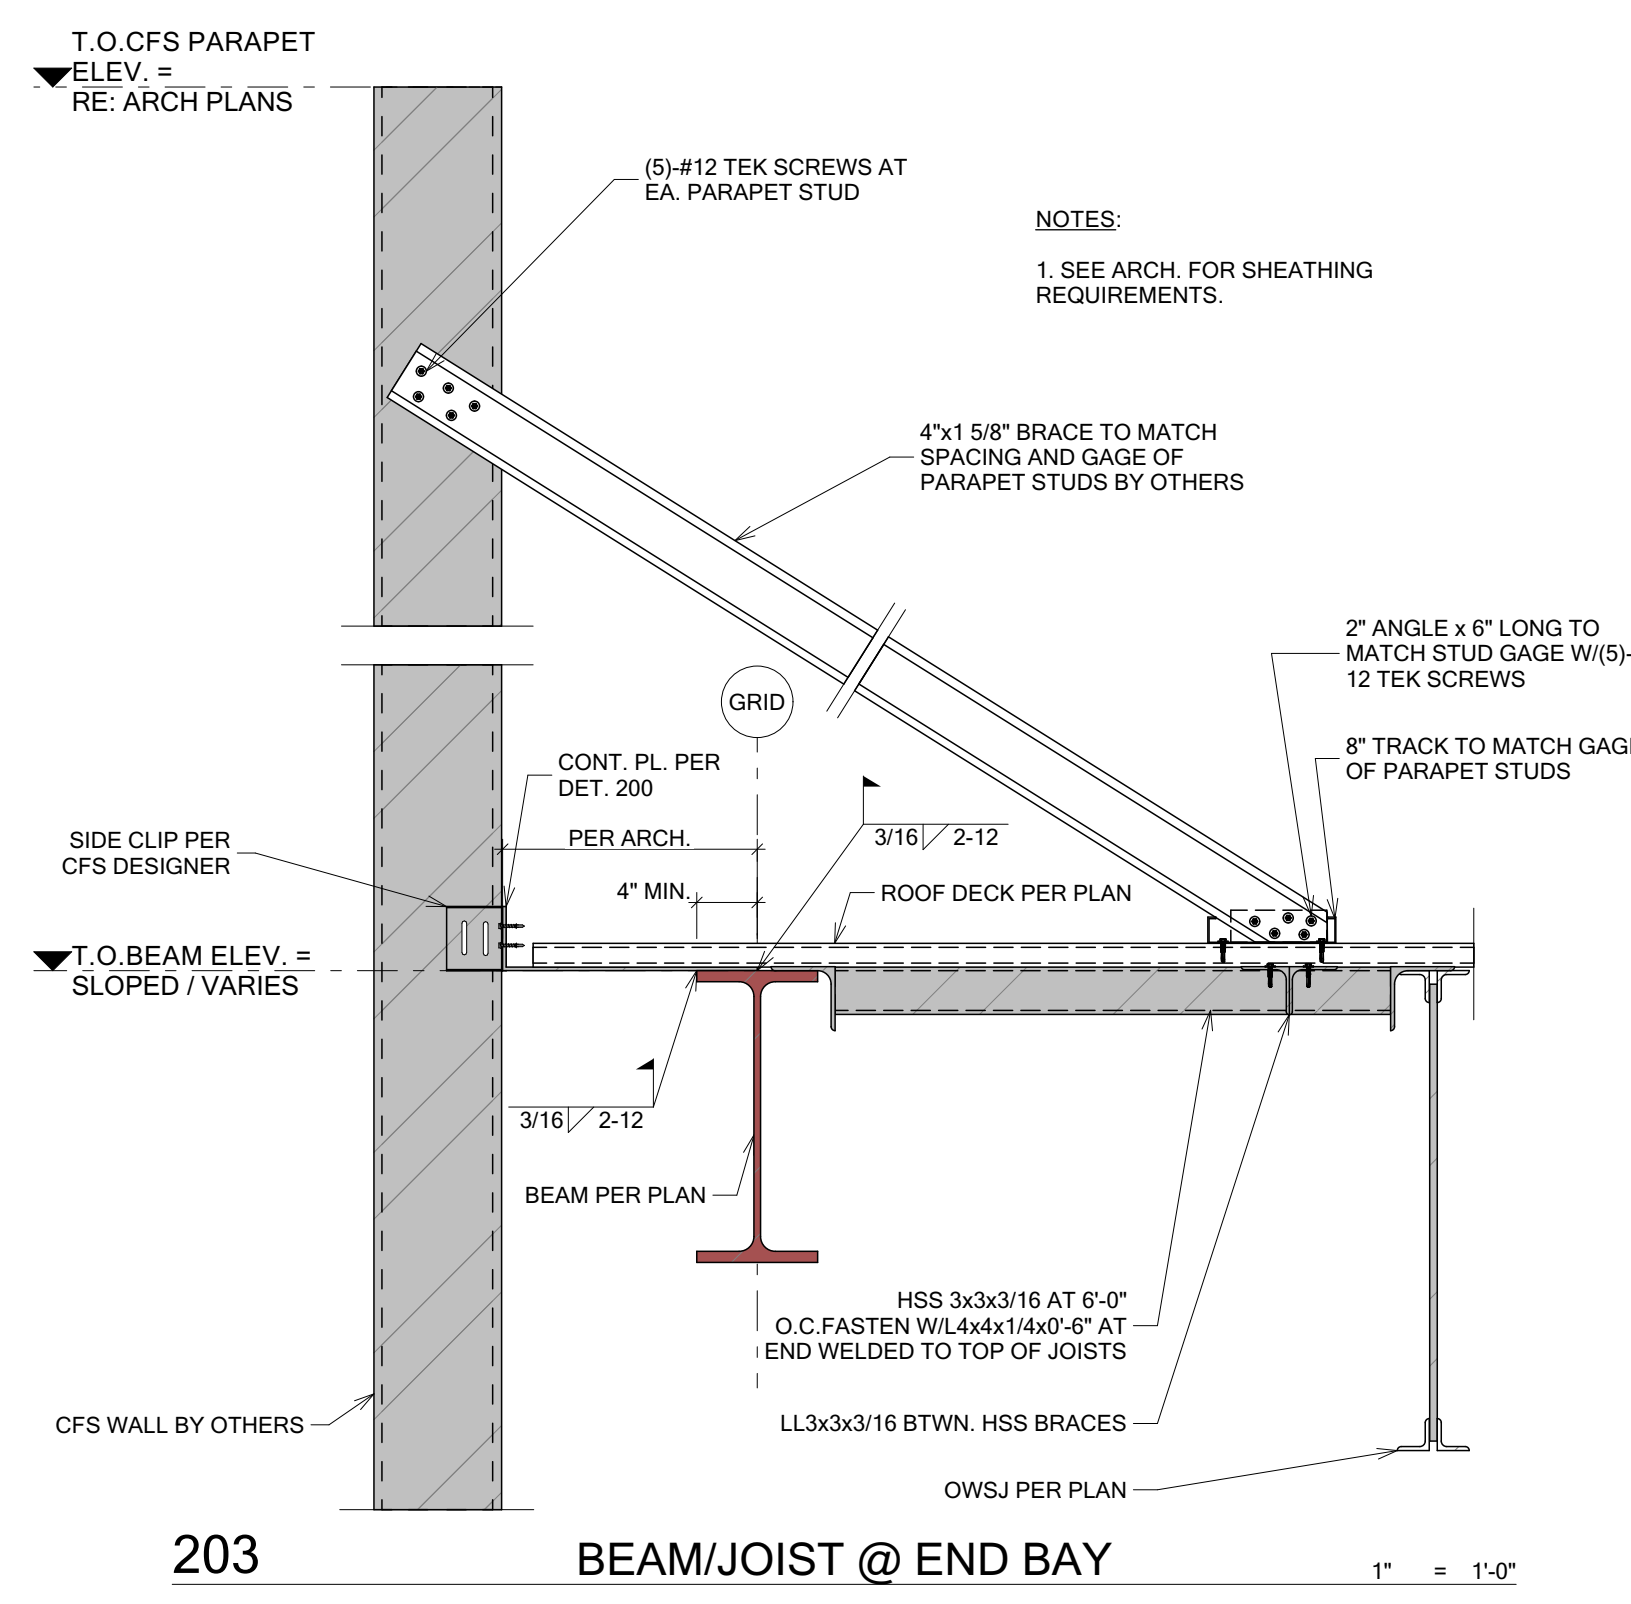


203 BEAM/JOIST @ END BAY 1" = 1'-0"



thriven
design

756 Haddon Avenue
Collingswood, NJ 08108
P: 856.854.1880
thriven.design

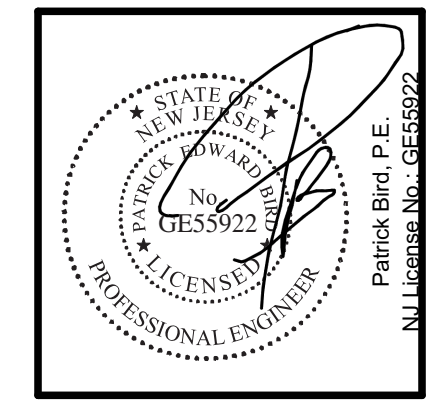

Date:		10-25-2024	
Job #:		2020005	
Drawn:			
Mngr:			
Rev. No.	Name	Date	
△ 01	REV 1	03.21.2025	
20005-1515-BldgC			



The District at
1515 Urban
Renewal, LLC

THE DISTRICT AT 15FIFTEEN - BUILDING C
1525 ROUTE 10
PARSIPPANY - TROY HILLS,, MORRIS COUNTY NEW JERSEY 07054
BLOCK 200, LOT 1.06

S201.1C

STEEL FRAMING
DETAILS

RCVD by DS 3/24/2025