
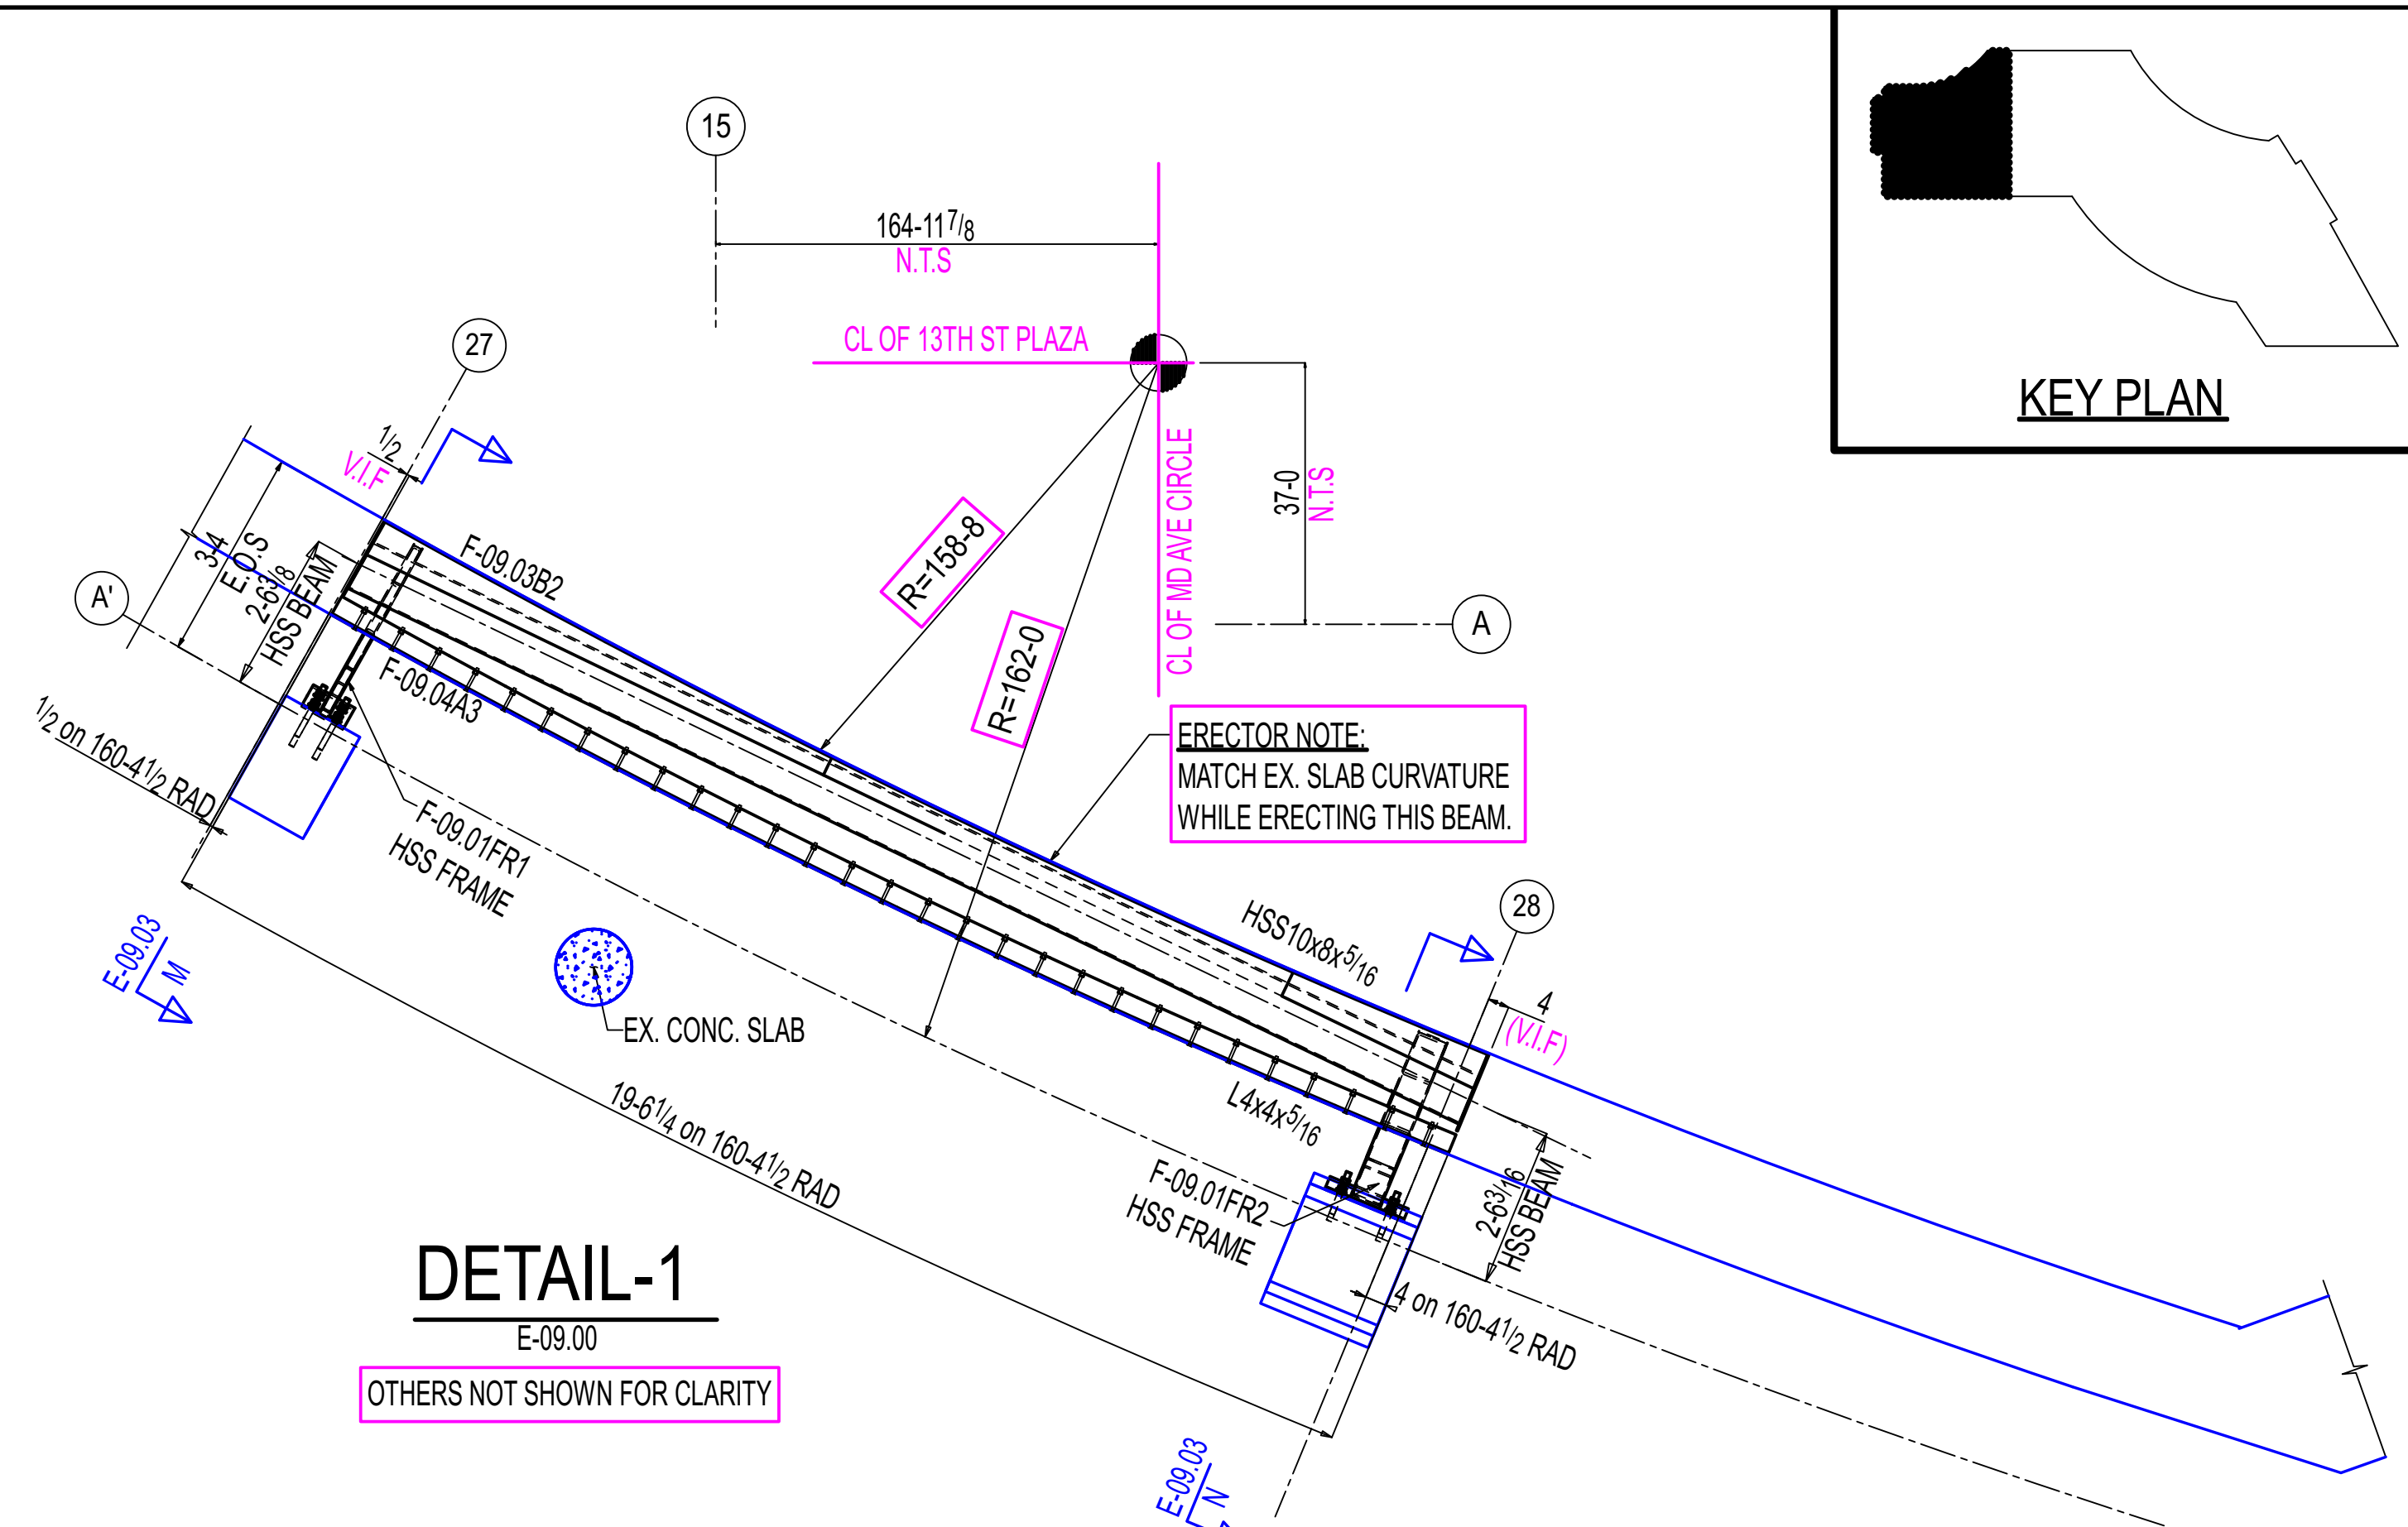



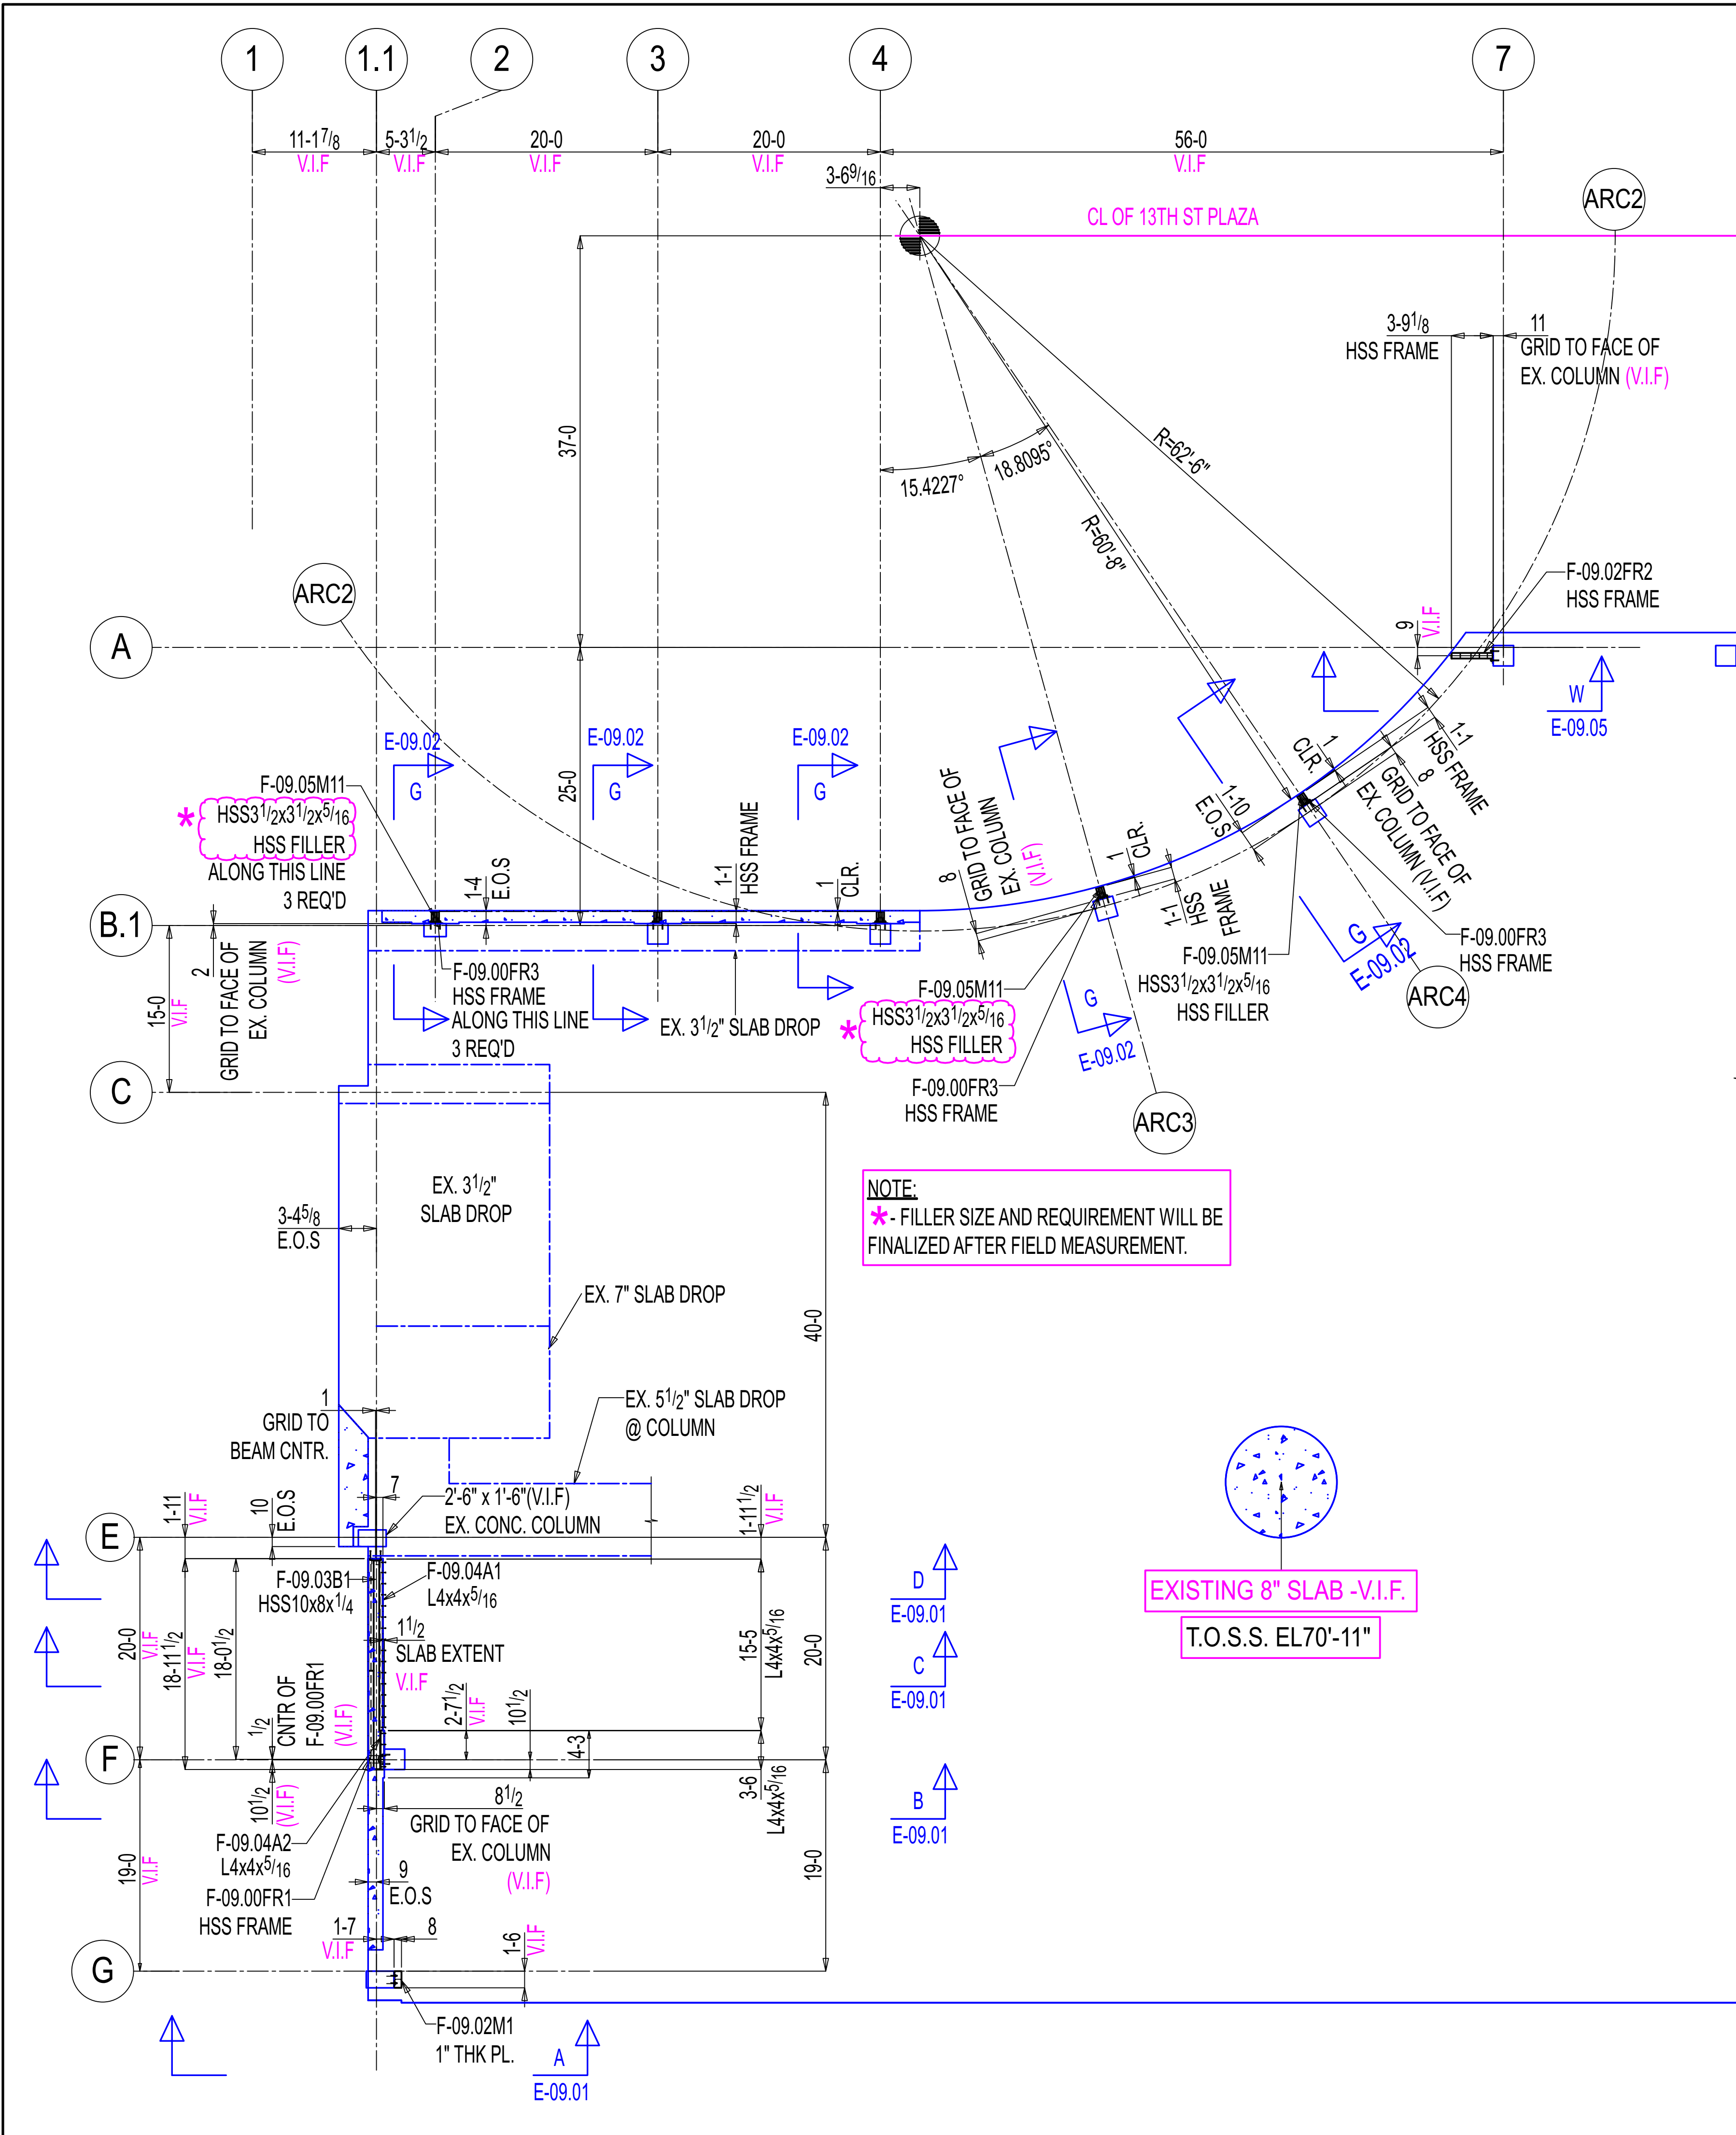


NEW SLAB EXTENSION SUPPORT FRAMING PLAN LEVEL-03

(REF: S108,1/A054)

NOTE:

1. ALL SLAB EXTENSION SUPPORT HSS FRAMES ARE FOR THE CENTER OF THE EXISTING CONCRETE COLUMN (U.N.O).
2. ALL SLAB EXTENSION SUPPORT FRAME SIZE IS HSS6x6x 5/16 (U.N.O).

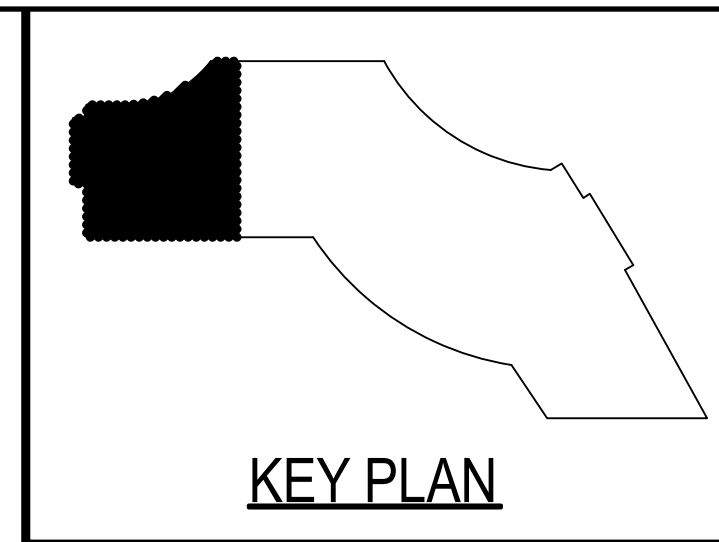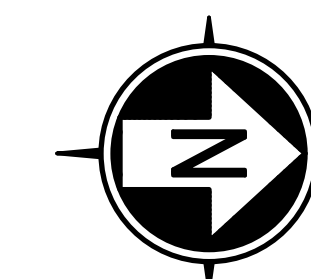

General Notes

- *Structural steel shall conform to ASTM-A992.
- *Structural SQR/RND,tubing conform to ASTM A500 Grade C
- *Pipe shall conform to ASTM A53, Grade B.
- *Channels, Angles and plates shall conform to A36.
- *All bolts shall be 3/4" High strength in accordance with ASTM A325 (UNO)
- *Welding Electrodes for Carbon steel :E70xx

# of Copies	Revision/ Issue	Destination	Date
5	0	For Construction	11-14-2025
4	D	For Re-Approval	10-24-2025
3	C	For Re-Approval	09-19-2025
2	B	For Re-Approval	06-23-2025
1	A	For Approval	02-25-2025

IRON FABRICATION SERVICES, LLC.

3029 M. Street, NW, Suite 202
Washington, DC 20007
Tel: 202-800-5599
Fax: 202-478-0303

Project Name and Address
MARYLAND AVENUE

Location: **1250 MARYLAND AVENUE SW
WASHINGTON, DC 20024**

Contractor:

BALFOUR BEATTY

Approved for Fabrication by:

Signature

Contract # **224009**

Drawing # **E-09.00**



Contract Item: **LEVEL-03
SLAB EXTENSION**

Ref:

SOW-09: (S108,1/A054)

Date
01/20/2025
Scale
VARIES

Drawing Title:
**SOW #09 LEVEL-03 NEW
SLAB EXTENSION SUPPORT
FRAMING PLAN**

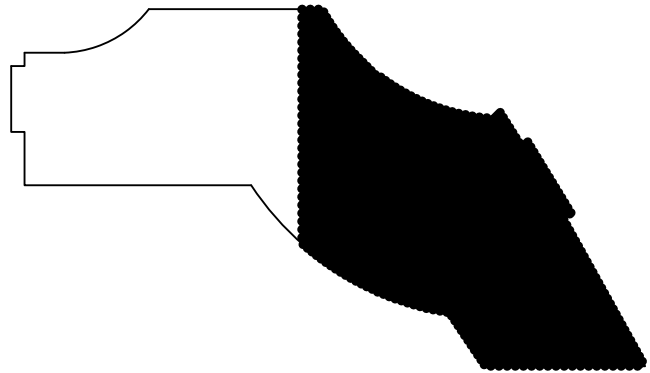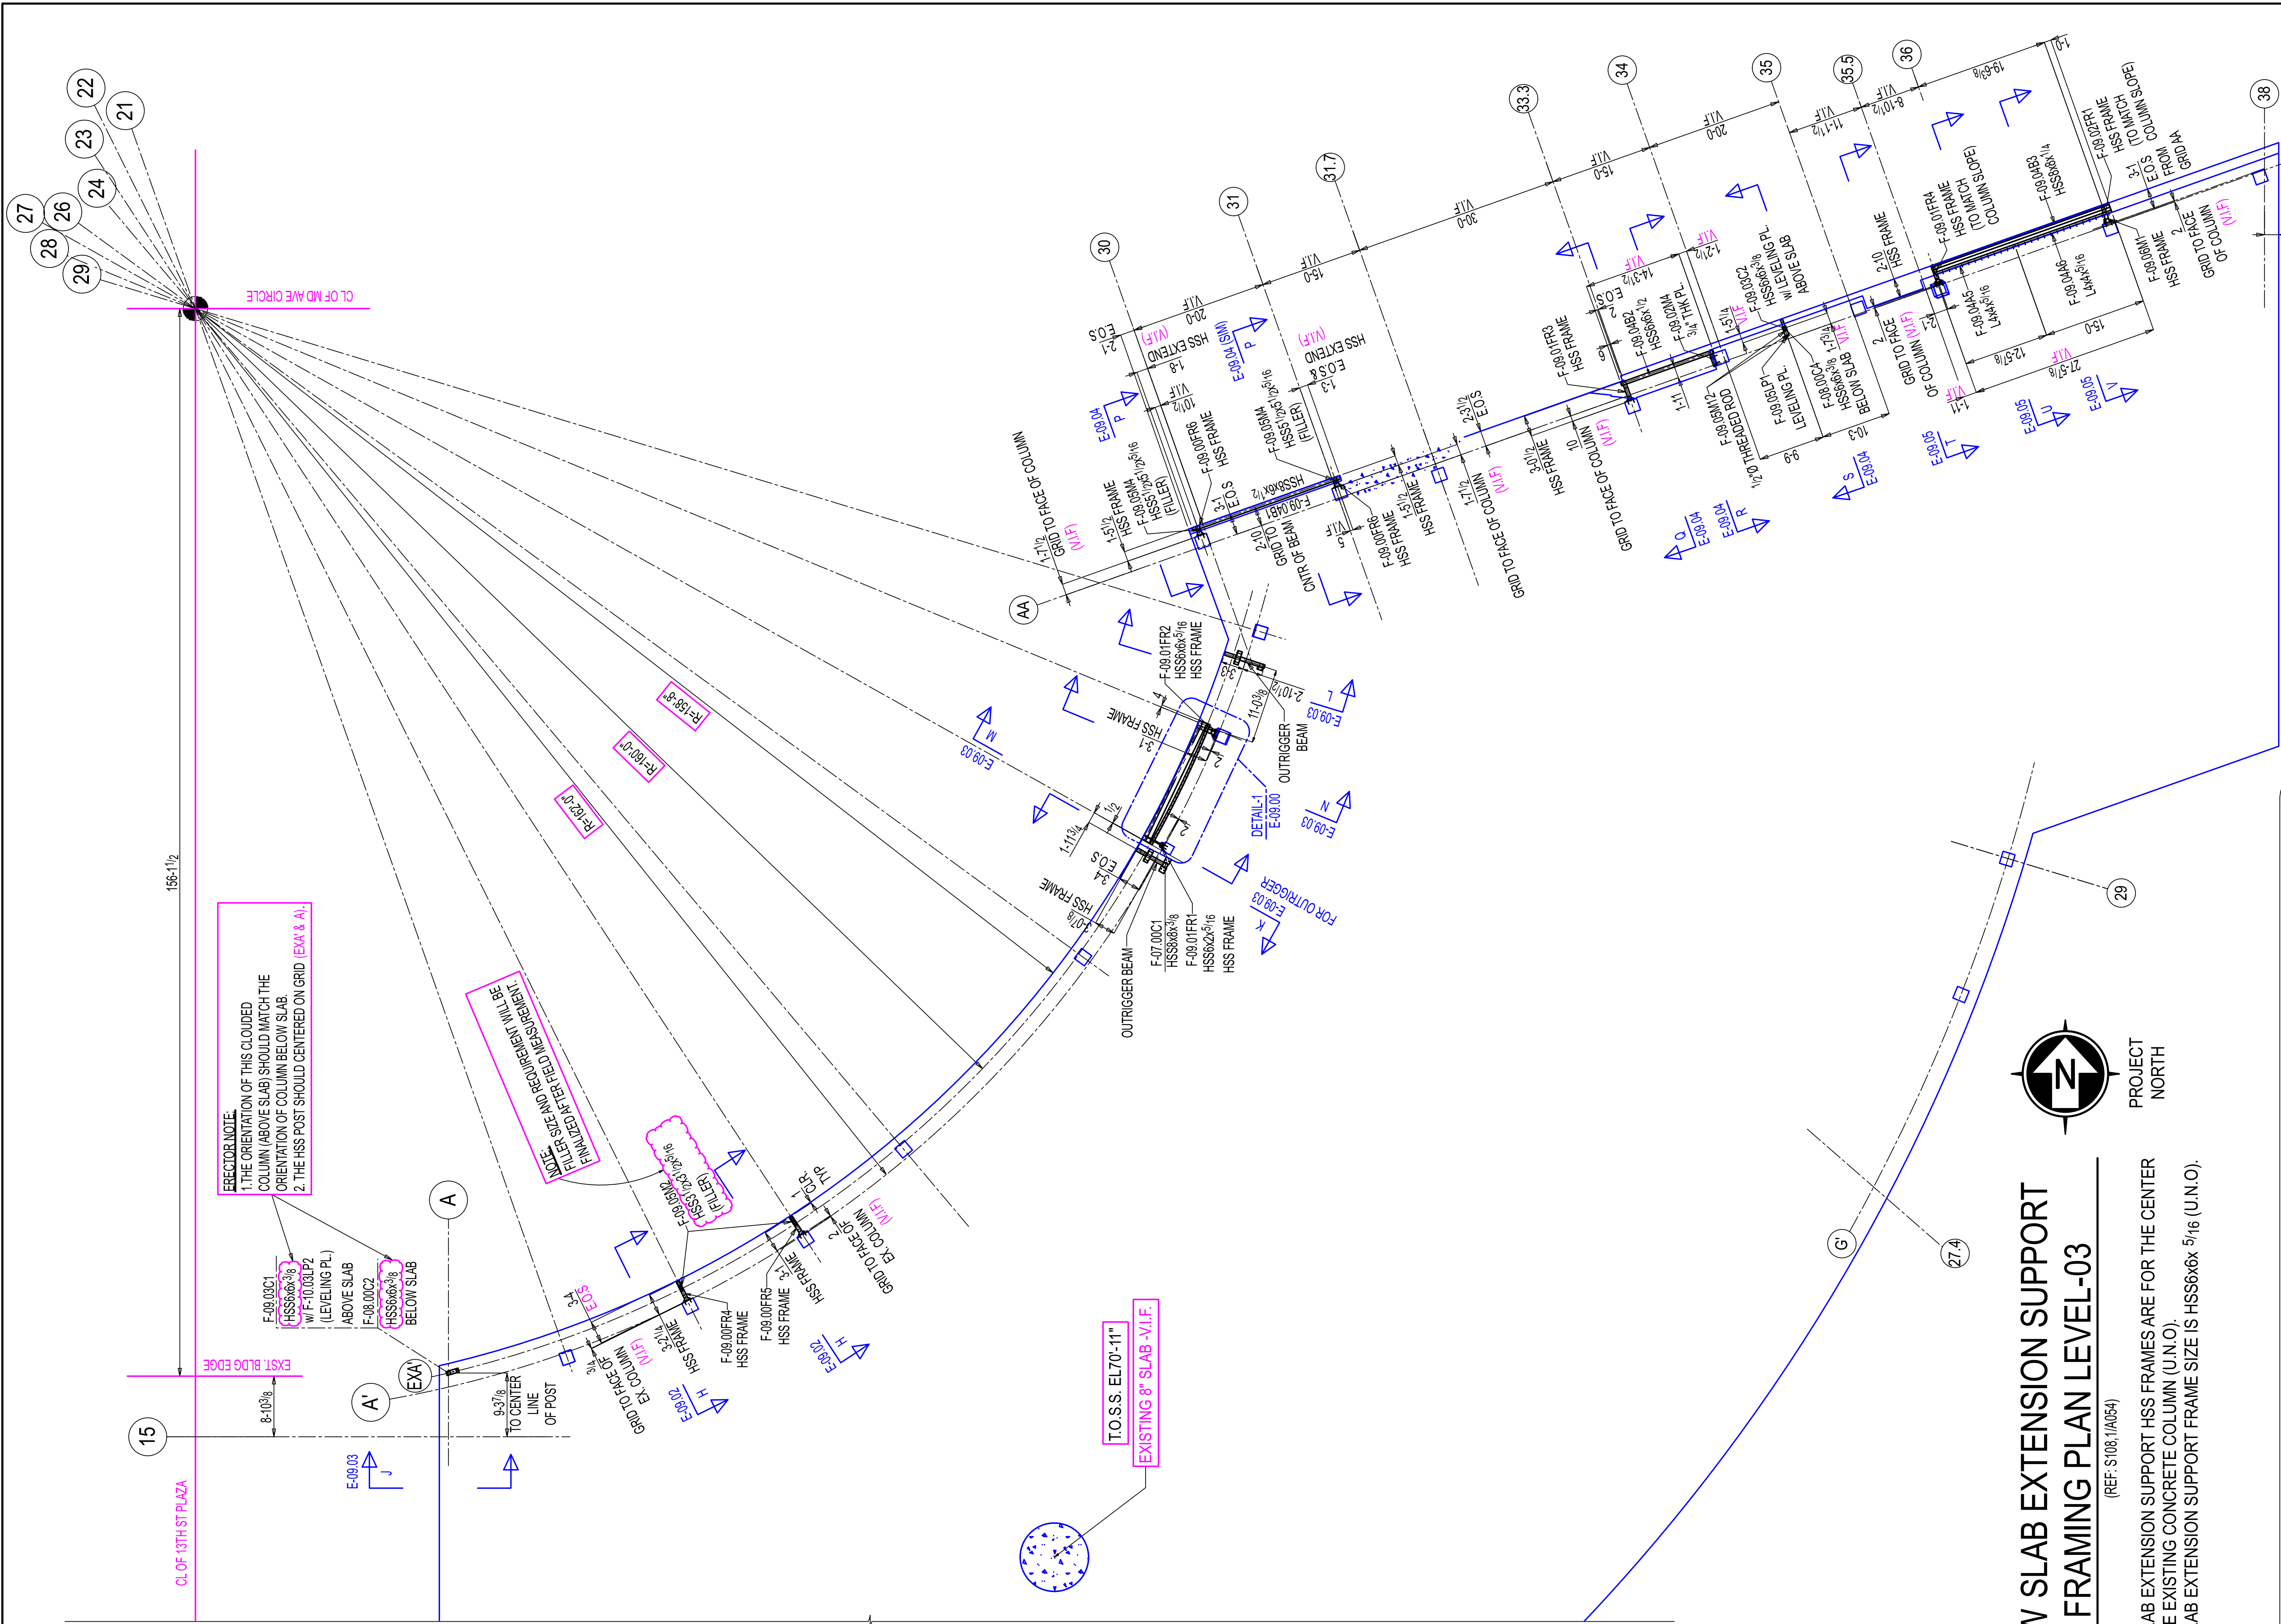

KEY PLAN

General Notes

- *Structural steel shall conform to ASTM-A992.
- *Structural SQR/RND,tubing conform to ASTM A500 Grade C
- *Pipe shall conform to ASTM A53, Grade B.
- *Channels, Angles and plates shall conform to A36.
- *All bolts shall be 3/4" High strength in accordance with ASTM A325 (UNO)
- *Welding Electrodes for Carbon steel :E70xx

# of Copies	Revision/ Issue	Destination	Date
3	0	For Construction	11-14-2025
2	B	For Re-Approval	10-24-2025
1	A	For Approval	09-19-2025

IRON FABRICATION SERVICES, LLC.

3029 M. Street, NW, Suite 202
Washington, DC 20007
Tel: 202-800-5599
Fax: 202-478-0303

Project Name and Address
MARYLAND AVENUE

Location: **1250 MARYLAND AVENUE SW
WASHINGTON, DC 20024**

Contractor:

BALFOUR BEATTY

Approved for Fabrication by:

Signature

Contract # **224009**

Drawing # **E-09.00A**

Contract Item: **LEVEL-03
SLAB EXTENSION**

Ref:

SOW-09: (S108,1/A054)

Date
01/ 20/ 2025
Scale
VARIES


Drawing Title:
**SOW #09 LEVEL-03 NEW
SLAB EXTENSION SUPPORT
FRAMING PLAN**

NEW SLAB EXTENSION SUPPORT
FRAMING PLAN LEVEL-03




(REF: S108,1/A054)

NOTE:

1. ALL SLAB EXTENSION SUPPORT HSS FRAMES ARE FOR THE CENTER OF THE EXISTING CONCRETE COLUMN (U.N.O.).
2. ALL SLAB EXTENSION SUPPORT FRAME SIZE IS HSS6x6x 5/16 (U.N.O.).



PROJECT
NORTH

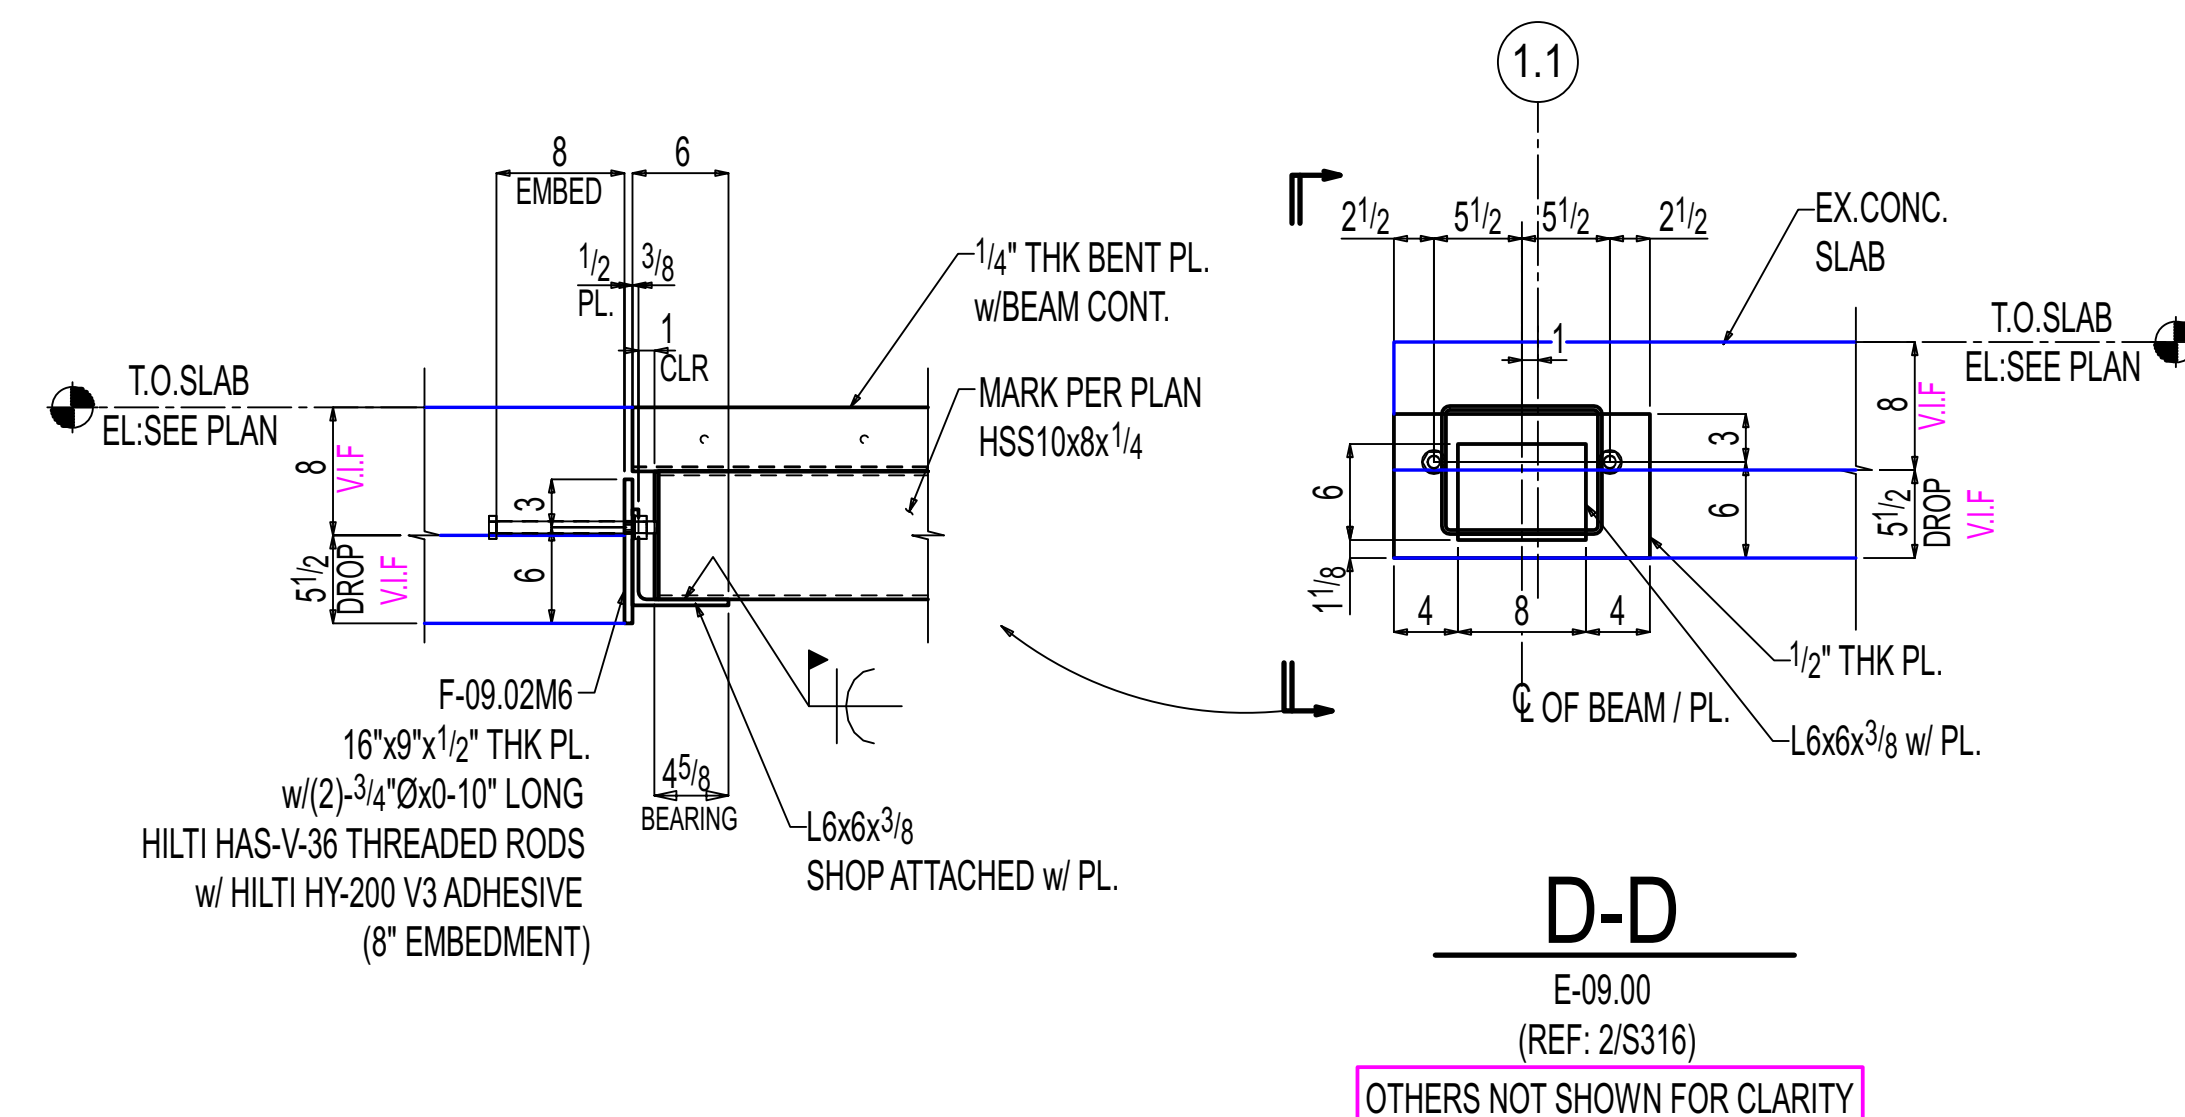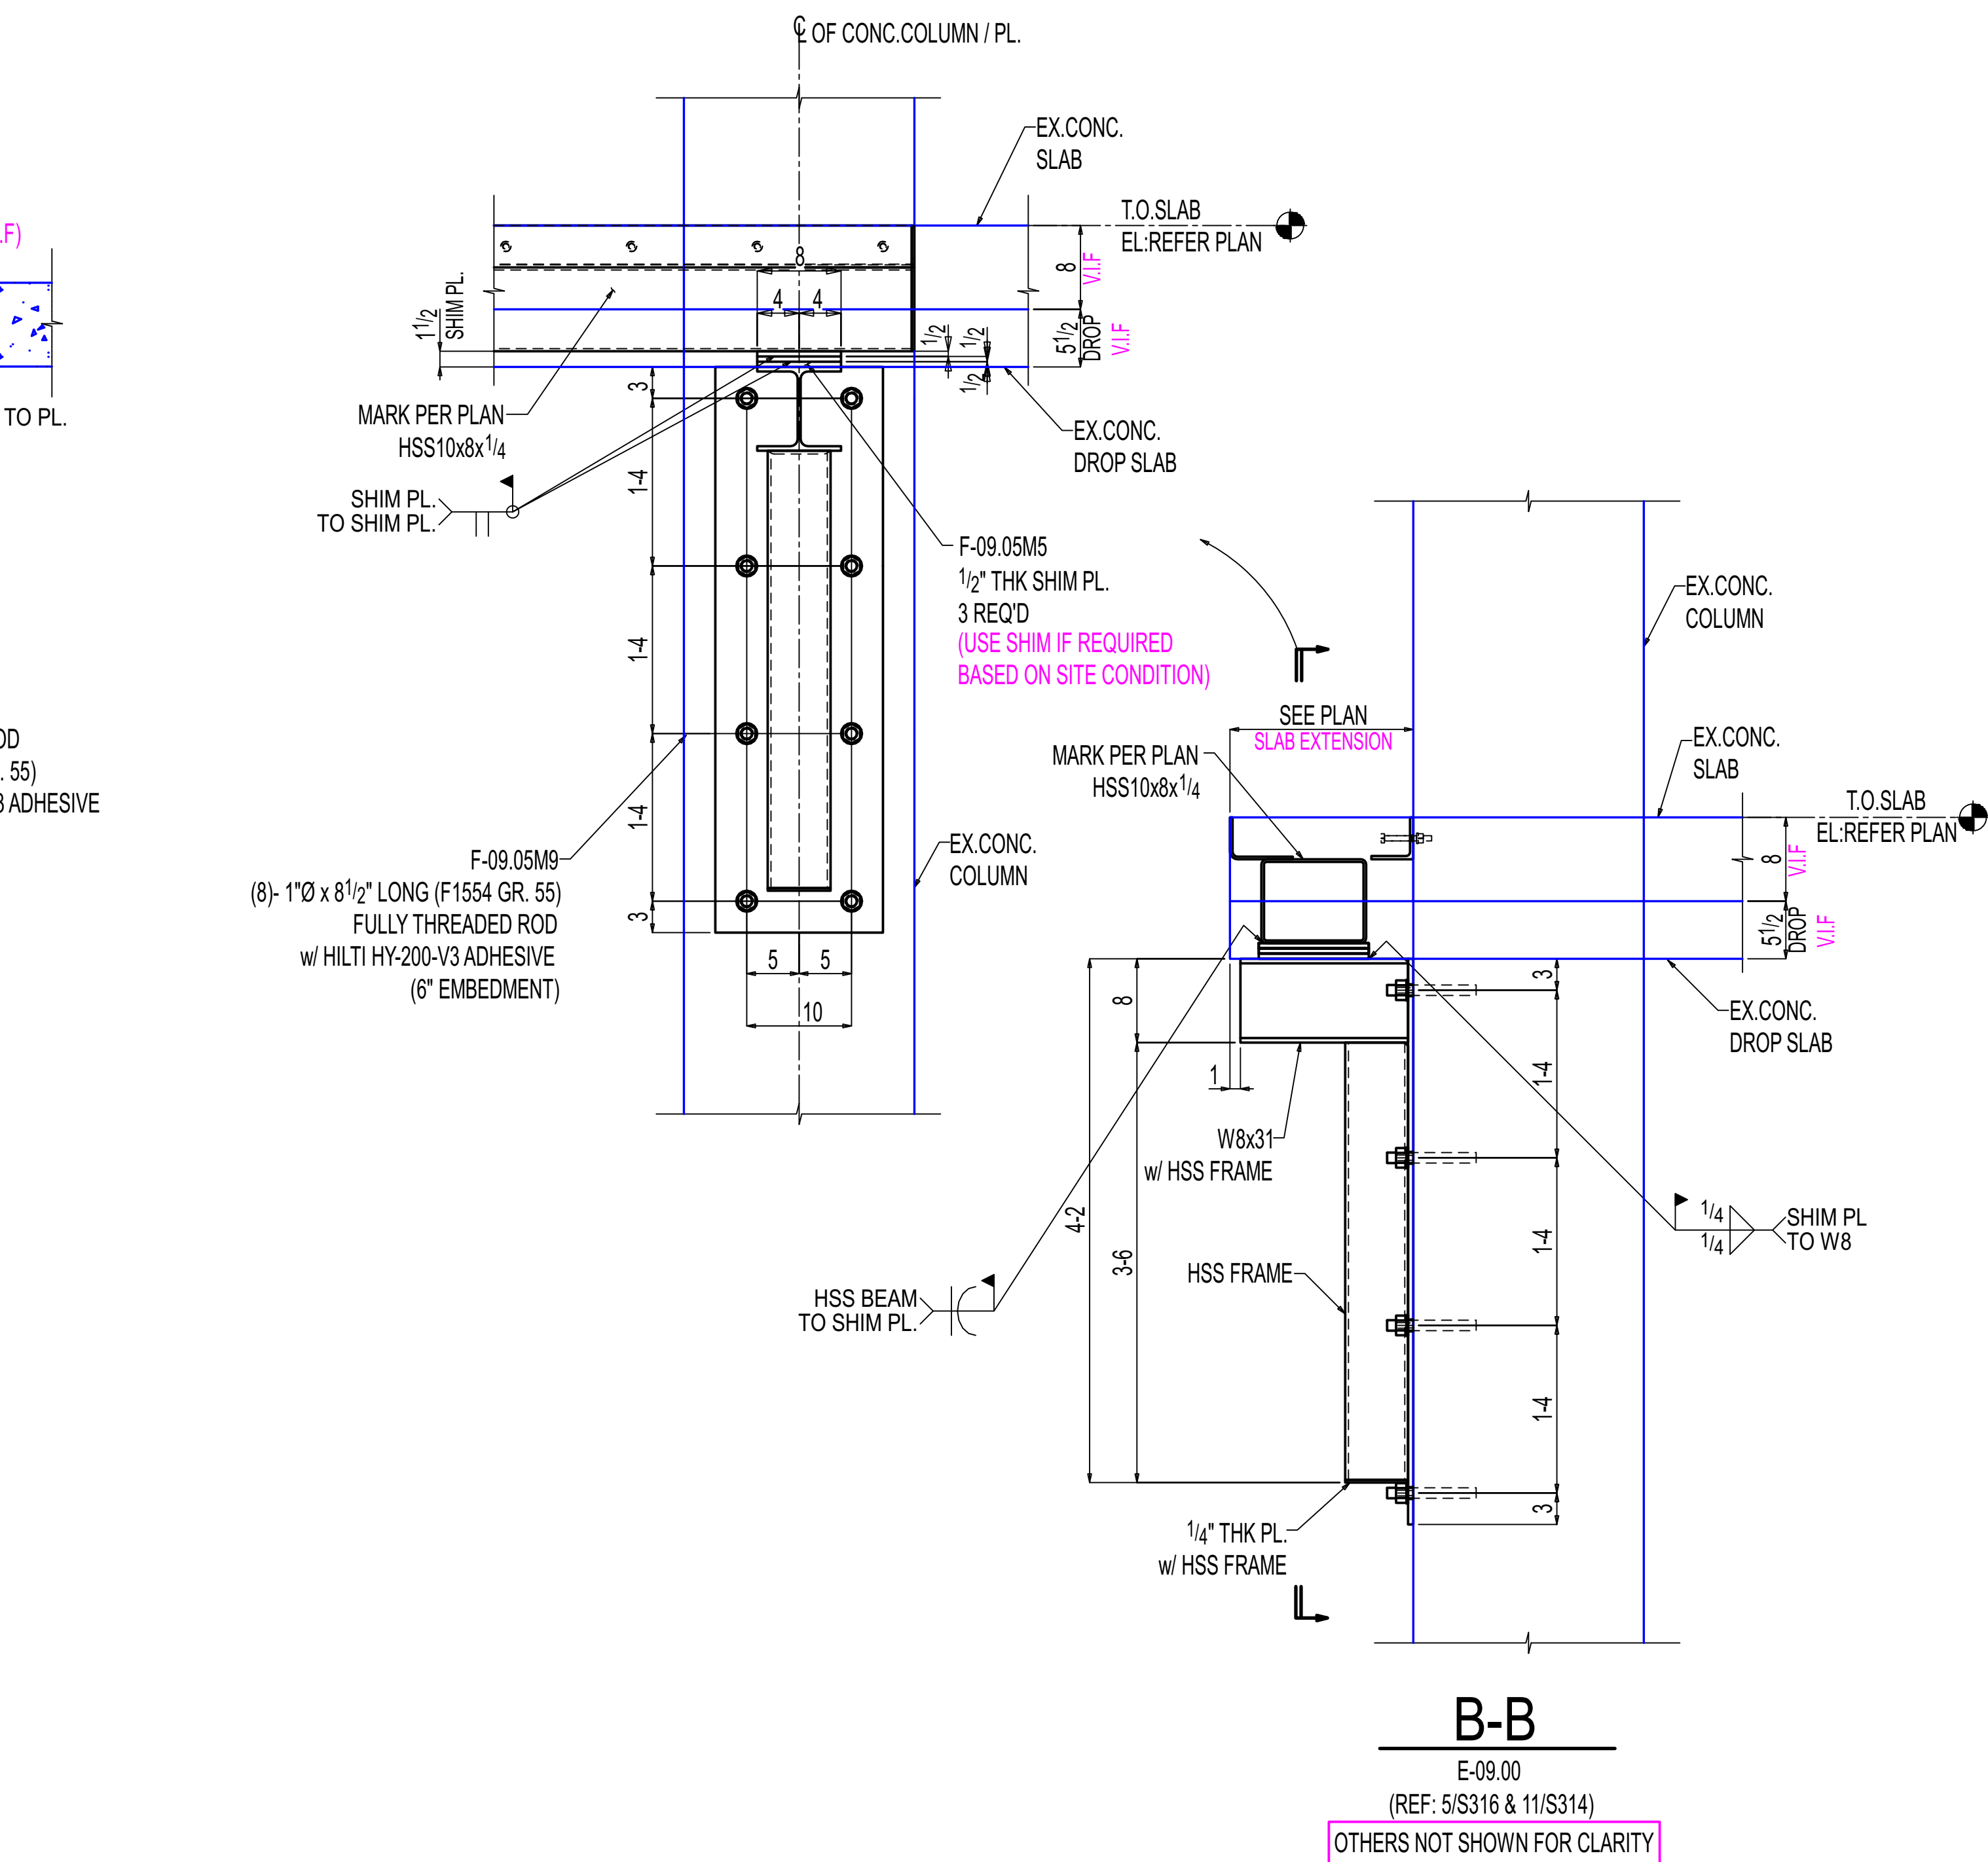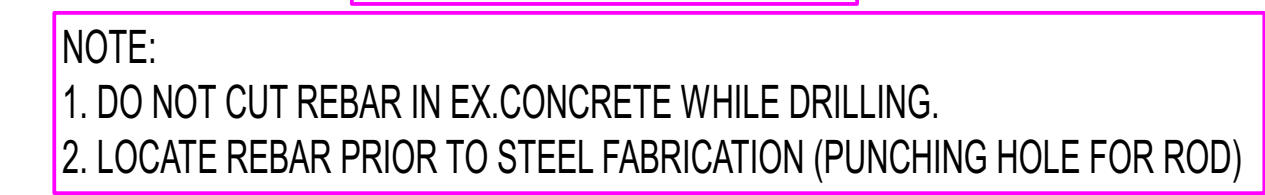

- *Structural steel shall conform to ASTM-A992.
- *Structural SQR/RND tubing conform to ASTM A500 Grade C
- *Pipe shall conform to ASTM A53, Grade B.
- *Channels, Angles and plates shall conform to A36.
- *All bolts shall be 3/4" High strength in accordance with ASTM A325 (UNO)
- *Welding Electrodes for Carbon steel :E70xx

5	0	For Construction	11-14-2025
4	D	For Re-Approval	10-24-2025
3	C	For Re-Approval	09-19-2025
2	B	For Re-Approval	06-23-2025
1	A	For Approval	02-25-2025
# of Copies	Revision/ Issue	Destination	Date

3029 M. Street, NW, Suite 202
Washington, DC 20007
Tel: 202-800-5599
Fax: 202-478-0303

Location: **1250 MARYLAND AVENUE SW**
WASHINGTON, DC 20024

BALFOUR BEATTY

signature



Drawing # **E-09.01**

Drawing Title:

**SOW #09 LEVEL-03 NEW
SLAB EXTENSION SUPPORT
SECTIONS**

NOT IN USE

F-F
E-09.00

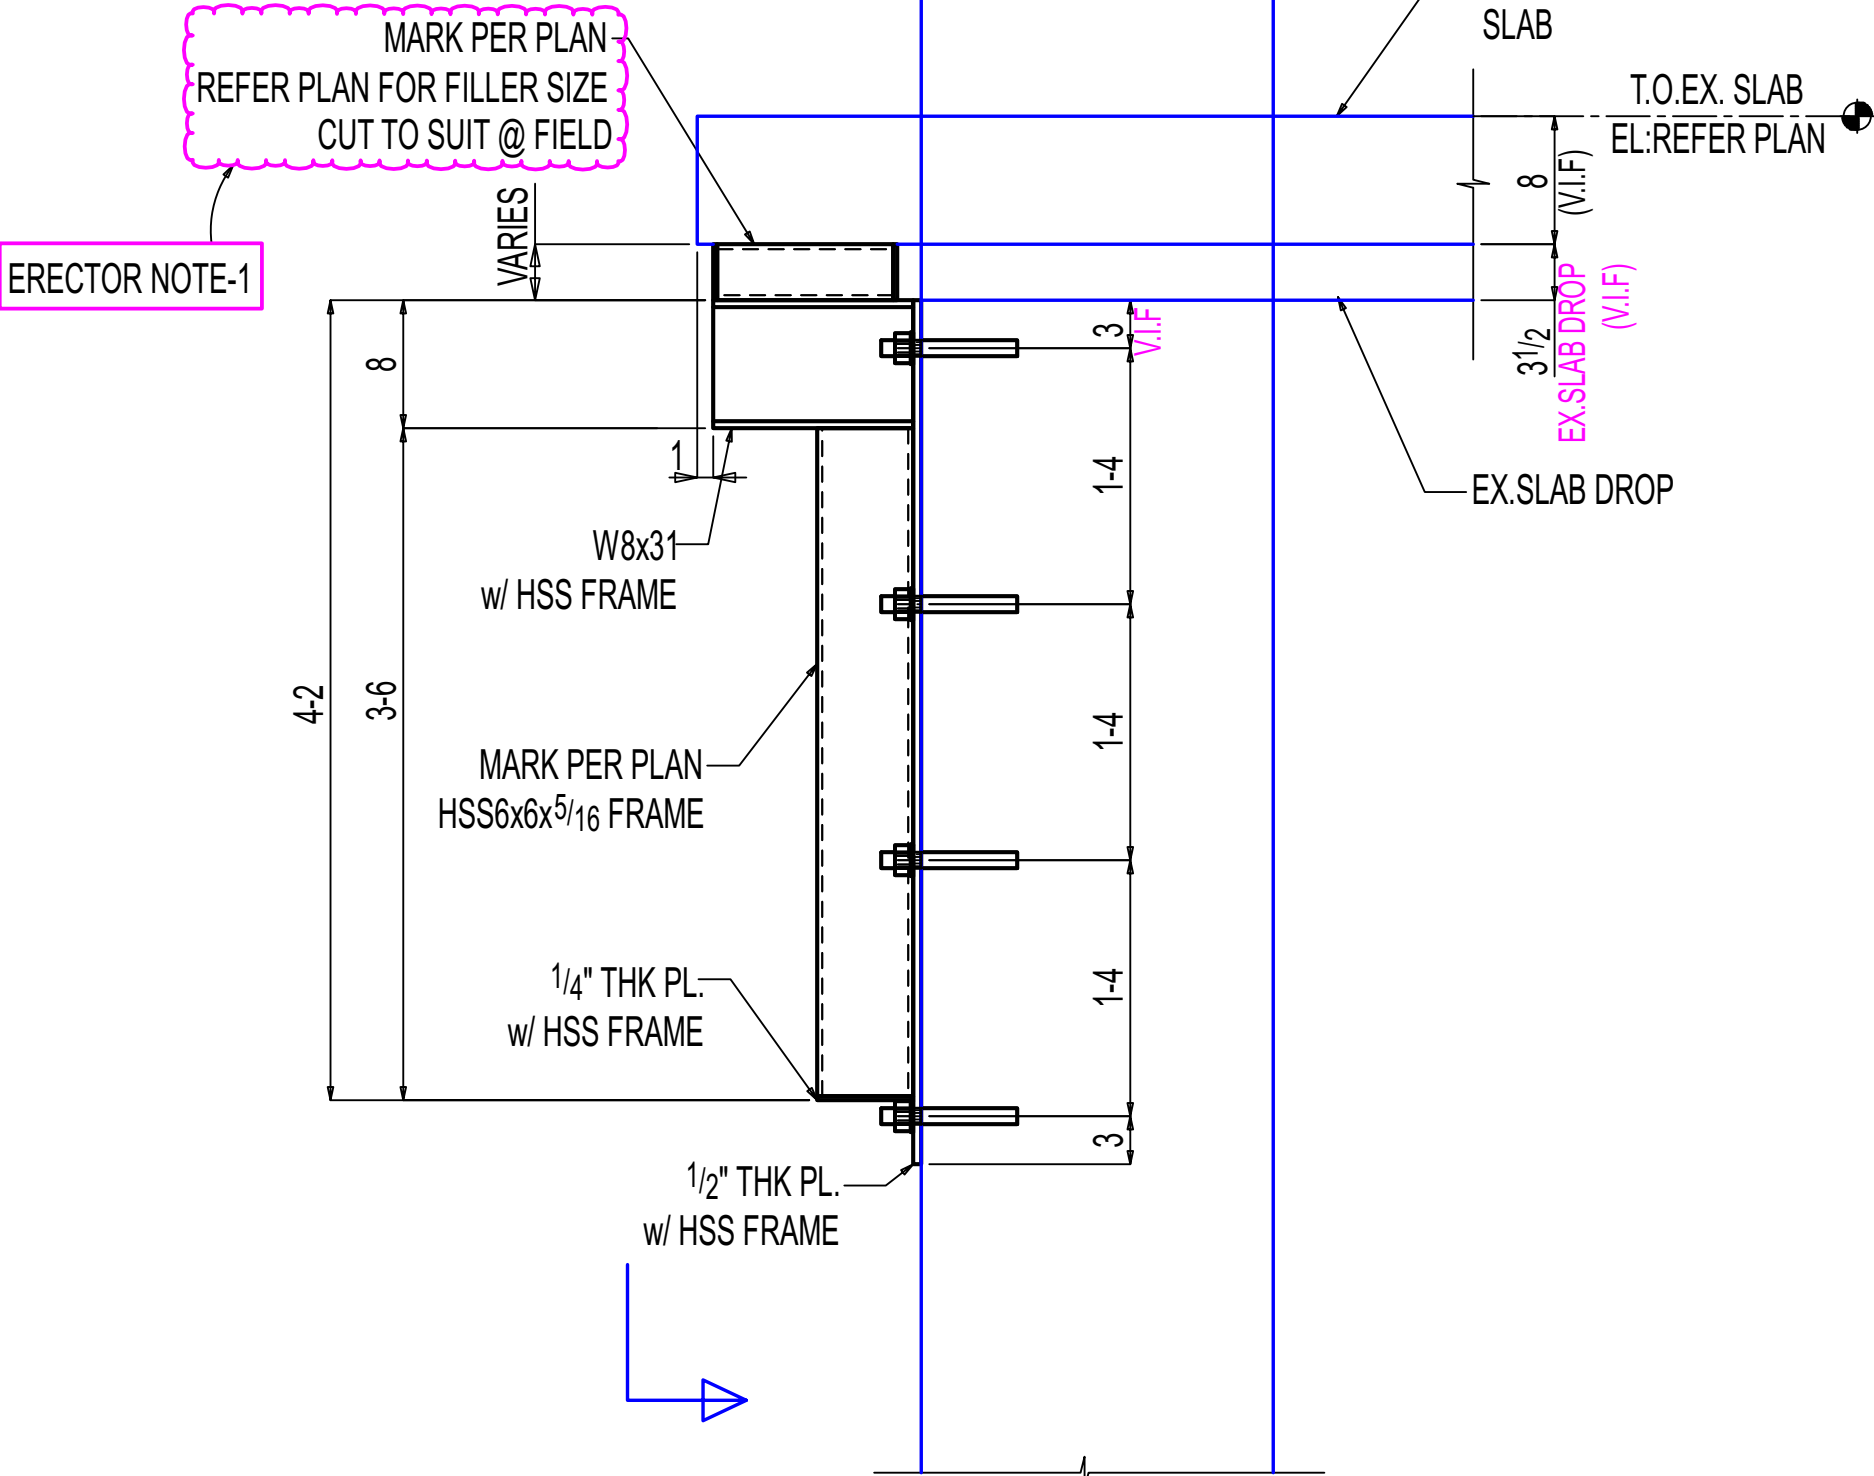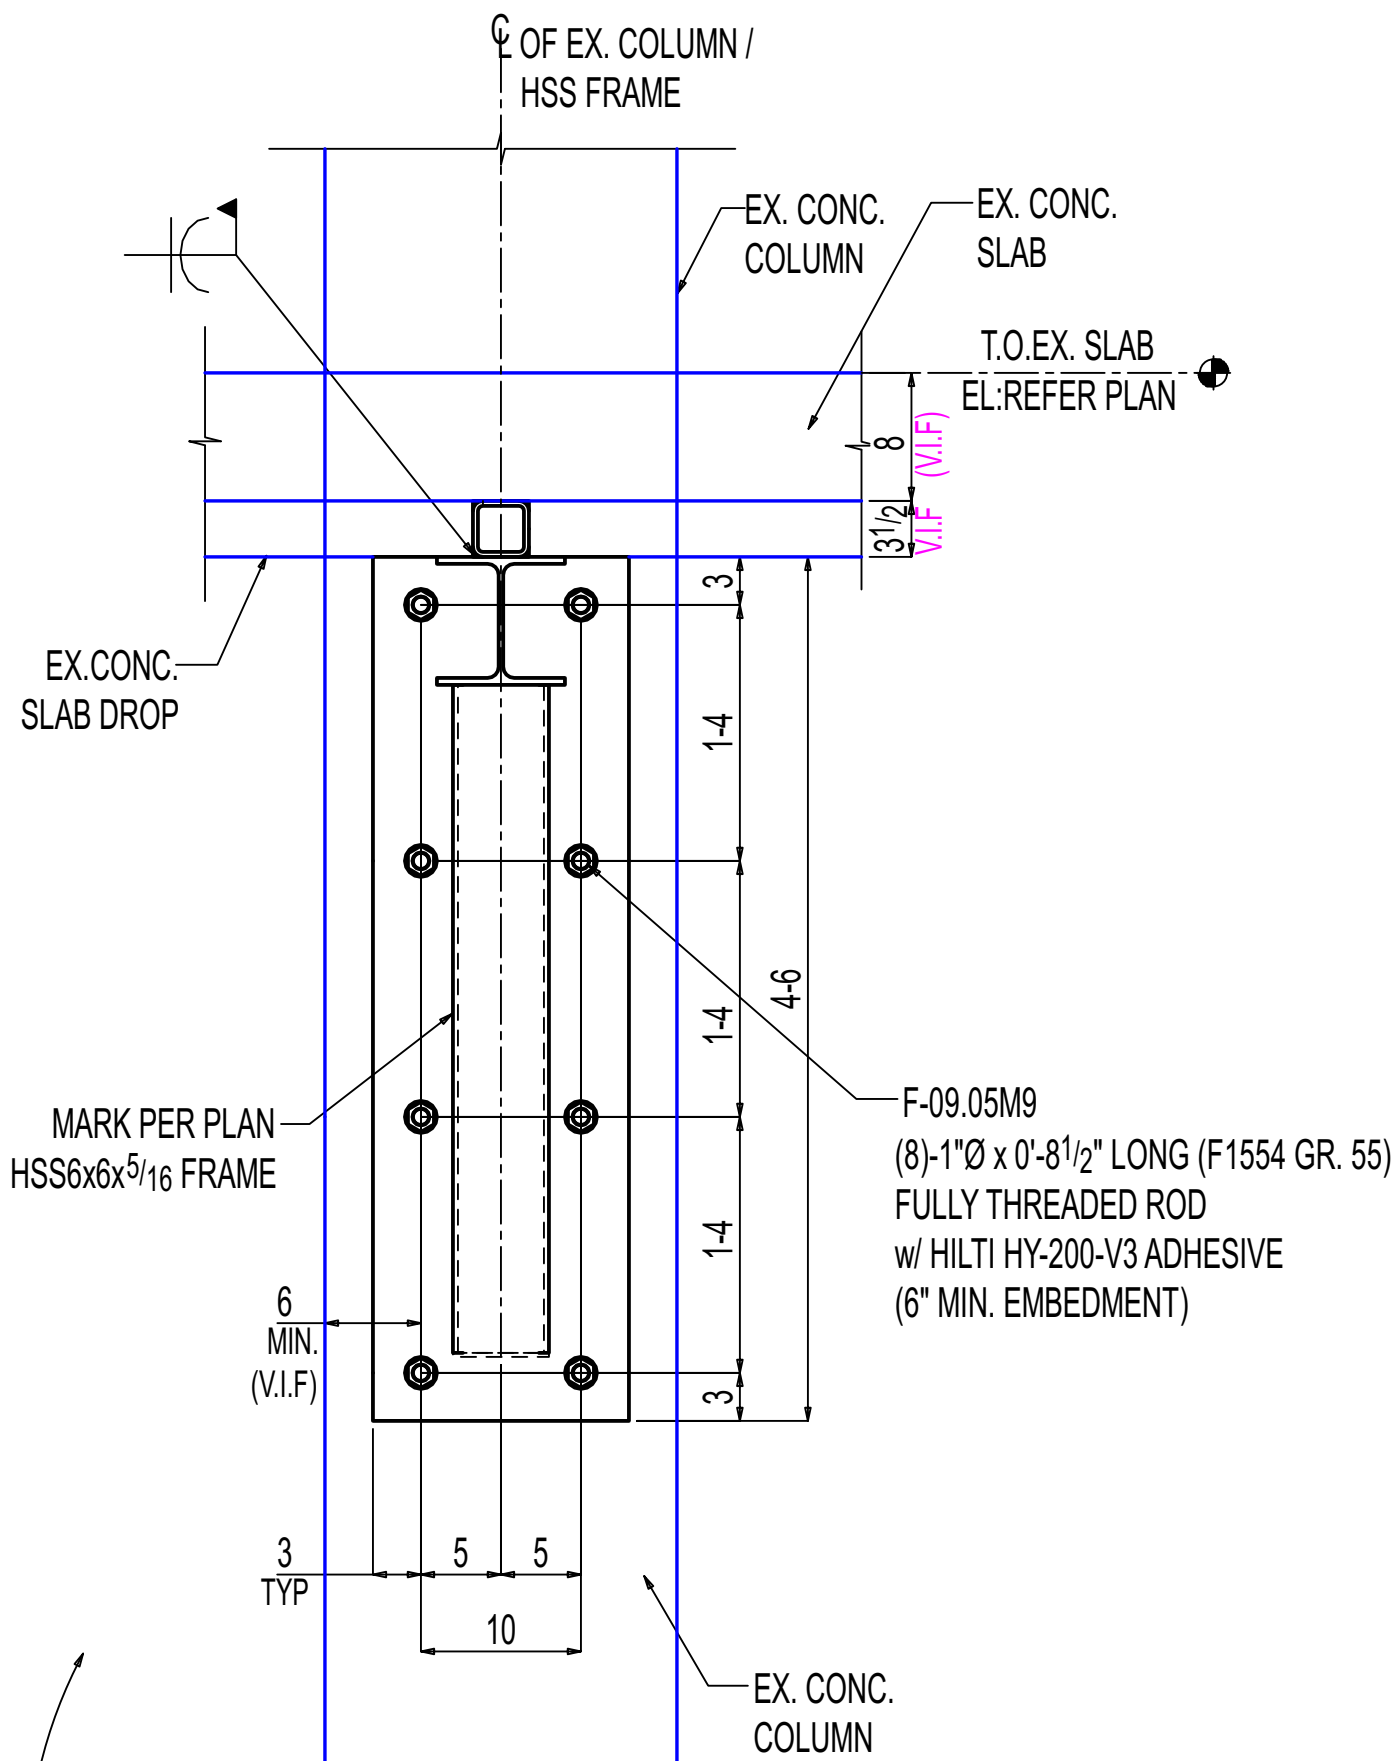

G-G

E-09.00
(REF: 11/S314)

OTHERS NOT SHOWN FOR CLARITY


SHOP / ERECTOR NOTE:
LOCATE EXISTING REBAR PRIOR TO FABRICATION OF PLATE.
DO NOT DRILL THROUGH REBAR.

ERECTOR NOTE-1:
ADJUST HSS DEPTH IN FIELD BY CUT THE HSS TO MATCH
EXISTING SLAB DROP THICKNESS, AND WELD TO THE
TOP OF HSS FRAME AT SITE PRIOR TO ERECTING THE HSS FRAME.

NOTE:
FILLER SIZE AND REQUIREMENT WILL BE
FINALIZED AFTER FIELD MEASUREMENT.

MARK PER PLAN
HSS3 1/2x3 1/2x5/16
CUT TO SUIT @ FIELD

ERECTOR NOTE-1

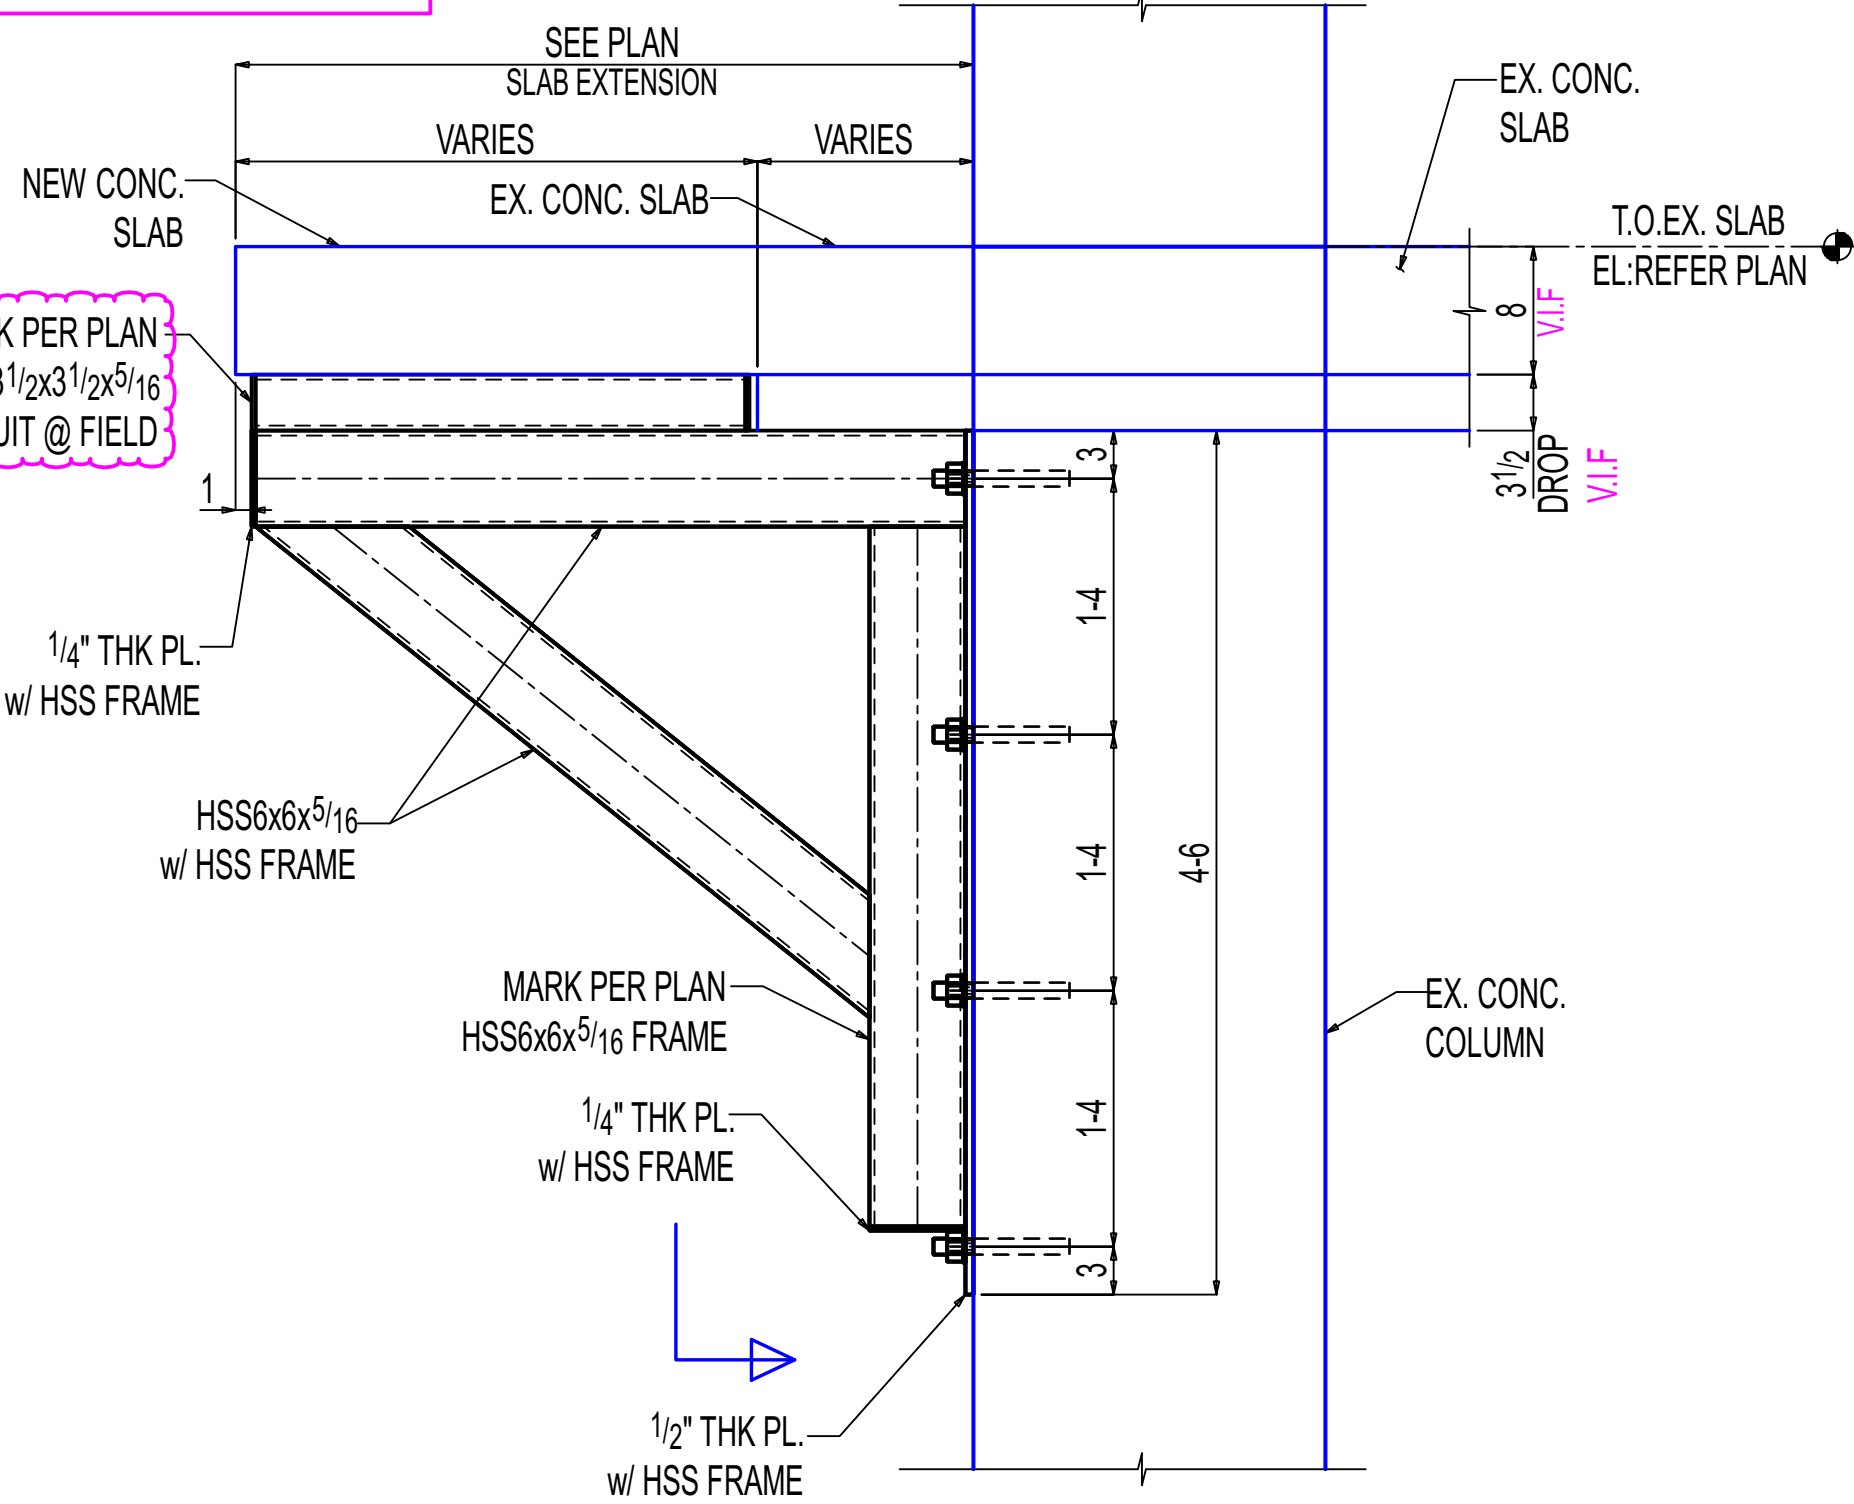

H-H

E-09.00A
(REF: 3/S307)

OTHERS NOT SHOWN FOR CLARITY

General Notes

- *Structural steel shall conform to ASTM-A992.
- *Structural SQR/RND,tubing conform to ASTM A500 Grade C
- *Pipe shall conform to ASTM A53, Grade B.
- *Channels, Angles and plates shall conform to A36.
- *All bolts shall be 3/4" High strength in accordance with ASTM A325 (UNO)
- *Welding Electrodes for Carbon steel :E70xx

# of Copies	Revision/ Issue	Destination	Date
5	0	For Construction	11-14-2025
4	D	For Re-Approval	10-24-2025
3	C	For Re-Approval	09-19-2025
2	B	For Re-Approval	06-23-2025
1	A	For Approval	02-25-2025

IRON FABRICATION SERVICES, LLC.

3029 M. Street, NW, Suite 202
Washington, DC 20007
Tel: 202-800-5599
Fax: 202-478-0303

Project Name and Address

MARYLAND AVENUE

Location: **1250 MARYLAND AVENUE SW
WASHINGTON, DC 20024**

Contractor:

BALFOUR BEATTY

Approved for Fabrication by:

Signature

Contract # **224009**

Drawing # **E-09.02**

Contract Item: **LEVEL-03
SLAB EXTENSION**

Ref:

SOW-09: 3,4,5&6 / S307

Date


01/ 20/ 2025

Drawing Title:

**SOW #09 LEVEL-03 NEW
SLAB EXTENSION SUPPORT
SECTIONS**


Scale

VARIES

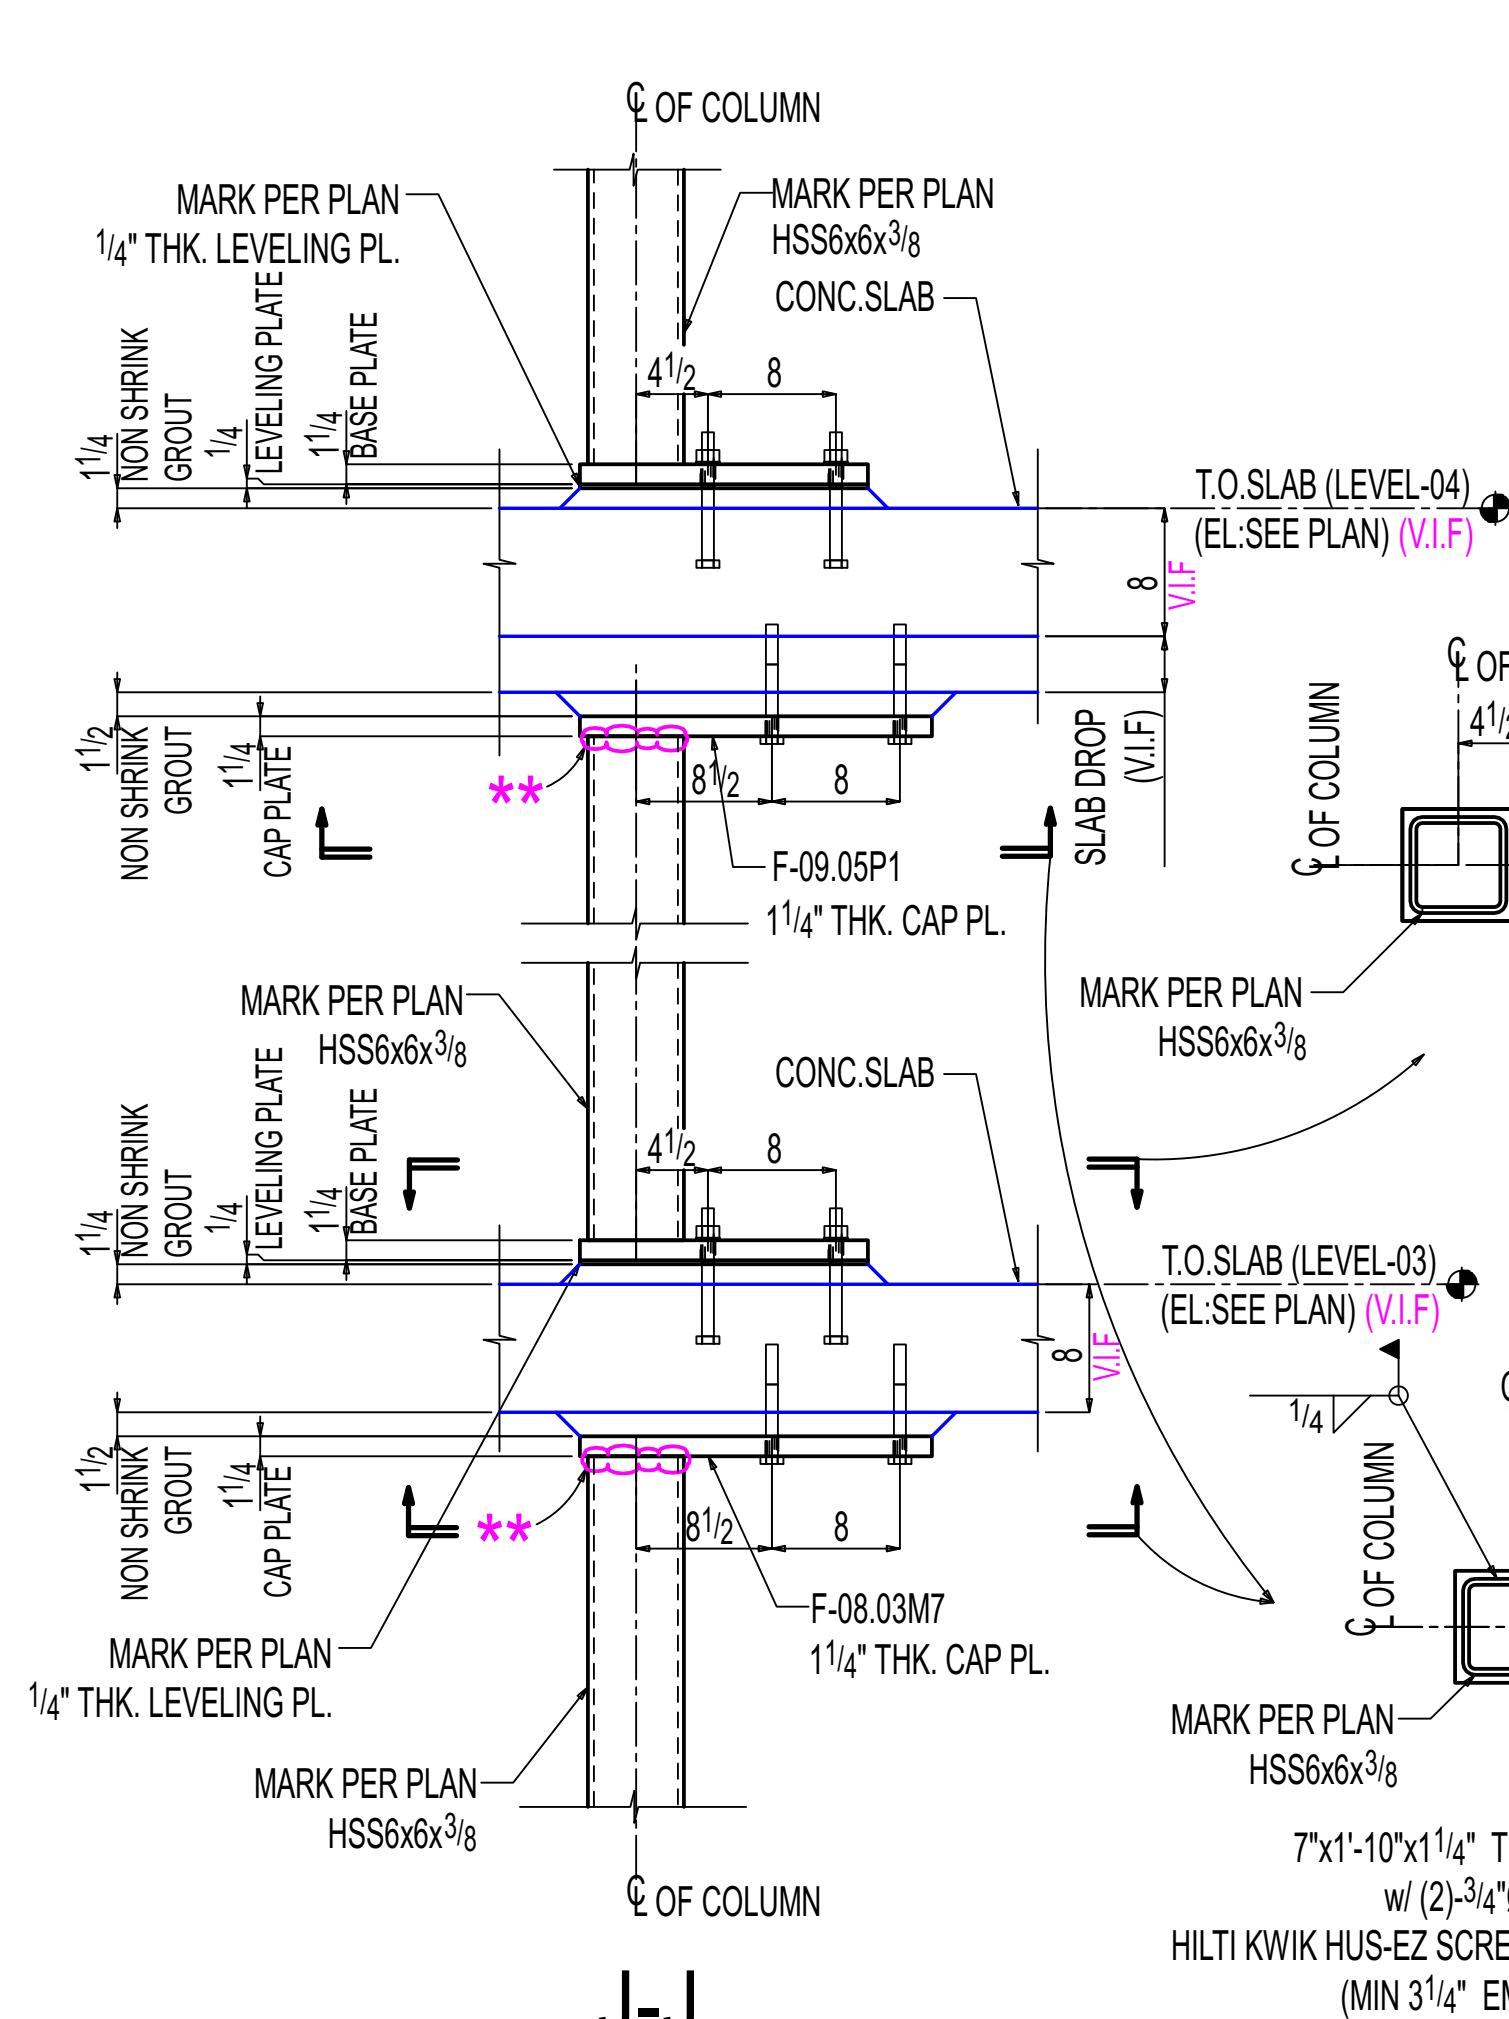


ERECTOR NOTE:
ALL * INDICATED COLUMN ENDS TO BE CUT TO SUIT @ FIELD BASED ON FLOOR TO FLOOR CLEARANCE AND WELD IT TO THE CAP PLATE.

SHOP / ERECTOR NOTE:
LOCATE EXISTING REBAR PRIOR TO FABRICATION OF PLATE.
DO NOT DRILL THROUGH REBAR.

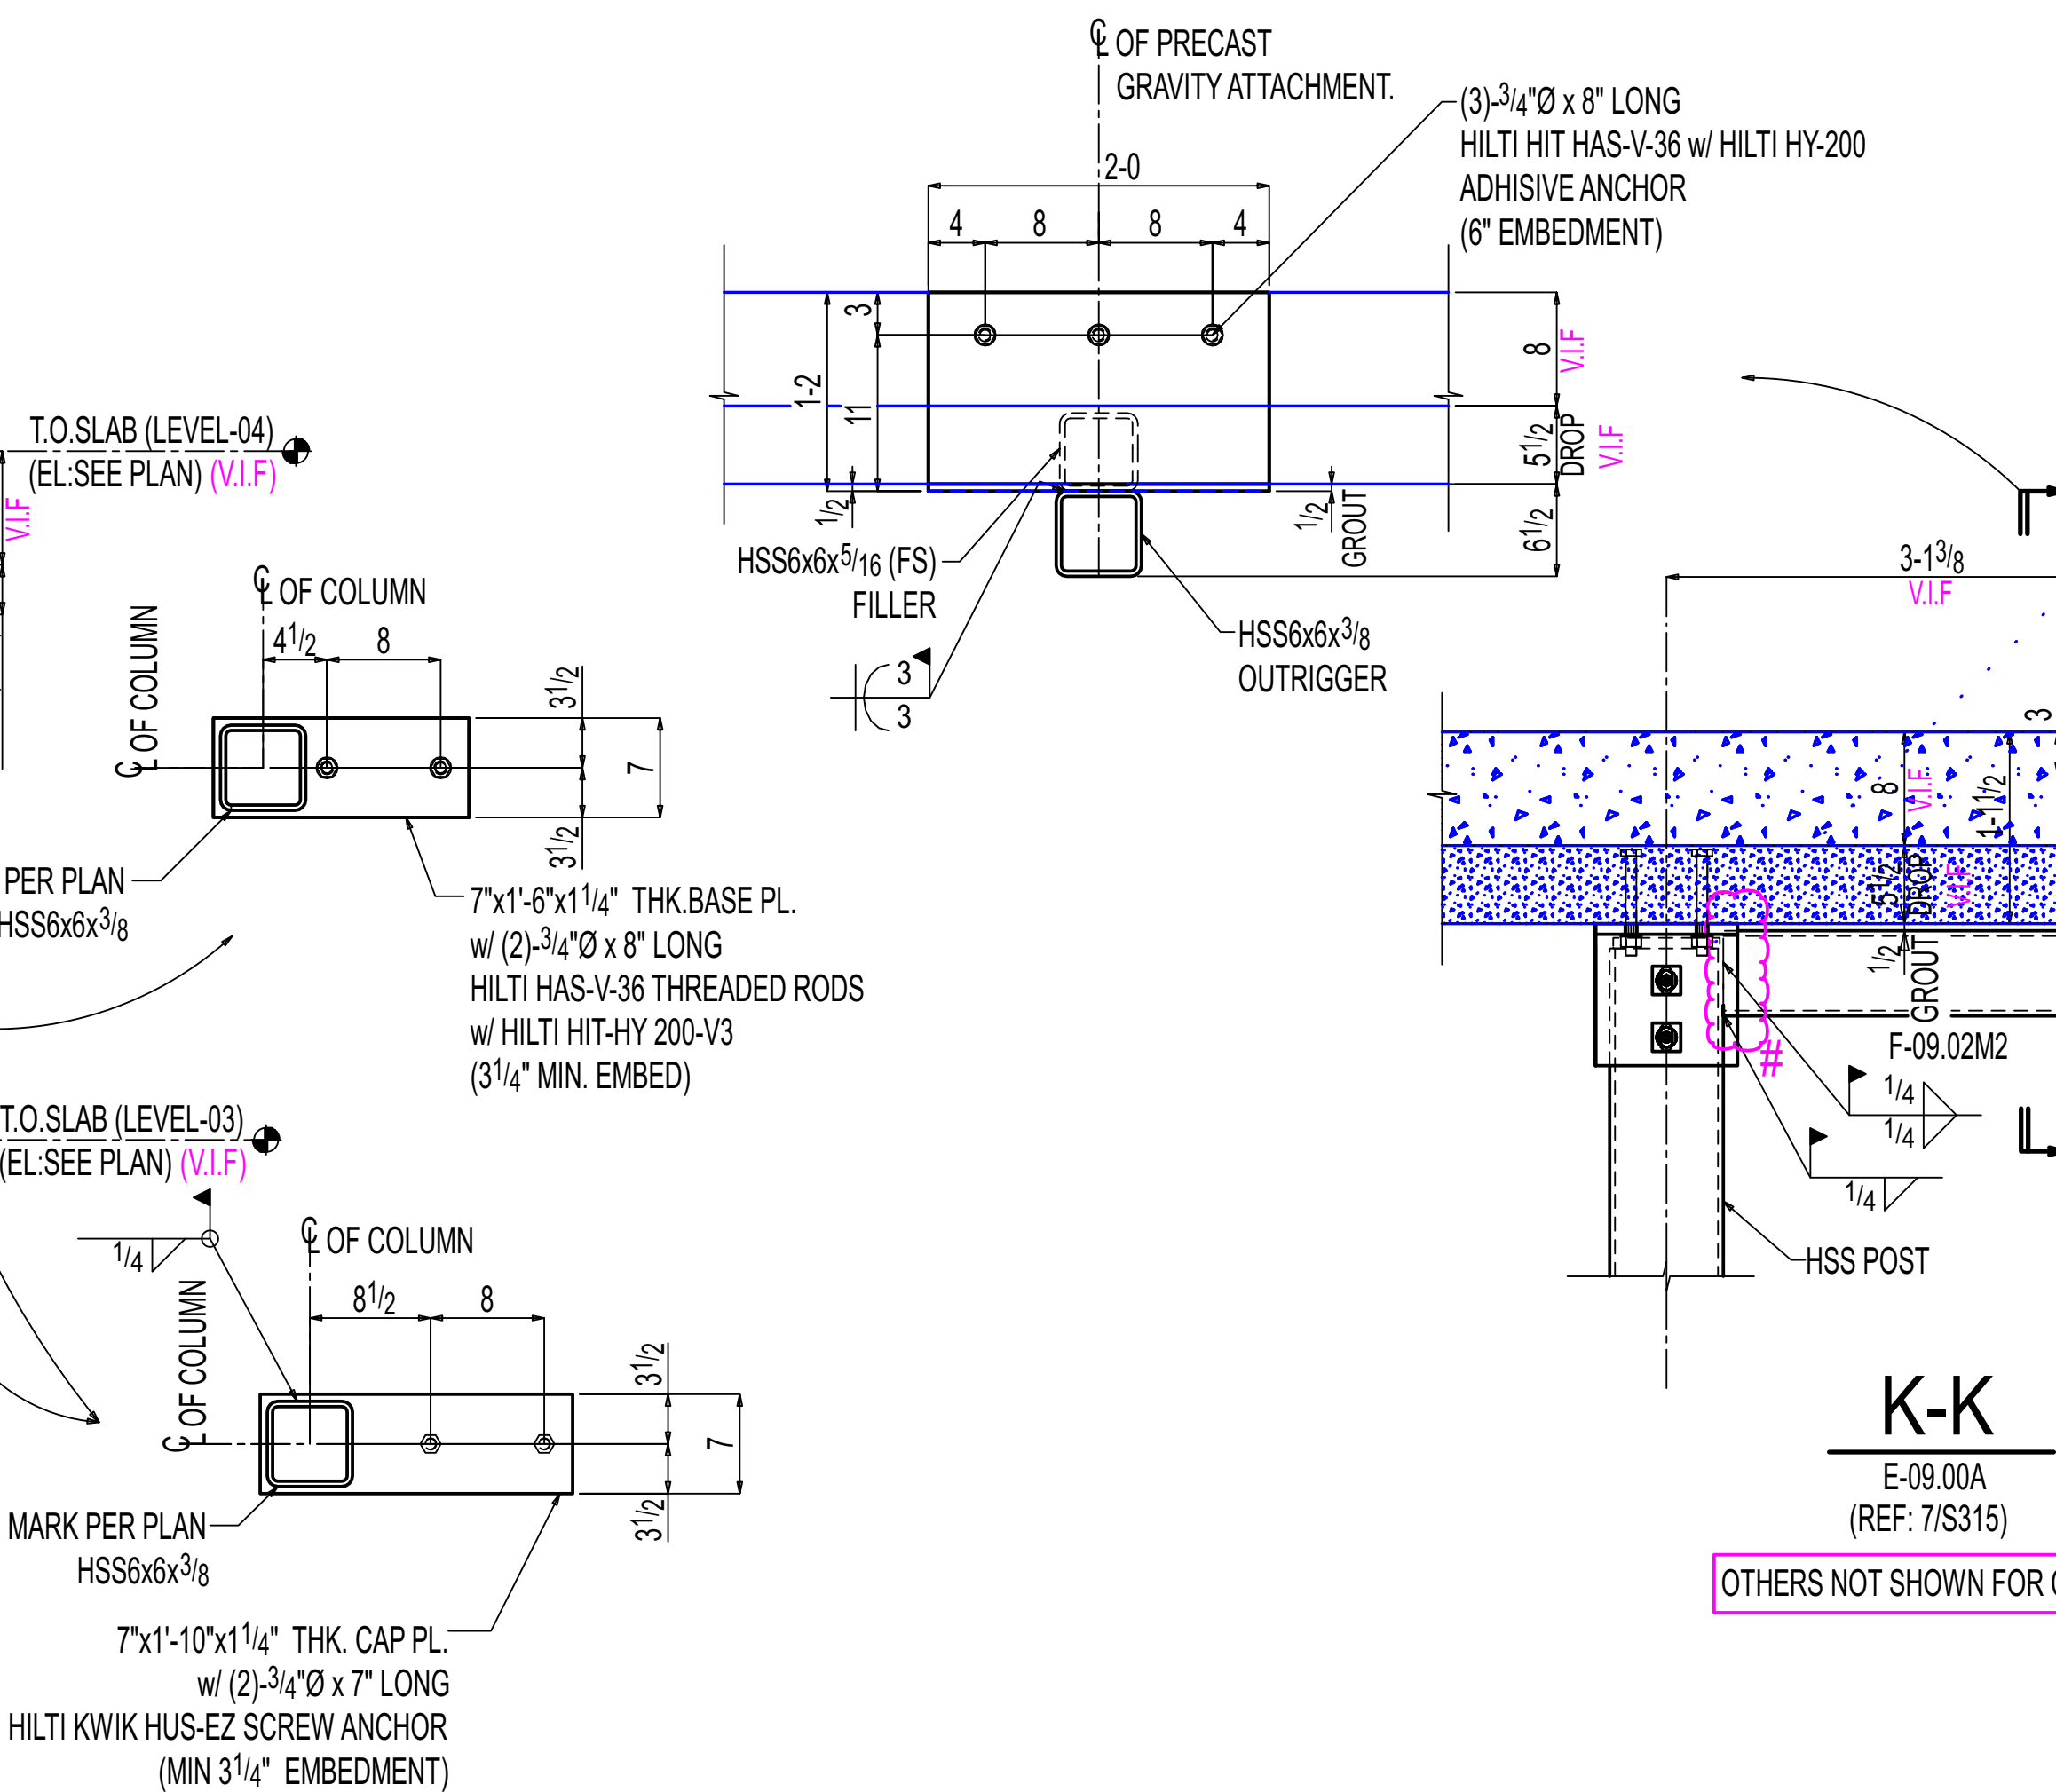


ERECTOR NOTE:
THE BENT PLATE SHOULD CENTERED HORIZONTALLY ON PRECAST GRAVITY ATTACHMENT

-ERECTOR NOTE:
FIELD CUT HSS6x6 ENDS TO SUIT HSS8x8 COLUMN.

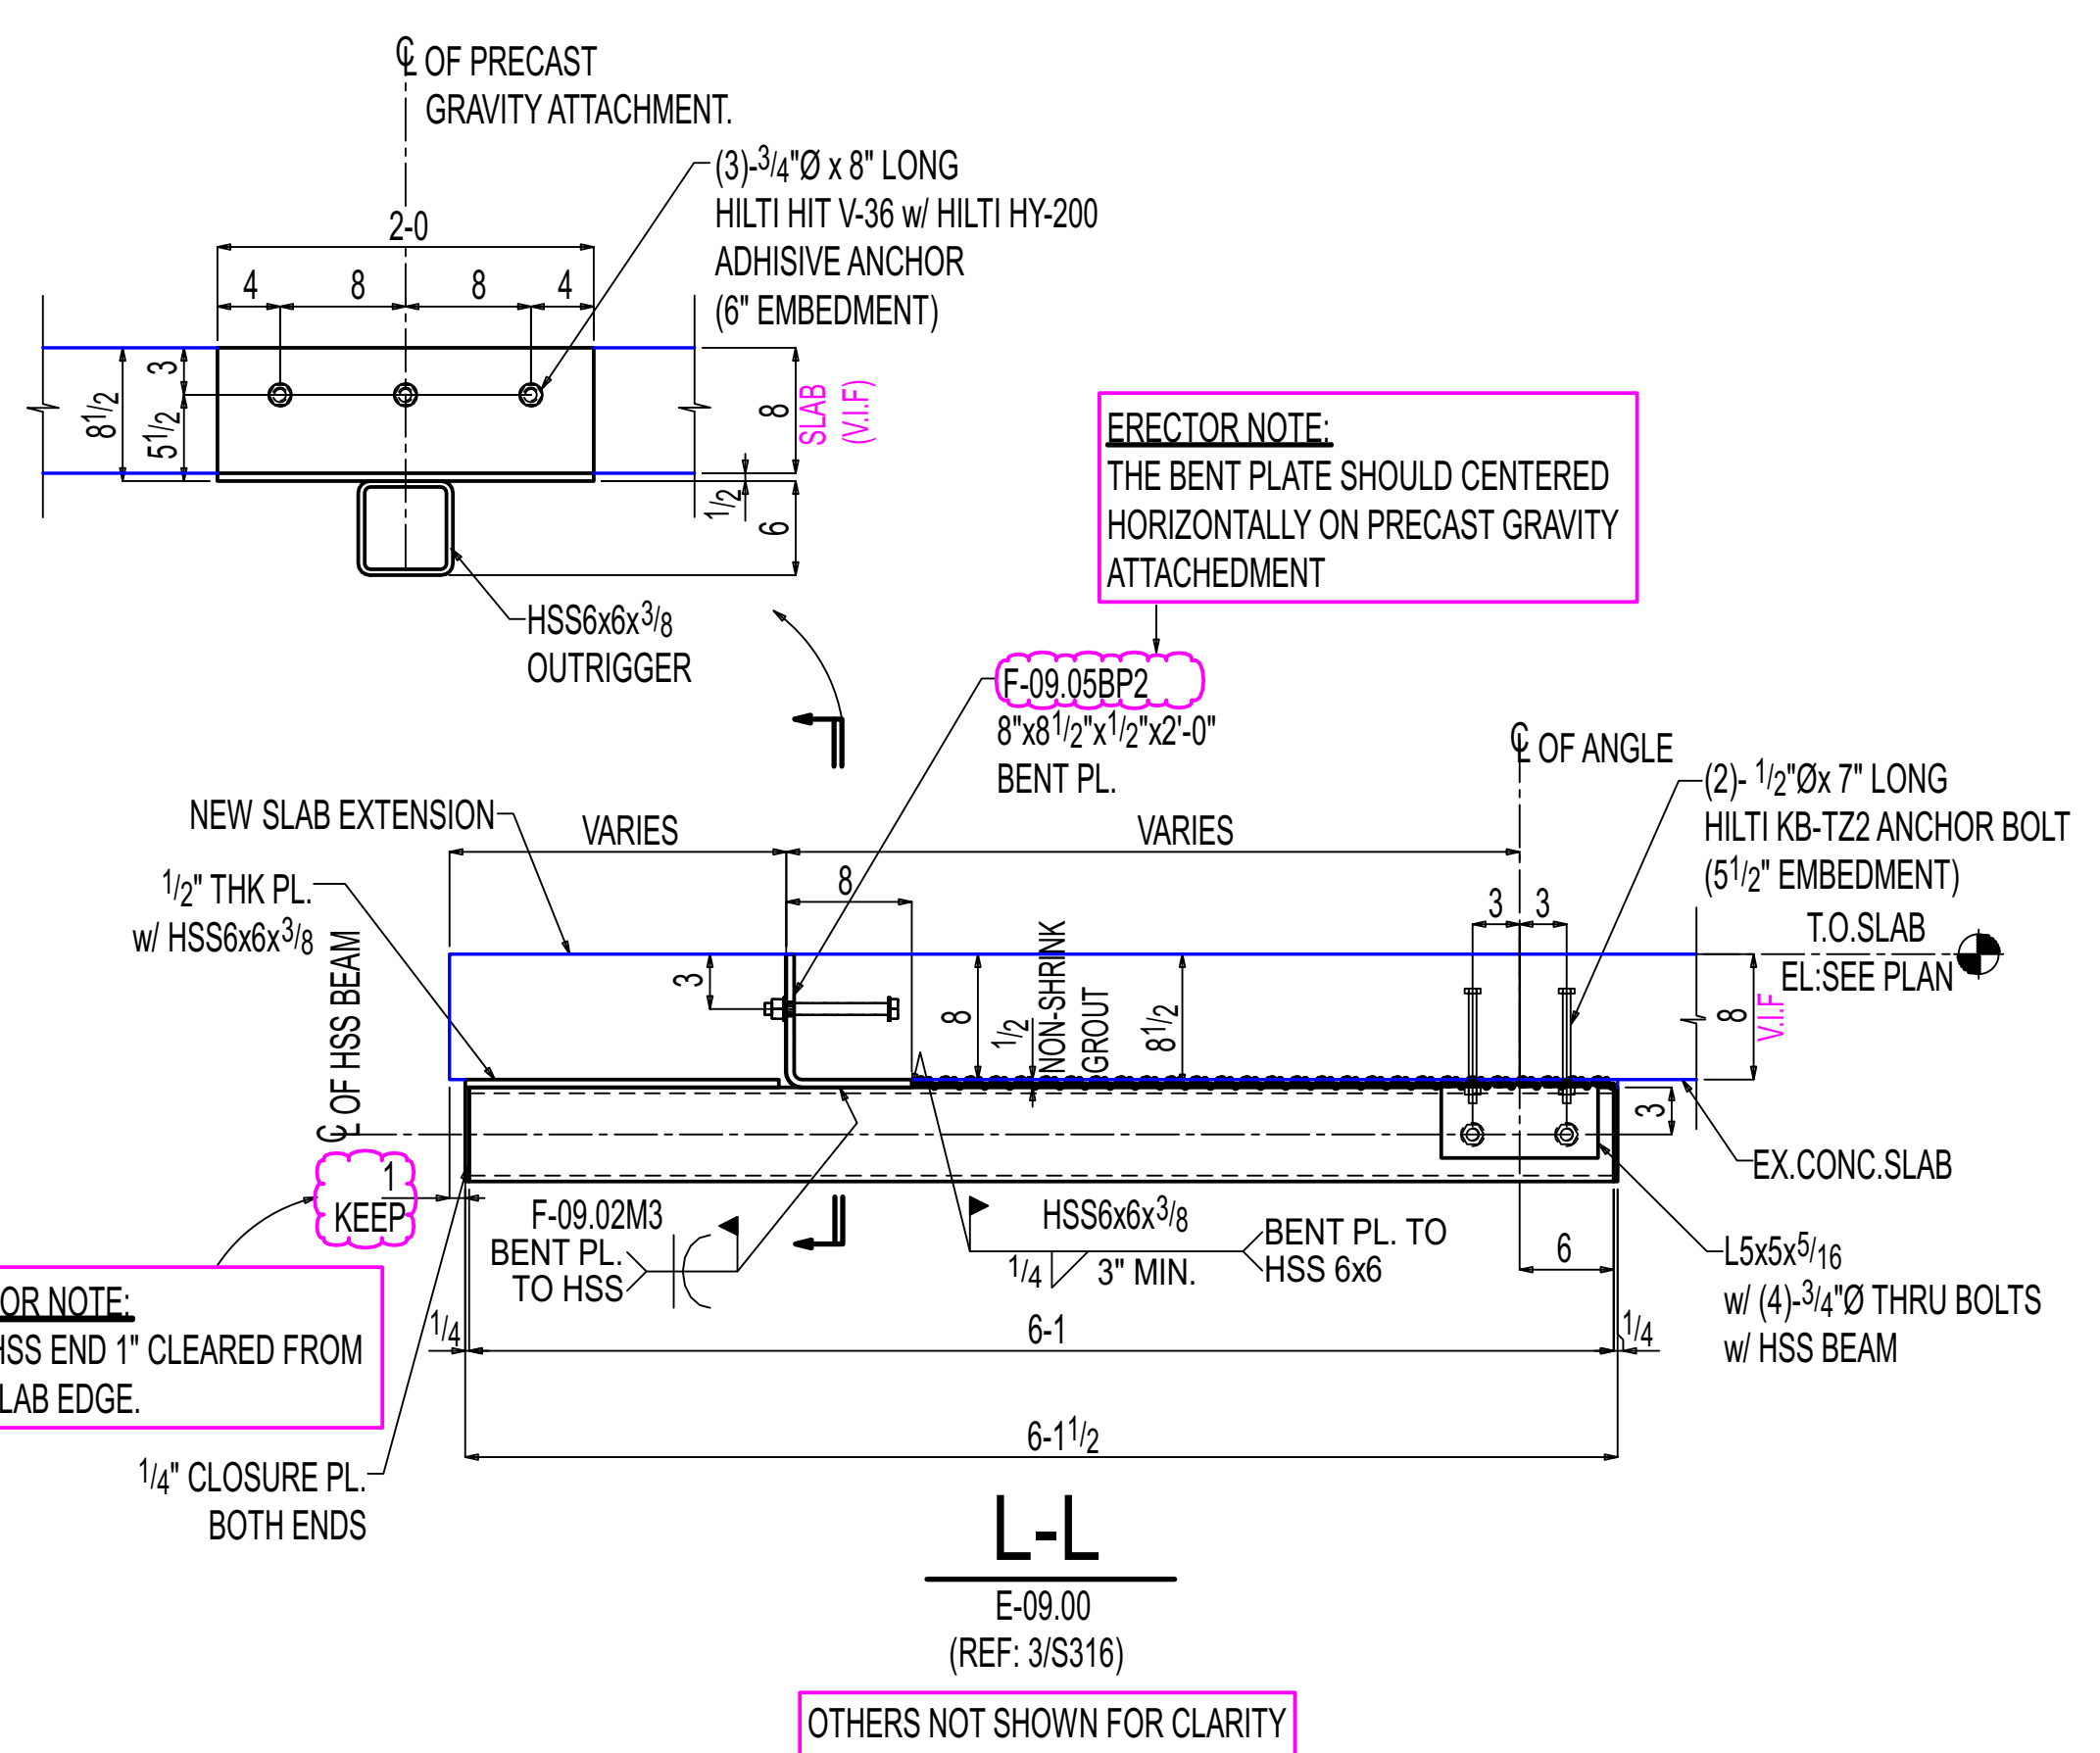


ERECTOR NOTE:
THE BENT PLATE SHOULD CENTERED HORIZONTALLY ON PRECAST GRAVITY ATTACHMENT

ERECTOR NOTE:
KEEP HSS END 1" CLEARED FROM NEW SLAB EDGE.

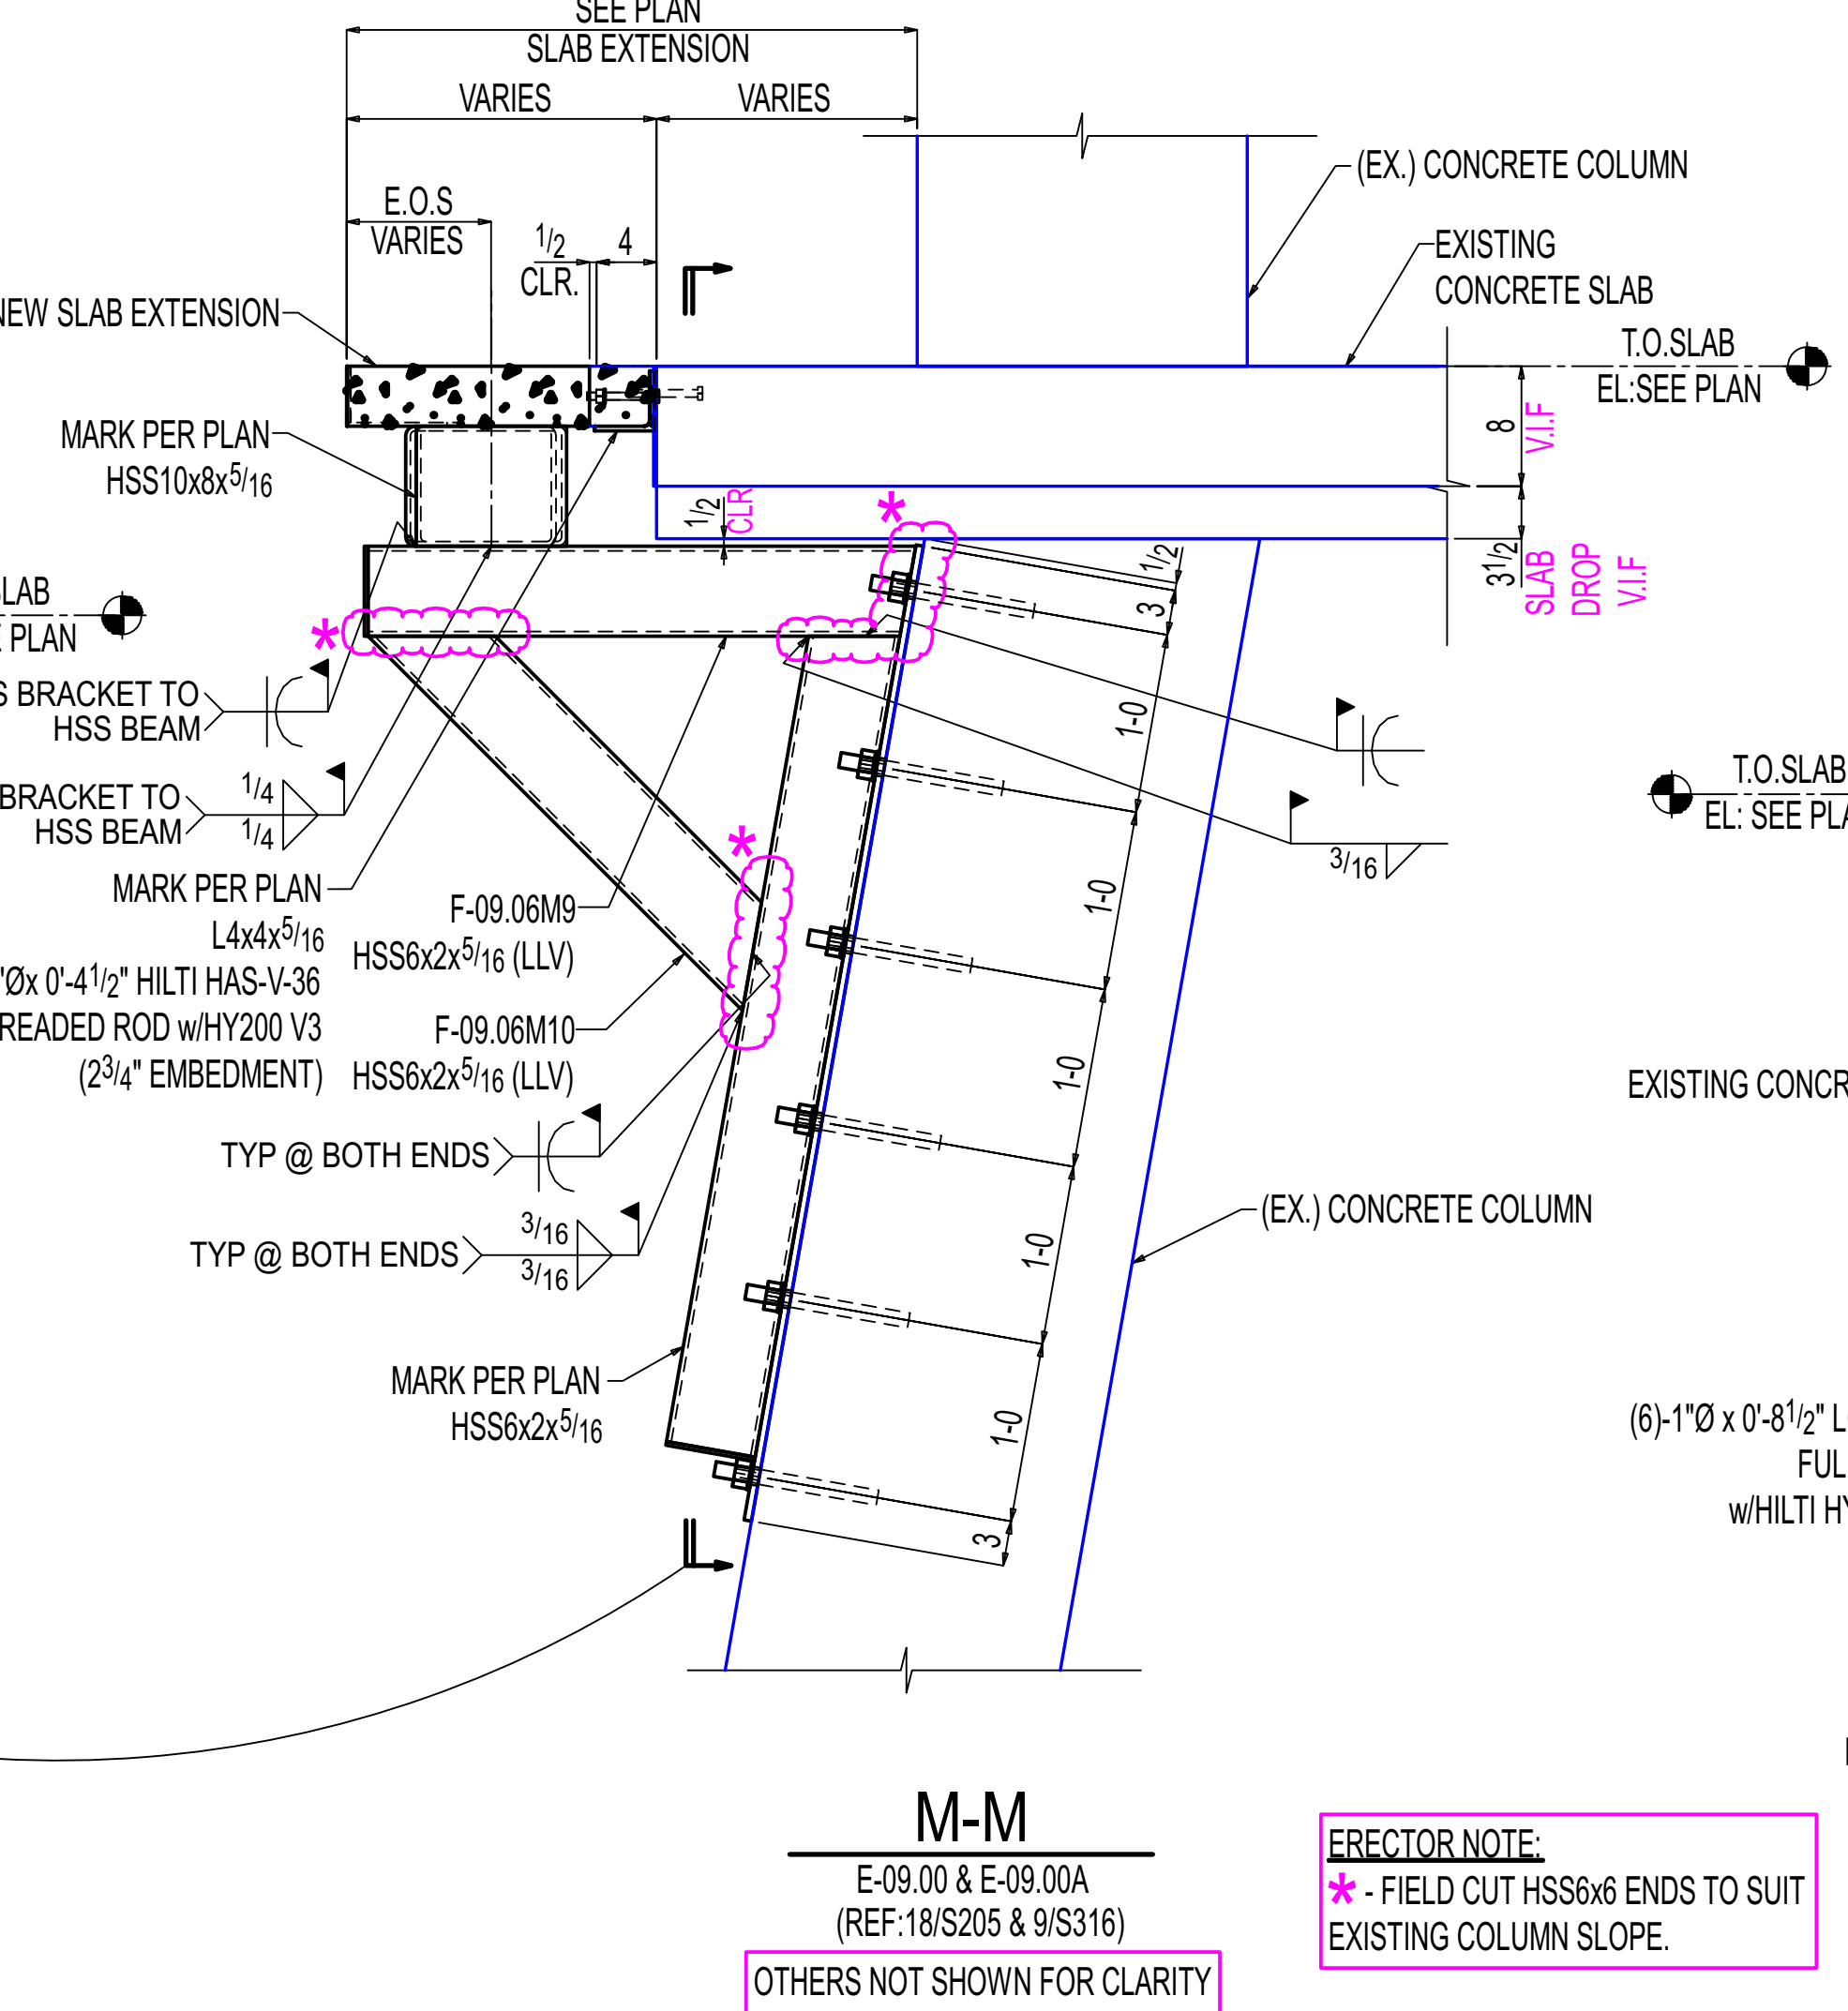

ERECTOR NOTE:
* - FIELD CUT HSS6x6 ENDS TO SUIT EXISTING COLUMN SLOPE.

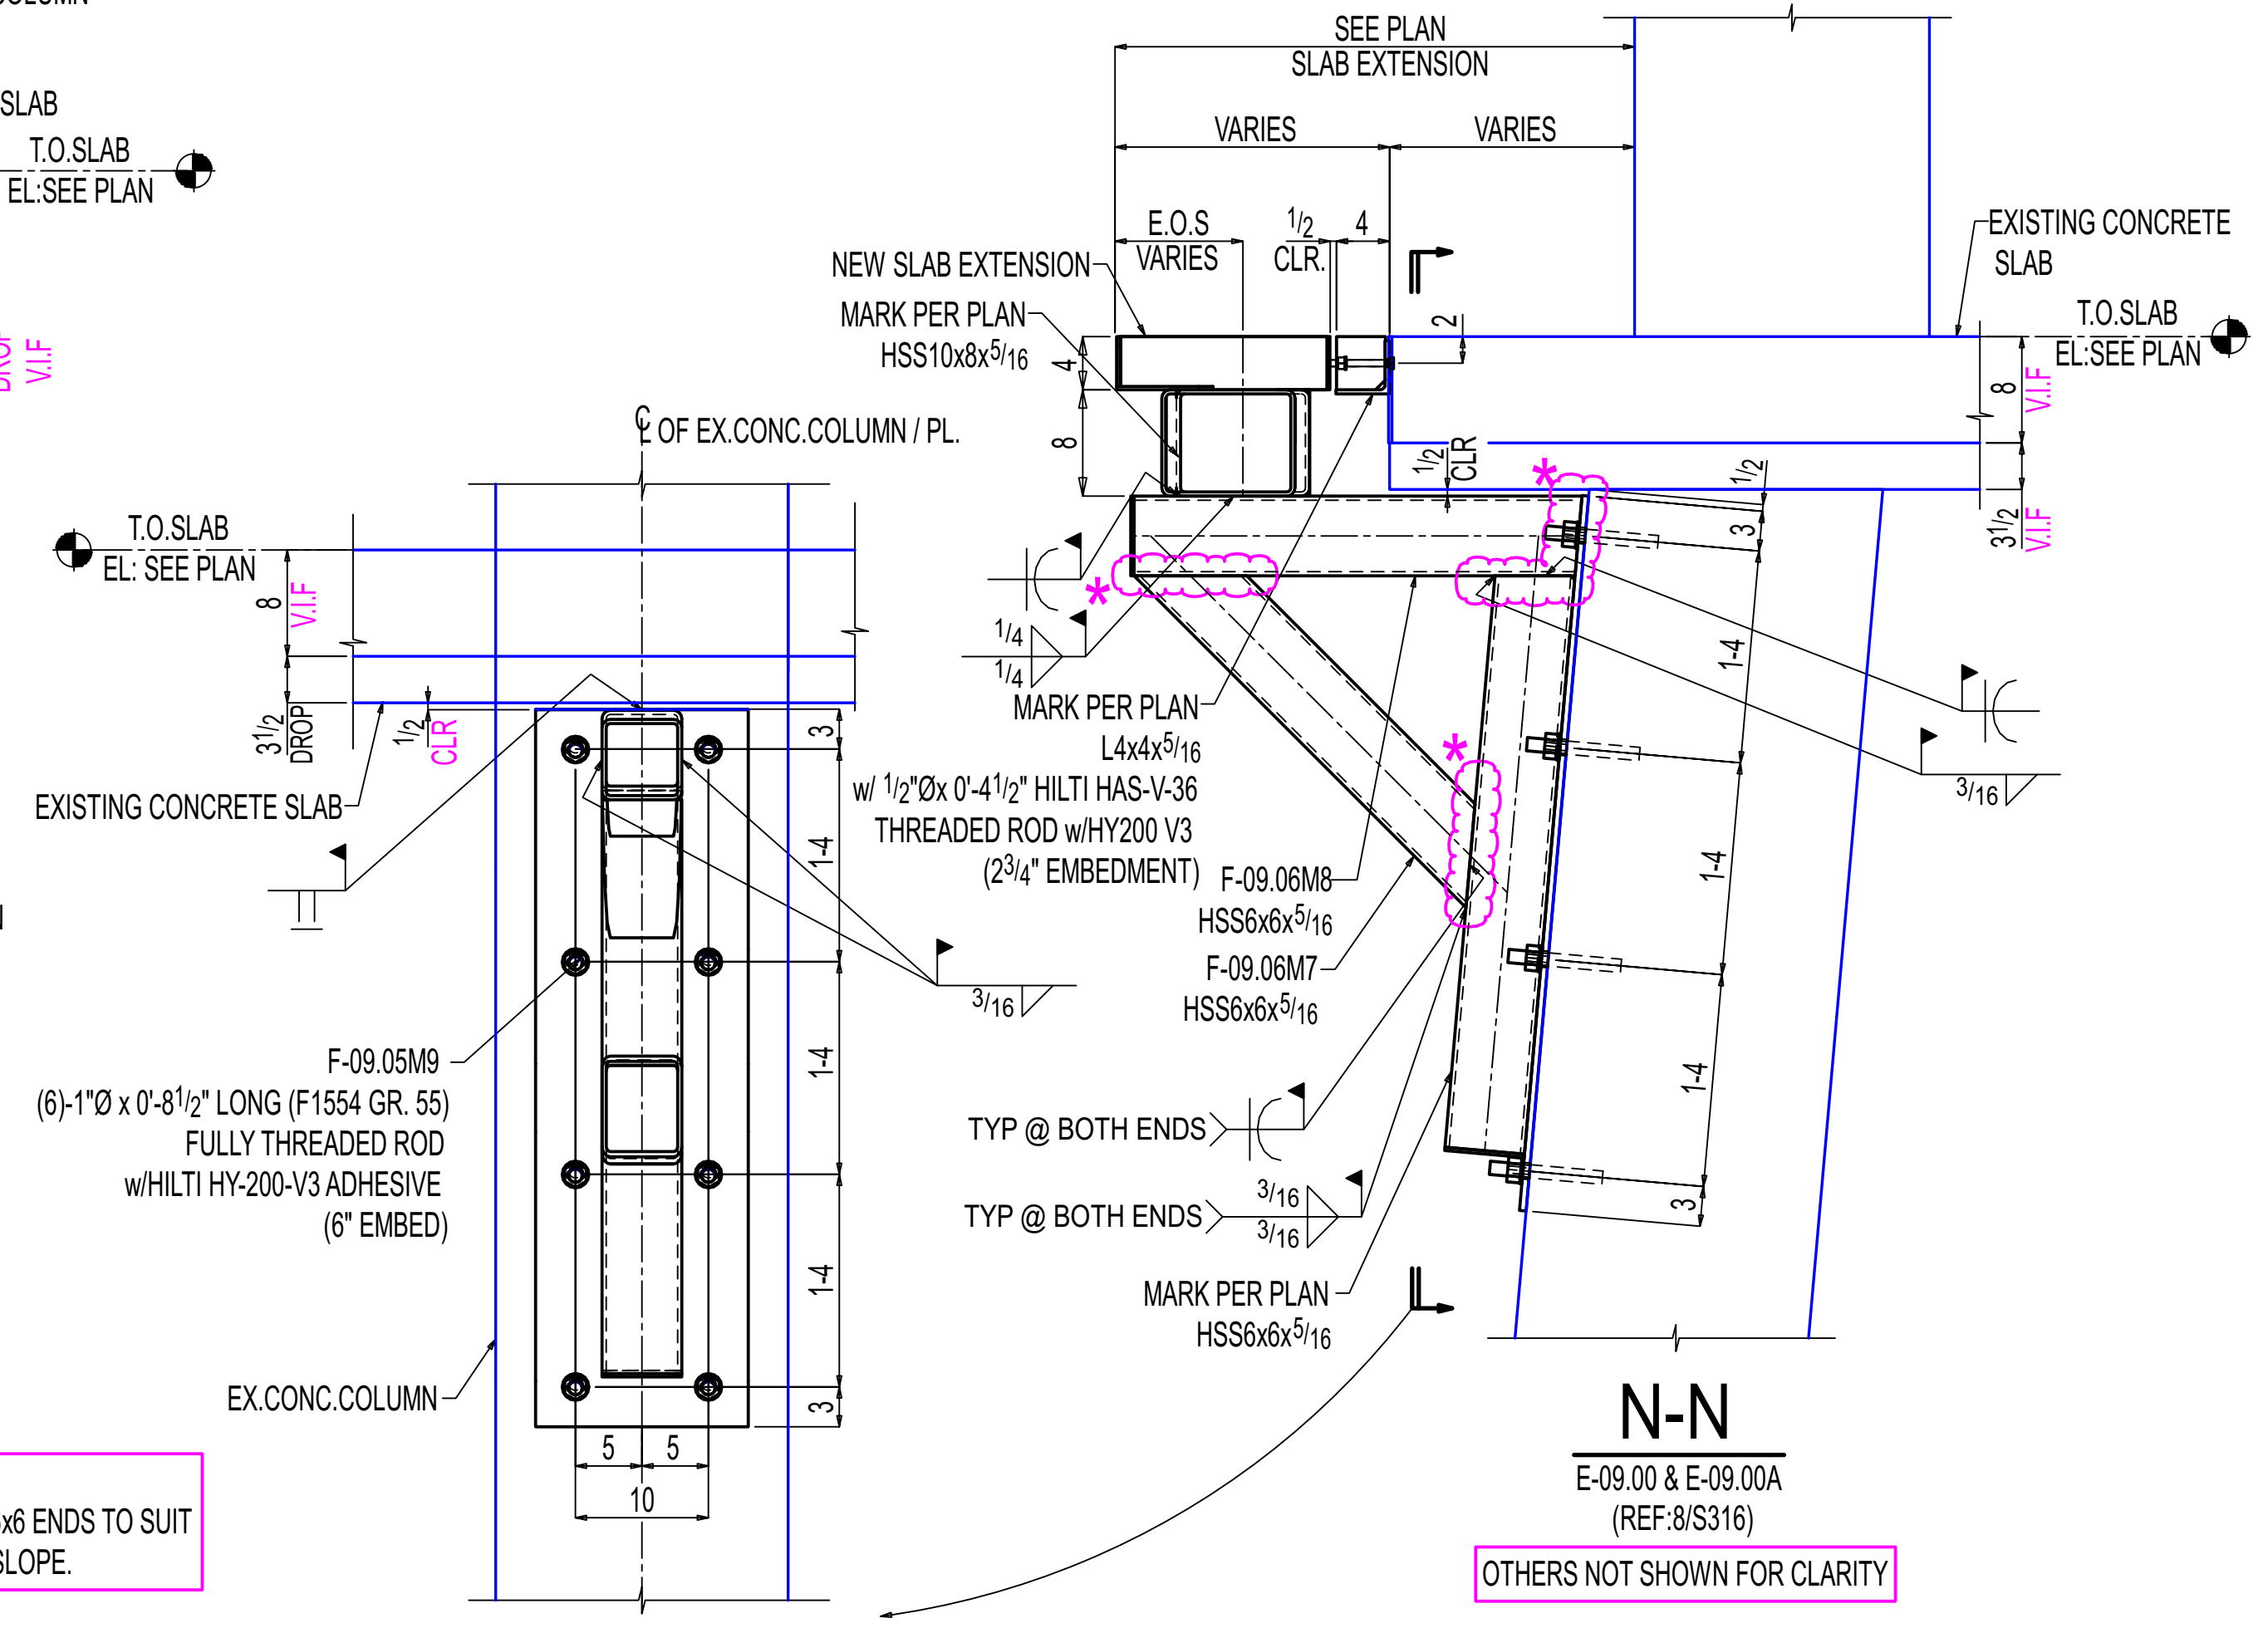

General Notes

- *Structural steel shall conform to ASTM-A992.
- *Structural SQR/RND tubing conform to ASTM A500 Grade C
- *Pipe shall conform to ASTM A53, Grade B.
- *Channels, Angles and plates shall conform to A36.
- *All bolts shall be 3/4" High strength in accordance with ASTM A325 (UNO)
- *Welding Electrodes for Carbon steel :E70xx

# of Copies	Revision/ Issue	Destination	Date
4	0	For Construction	11-14-2025
3	C	For Re-Approval	10-24-2025
2	B	For Re-Approval	09-19-2025
1	A	For Approval	02-25-2025

IRON FABRICATION SERVICES, LLC.

3029 M. Street, NW, Suite 202
Washington, DC 20007
Tel: 202-800-5599
Fax: 202-478-0303

Project Name and Address
MARYLAND AVENUE

Location: **1250 MARYLAND AVENUE SW
WASHINGTON, DC 20024**

Contractor:
BALFOUR BEATTY

Approved for Fabrication by: _____ Signature _____


Contract # **224009** Drawing # **E-09.03**

Contract Item: **LEVEL-03
SLAB EXTENSION**


Ref: **SOW-09: 3,4,5&6 / S307**

Date **01/20/2025** Drawing Title:
**SOW #09 LEVEL-03 NEW
SLAB EXTENSION SUPPORT
SECTIONS**

Scale **VARIES**

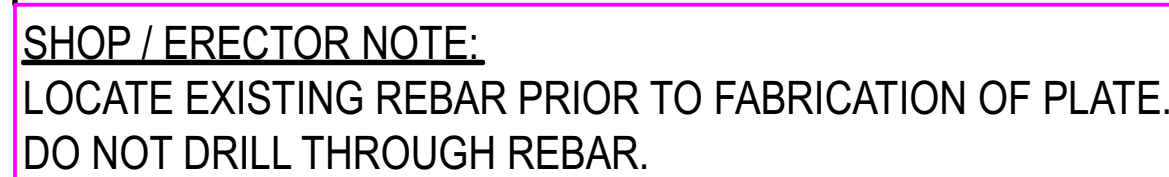

* - ERECTOR NOTE:
PROVIDE 1" NON-SHRINK GROUT x 12" LONG
CENTERED BENEATH AT PRECAST
ATTACHMENT POINTS.



IRON FABRICATION SERVICES, LLC.

3029 M. Street, NW, Suite 202
Washington, DC 20007
Tel: 202-800-5599
Fax: 202-478-0303


Project Name and Address
MARYLAND AVENUE

Location: **1250 MARYLAND AVENUE SW**
WASHINGTON, DC 20024

Contractor: **BALFOUR BEATTY**


Approved for Fabrication by:	Signature

Contract # 224009		Drawing # E-09.04	
Contract Item: LEVEL-03 SLAB EXTENSION			
Ref: SOW-09: 3,4,5&6 / S307			
Date 01/20/2025		Drawing Title: SOW #09 LEVEL-03 NEW SLAB EXTENSION SUPPORT SECTIONS	
Scale VARIABLE			

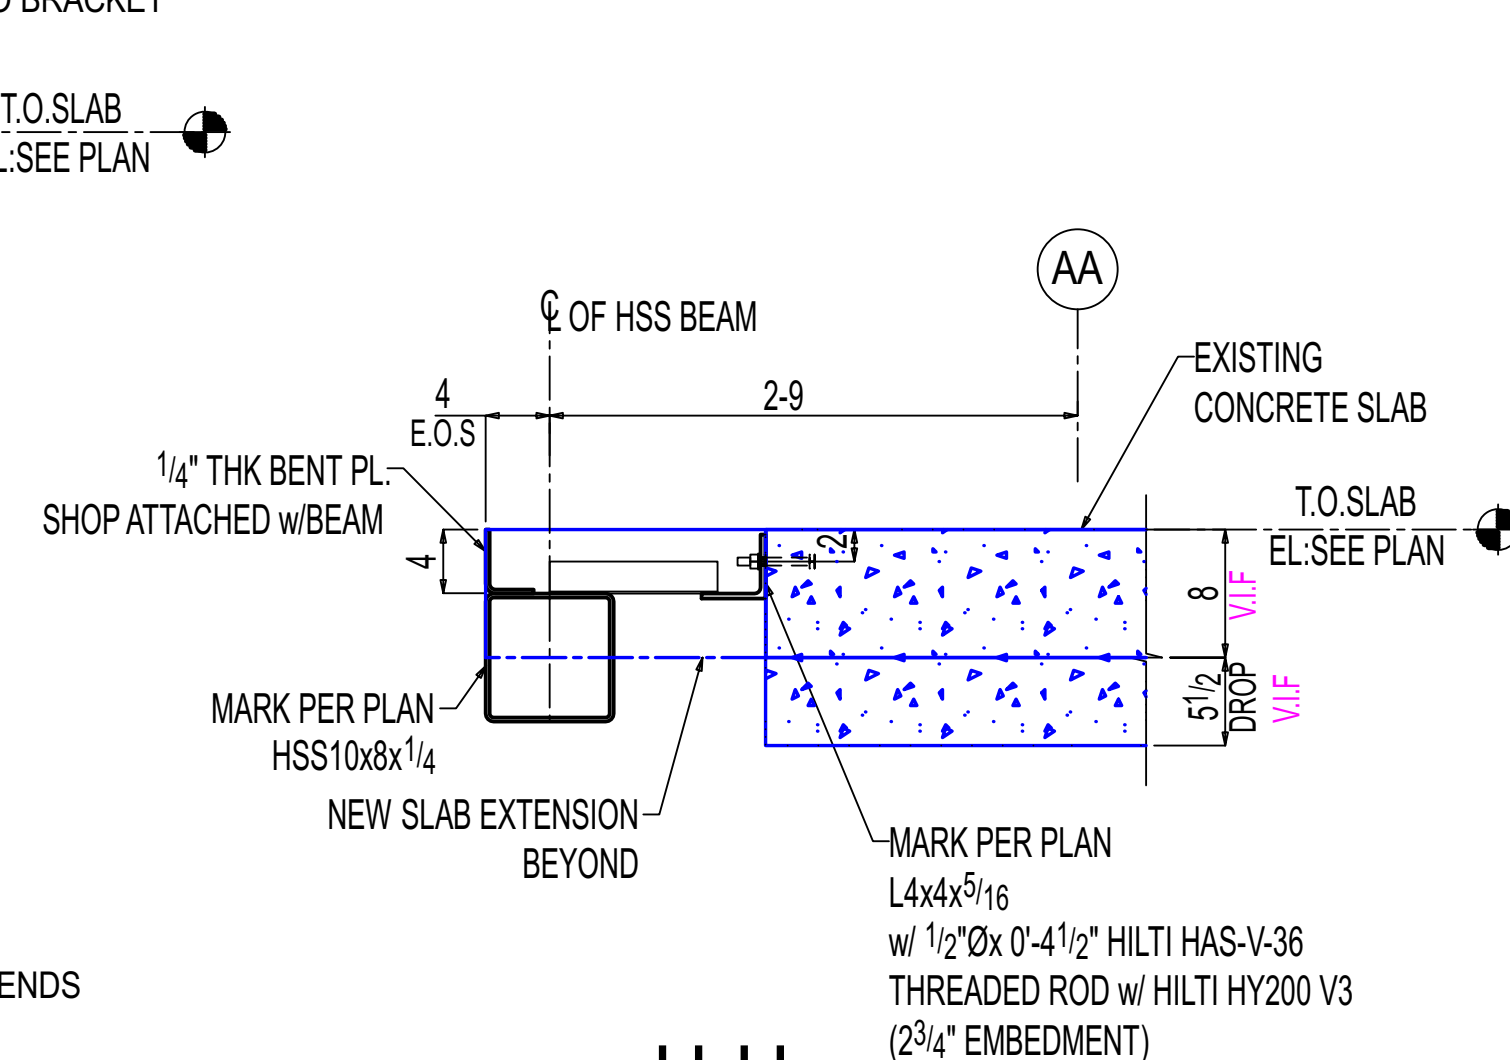

Elevation view of a column and slab joint. The diagram shows a central column with a 6x6x5/16 HSS section and two 8x1 1/2 inch fully threaded rods (F-09.05M9) with 6-inch embedment. The column is surrounded by a 5 1/2 inch drop slab. Dimensions include 3 inches for the top and bottom slab thickness, 14 inches for the column height, and 5 inches for the rod embedment. Labels include "EX. CONC. COLUMN", "HSS6x6x5/16 w/ HSS FRAME", "F-09.05M9 (8)-1"Ø x 8 1/2" LONG (F1554 GR. 55) FULLY THREADED ROD w/ HILTI HY-200 V3 ADHESIVE (6" EMBEDMENT)", "T.O. EX. SLAB EL: REFER PLAN", and "V.I.F.".

OTHERS NOT SHOWN FOR CLARITY

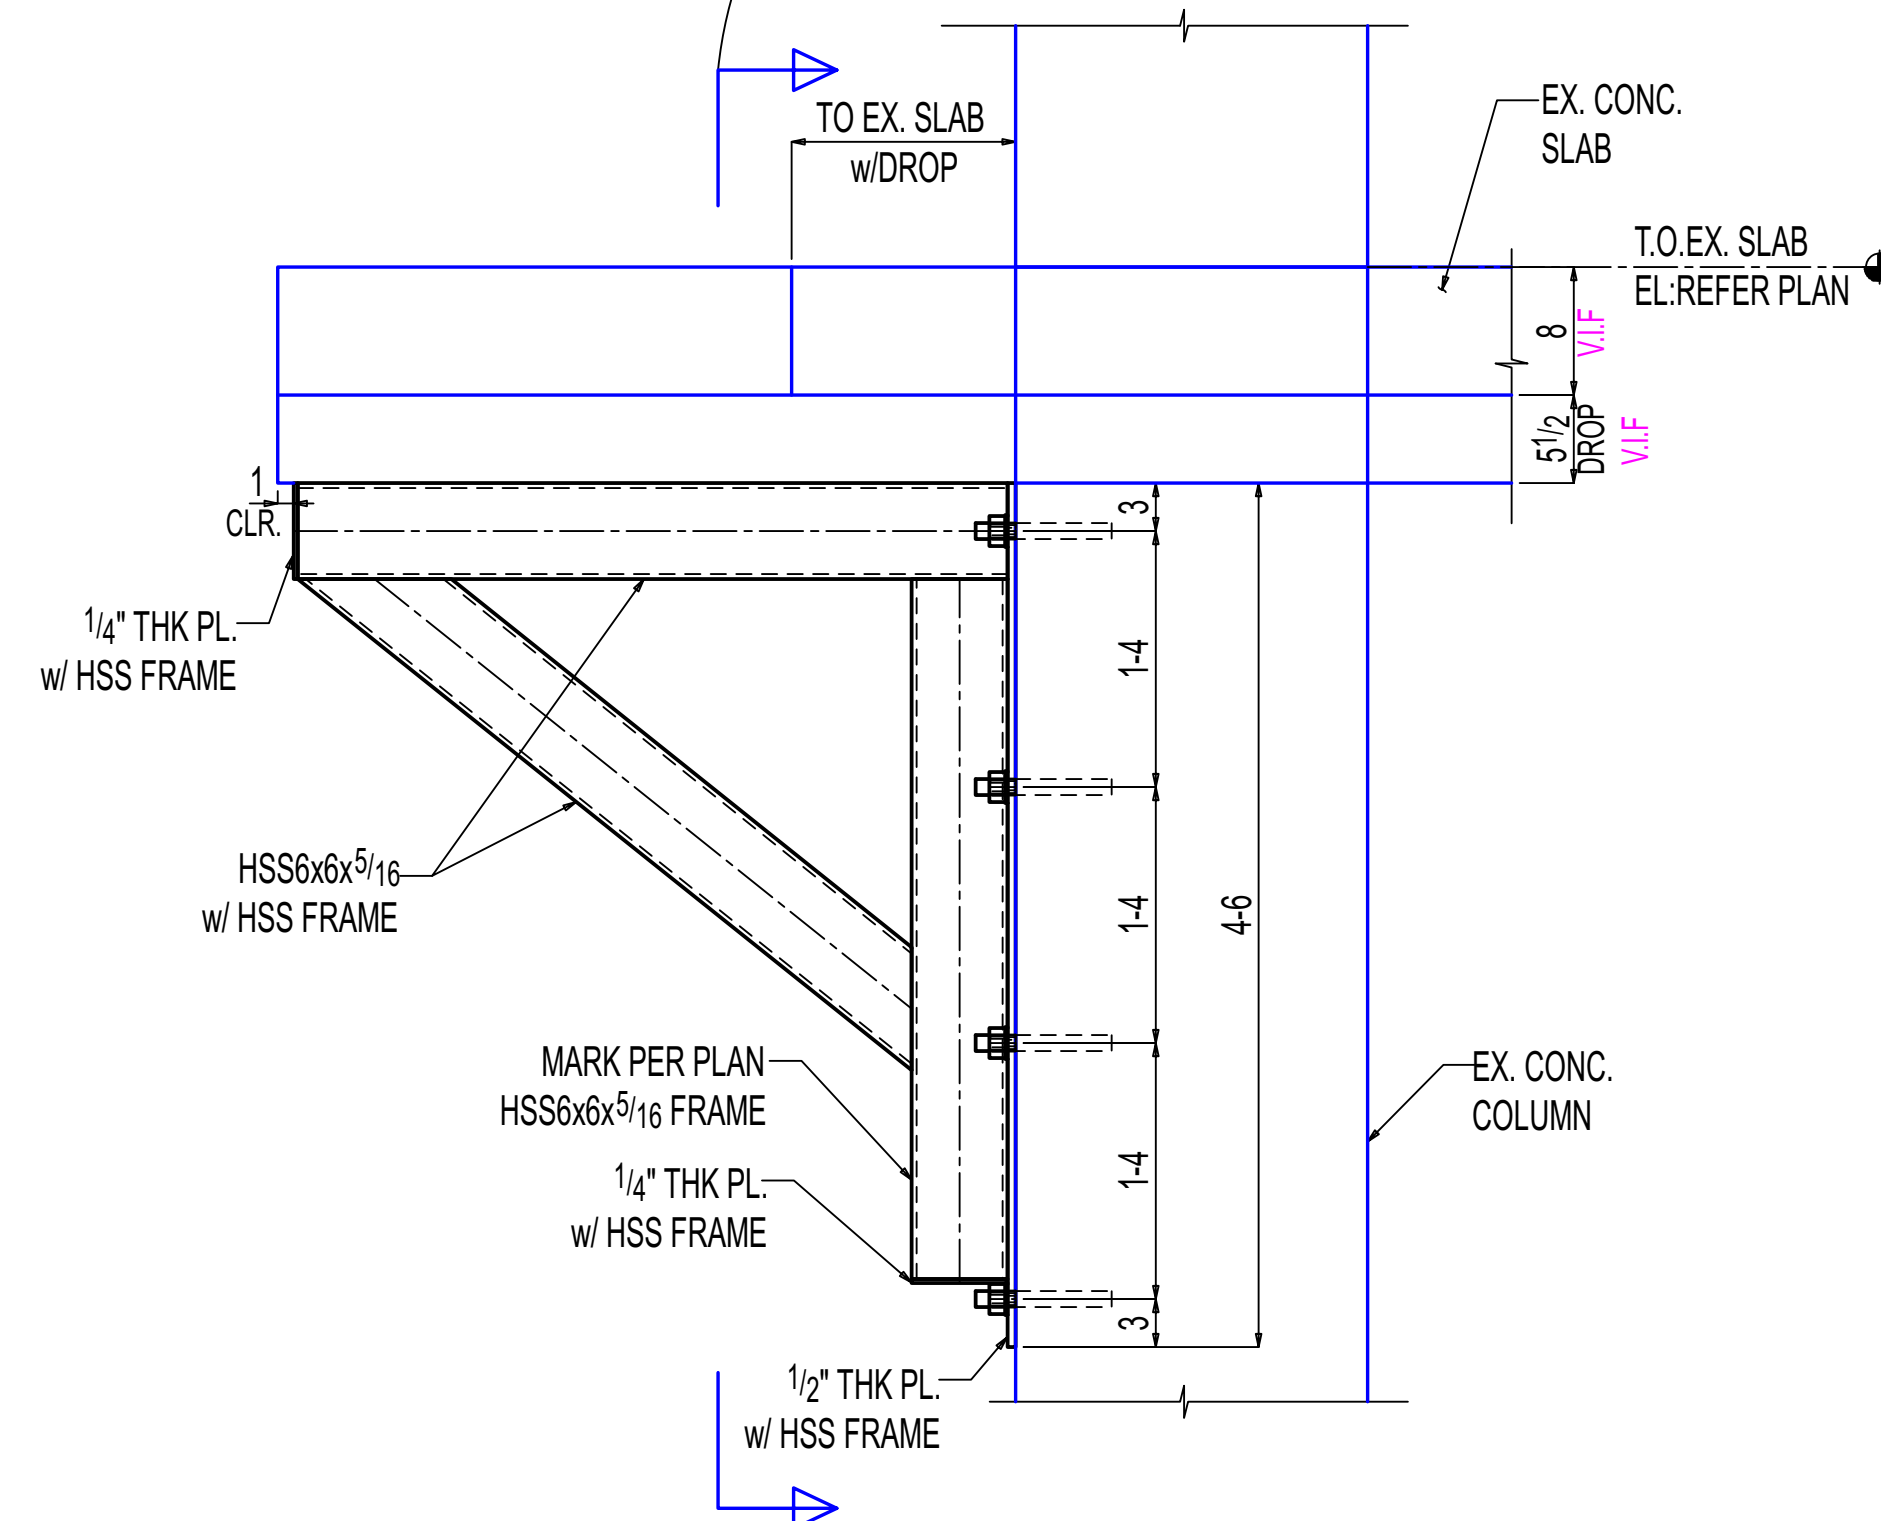

OTHERS NOT SHOWN FOR CLARITY

OTHERS NOT SHOWN FOR CLARITY

Date 01/ 20/ 2025	Drawing Title: SOW #09 LEVEL-03 NEW SLAB EXTENSION SUPPORT SECTIONS
Scale VARIES	