



ERECTOR NOTE:
1"NSx6" WIDTH GROUT @ PRECAST BEARING POINT ONLY
CO-ORDINATE BEARING POINT LOCATION WITH
PRECAST MANUFACTURER.

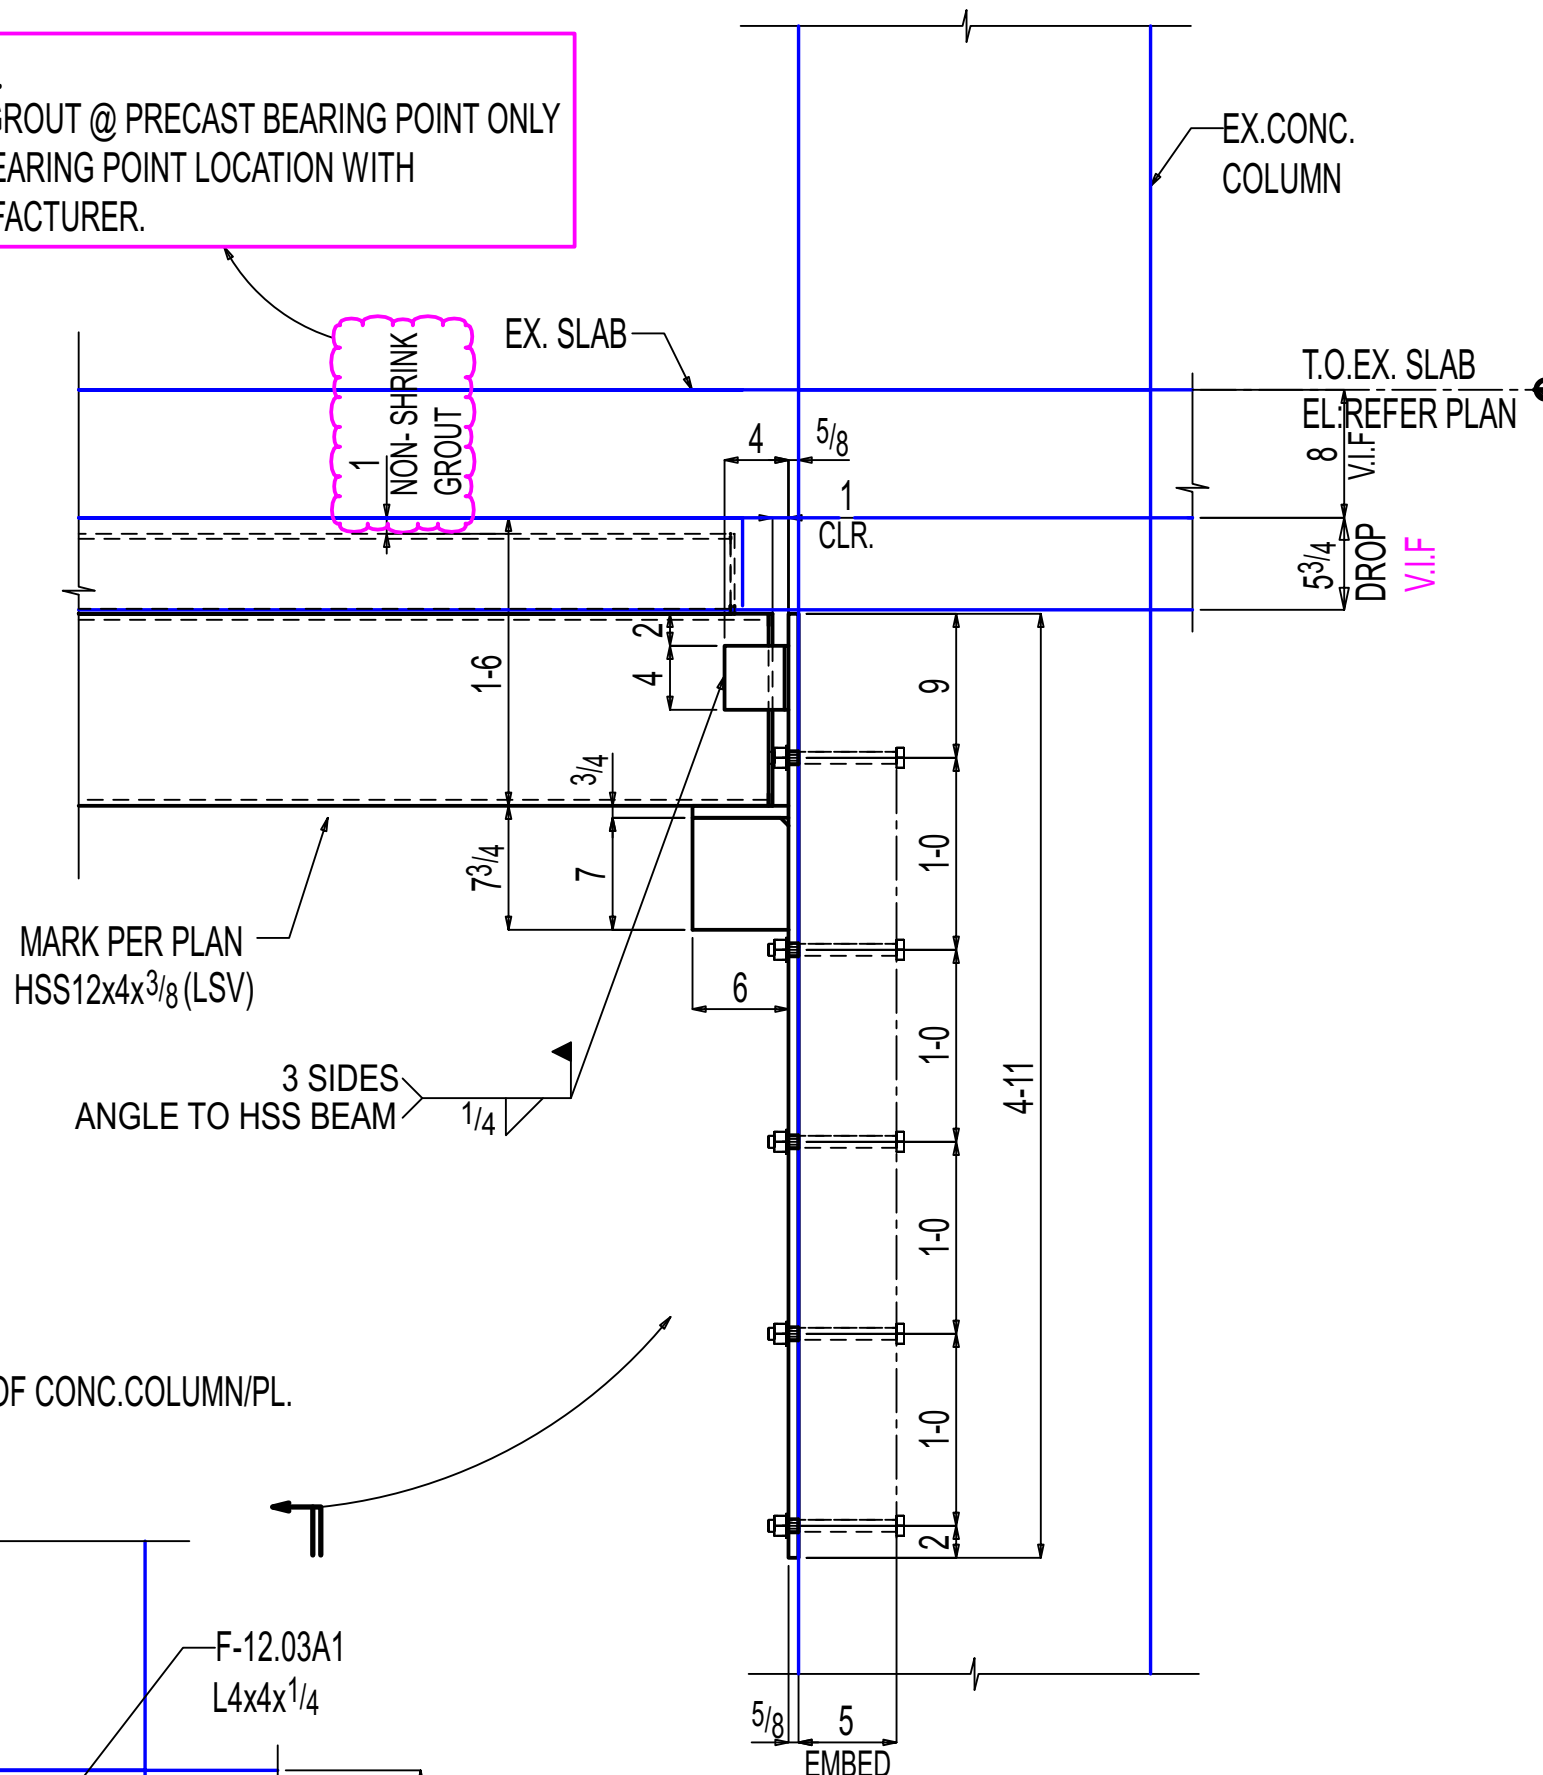


NOTE:
FILLER SIZE AND REQUIREMENT WILL BE
FINALIZED AFTER FIELD MEASUREMENT.

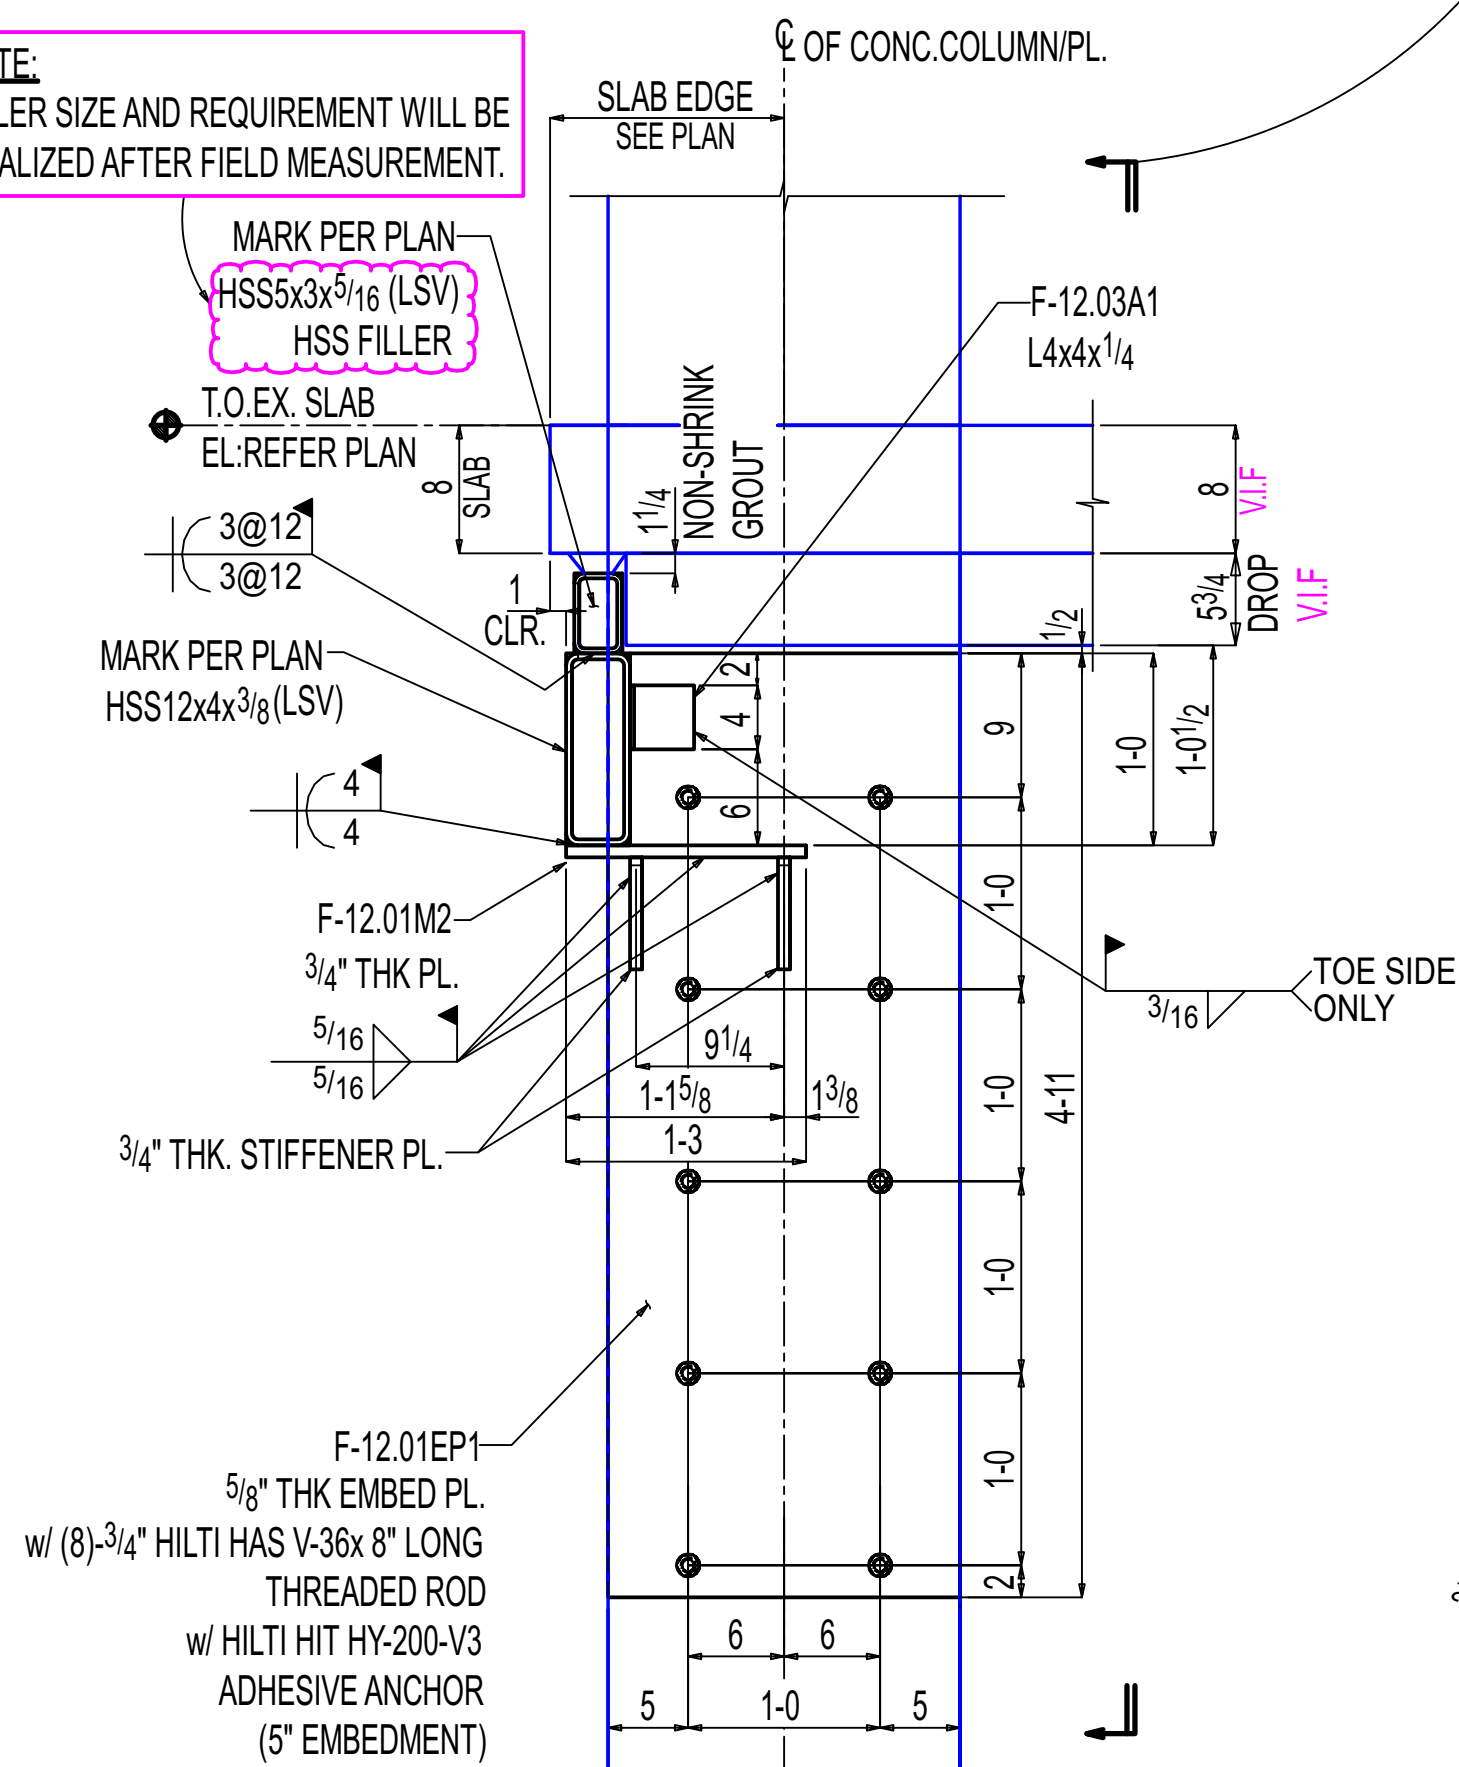


G-G
E-12.00
(REF:1/S316)

OTHERS NOT SHOWN FOR CLARITY

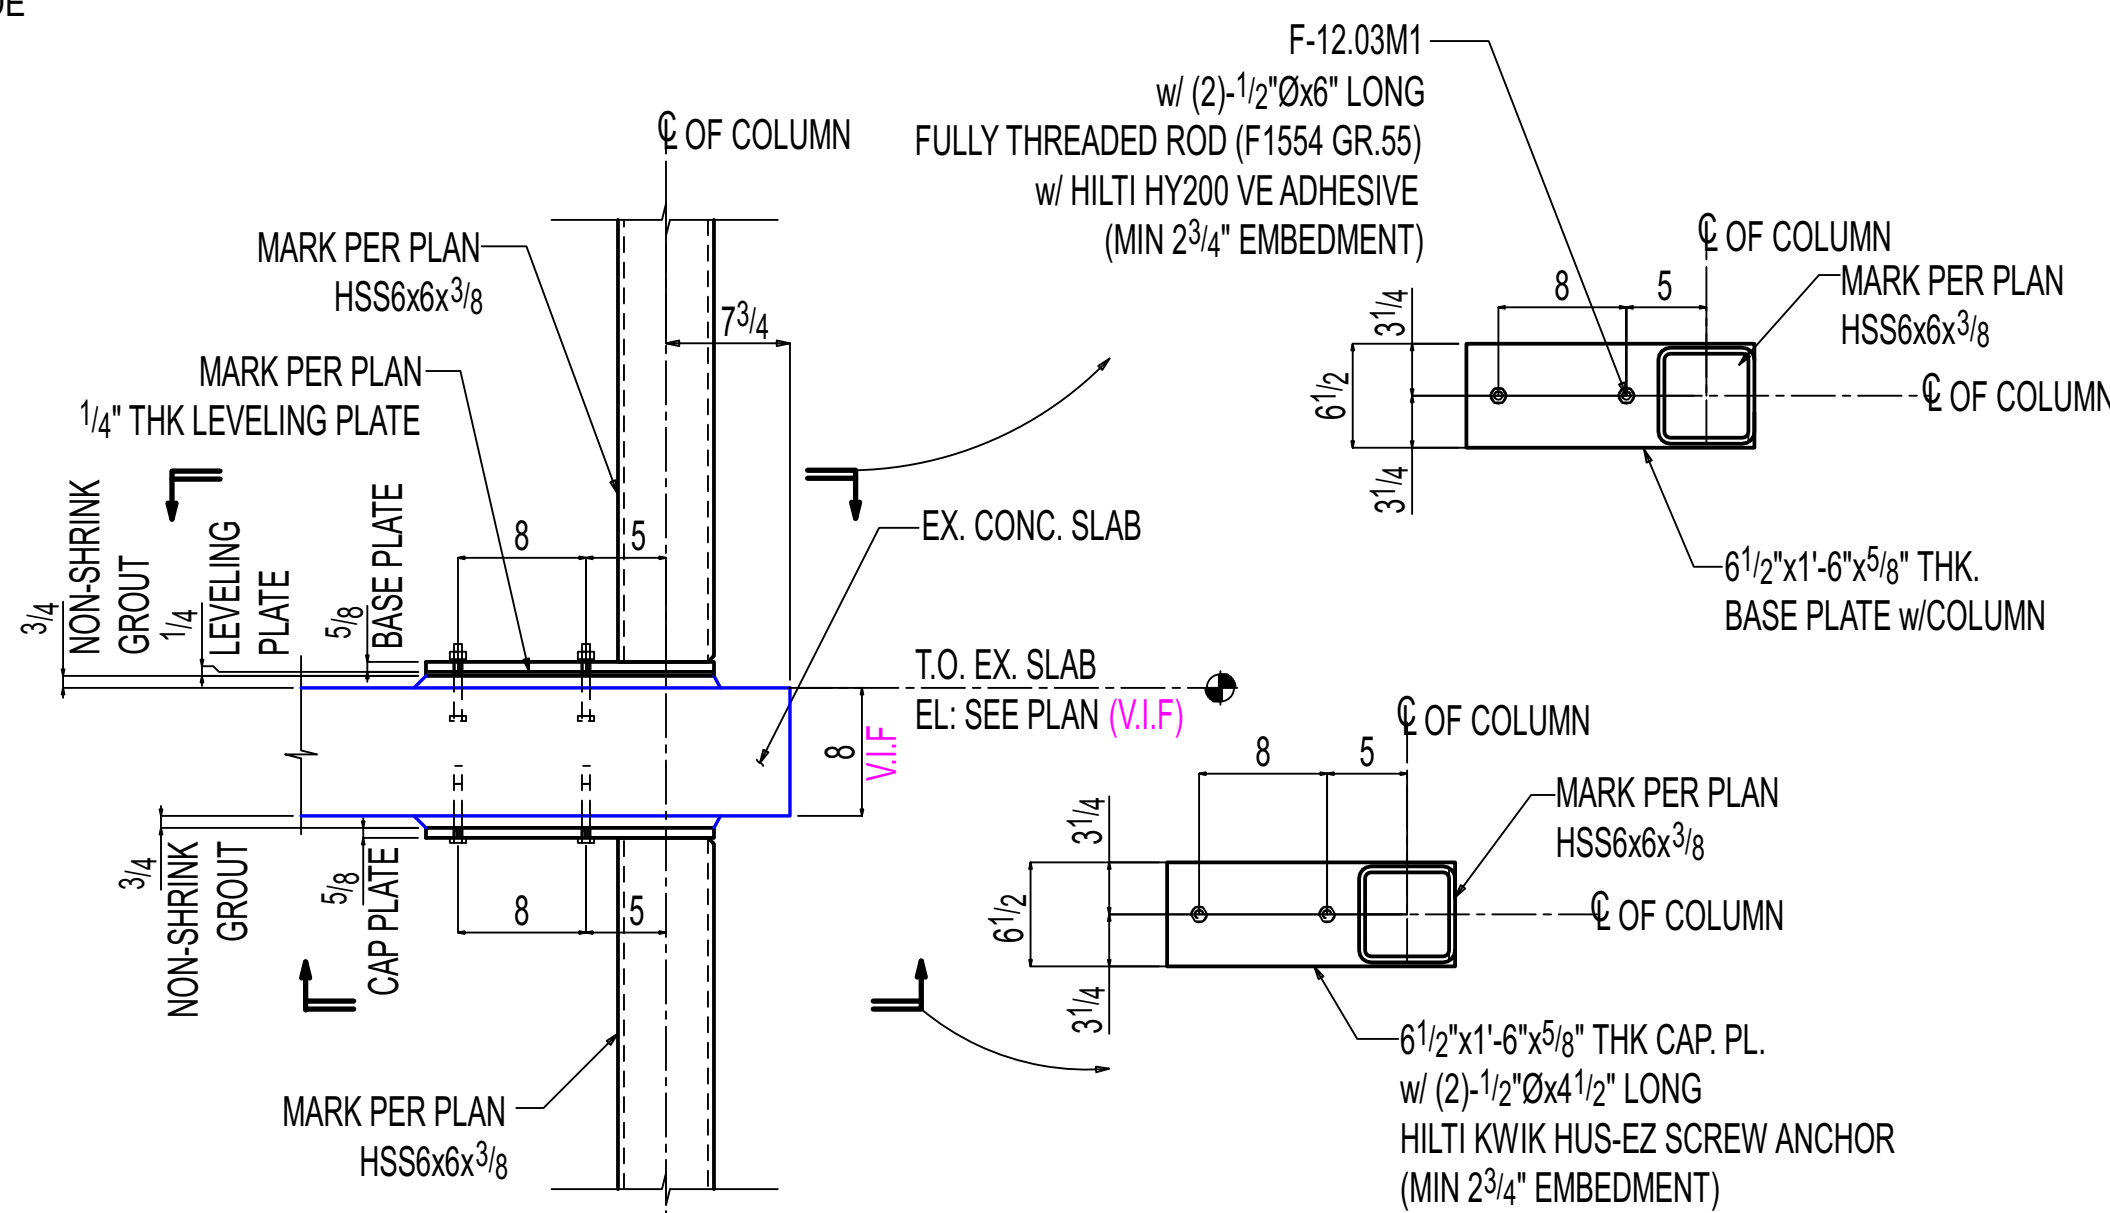

H-H
E-12.00
(REF:1/S317)

OTHERS NOT SHOWN FOR CLARITY

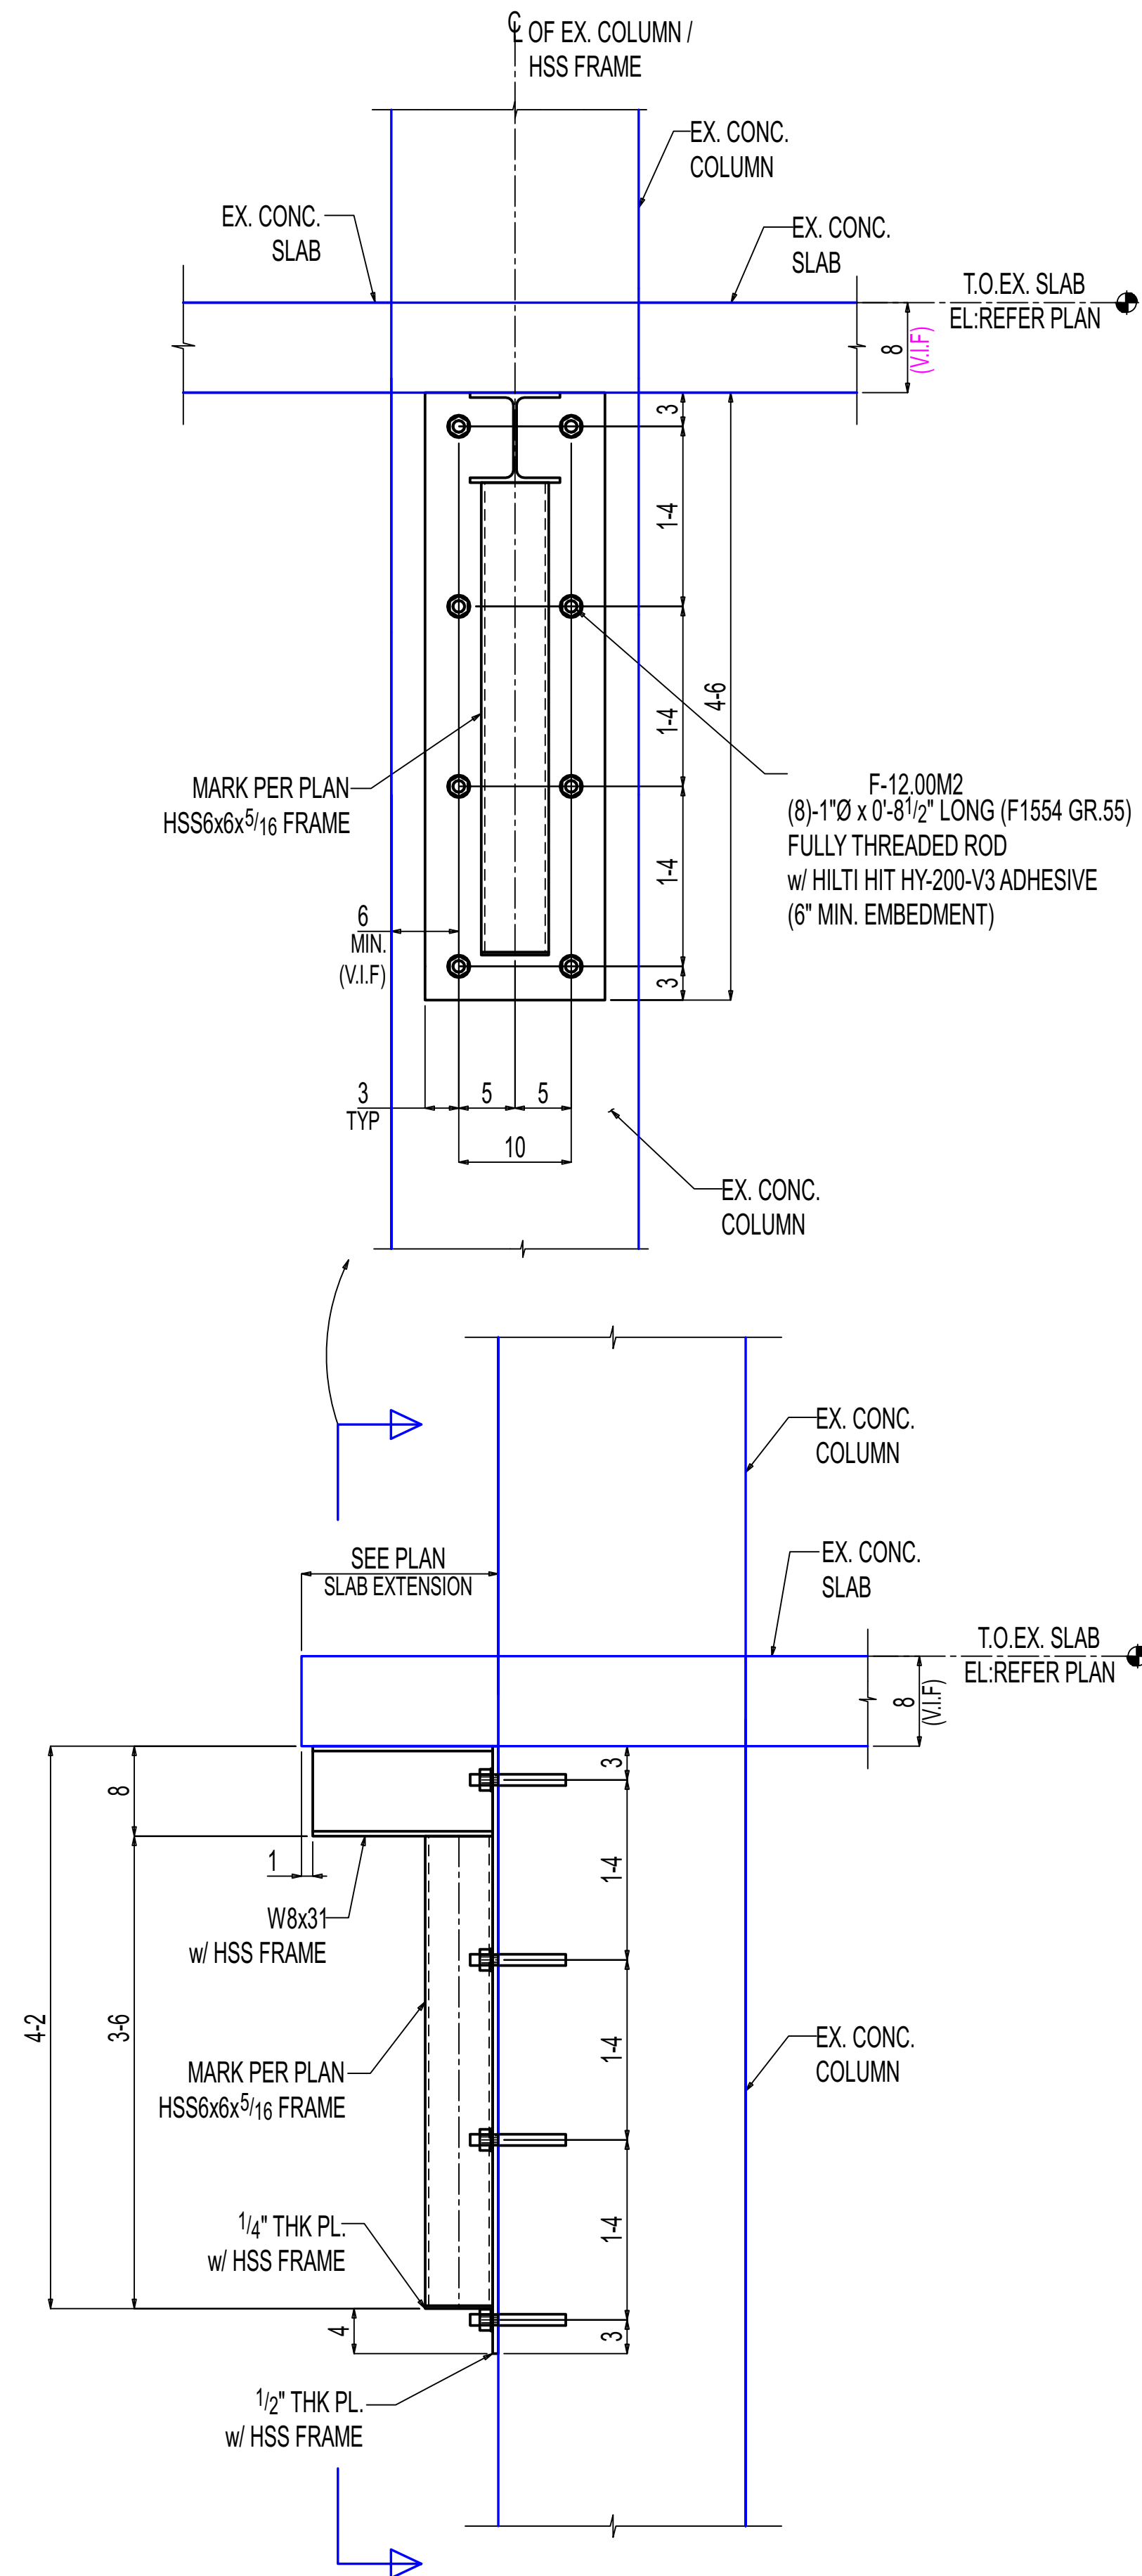

J-J
E-12.00
(REF:10/S314)

(NEW SLAB EXTENSION SUPPORT 1'-6" TO 3'-1")

OTHERS NOT SHOWN FOR CLARITY

General Notes

- *Structural steel shall conform to ASTM-A992.
- *Structural SQR/RND tubing conform to ASTM A500 Grade C
- *Pipe shall conform to ASTM A53, Grade B.
- *Channels, Angles and plates shall conform to A36.
- *All bolts shall be 3/4" High strength in accordance with ASTM A325 (UNO)
- *Welding Electrodes for Carbon steel :E70xx

# of Copies	Revision/ Issue	Destination	Date
3	0	For Construction	11-14-2025
2	B	For Re-Approval	10-24-2025
1	A	For Approval	09-19-2025

IRON FABRICATION SERVICES, LLC.

3029 M. Street, NW, Suite 202
Washington, DC 20007
Tel: 202-800-5599
Fax: 202-478-0303

Project Name and Address

MARYLAND AVENUE
Location: **1250 MARYLAND AVENUE SW**
WASHINGTON, DC 20024

Contractor:

BALFOUR BEATTY

Approved for Fabrication by:

Signature

Contract # **224009**

Drawing # **E-12.03**

Contract Item: **LEVEL-06**
SLAB EXTENSION

Ref: **SOW-12: 3,4,5&6 / S307**

Date

01/20/2025

Scale

VARIES

Drawing Title:

SOW #12 LEVEL-06 NEW
SLAB EXTENSION SUPPORT
SECTIONS

SHOP / ERECTOR NOTE:
LOCATE EXISTING REBAR PRIOR TO FABRICATION OF PLATE.
DO NOT DRILL THROUGH REBAR.