
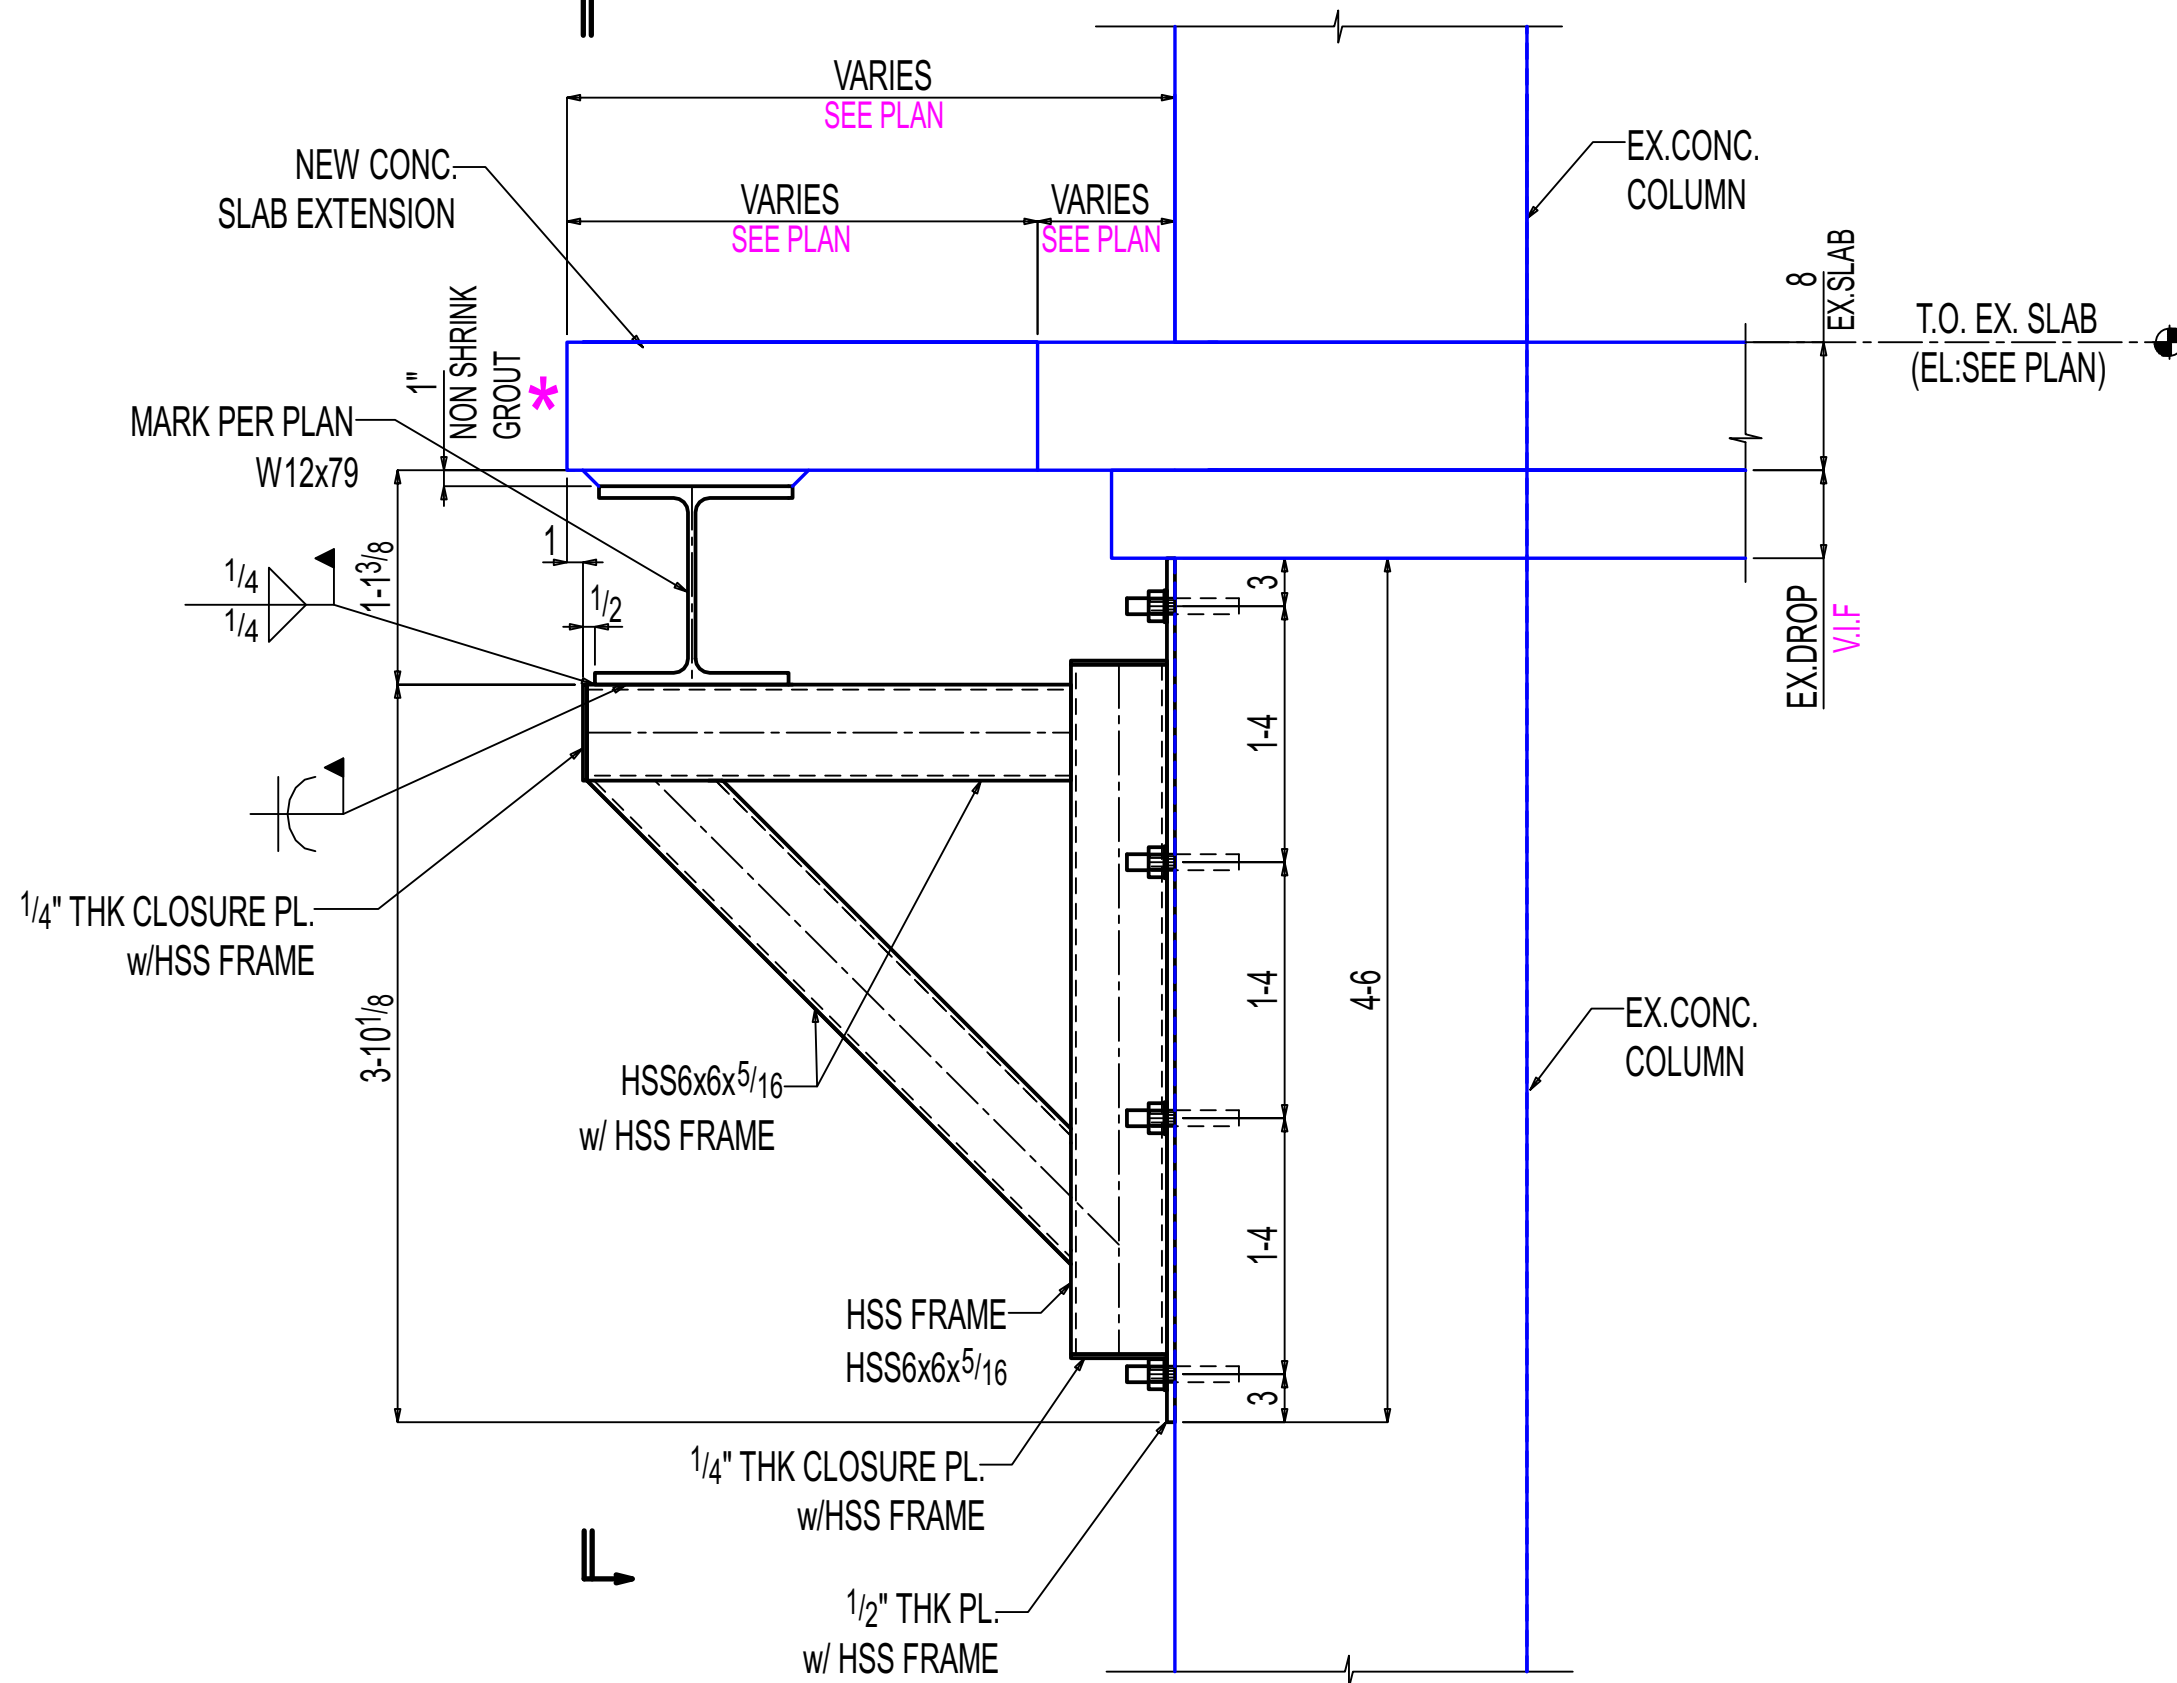


* - ERECTOR NOTE:
PROVIDE 1" NON-SHRINK GROUT x 12" LONG
CENTERED BENEATH AT PRECAST
ATTACHMENT POINTS.

ERECTOR NOTE:
FIELD TRIM AS REQUIRED AT CLOUDED BEAM END.

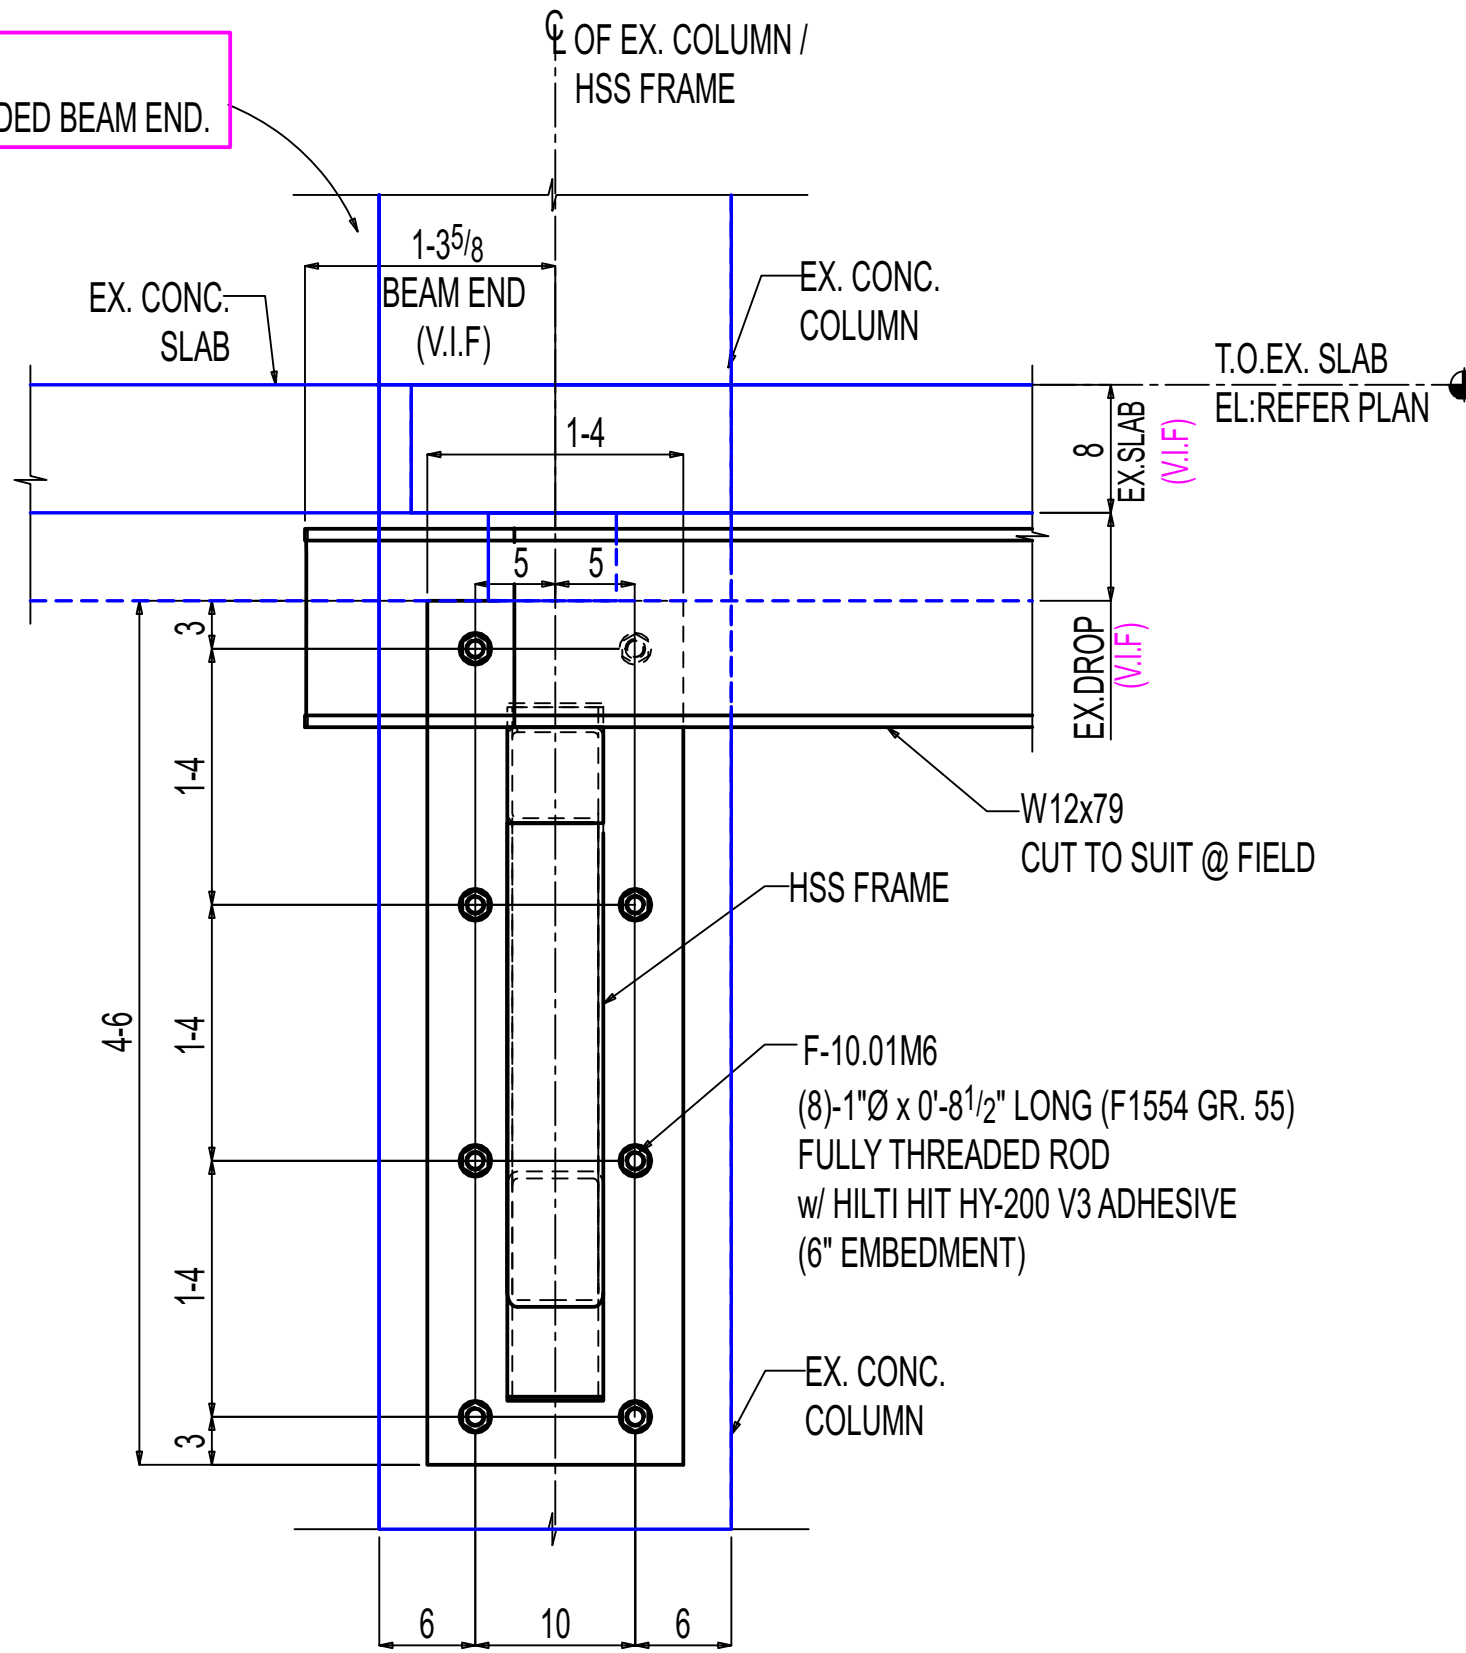



D-D

E-10.00

(REF: 13 & 14/S312)

OTHERS NOT SHOWN FOR CLARITY

SHOP / ERECTOR NOTE:
LOCATE EXISTING REBAR PRIOR TO FABRICATION OF PLATE.
DO NOT DRILL THROUGH REBAR.

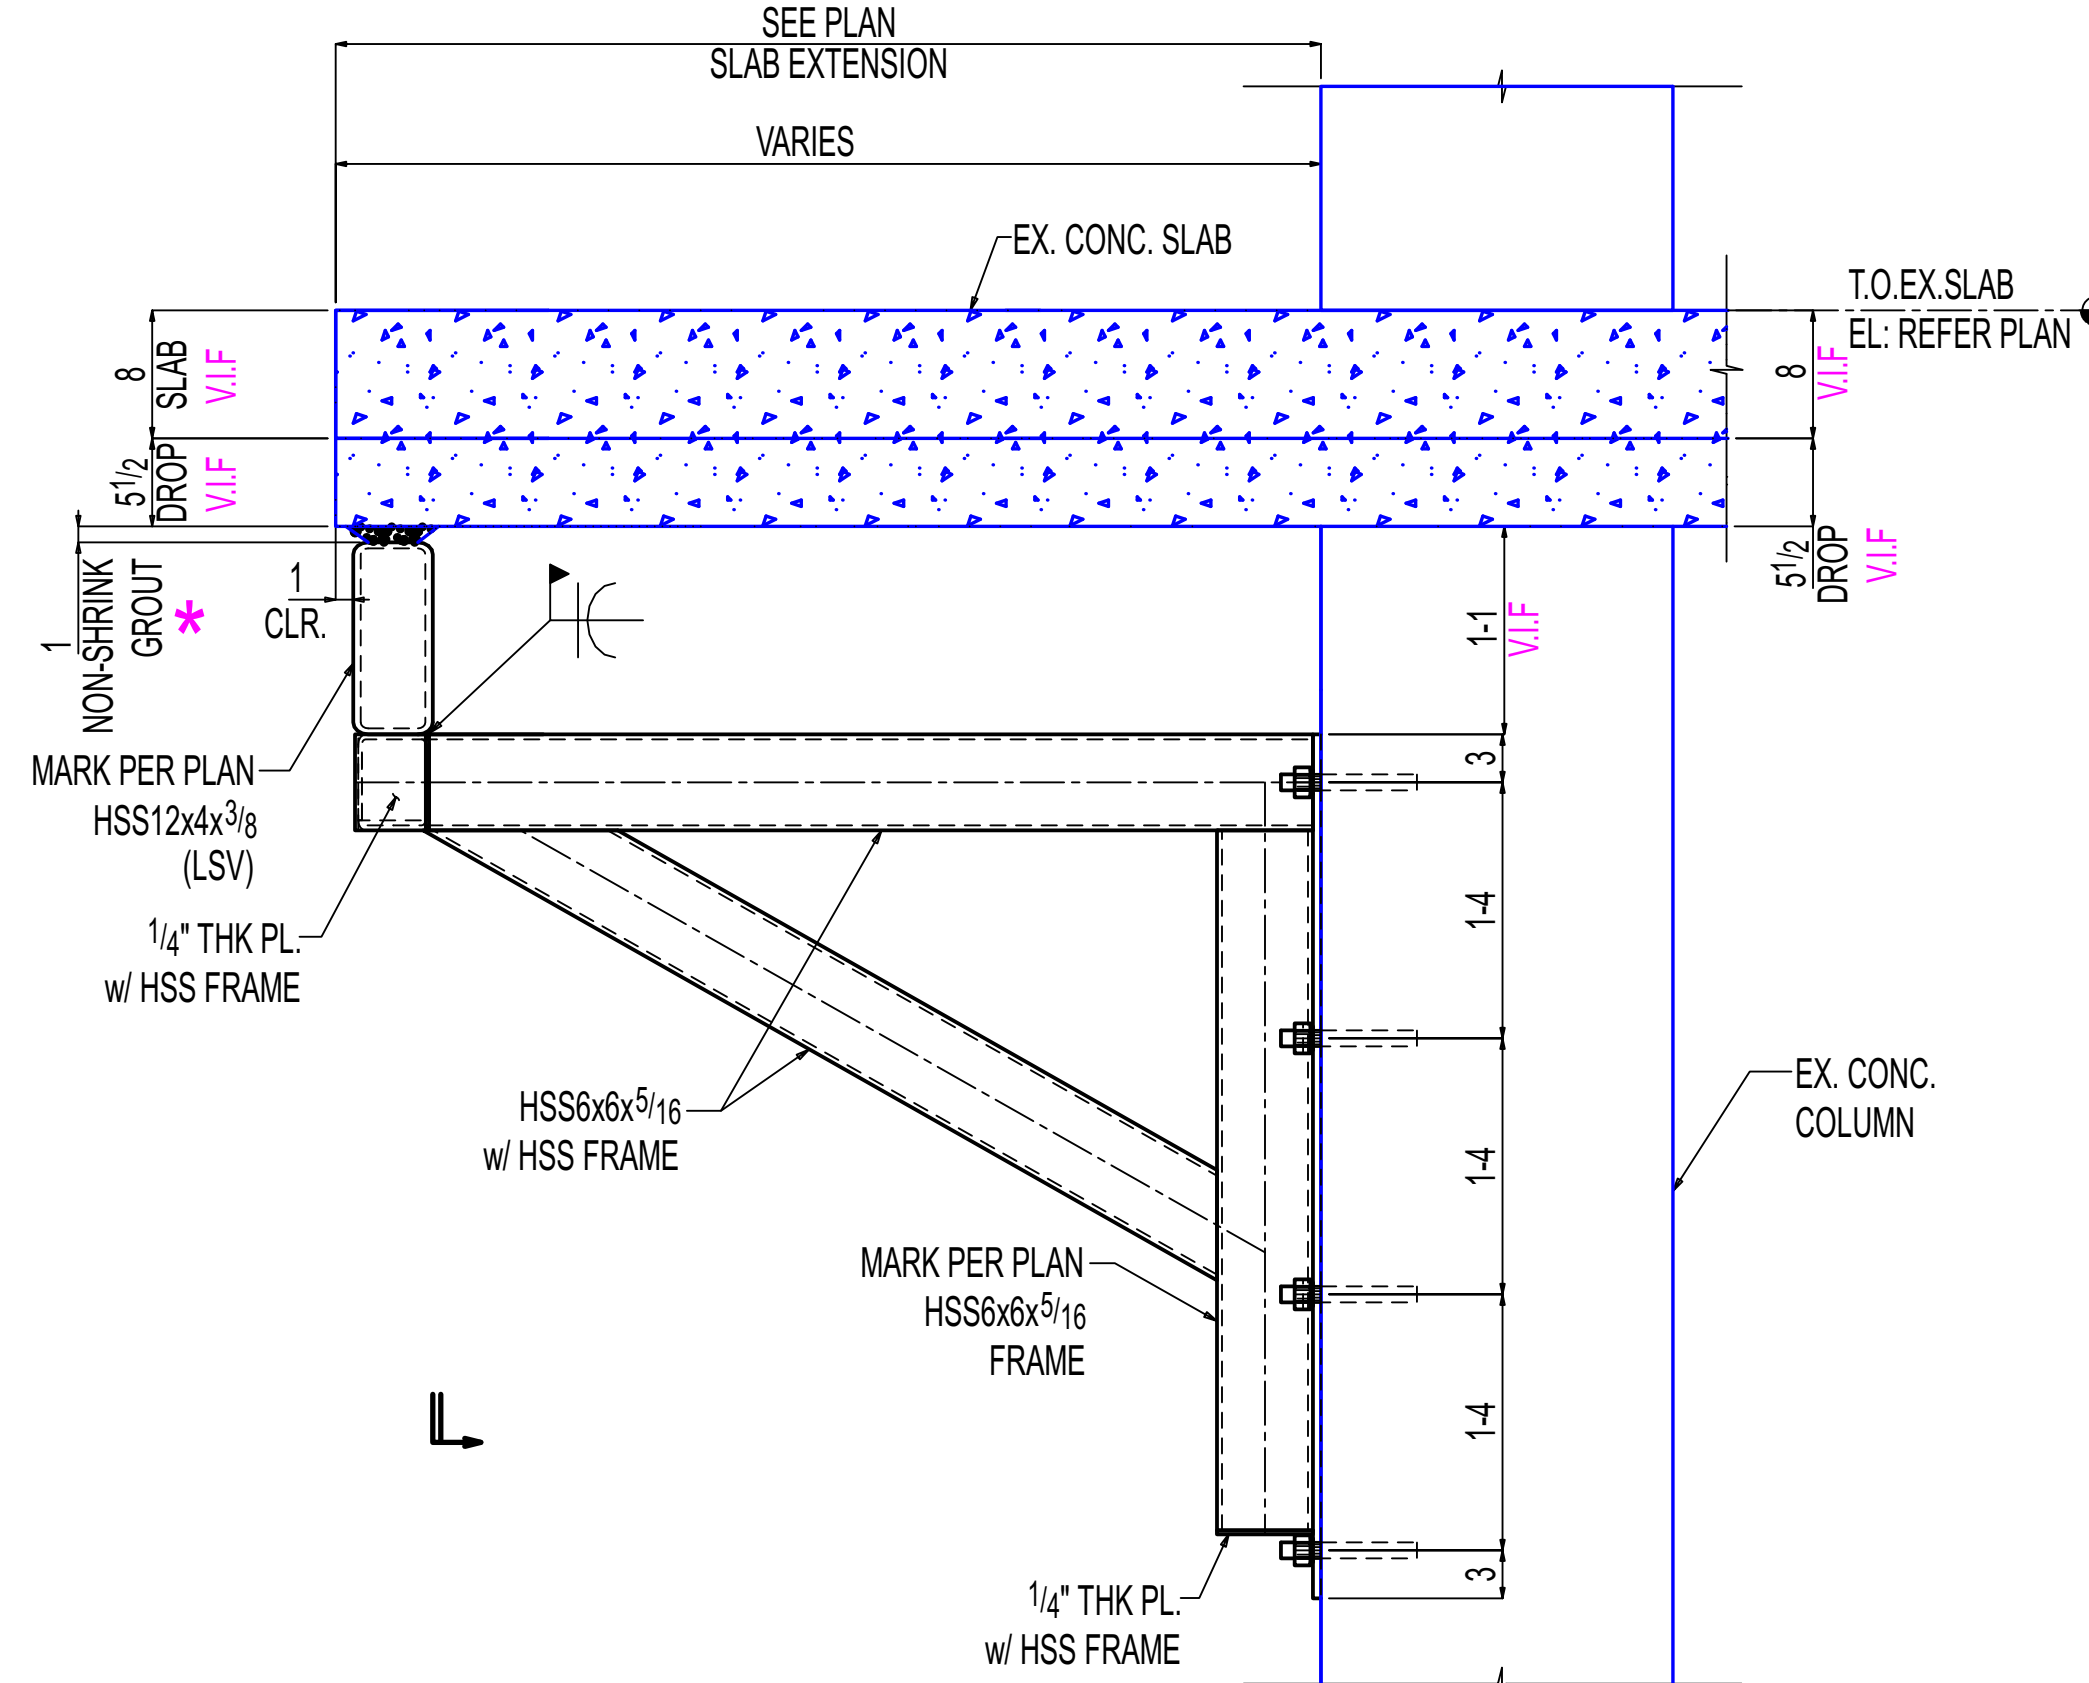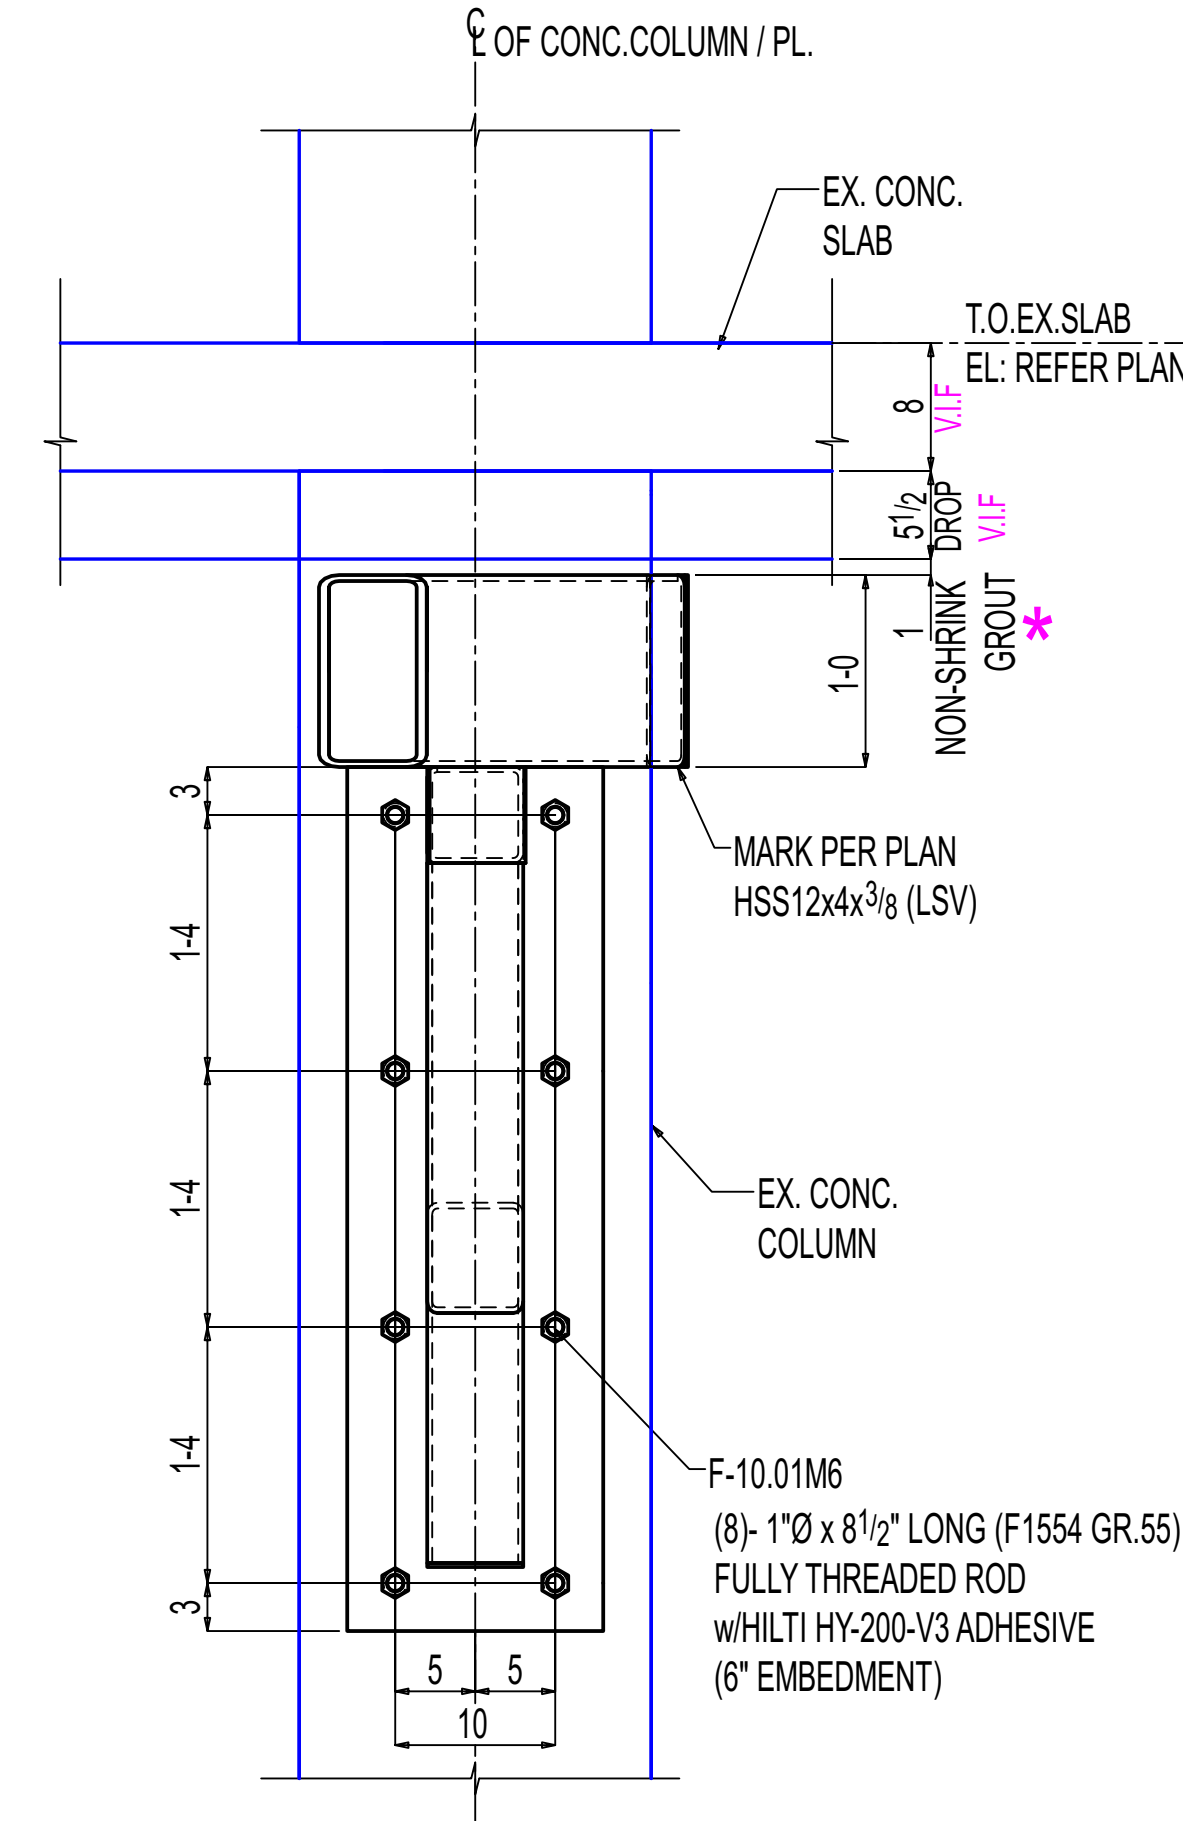

F-F

E-10.00A

(REF: 6/S316)

OTHERS NOT SHOWN FOR CLARITY

General Notes

- *Structural steel shall conform to ASTM-A992.
- *Structural SQR/RND. tubing conform to ASTM A500 Grade C
- *Pipe shall conform to ASTM A53, Grade B.
- *Channels, Angles and plates shall conform to A36.
- *All bolts shall be 3/4" High strength in accordance with ASTM A325 (UNO)
- *Welding Electrodes for Carbon steel :E70xx

# of Copies	Revision/ Issue	Destination	Date
5	0	For Construction	11-14-2025
4	D	For Re-Approval	10-24-2025
3	C	For Re-Approval	09-19-2025
2	B	For Re-Approval	06-23-2025
1	A	For Approval	02-25-2025

IRON FABRICATION SERVICES, LLC.

3029 M. Street, NW, Suite 202
Washington, DC 20007
Tel: 202-800-5599
Fax: 202-478-0303

Project Name and Address

MARYLAND AVENUE

Location: **1250 MARYLAND AVENUE SW
WASHINGTON, DC 20024**

Contractor:

BALFOUR BEATTY

Approved for Fabrication by:

Signature

Contract # **224009**

Drawing # **E-10.02**

Contract Item: **LEVEL-04
SLAB EXTENSION**

Ref: **SOW-10: 3,4,5&6 / S307**

Date

01/20/2025

Drawing Title:

**SOW #10 LEVEL-04 NEW
SLAB EXTENSION SUPPORT
SECTIONS**

Scale

VARIES