
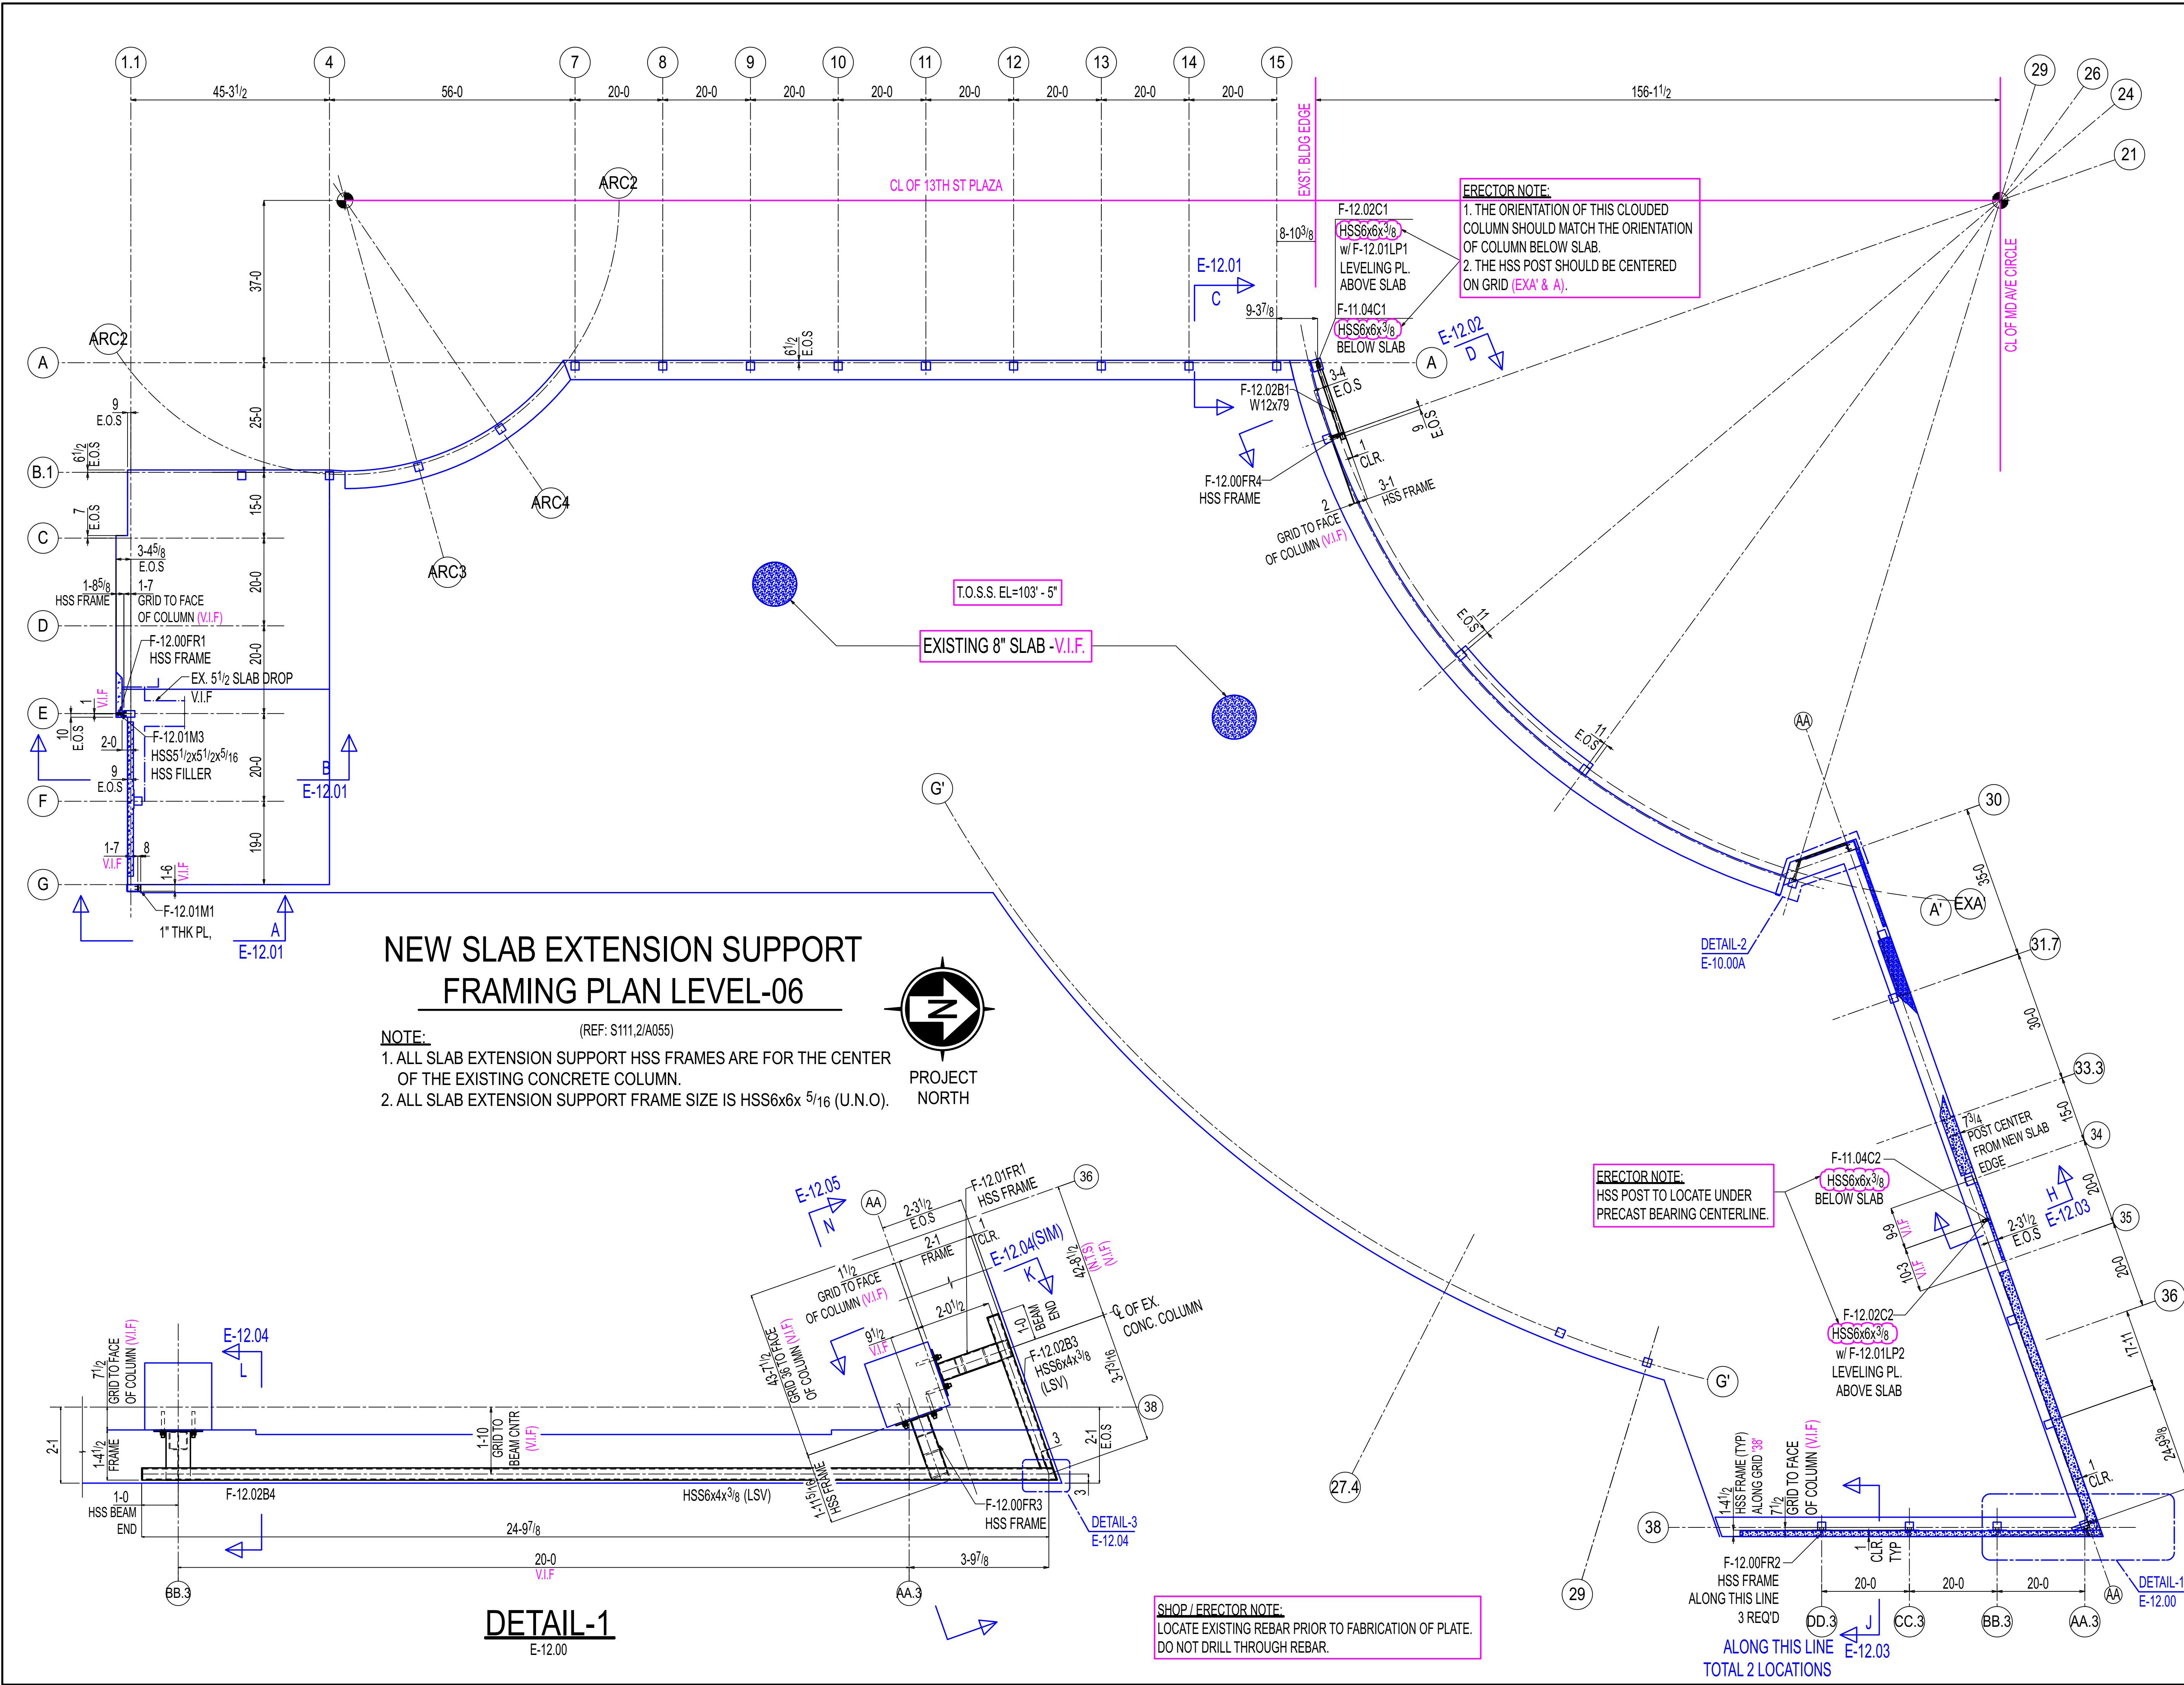


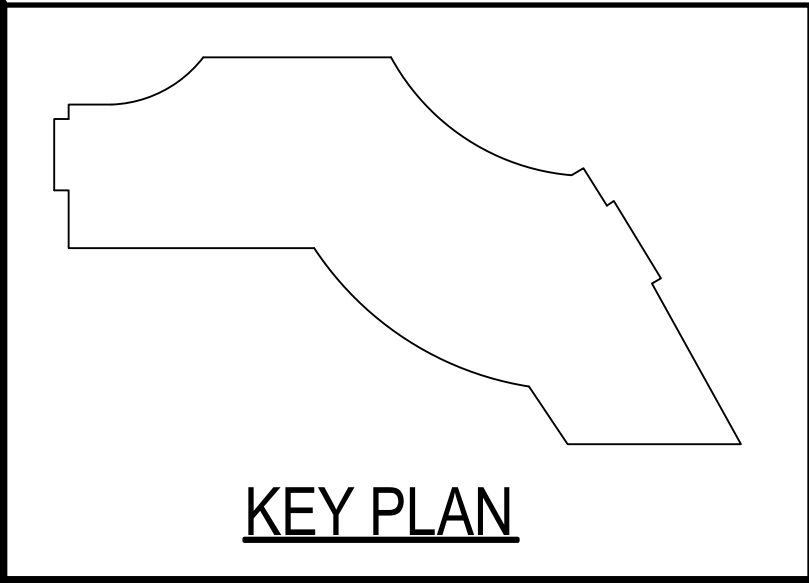

**General Notes**

- \*Structural steel shall conform to ASTM-A992.
- \*Structural SQR/RND tubing conform to ASTM A500 Grade C.
- \*Pipe shall conform to ASTM A53, Grade B.
- \*Channels, Angles and plates shall conform to A36.
- \*All bolts shall be 3/4" High strength in accordance with ASTM A325 (UNO).
- \*Welding Electrodes for Carbon steel :E70xx

| # of Copies | Revision/ Issue | Destination      | Date       |
|-------------|-----------------|------------------|------------|
| 5           | 0               | For Construction | 11-14-2025 |
| 4           | D               | For Re-Approval  | 10-24-2025 |
| 3           | C               | For Re-Approval  | 09-19-2025 |
| 2           | B               | For Re-Approval  | 06-23-2025 |
| 1           | A               | For Approval     | 02-25-2025 |

**IRON FABRICATION SERVICES, LLC.**

3029 M. Street, NW, Suite 202  
Washington, DC 20007  
Tel: 202-800-5599  
Fax: 202-478-0303

Project Name and Address  
**MARYLAND AVENUE**

Location: **1250 MARYLAND AVENUE SW  
WASHINGTON, DC 20024**

Contractor:  
**BALFOUR BEATTY**

Approved for Fabrication by: \_\_\_\_\_  
Signature

Contract # **224009**      Drawing # **E-12.00**

Contract Item: **LEVEL-06  
SLAB EXTENSION**

Ref: **SOW-12: (S111,2/A055)**

| Date       | Drawing Title:                                                          |
|------------|-------------------------------------------------------------------------|
| 01/20/2025 | <b>SOW #12 LEVEL-06 NEW<br/>SLAB EXTENSION SUPPORT<br/>FRAMING PLAN</b> |

Scale  
VARIES

SHOP/ERECTOR NOTE:  
LOCATE EXISTING REBAR PRIOR TO FABRICATION OF PLATE.  
DO NOT DRILL THROUGH REBAR.

ERECTOR NOTE:  
HSS POST TO LOCATE UNDER  
PRECAST BEARING CENTERLINE.

ERECTOR NOTE:  
1. THE ORIENTATION OF THIS CLOUDED  
COLUMN SHOULD MATCH THE ORIENTATION  
OF COLUMN BELOW SLAB.  
2. THE HSS POST SHOULD BE CENTERED  
ON GRID (EXA' & A).