

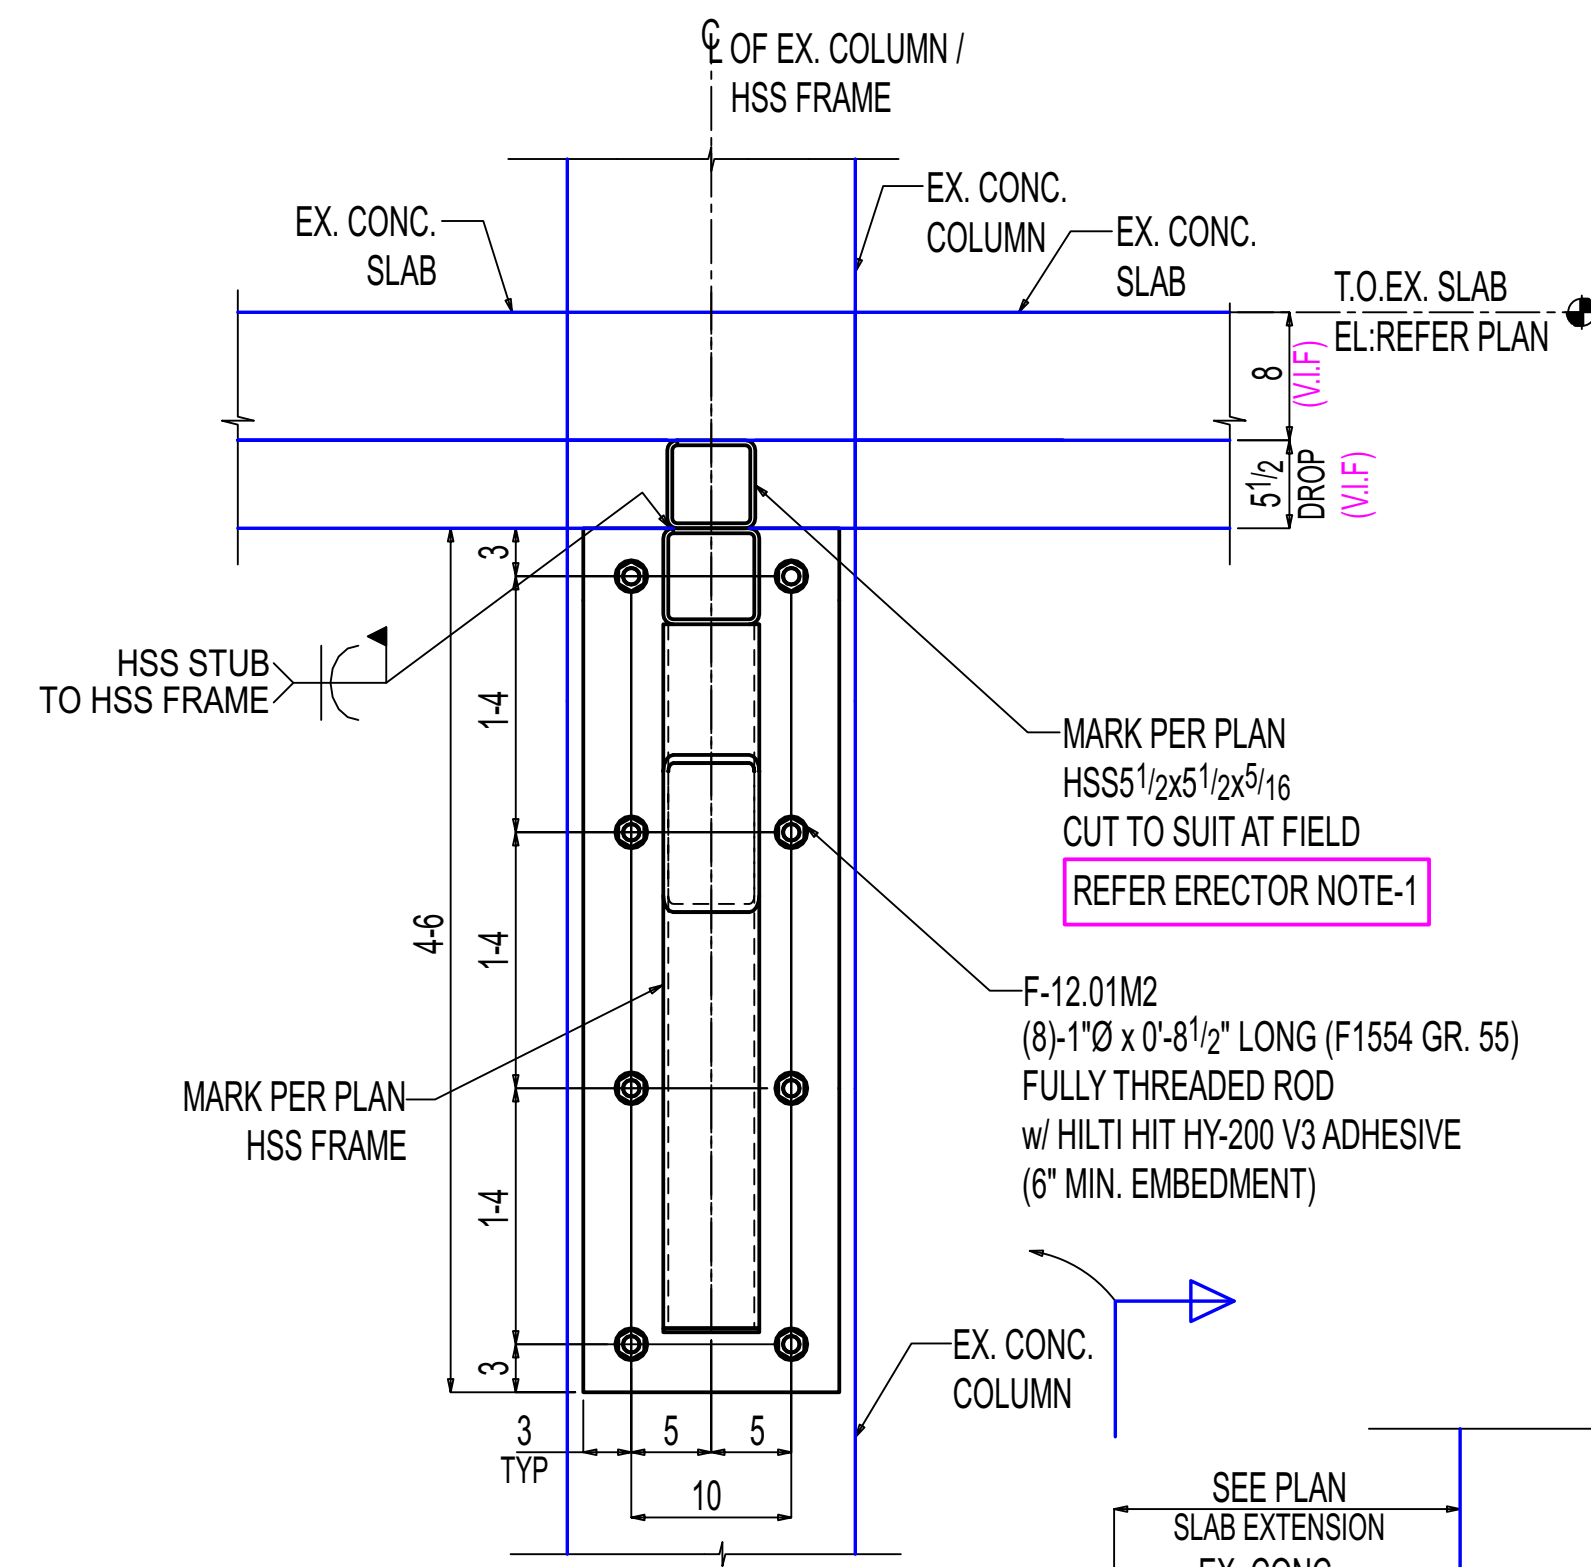
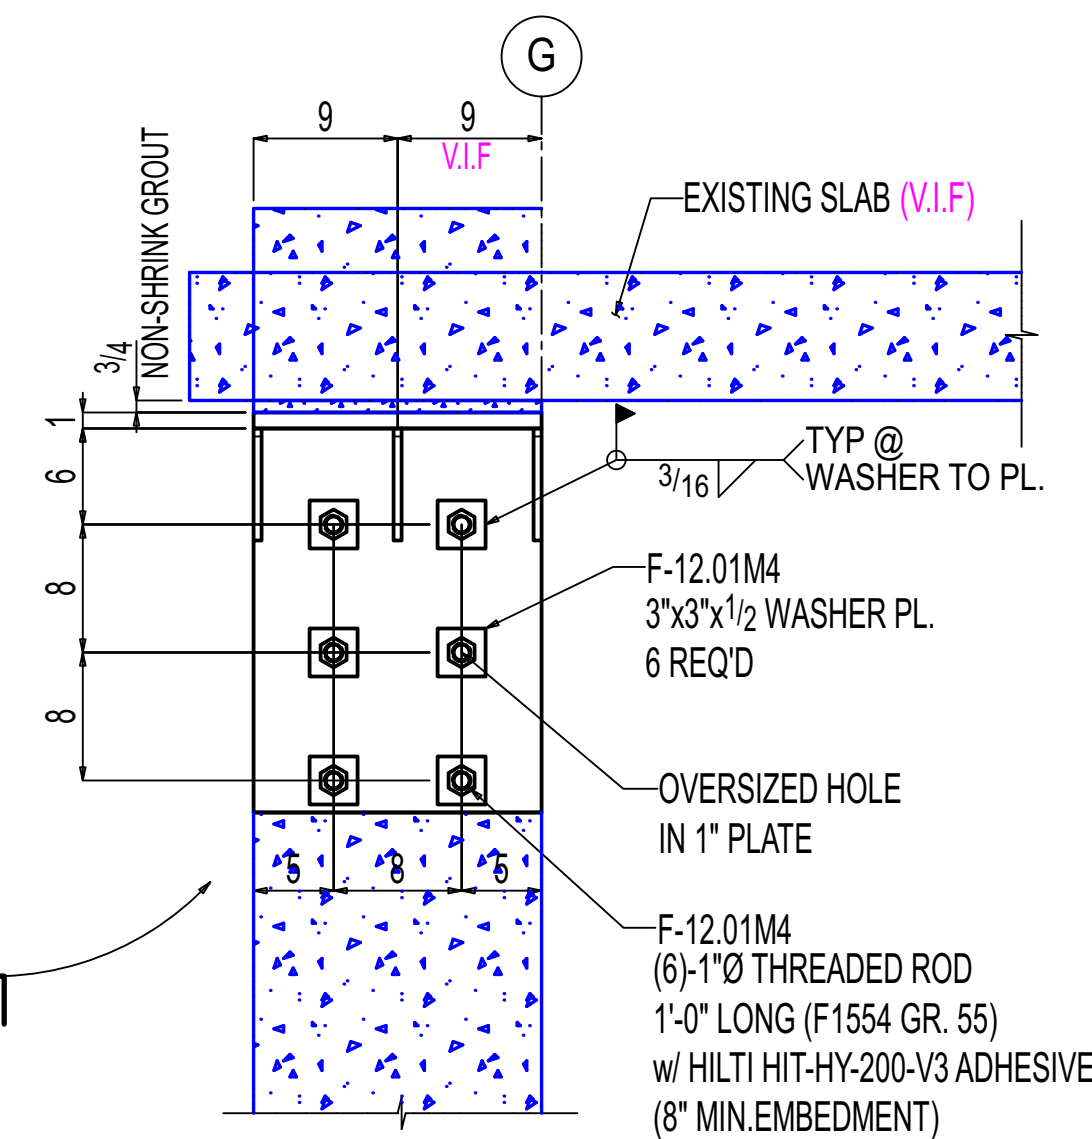




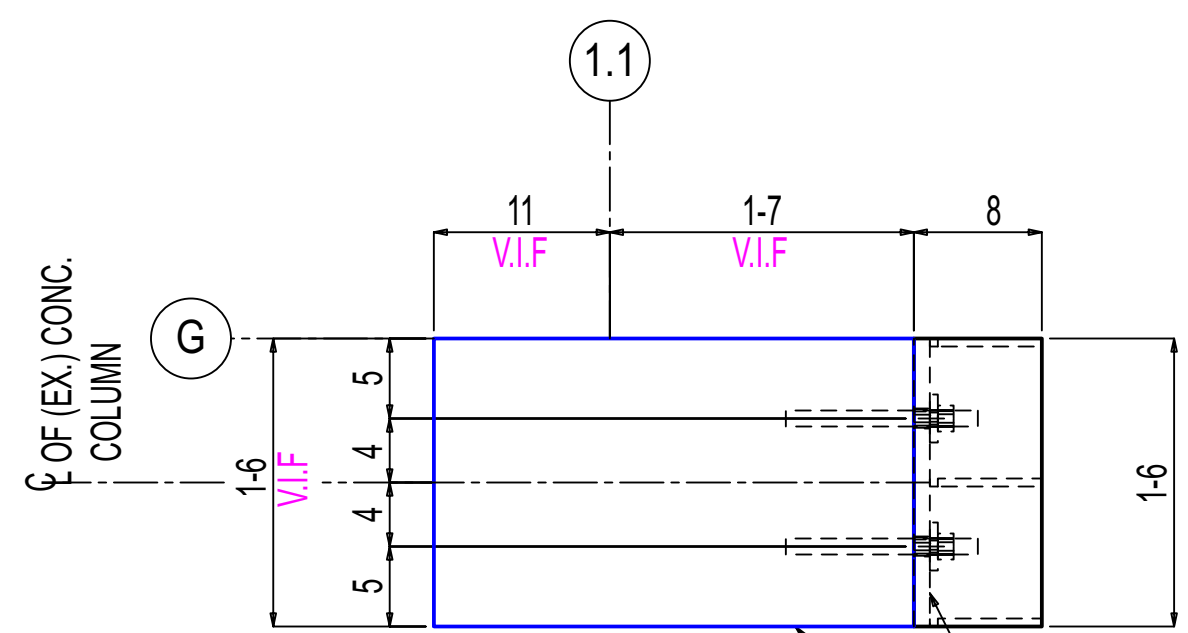


ERECTOR NOTE-1:
ADJUST HSS DEPTH IN FIELD BY CUT THE HSS TO MATCH EXISTING SLAB DROP THICKNESS, AND WELD TO THE TOP OF HSS FRAME AT SITE PRIOR TO EXISTING THE HSS FRAME.


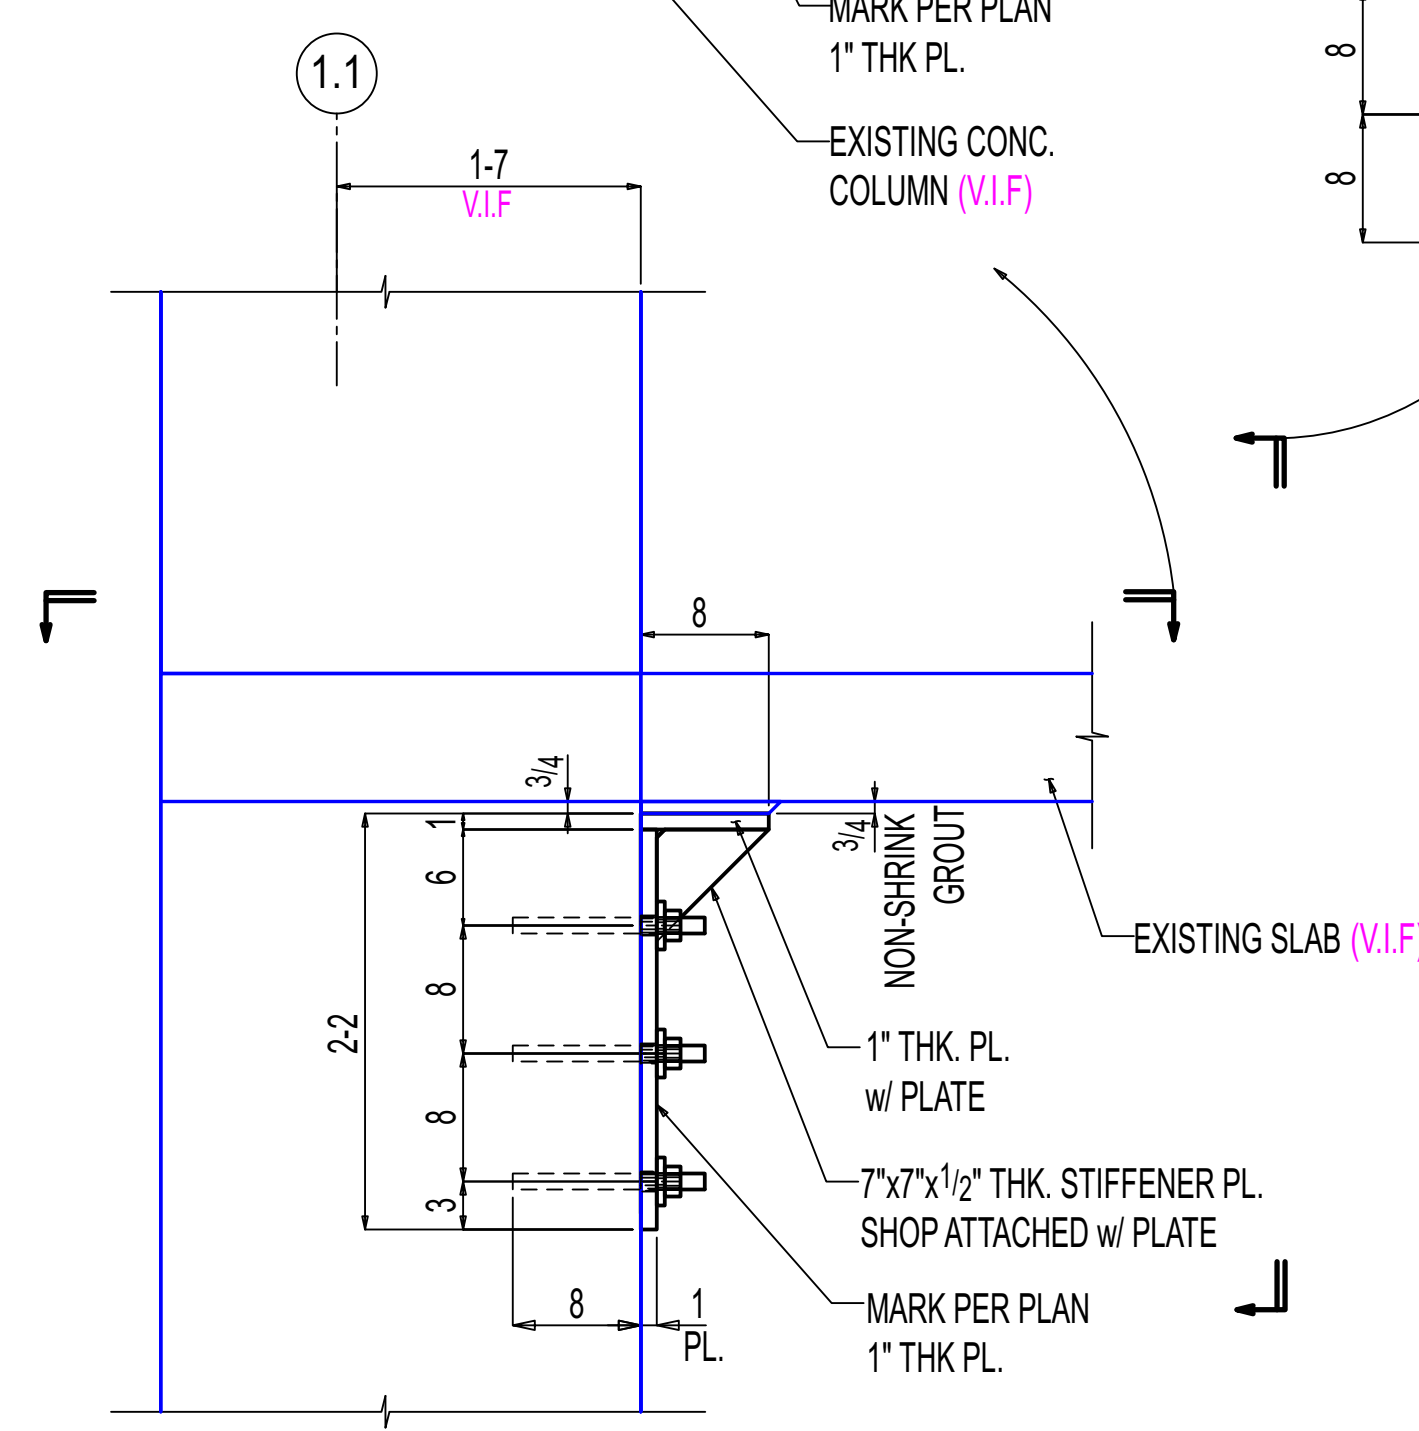


A-A
E-12.00
(REF:4/S317)
OTHERS NOT SHOWN FOR CLARITY

NOTE:
1. DO NOT CUT EXISTING REBAR WHEN DRILLING FOR NEW BOLTS. GPR CONCRETE TO LOCATE REBAR PRIOR TO FINAL STEEL FABRICATION AND DRILLING. SPACING OF HOLES SHALL BE COORDINATED BY CONTRACTOR WITH RGA FOR EXISTING FIELD CONDITIONS.
2. INSTALL WASHER PLATE SO TOP OF THREADED ROD IS IN BEARING WITH WASHER PRIOR TO WELDING AND NON-SHRINK GROUT PLACEMENT.
3. AFTER THREADED ROD IS INSERTED, PRESSURE INJECT DURAL 452LV OR APPROVED ALTERNATIVE FULL WIDTH OF COLUMN.

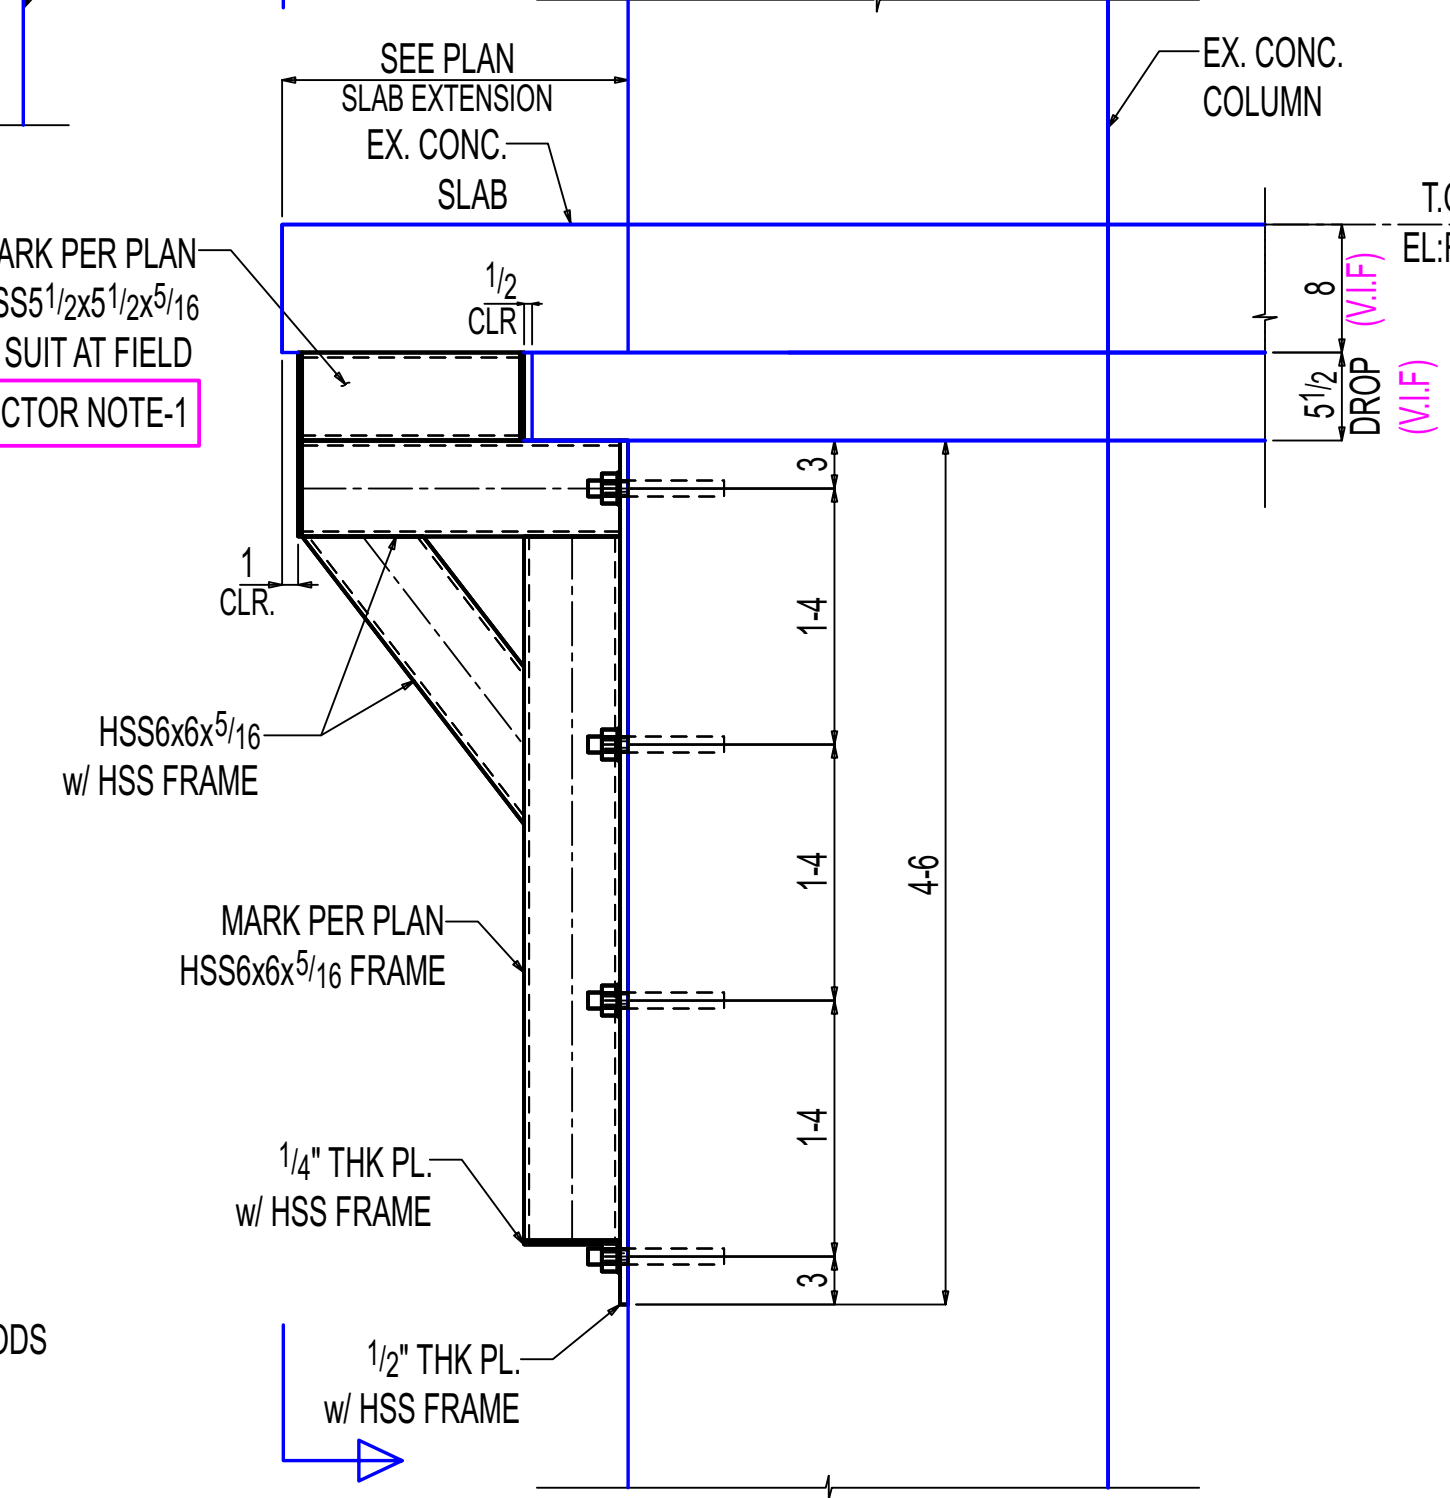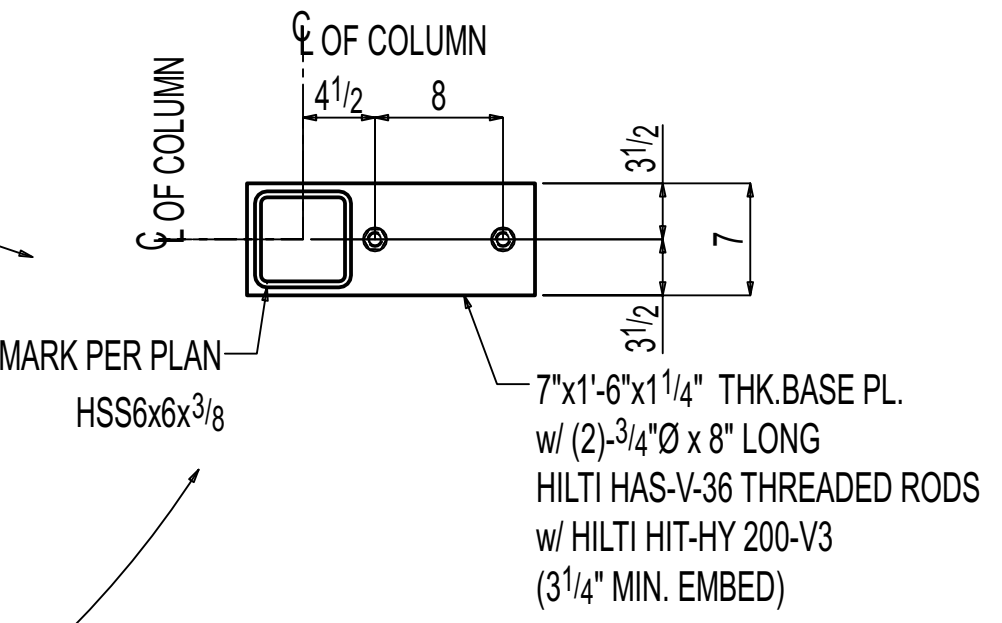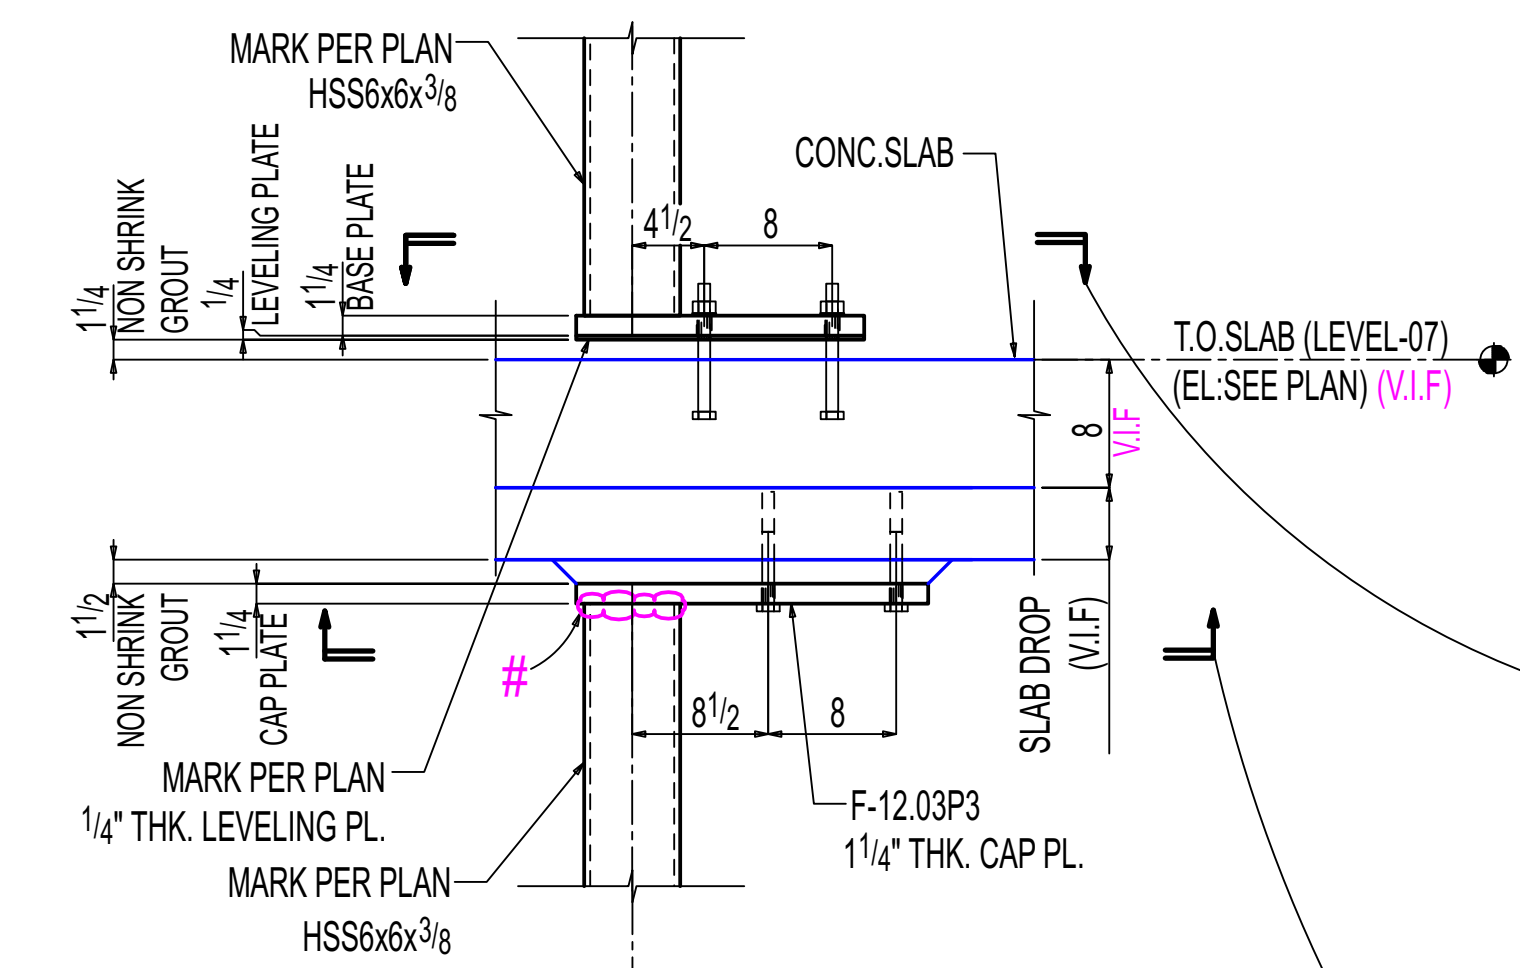

B-B
(NEW SLAB EXTENSION SUPPORT (1'-6" TO 3'-10"))
E-12.00
(REF:3/S307)
OTHERS NOT SHOWN FOR CLARITY

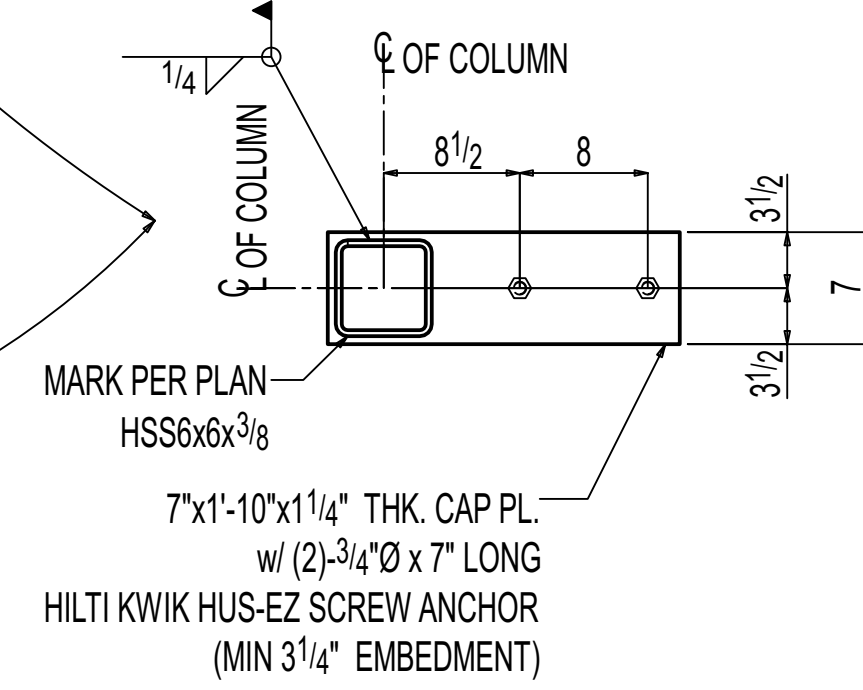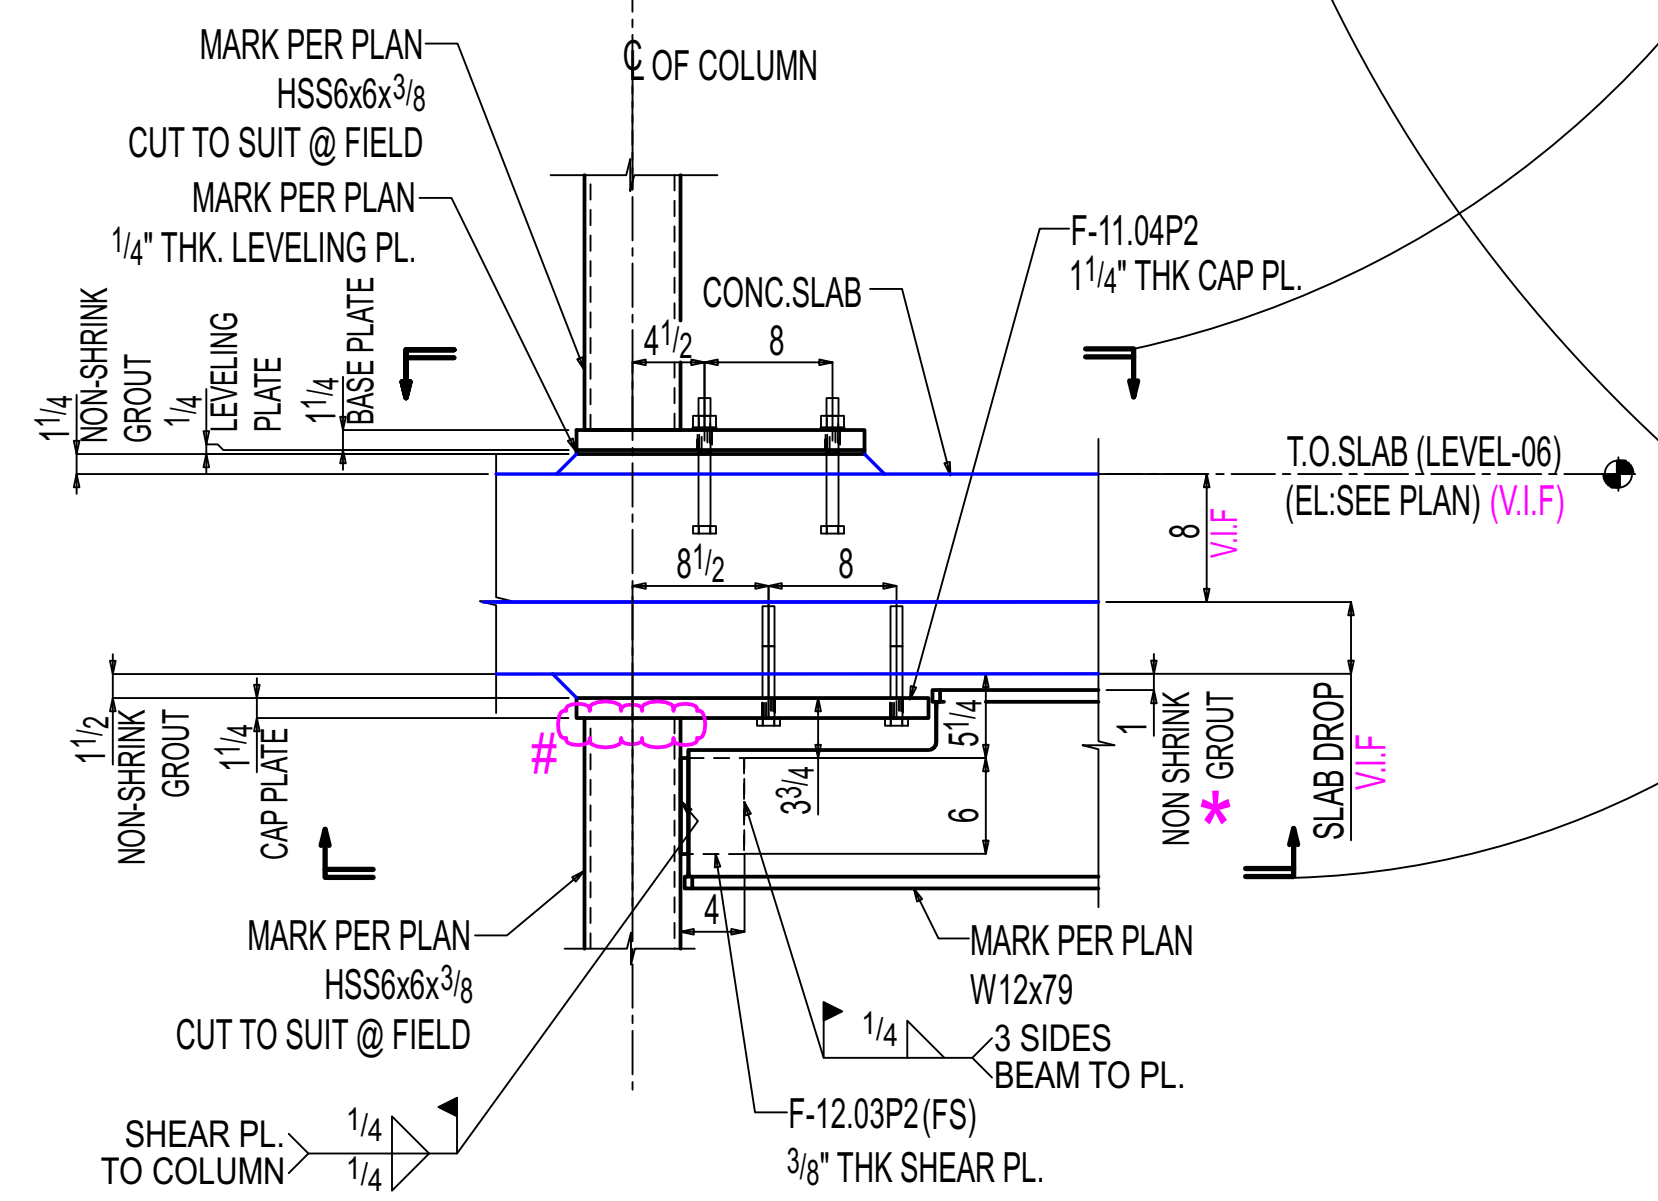

C-C
E-12.00
(REF:5.6 & 7/S314)
OTHERS NOT SHOWN FOR CLARITY

SHOP / ERECTOR NOTE:
LOCATE EXISTING REBAR PRIOR TO FABRICATION OF PLATE. DO NOT DRILL THROUGH REBAR.

ERECTOR NOTE:
ALL # INDICATED COLUMN ENDS TO BE CUT TO SUIT @ FIELD BASED ON FLOOR TO FLOOR CLEARANCE AND WELD IT TO THE CAP PLATE.

***-ERECTOR NOTE:**
PROVIDE 1" NON-SHRINK GROUT x 12" LONG CENTERED BENEATH AT PRECAST ATTACHMENT POINTS.

General Notes			
*Structural steel shall conform to ASTM-A992.			
*Structural SQR/RND tubing conform to ASTM A500 Grade C			
*Pipe shall conform to ASTM A53, Grade B.			
*Channels, Angles and plates shall conform to A36.			
*All bolts shall be 3/4" High strength in accordance with ASTM A325 (UNO)			
*Welding Electrodes for Carbon steel :E70xx			
# of Copies	Revision/ Issue	Destination	Date
5	0	For Construction	11-14-2025
4	D	For Re-Approval	10-24-2025
3	C	For Re-Approval	09-19-2025
2	B	For Re-Approval	06-23-2025
1	A	For Approval	02-25-2025

IRON FABRICATION SERVICES, LLC.

3029 M. Street, NW, Suite 202
Washington, DC 20007
Tel: 202-800-5599
Fax: 202-478-0303

Project Name and Address
MARYLAND AVENUE

Location: **1250 MARYLAND AVENUE SW WASHINGTON, DC 20024**

Contractor:
BALFOUR BEATTY

Approved for Fabrication by: _____
Signature

Contract # **224009** Drawing # **E-12.01**
Contract Item: **LEVEL-06 SLAB EXTENSION**
Ref: **SOW-12: 3,4,5&6 / S307**

Date **01/20/2025** Drawing Title: **SOW #12 LEVEL-06 NEW SLAB EXTENSION SUPPORT SECTIONS**
Scale **VARIES**