

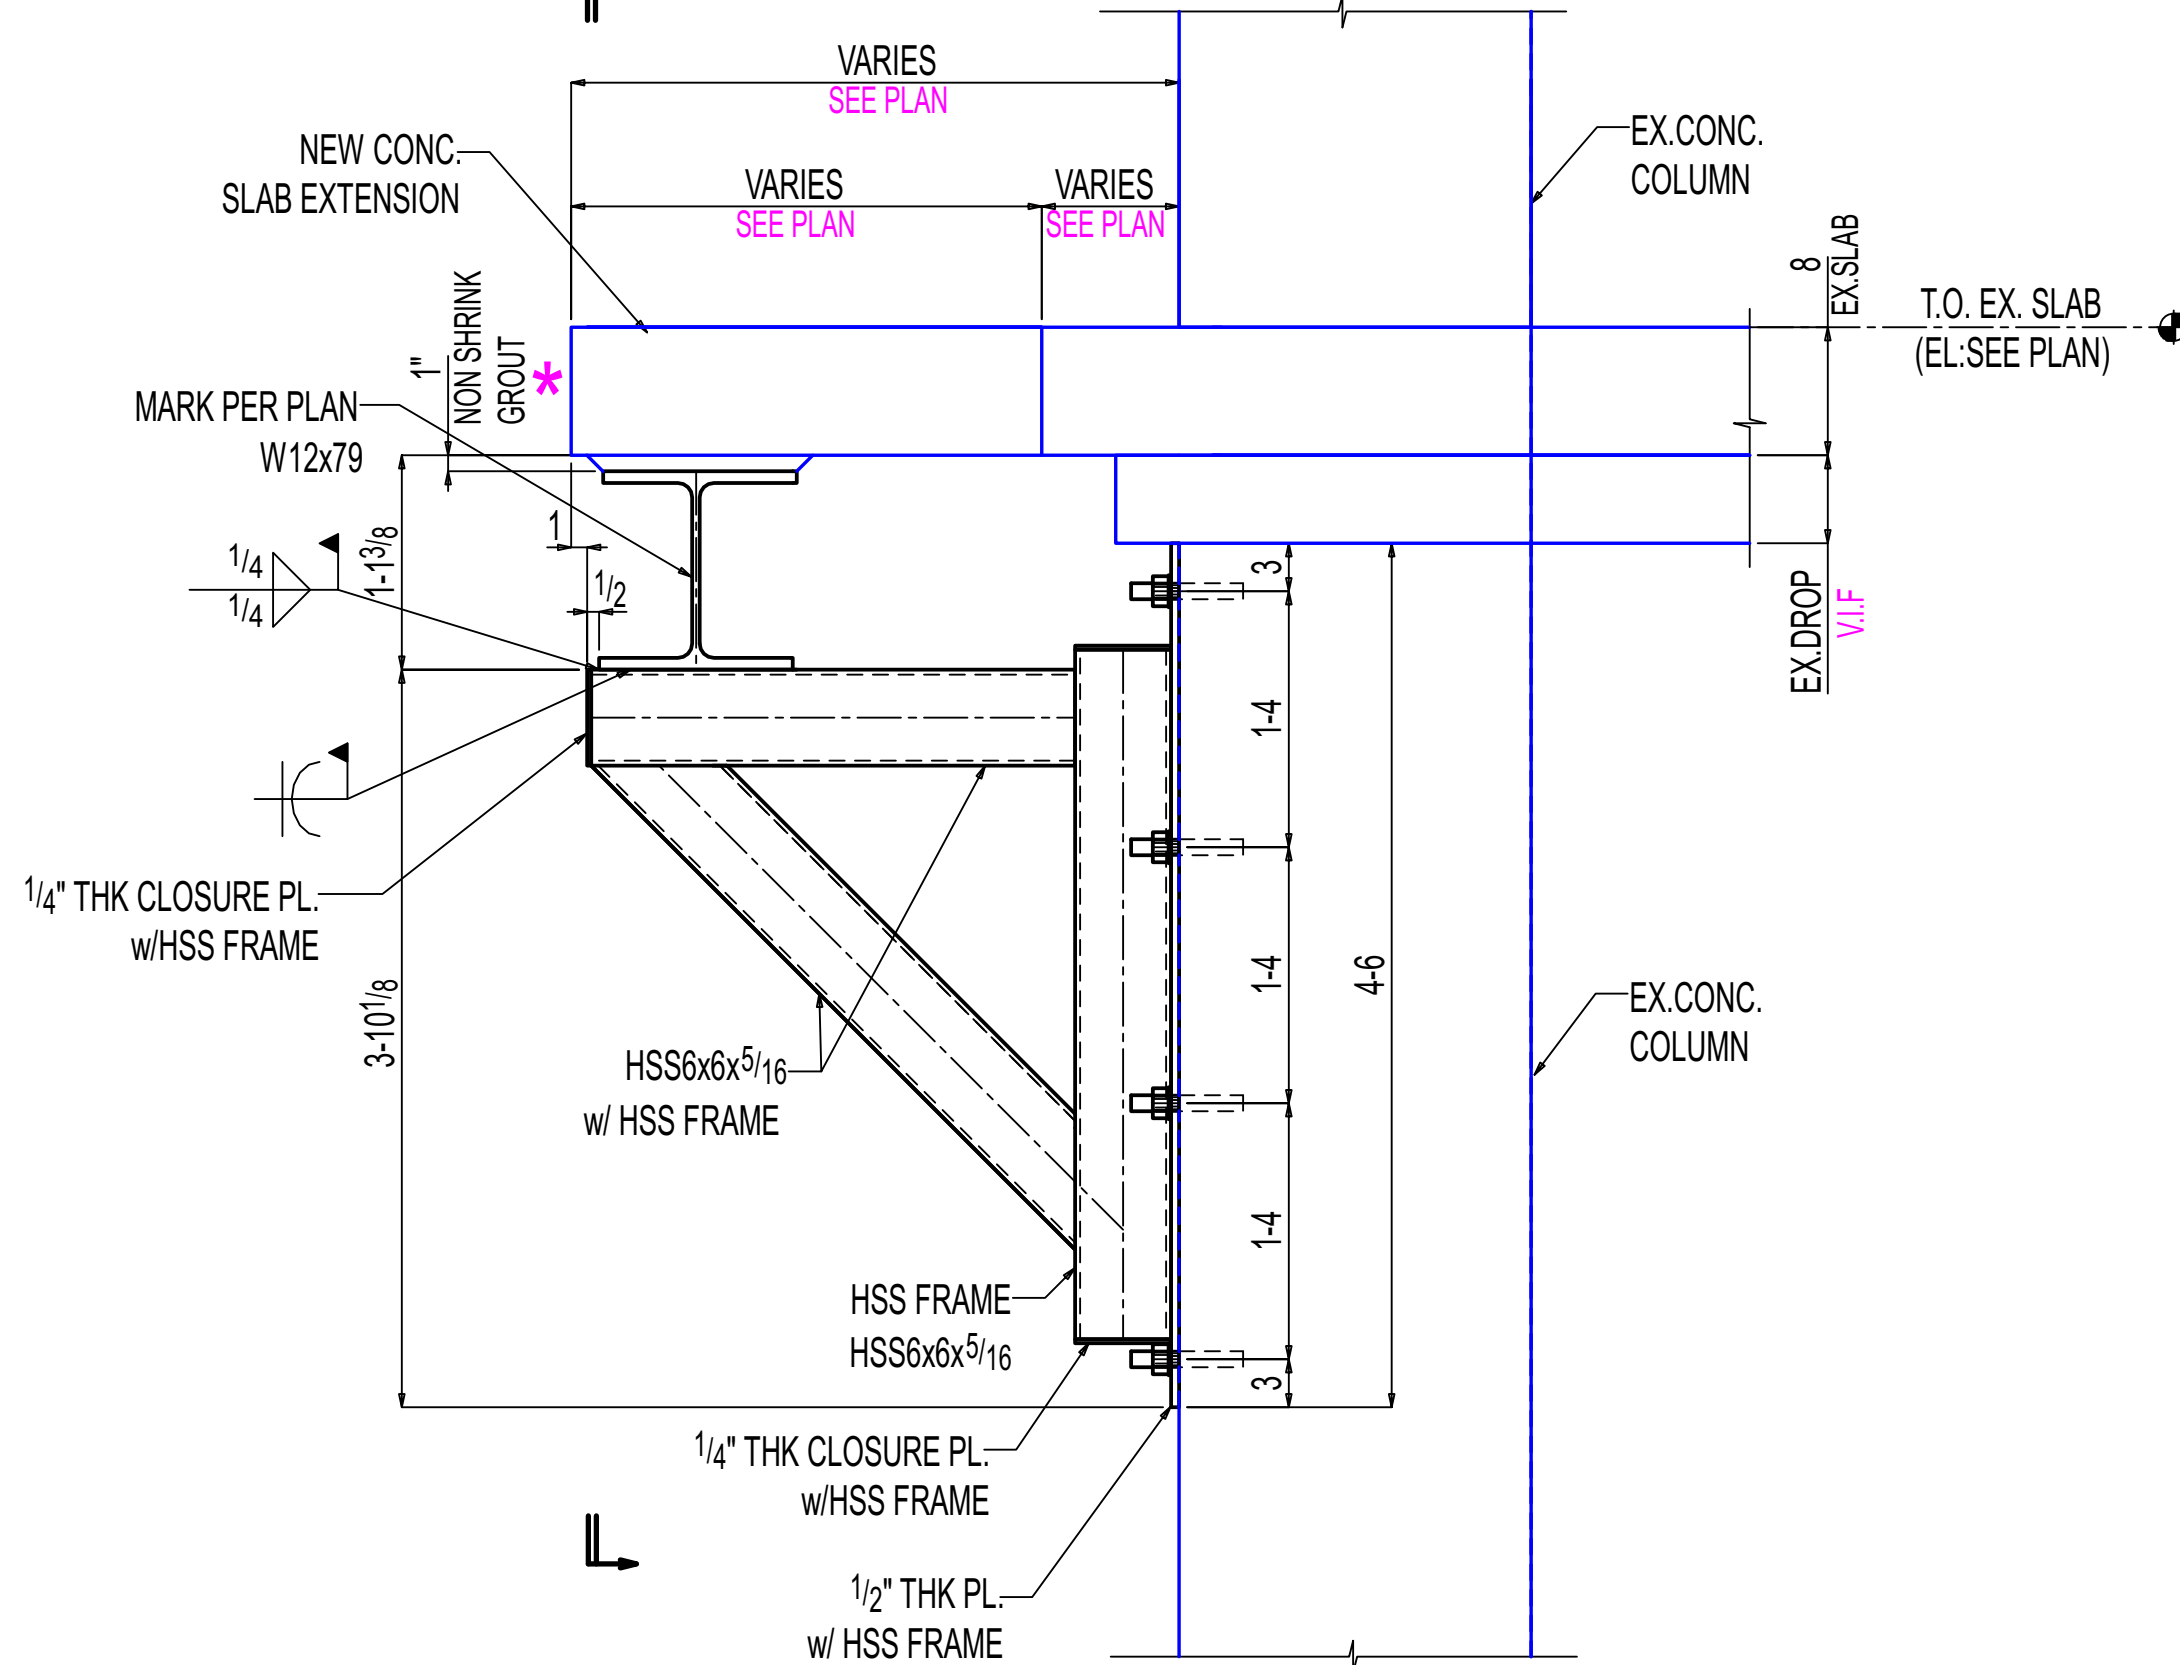
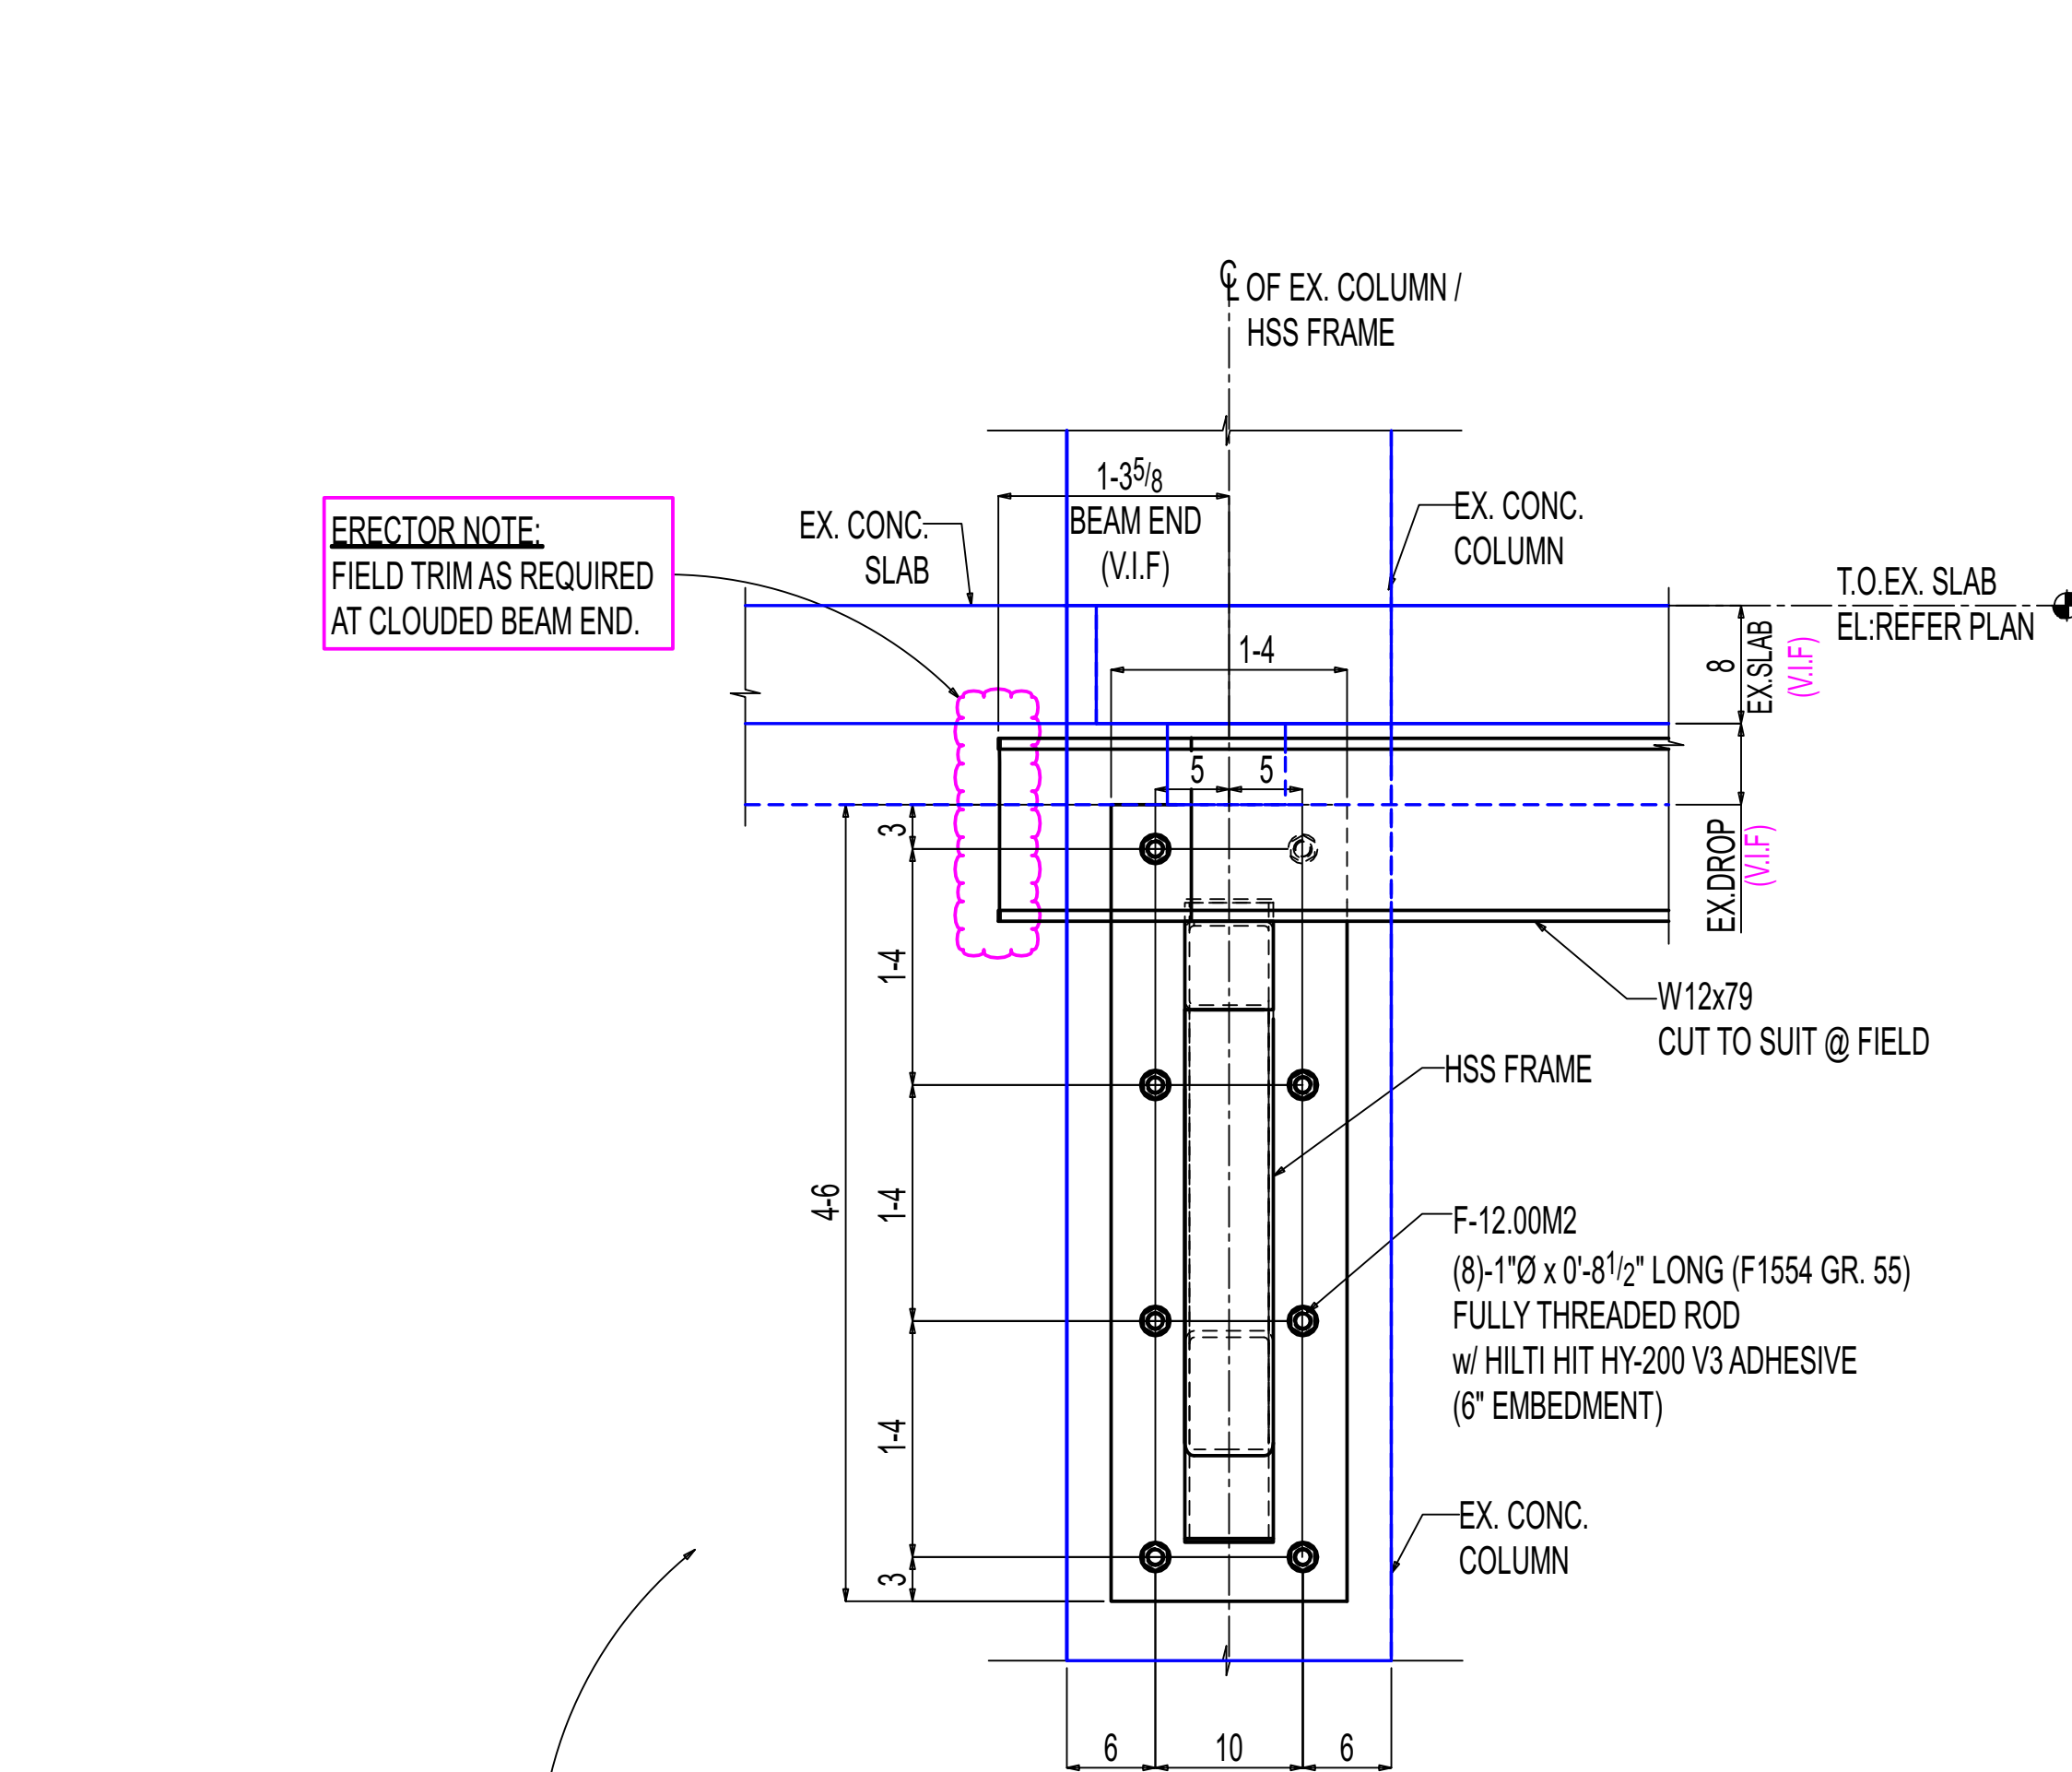


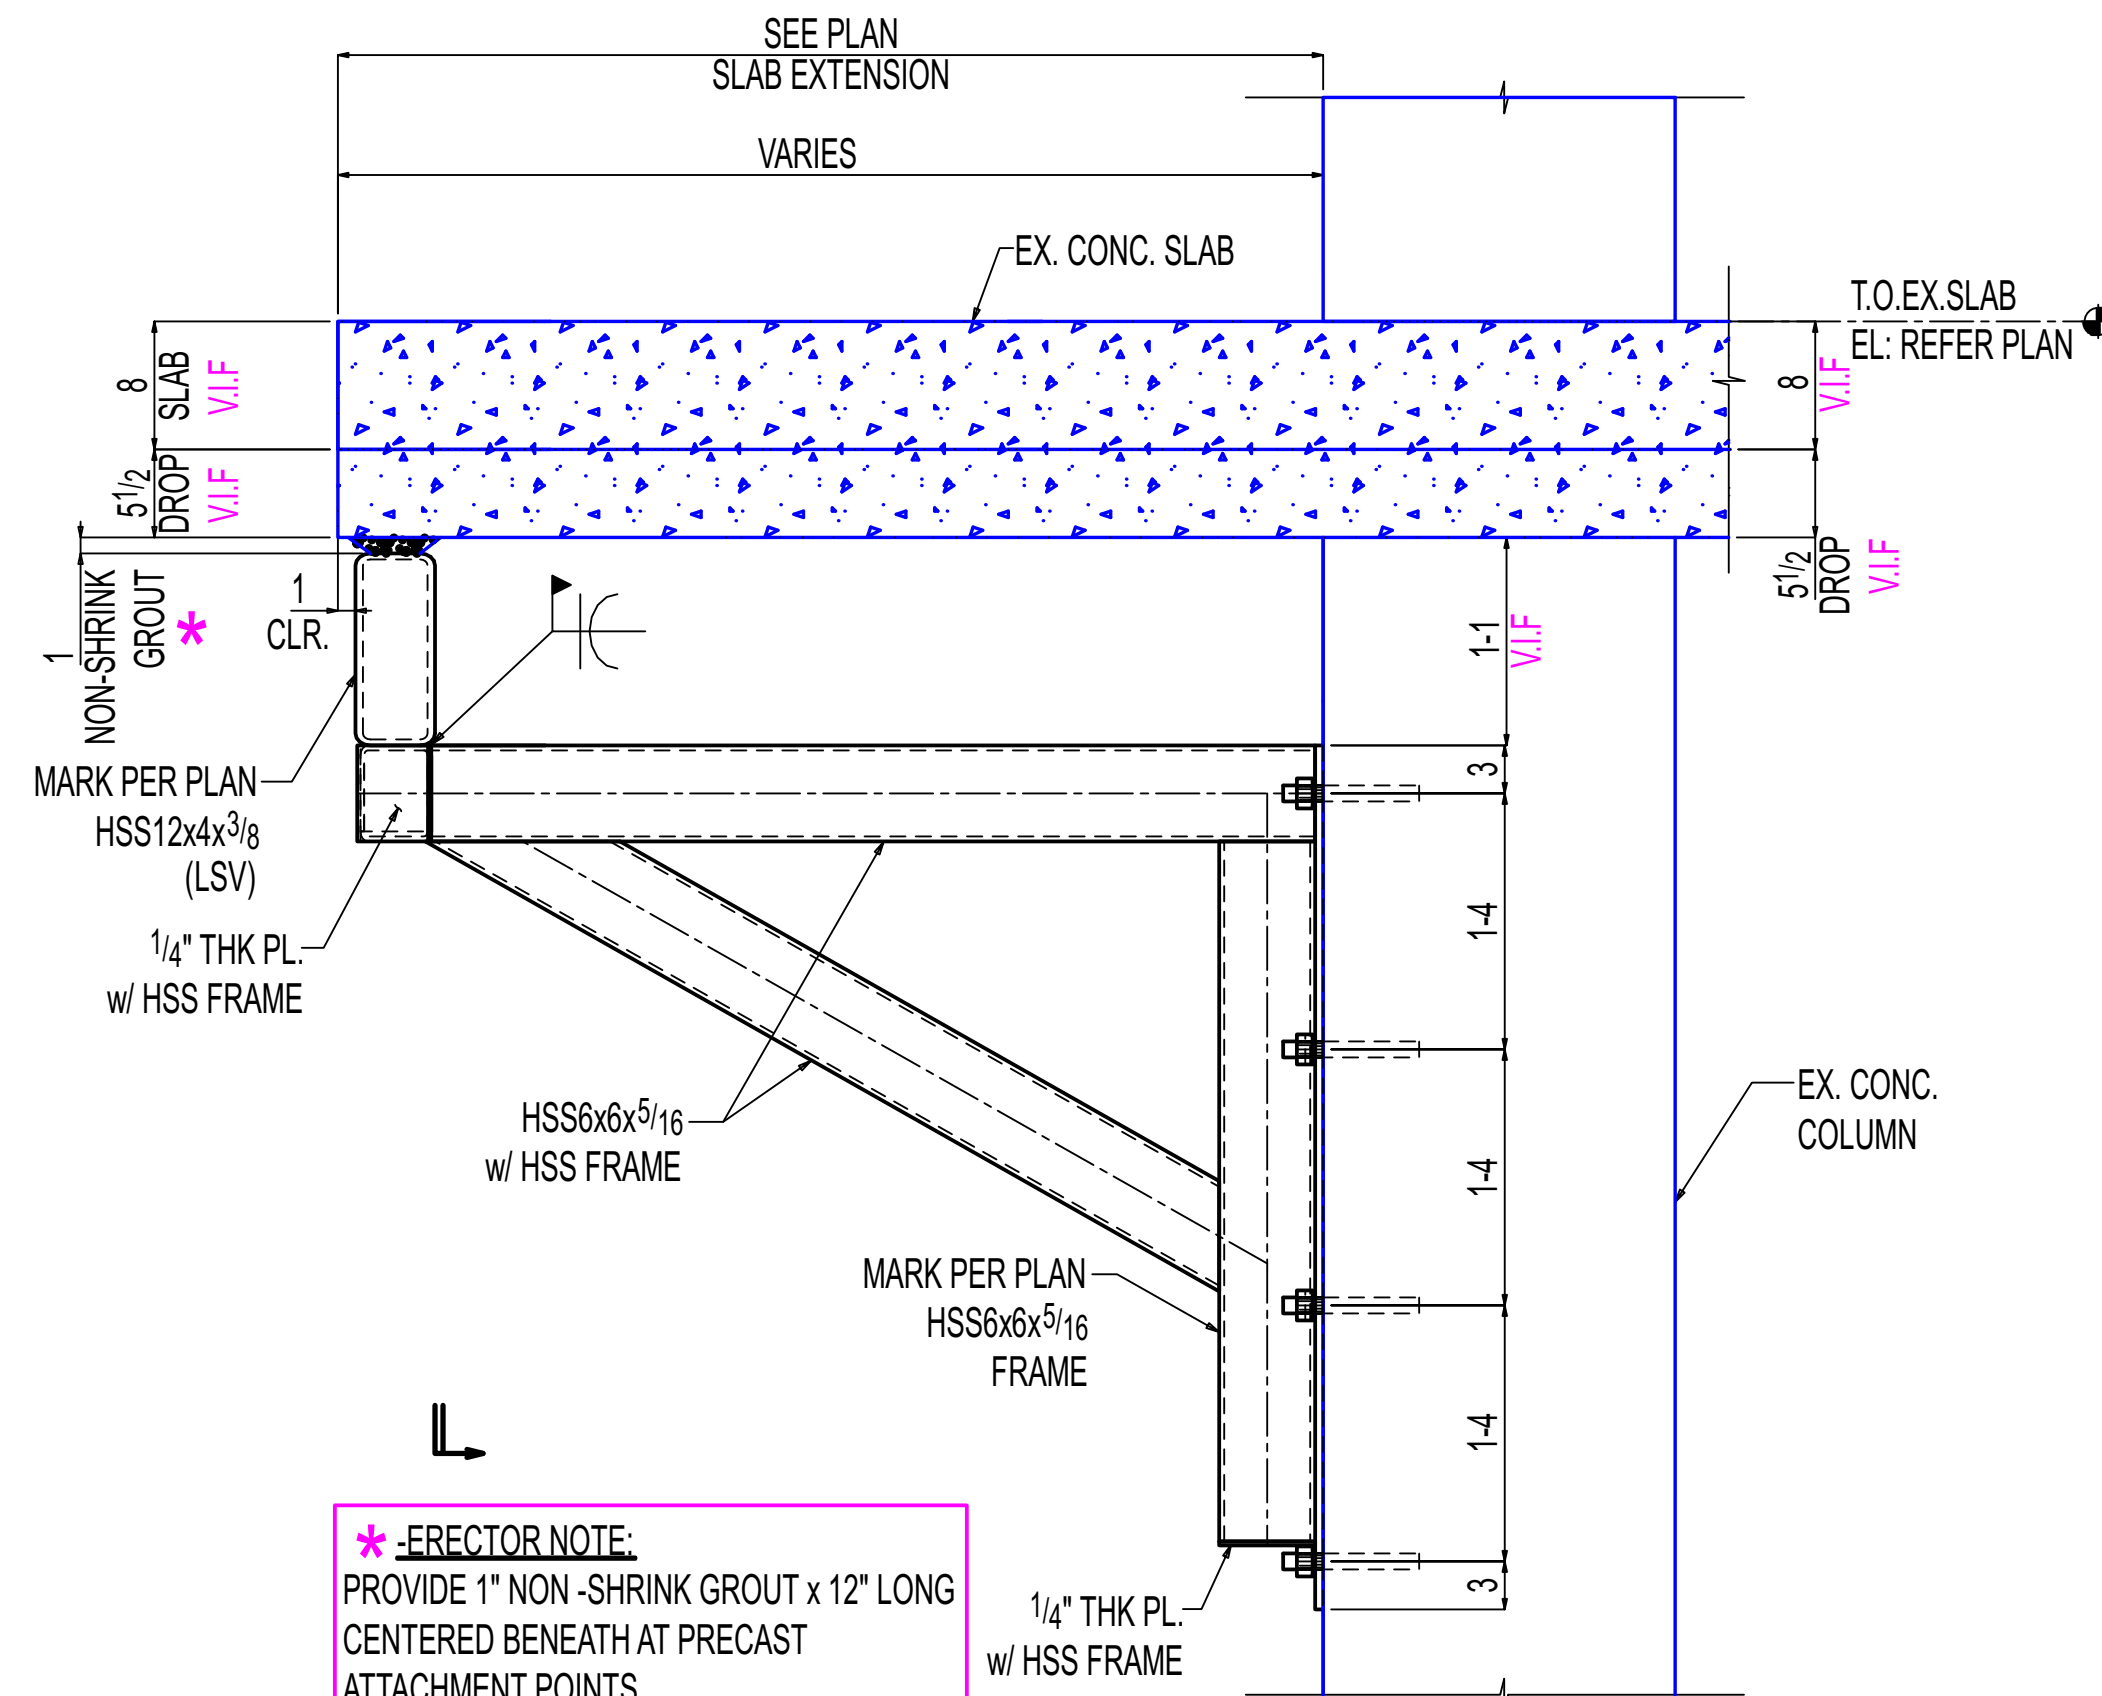

D-D

E-12.00
(REF:13/S312)

OTHERS NOT SHOWN FOR CLARITY

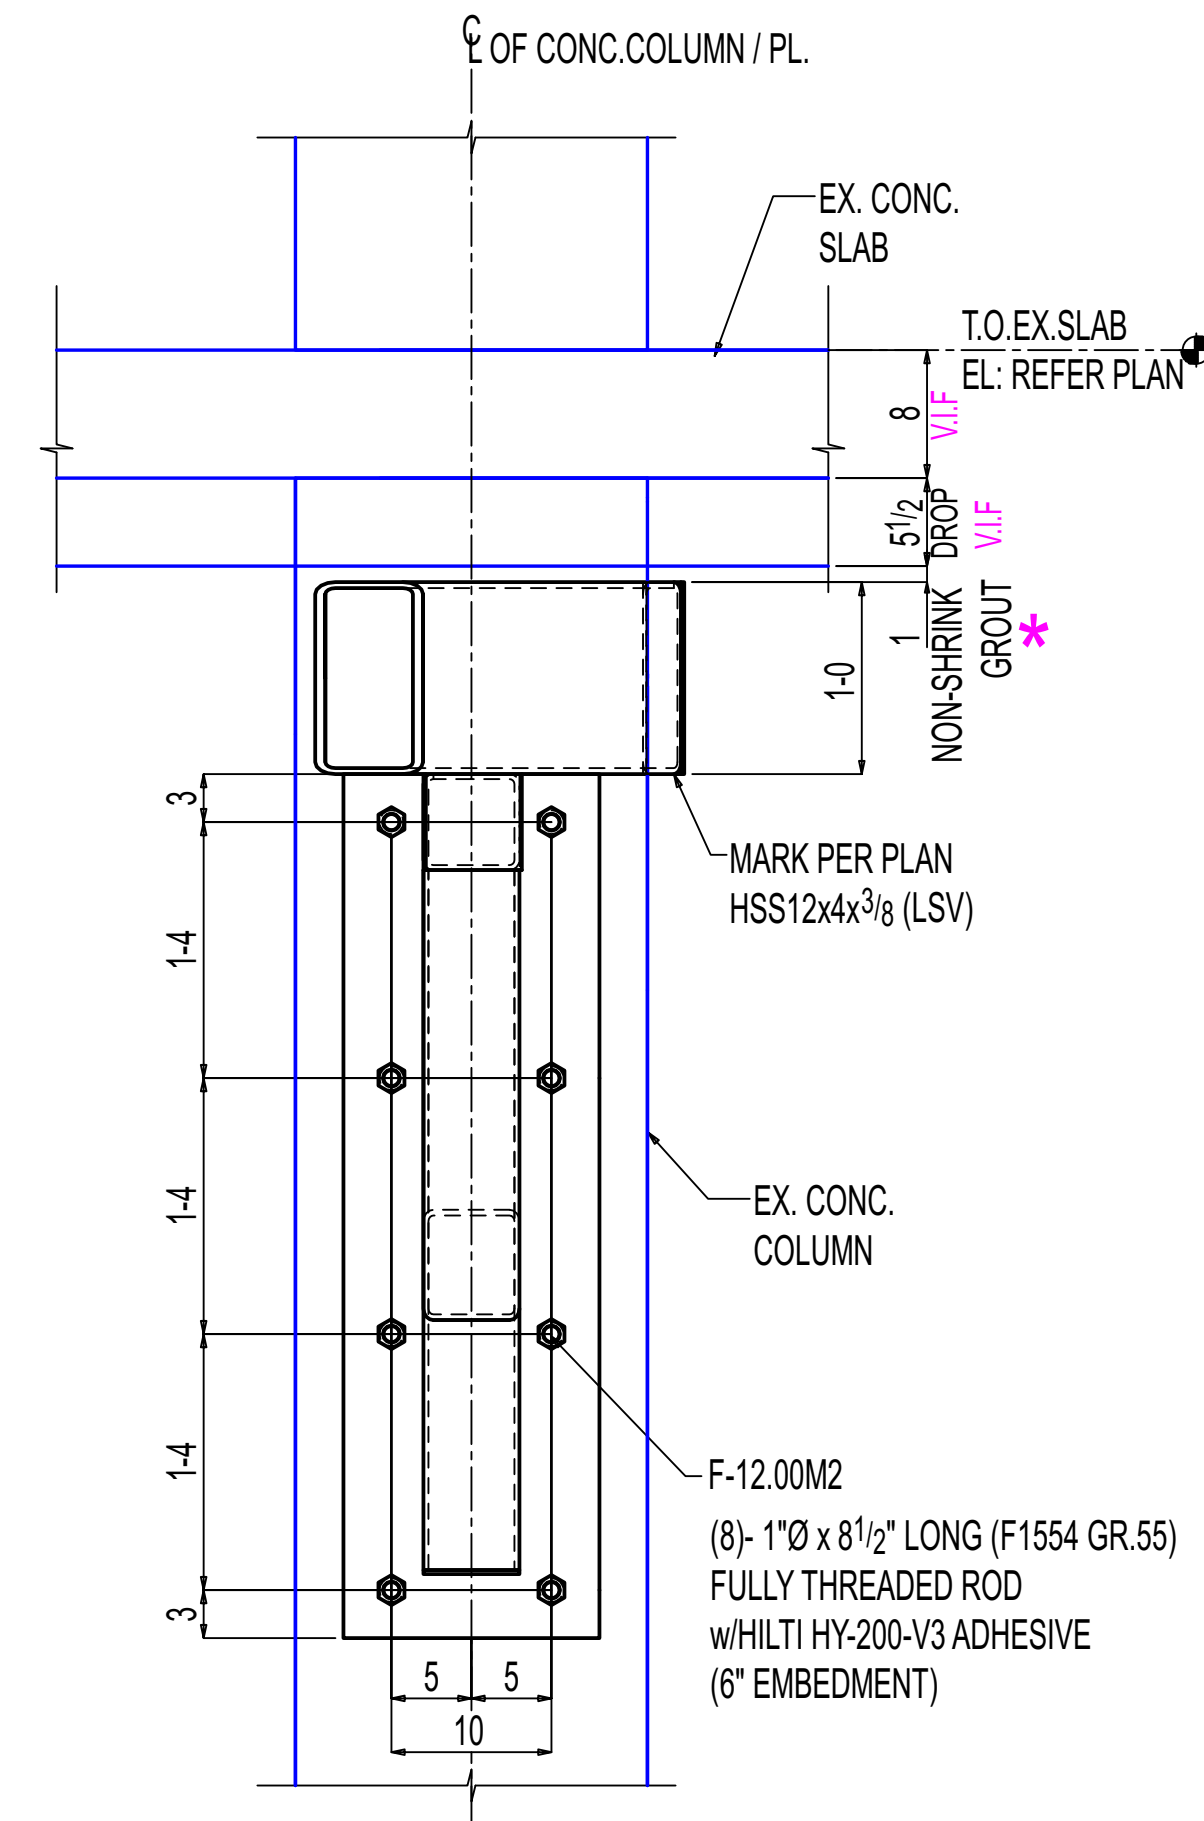

*-ERECTOR NOTE:
PROVIDE 1" NON-SHRINK GROUT x 12" LONG
CENTERED BENEATH AT PRECAST
ATTACHMENT POINTS.

F-F

E-12.00A
(REF:6/S316)

OTHERS NOT SHOWN FOR CLARITY

SHOP / ERECTOR NOTE:
LOCATE EXISTING REBAR PRIOR TO FABRICATION OF PLATE.
DO NOT DRILL THROUGH REBAR.

General Notes

- *Structural steel shall conform to ASTM-A992.
- *Structural SQR/RND.tubing conform to ASTM A500 Grade C
- *Pipe shall conform to ASTM A53, Grade B.
- *Channels, Angles and plates shall conform to A36.
- *All bolts shall be 3/4" High strength in accordance with ASTM A325 (UNO)
- *Welding Electrodes for Carbon steel :E70xx

# of Copies	Revision/ Issue	Destination	Date
5	0	For Construction	11-14-2025
4	D	For Re-Approval	10-24-2025
3	C	For Re-Approval	09-19-2025
2	B	For Re-Approval	06-23-2025
1	A	For Approval	02-25-2025

IRON FABRICATION SERVICES, LLC.

3029 M. Street, NW, Suite 202
Washington, DC 20007
Tel: 202-800-5599
Fax: 202-478-0303

Project Name and Address
MARYLAND AVENUE

Location: **1250 MARYLAND AVENUE SW
WASHINGTON, DC 20024**

Contractor:
BALFOUR BEATTY

Approved for Fabrication by: Signature

Contract # **224009** Drawing # **E-12.02**

Contract Item: **LEVEL-06
SLAB EXTENSION**

Ref: **SOW-12: 3,4,5&6 / S307**

Date
01/20/2025
Scale
VARIES

Drawing Title:
**SOW #12 LEVEL-06 NEW
SLAB EXTENSION SUPPORT
SECTIONS**