


Delhi Groundwater Recharge Zones and Parks

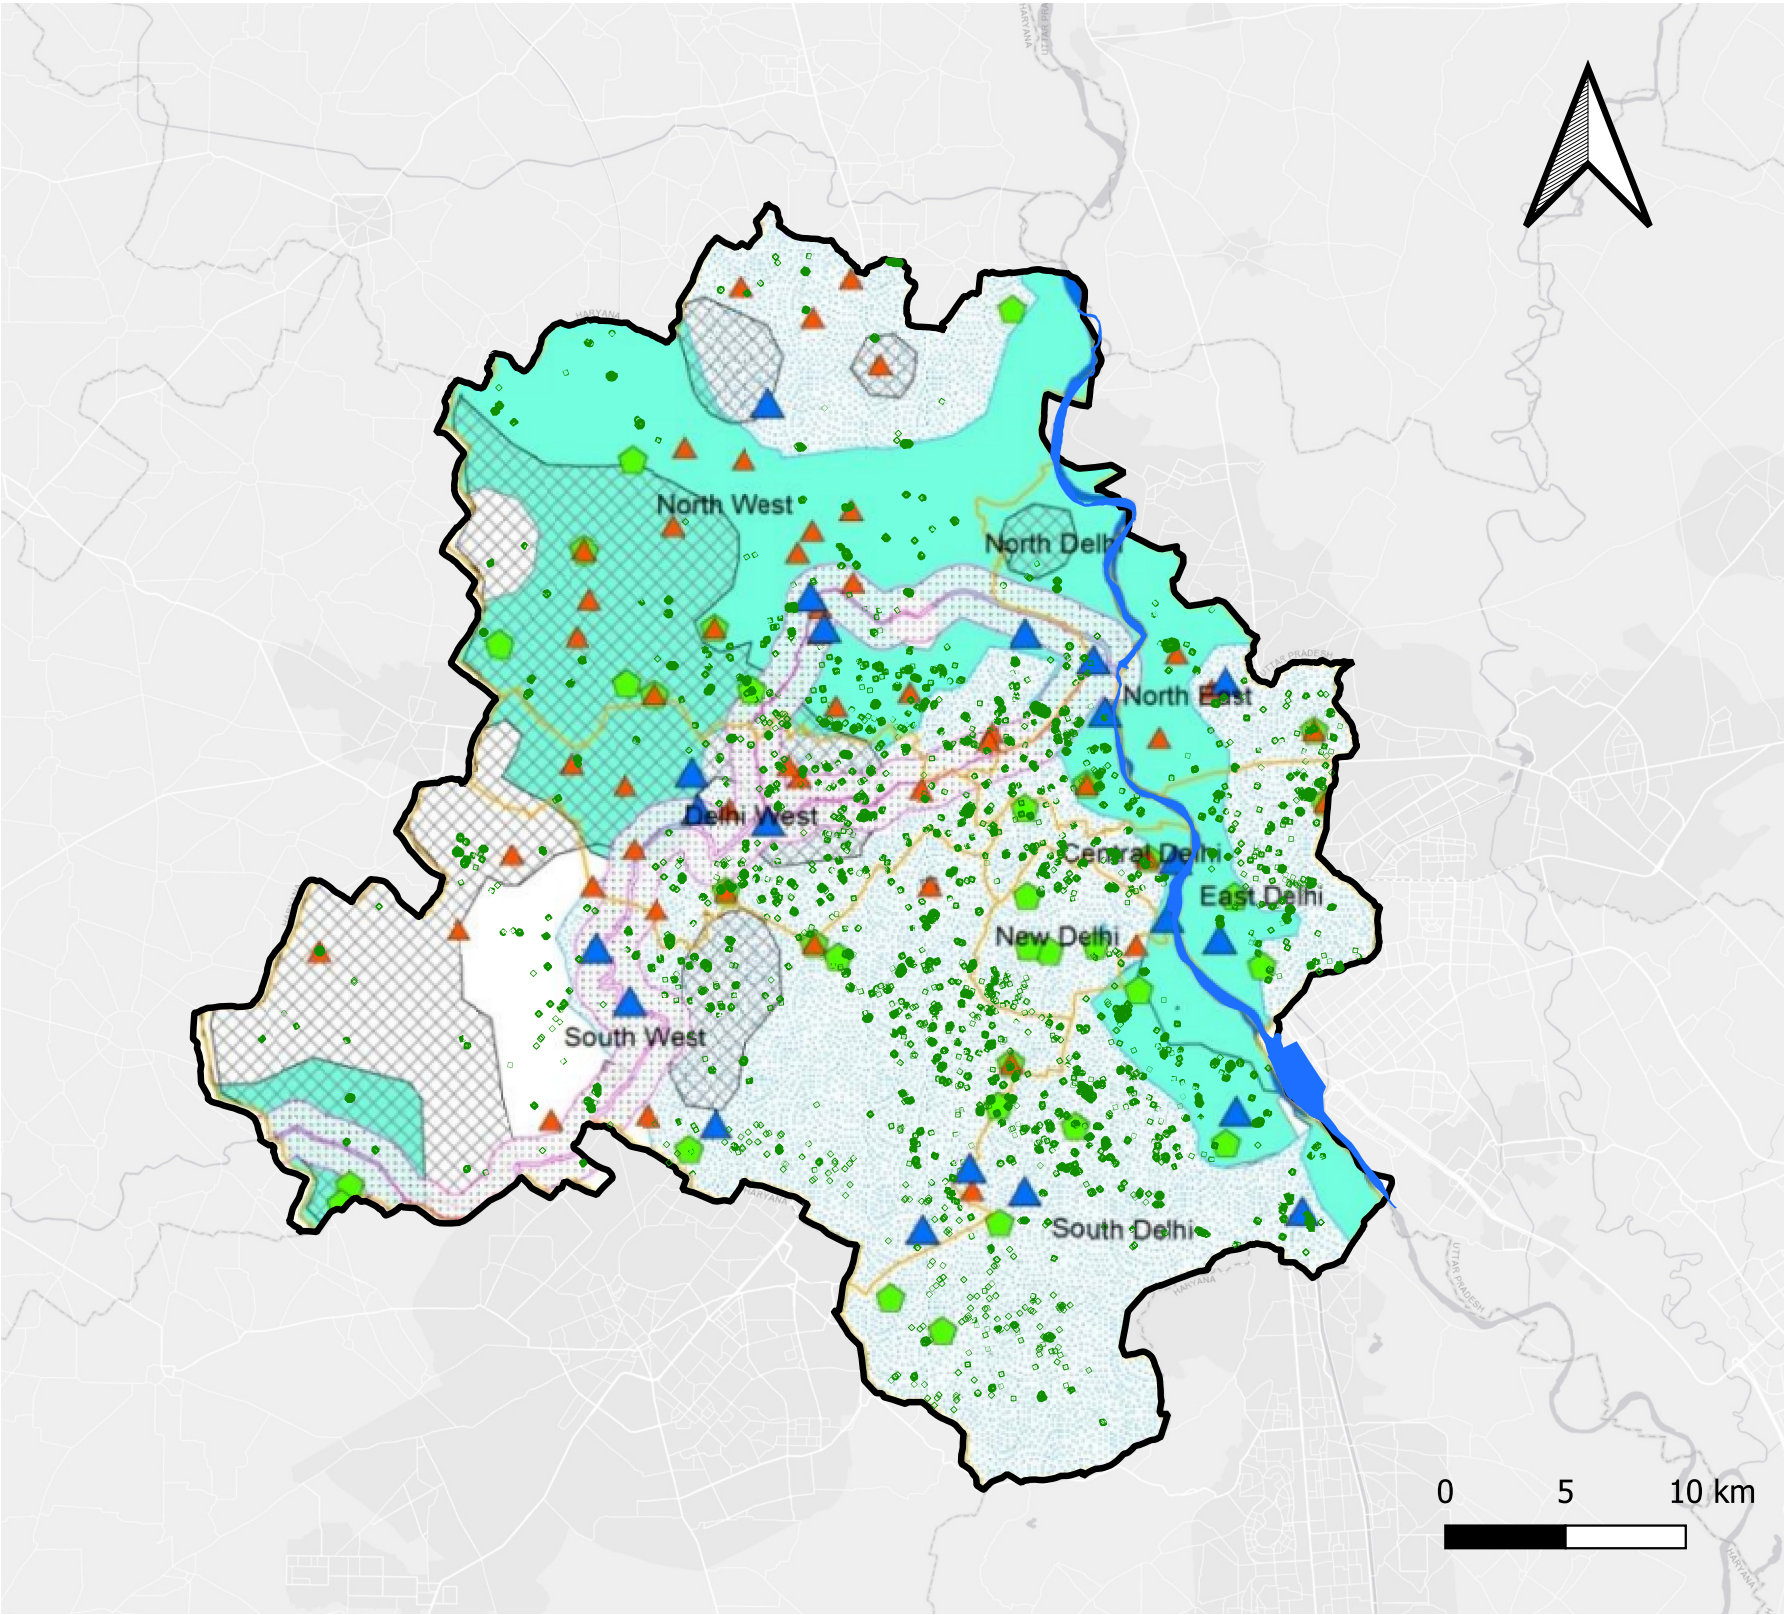

Legend

- ▲ Sewage Treatment Plants
- ▲ Fluoride beyond permissible limit (>1.5 mg/l)
- ▲ Nitrate beyond permissible limit (> 45 mg/l)
- Zone-I Area suitable for GW withdrawal
- Zone-II Area suitable for GW withdrawal and recharge
- Zone-III GW Unsuitable for drinking & domestic use
- Zone- IV Suitable for recharge, regulation of GW withdrawal
- Poor GW Quality Area, GW Suitable for salt tolerant crop
- District Boundary
- Parks of Delhi
- Yamuna River
- Delhi

Source:

Master Plan of Delhi 2041
NAQUIM Report on AQUIFER MAPPING AND GROUND WATER MANAGEMENT PLAN
OF NCT DELHI