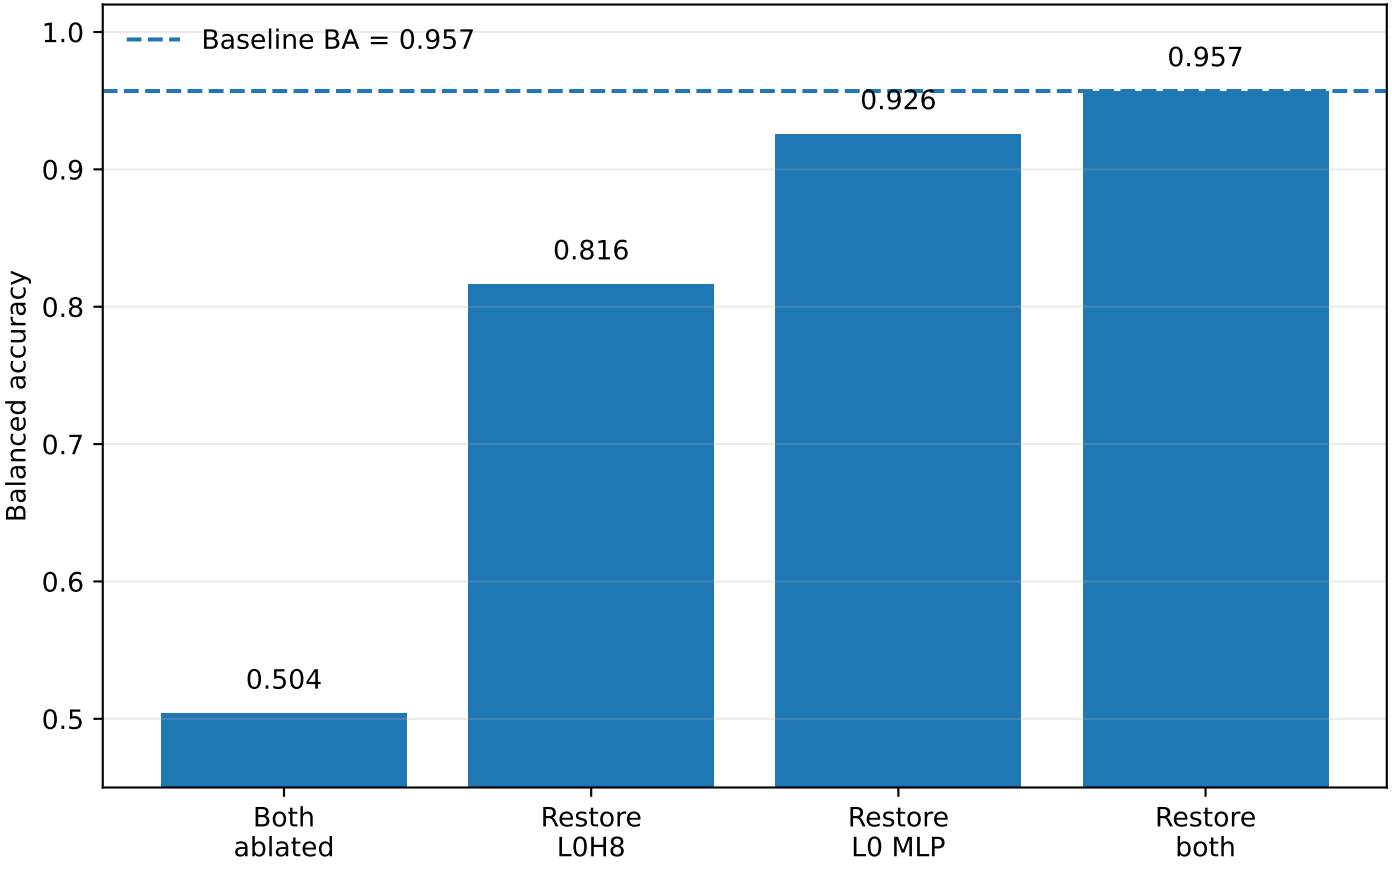
Activation Restoration Recovers Promoter Classification
Baseline BA = 0.957
Balanced accuracy
1.0
0.9
0.8
0.7
0.6
0.5
0.504
0.816
0.926
0.957
Both ablated
Restore L0H8
Restore L0 MLP
Restore both