




Detection rate

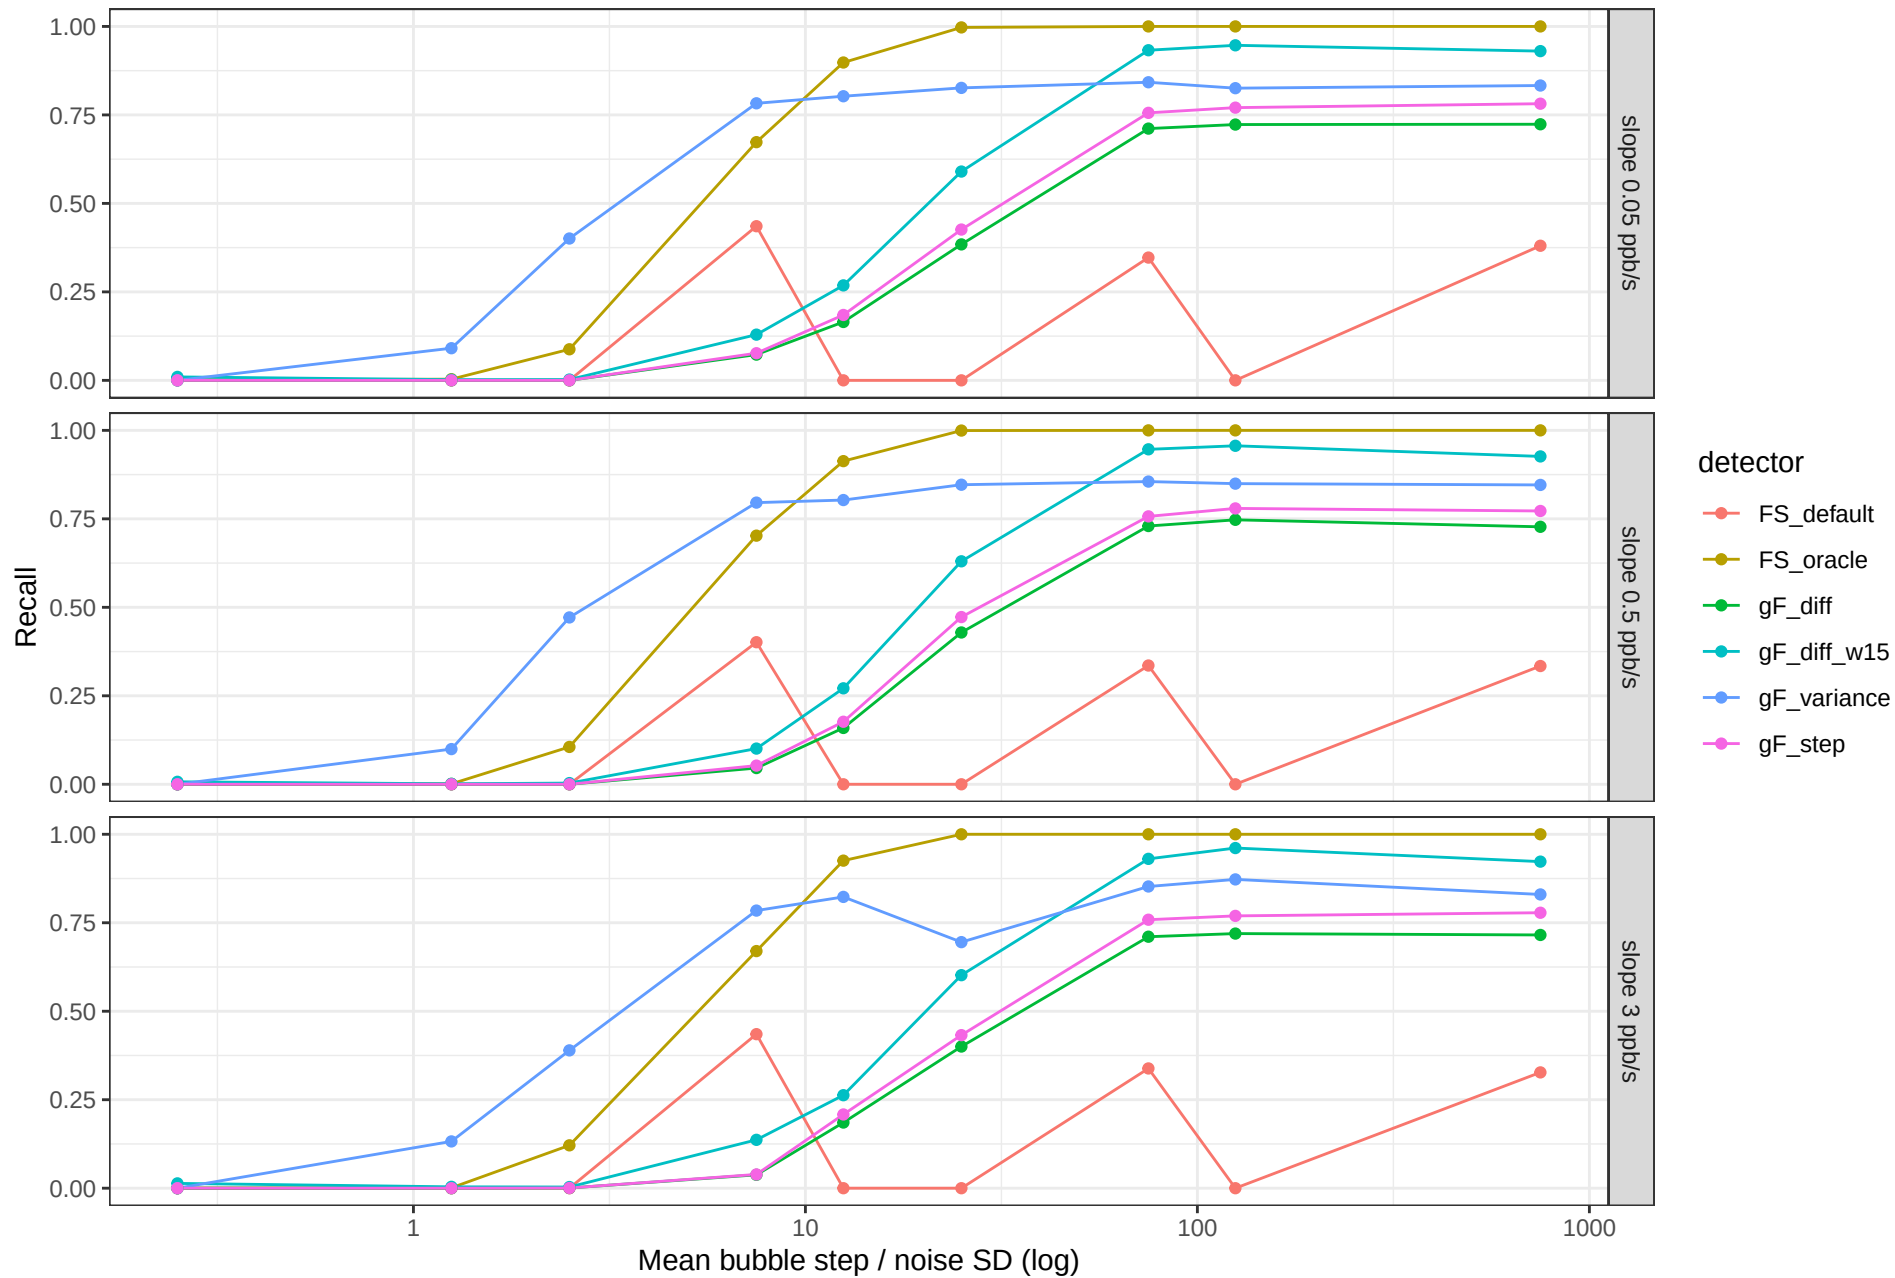


## False positives without ebullition

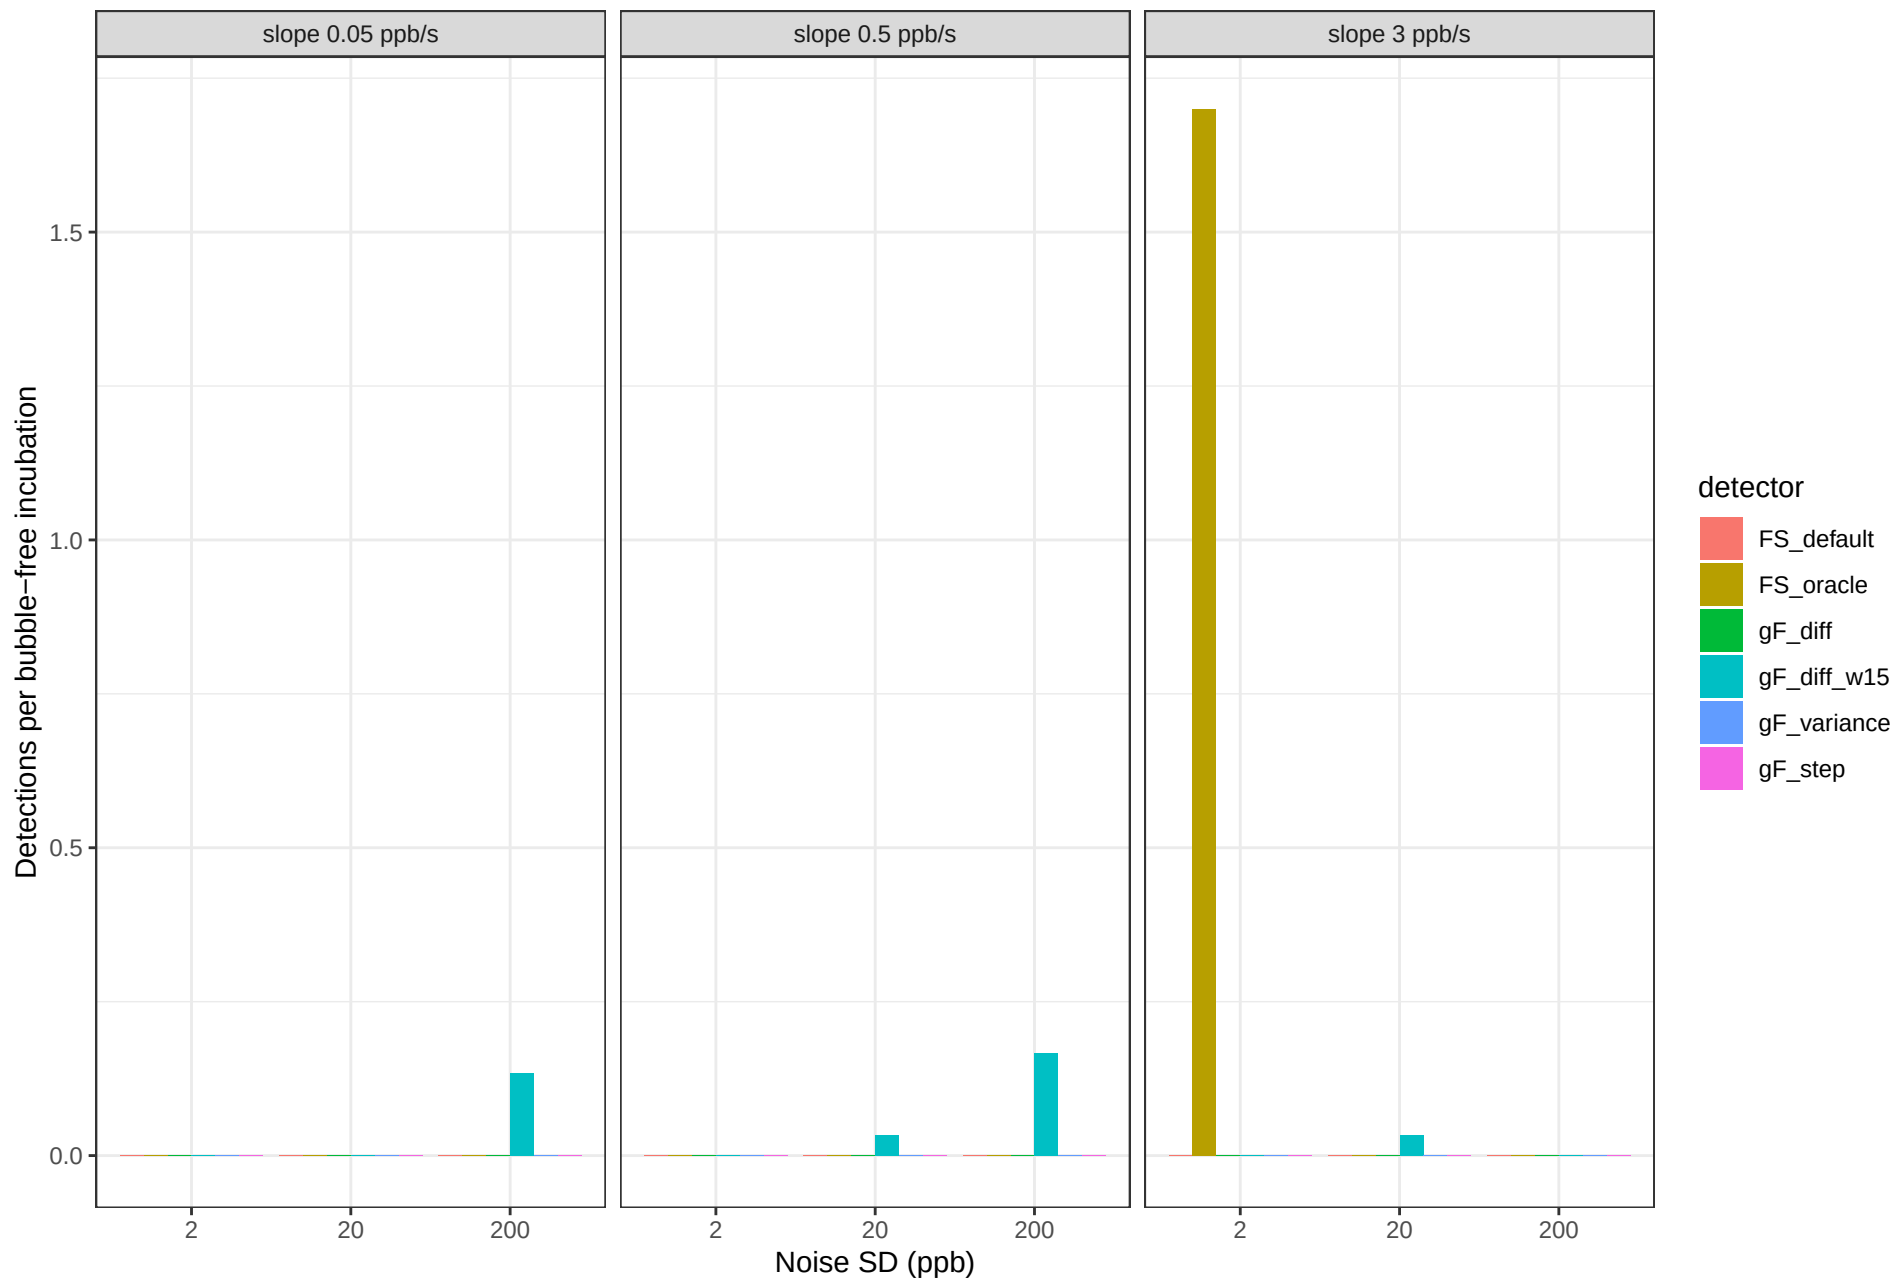

Magnitude bias (all incubations with bubbles)

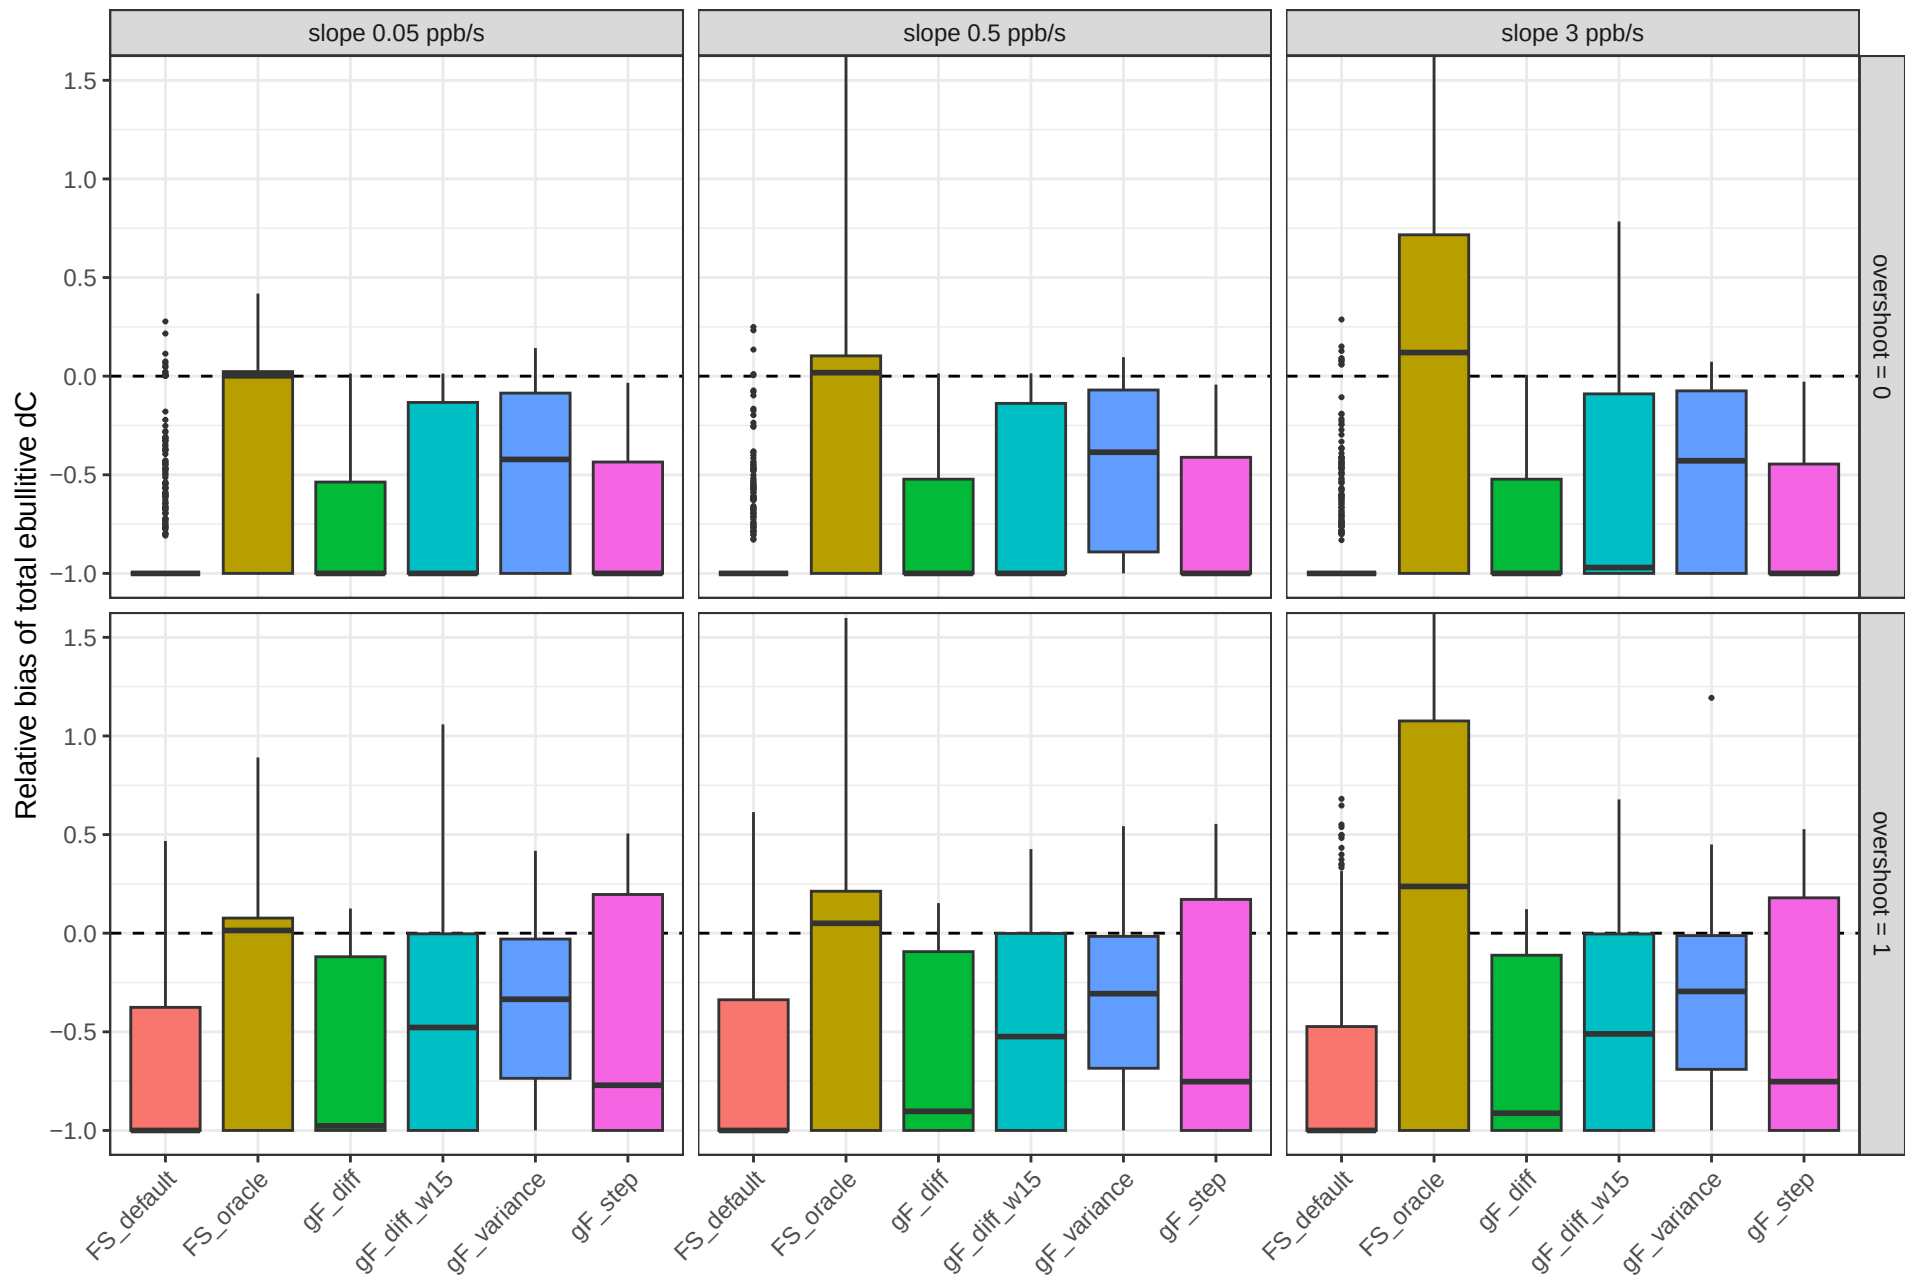


Event counting (merging &lt; 1 &lt; splitting)

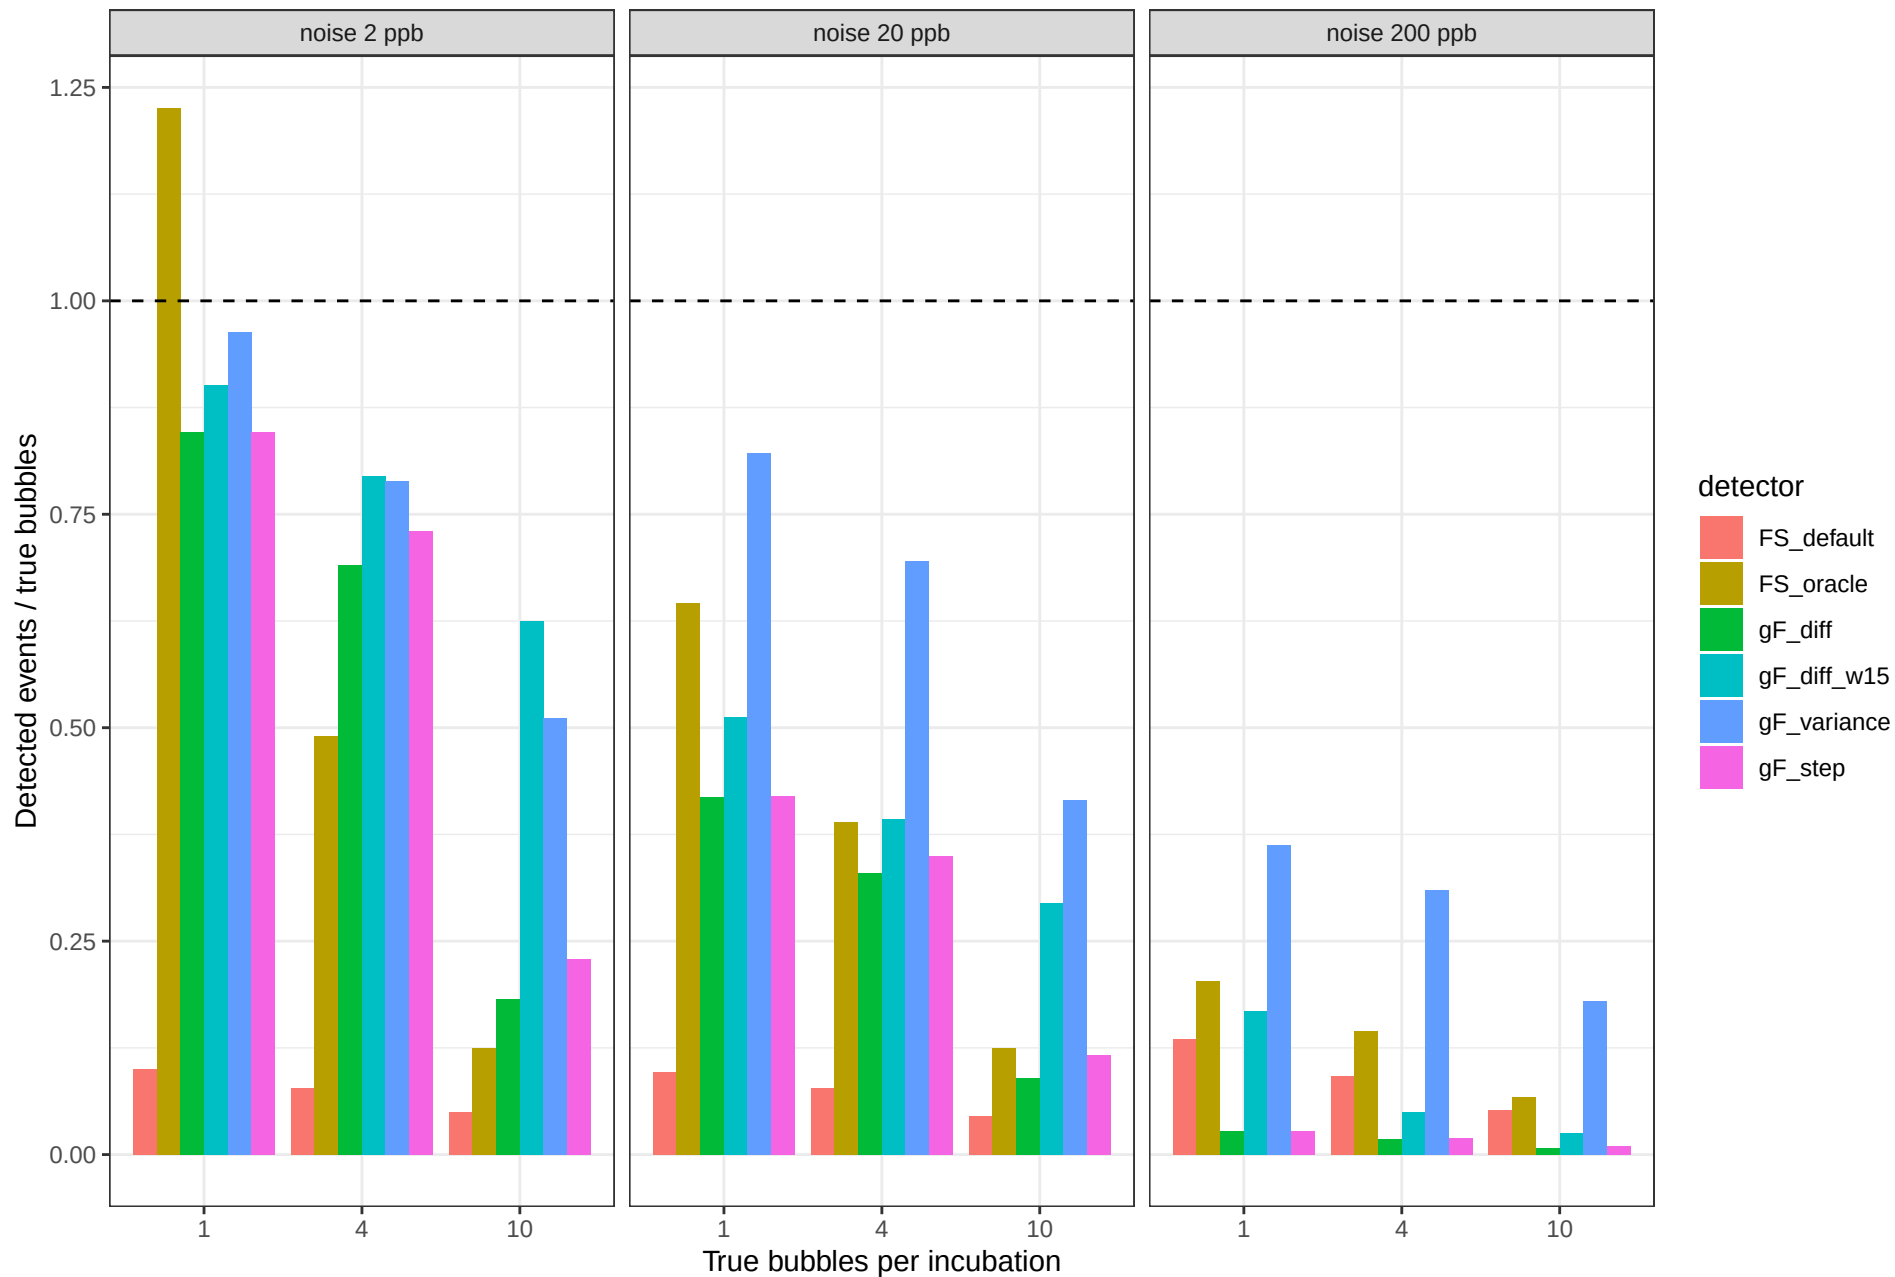


noise 20 ppb, slope 0.5 ppb/s, step 250 ppb, n = 4, overshoot 1

red dashed = true onsets; blue = detected events

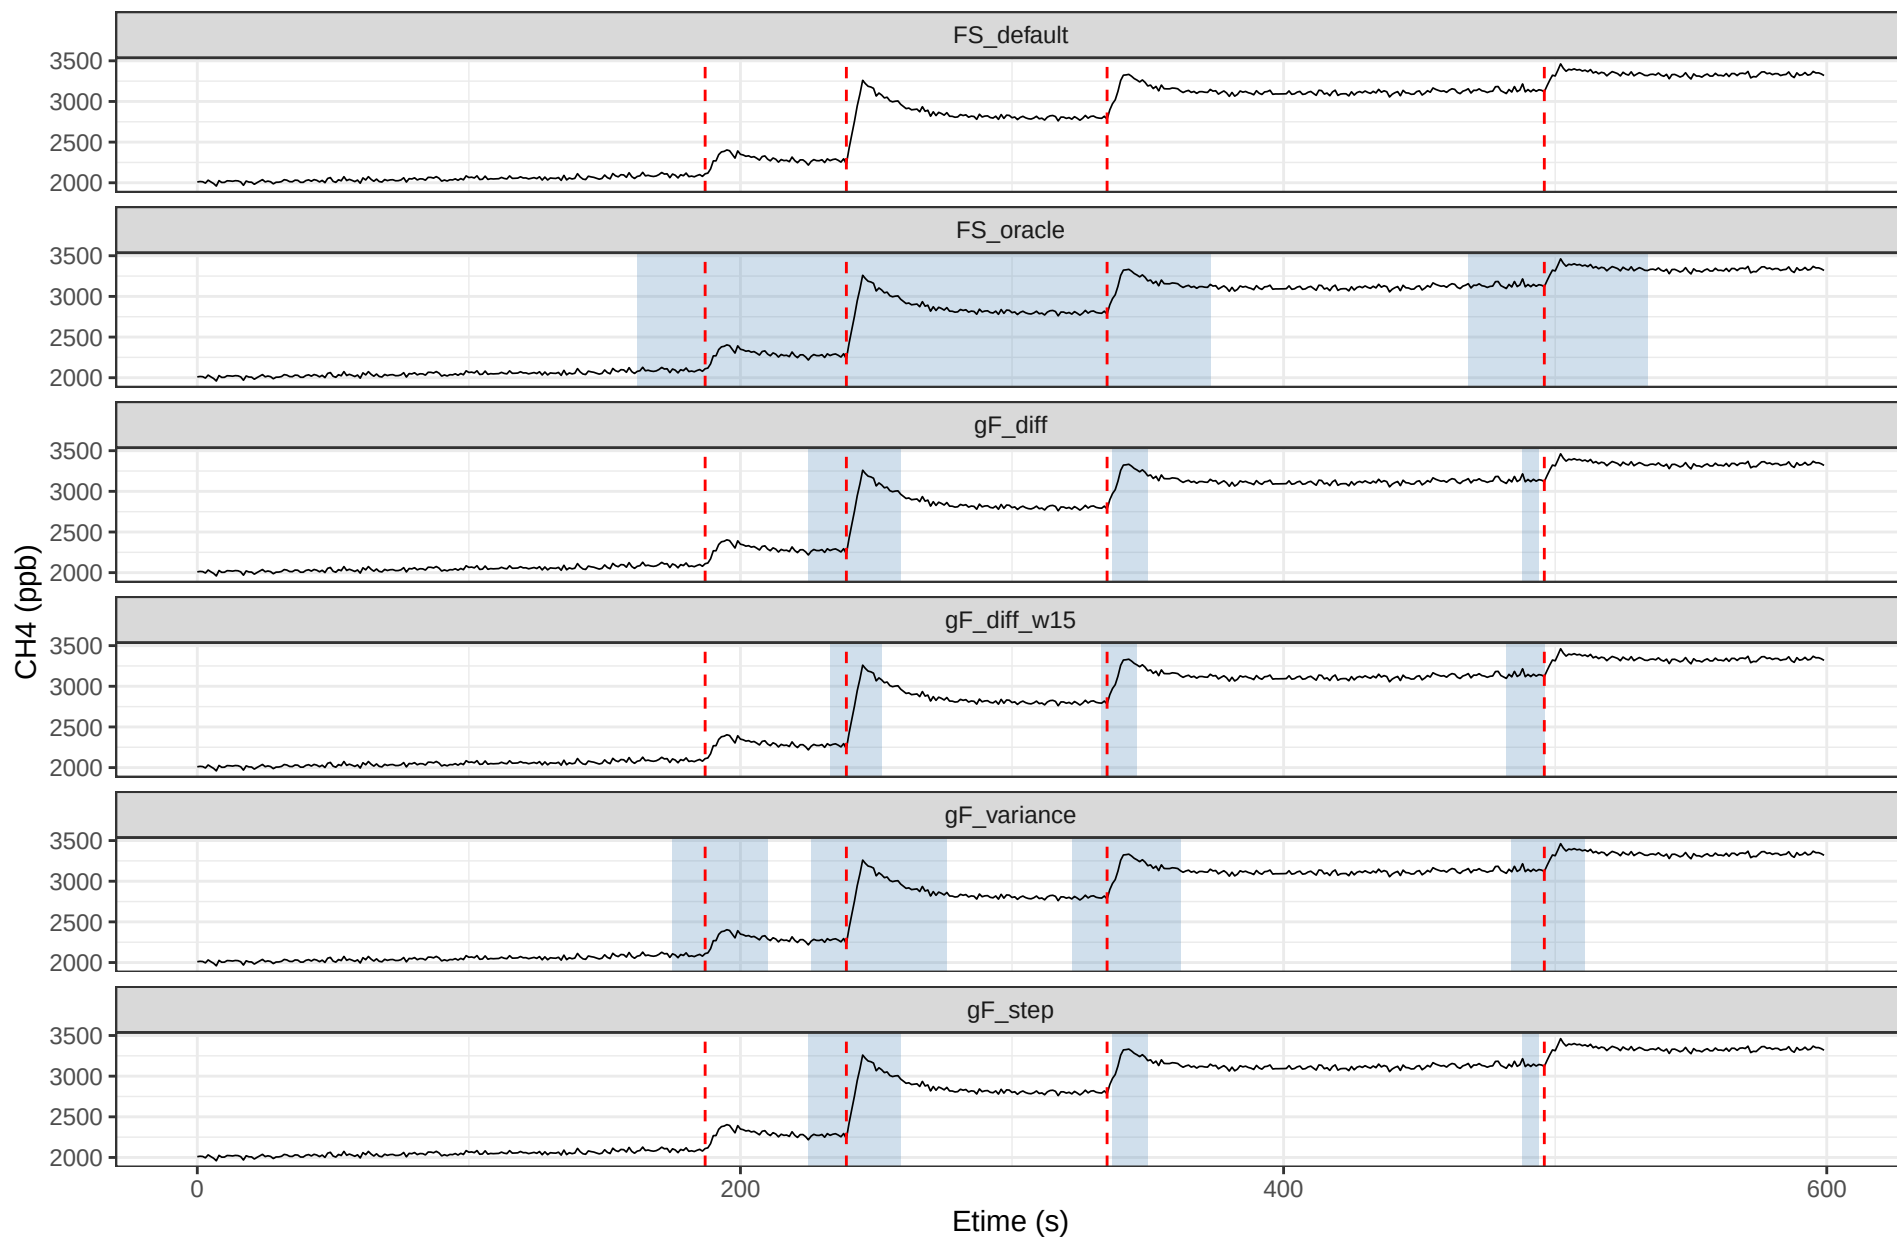

noise 2 ppb, slope 3 ppb/s, step 50 ppb, n = 4, overshoot 0

red dashed = true onsets; blue = detected events

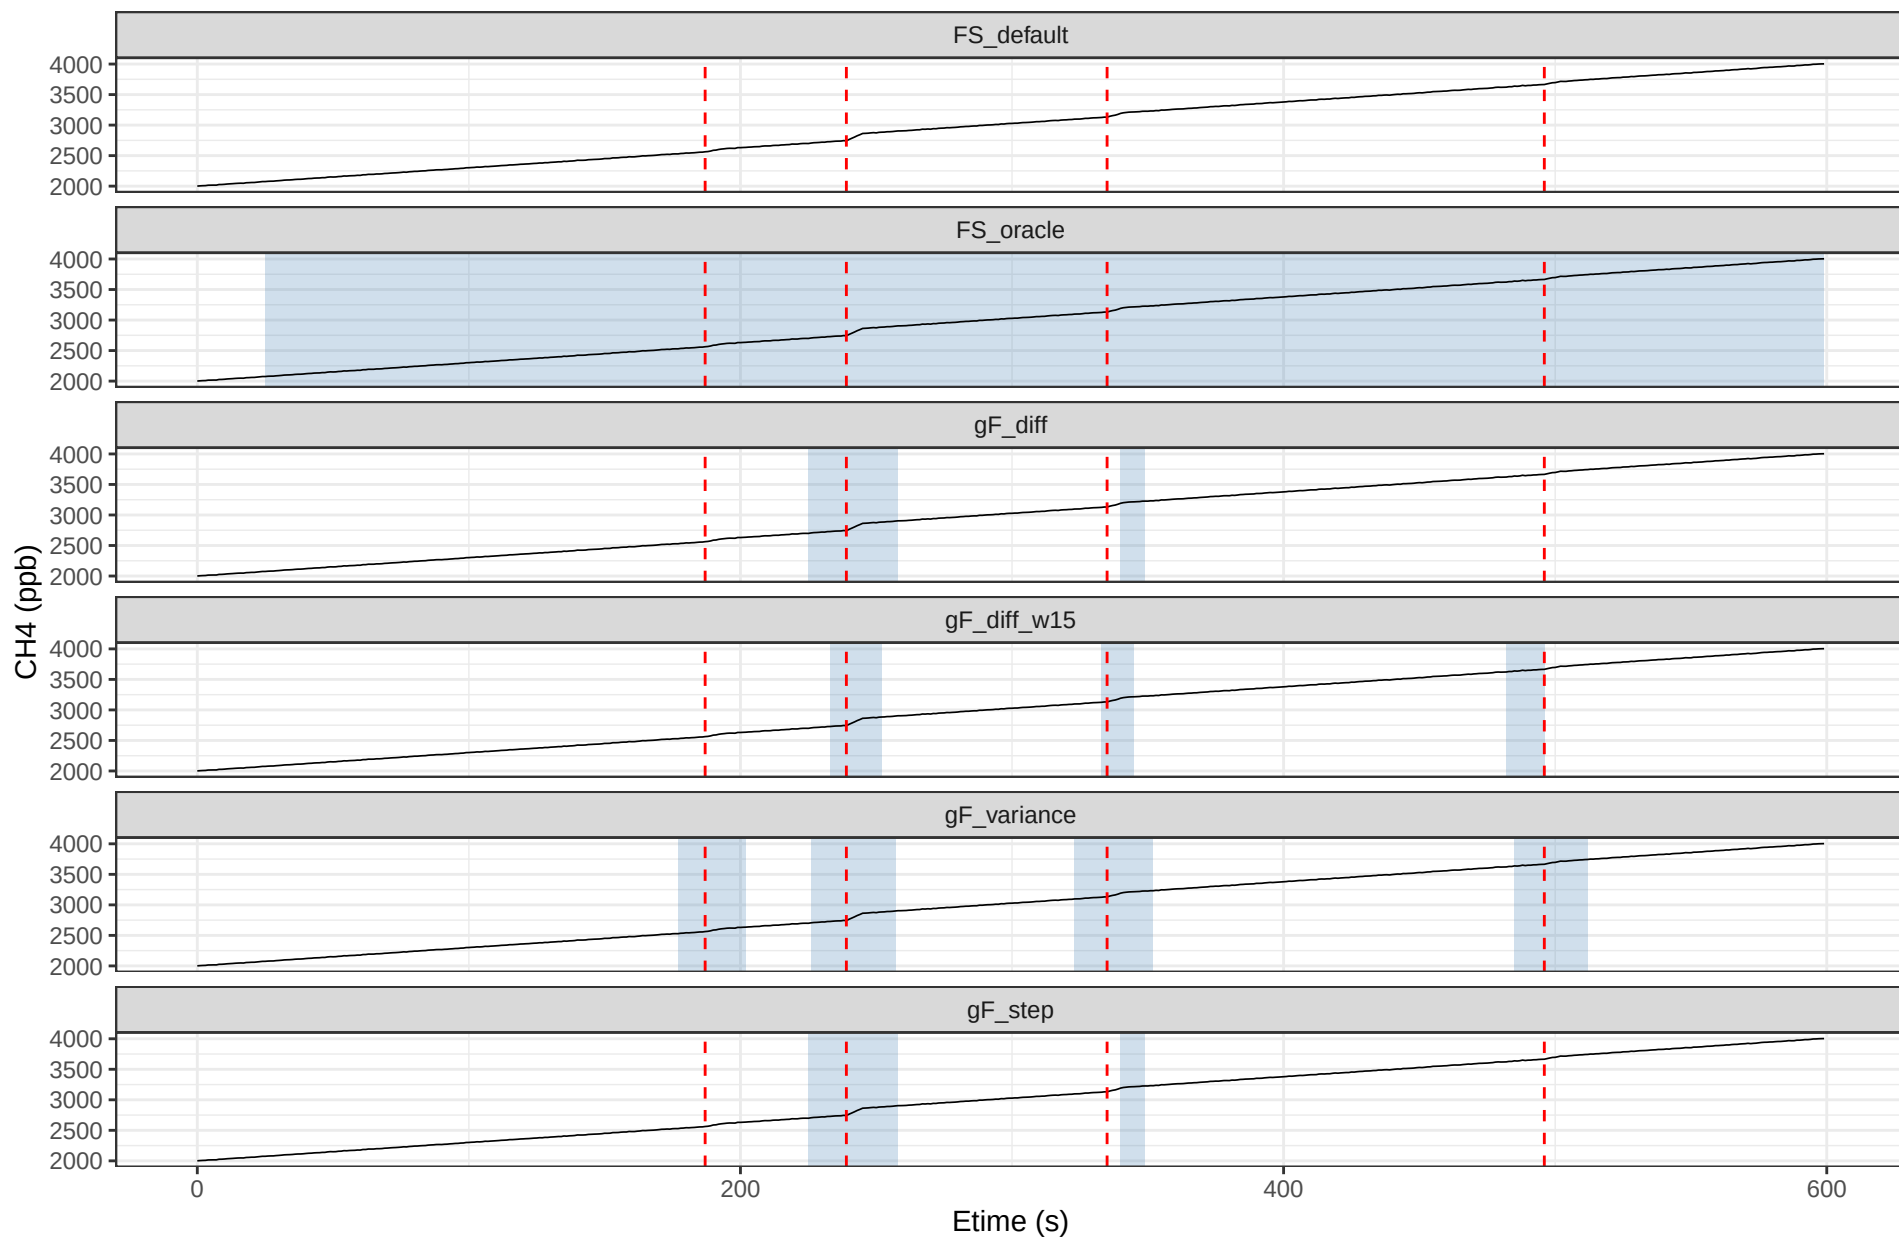

noise 20 ppb, slope 0.5 ppb/s, step 250 ppb, n = 10, overshoot 1

red dashed = true onsets; blue = detected events

