


ICF WALL REINFORCING		
WALL HEIGHT	VERTICAL REINFORCING	HORIZONTAL REINFORCING
10'-0" AND LESS	* 4 at 48"	* 4 at 32"
10'-1" TO 12'-0"	* 4 at 32"	* 4 at 32"
12'-1" TO 11'-0"	* 4 at 16"	* 4 at 32"


1. CONCRETE MINIMUM COMPRESSIVE STRENGTH = 3,000 PSI.
2. REINFORCING BARS MINIMUM YIELD = 60,000 PSI.

ROOF DECK
1/16" APA RATED SHEATHING, EXPOSURE 1,
SPAN RATING 24/16, NAIL W/ 8d
NAILS AT 6" O.C. AT PANEL EDGES AND
12" O.C. IN FIELD.

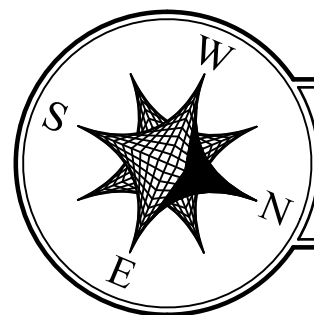


ROOF FRAMING PLAN

SCALE: 3/16" = 1'-0"

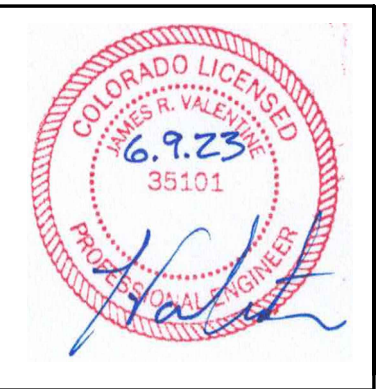

UNDERHILL RESIDENCE

5475 Schaefer Lane
Pueblo, Colorado
81004

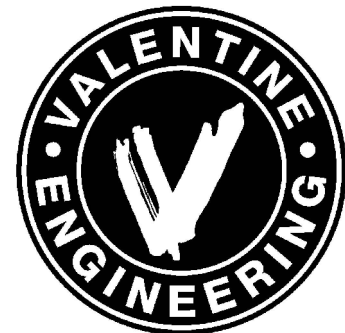

VALENTINE ENGINEERING, LLC

1108 N. Main Street
Pueblo, Colorado 81003 (719) 542-9230
www.VALENTINEENGINEERING.com

ROOF FRAMING PLAN

Project: 23.028
Date: June 9, 2023
Revision:

© 2023

S3

1' 3' 5' 7' 9'
SCALE BAR: 3/16" = 1'-0"