



False negatives per model and balancing strategy (fixed 12,000-flow test set per dataset)


CICIDS2017

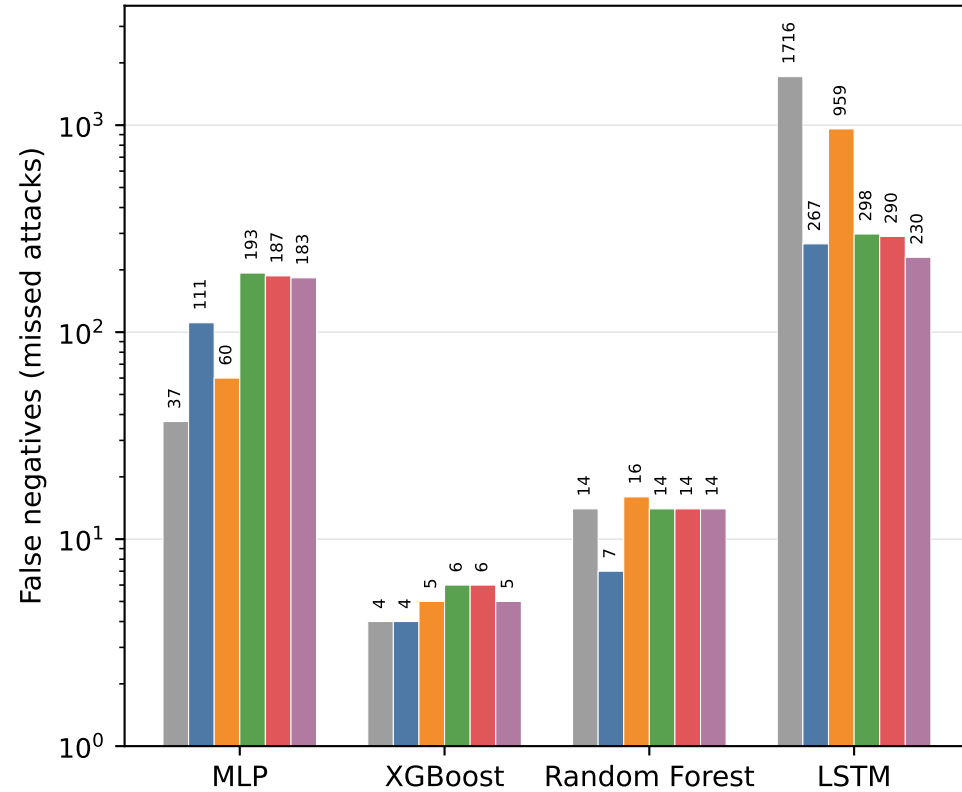

UNSW-NB15

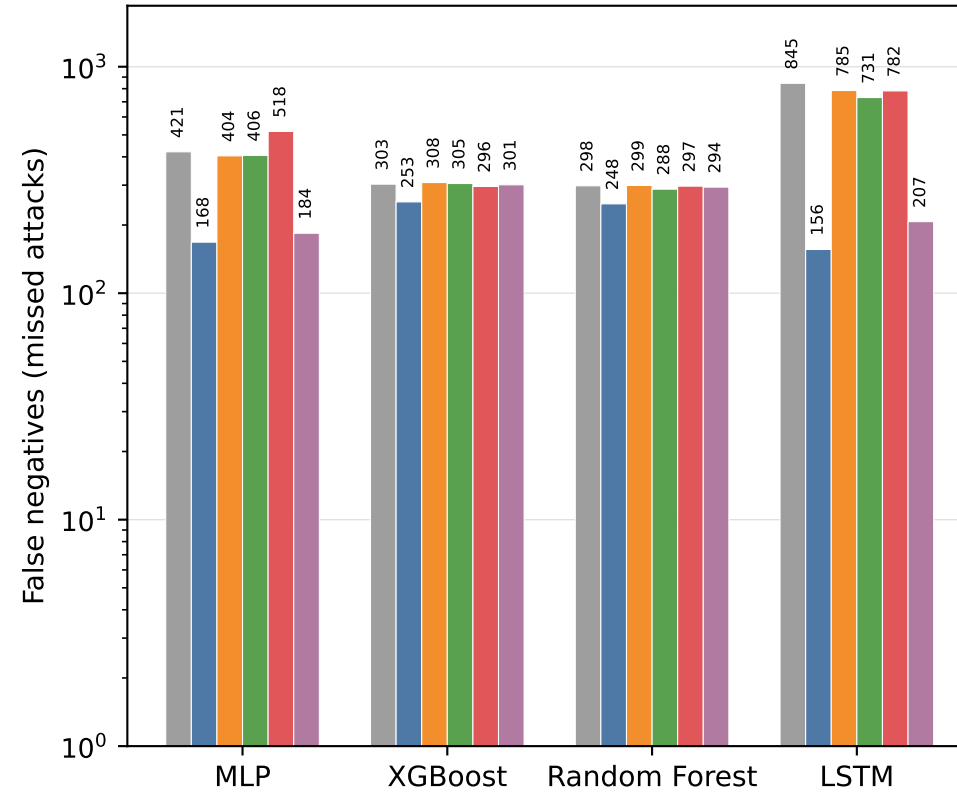

IoT-23

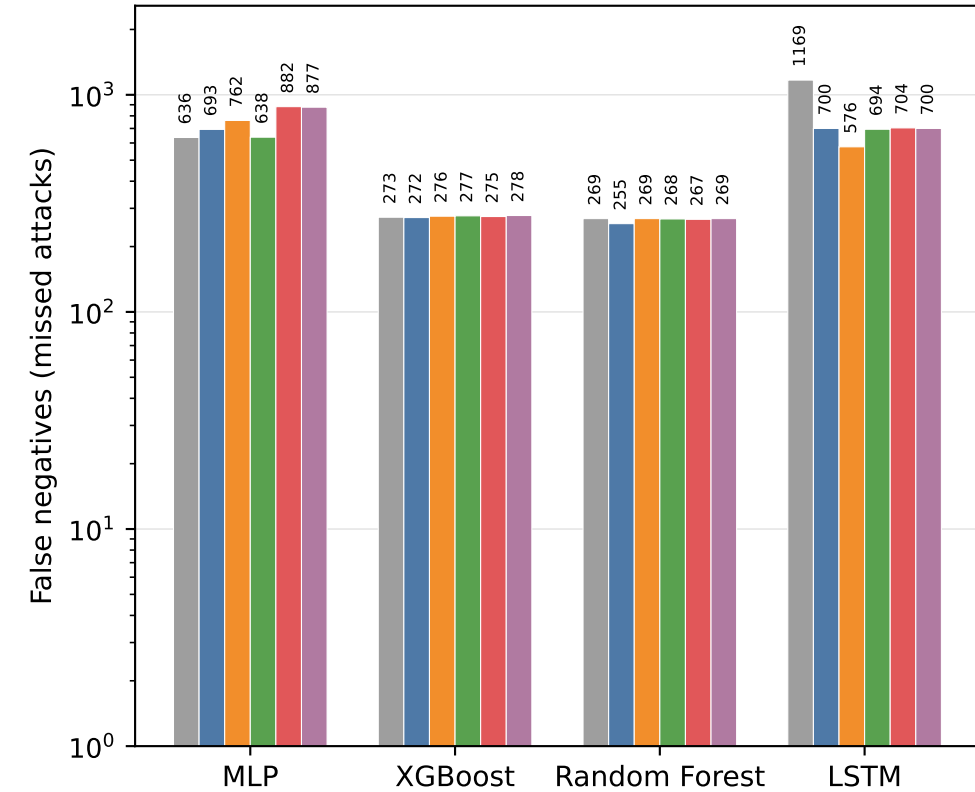

Original SMOTETomek GAN WGAN-GP cWGAN-GP CTGAN