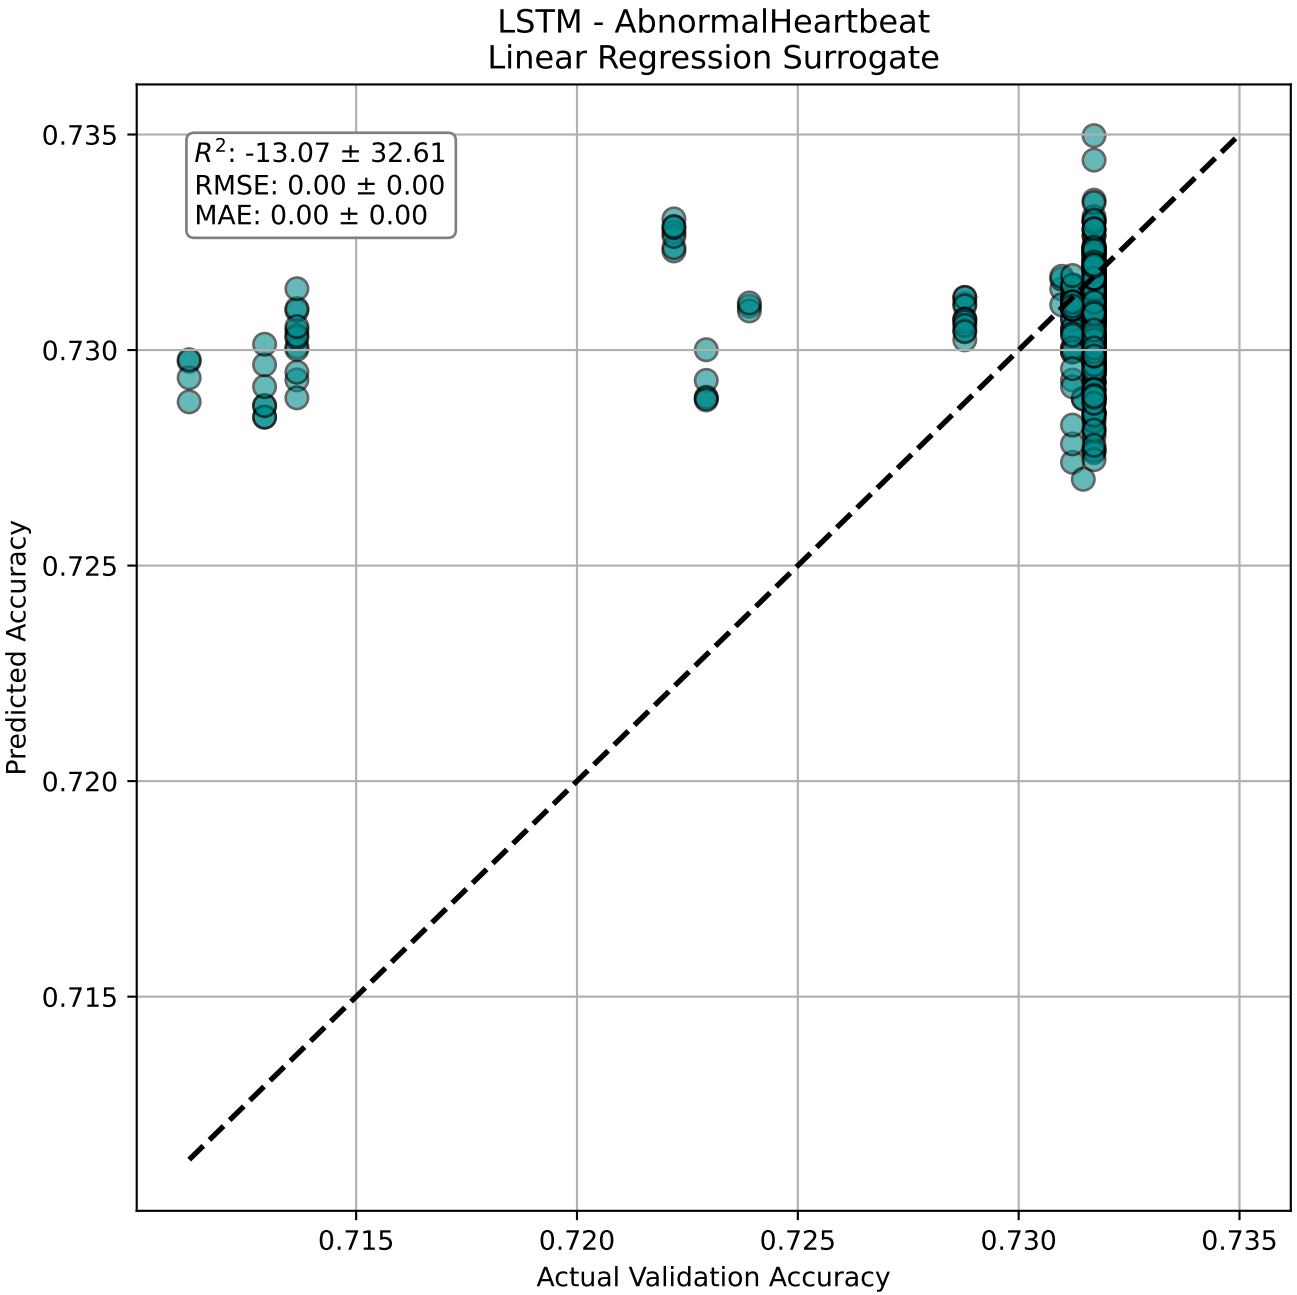
LSTM - AbnormalHeartbeat
Linear Regression Surrogate
R^2: -13.07 ± 32.61
RMSE: 0.00 ± 0.00
MAE: 0.00 ± 0.00
Predicted Accuracy
Actual Validation Accuracy
0.715
0.720
0.725
0.730
0.735