


UPPER HEAD AND ELEMENT DETAIL


NOTES:

MARK	QTY.	DESCRIPTION	PART #	REMARKS
1	1	DEFENDER FILTER SP-27-48-487-R	SP-27-48-487-R	
2	1	AUTOMATIC FILTER PROGRAMMER MODEL : RMF 12	MICRORMF	SHIP LOOSE
3	1	VACUUM TRANSFER UNIT	VACUUM	SHIP LOOSE
4	1	FILTER /REGULATOR 1/2" NPT CONNECTION	1000-5527	NOT SHOWN SHIP LOOSE
5	1	GAUGE PANEL KIT	1000-8245	SHIP LOOSE
6	1	VACUUM TRANSFER PLUMBING KIT	1000-5821	SHIP LOOSE
7	1	DEFENDER DRAIN VALVE 3" LEVER	1000-7320	SHIP LOOSE


1. FILTER TANK IS TO BE CONSTRUCTED OF HIGH QUALITY A36 CARBON STEEL, UPPER HEAD THICKNESS = 1 1/2" (38.1mm), LOWER HEAD THICKNESS = 5/16" (7.93mm) & SHELL THICKNESS = 1/4" (6.35mm).
2. INTERIOR OF TANK IS LINED WITH FLEXSOL 3000. EXTERIOR IS COATED WITH 5-8 MILS OF HIGH SOLIDS ENAMEL. NO WELDING OR EXTREME HEAT IS TO BE APPLIED TO TANK AFTER LINING OR COATING PROCESS IS DONE.
3. ELECTRICAL REQUIREMENTS: 120VAC-10-60Hz, 15 AMP CIRCUIT PROTECTION.
4. LOCATE ALL ELECTRICAL ITEMS IN A NON-HAZARDOUS LOCATION.
5. ELECTRICAL CONNECTIONS ARE THE RESPONSIBILITY OF THE CUSTOMER.
6. MEDIA QUANTITIES ARE INDICATED FOR INFORMATIONAL PURPOSES ONLY.
7. ALL PNEUMATIC TUBING SUPPLIED BY POOL CONTRACTOR.
8. DRAIN VALVE MUST BE A BUTTERFLY VALVE AND INSTALLED DIRECTLY ON THE BOTTOM TANK HEAD.
9. DESIGN PRESSURE IS 50 PSI (344.73 kpa). HYDROSTATICALLY TESTED TO 75 PSI (517.11 kpa).
10. THIS PRECOAT FILTER UTILIZES TUBE ELEMENTS AND THE EFFECTIVE FILTRATION AREA REPRESENTS THE UNCOATED AREA.

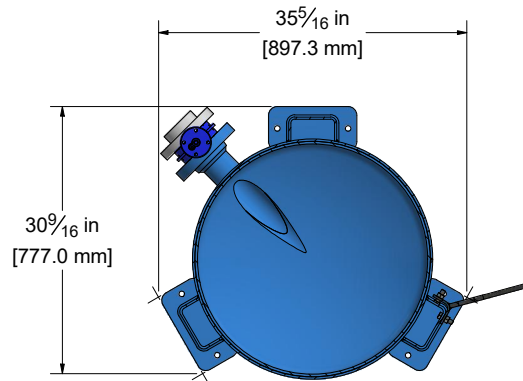

SECTION A-A
FOOT PRINT

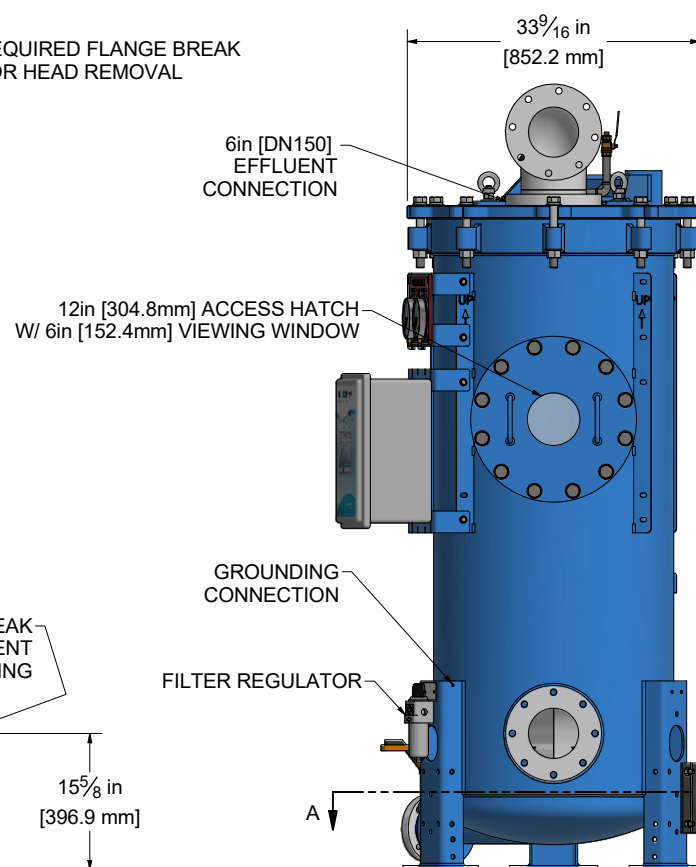

SHIPPING LEG

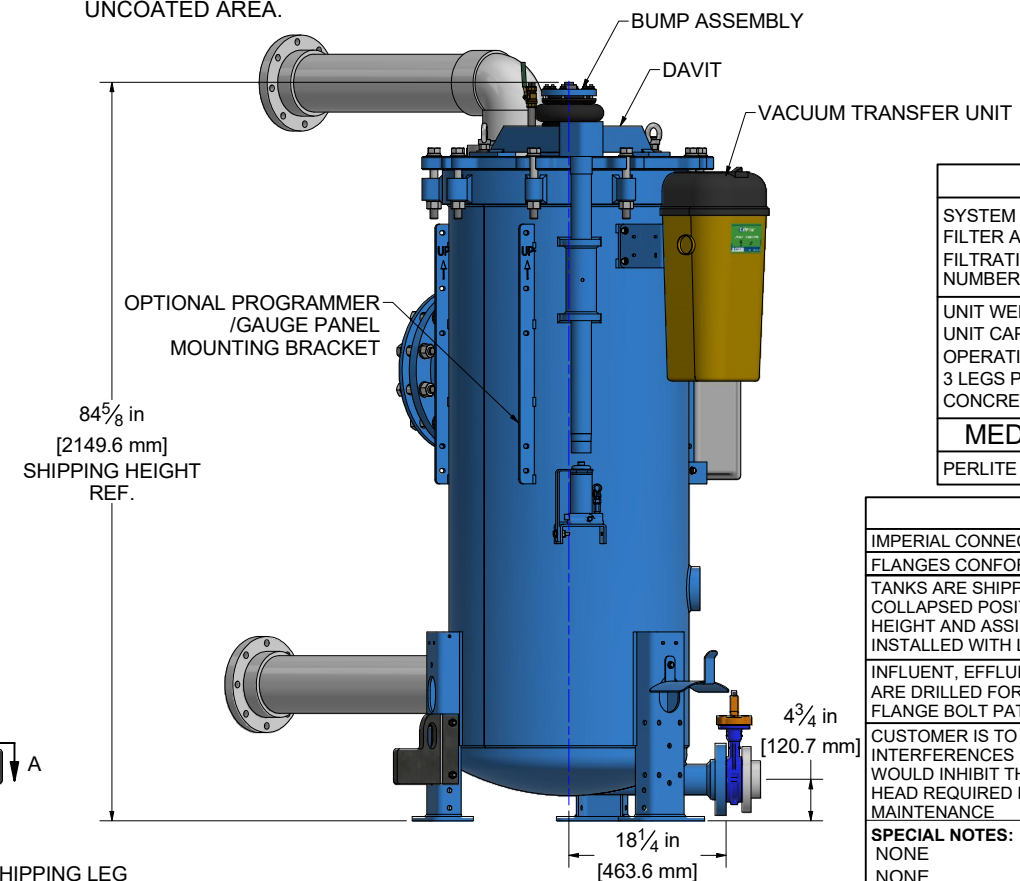

FILTER DATA
SYSTEM FLOW RATE = 191-535 GPM FILTER AREA = 255 SQ.FT FILTRATION RATE = .75-2.1 GPM/SQ.FT NUMBER OF TUBES = 487
UNIT WEIGHT - DRY : 1,650 LBS UNIT CAPACITY : 159 GALS OPERATING WEIGHT : 2,970 LBS 3 LEGS PER TANK CONCRETE BEARING PRESSURE =20 PSI
MEDIA REQUIREMENTS
PERLITE : 30 LBS (3.6 CU.FT.)

NOTES

IMPERIAL CONNECTIONS	
FLANGES CONFORM TO ANSI B16.5, CLASS 150	
TANKS ARE SHIPPED WITH LEGS IN THE COLLAPSED POSITION TO REDUCE OVERALL HEIGHT AND ASSIST TANK ACCESS. TANK MUST BE INSTALLED WITH LEGS IN EXTENDED POSITION.	
INFLUENT, EFFLUENT, & DRAIN CONNECTIONS ARE DRILLED FOR METRIC AND IMPERIAL FLANGE BOLT PATTERNS	
CUSTOMER IS TO CONFIRM THERE ARE NO INTERFERENCES IN THE FILTER ROOM THAT WOULD INHIBIT THE ROTATIONAL SWING OF THE HEAD REQUIRED FOR GENERAL FILTER MAINTENANCE	
SPECIAL NOTES:	
NONE	
NONE	

-	-	-	-	-	-	-
REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE APPROPRIATE TO THE DESIGN, ARE THE PROPERTY OF EVOLVO AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORM, OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOLVO. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE NOT TO BE USED IN VIOLATION OF ANY COPYRIGHT LAWS, UPON DEMAND OF EVOLVO. THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOLVO UPON REQUEST. ACCEPTANCE BY EVOLVO, ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY:	DATE
INT	MM/DD/YY
CKD BY:	DATE
INT	MM/DD/YY
APPD BY:	DATE
MGD BY:	
REF:	
SCALE:	NTS

TITLE	
CLIENT	
	 evoqua WATER TECHNOLOGIES

PROJECT NAME			
POOL NAME			
CLIENT NAME			
EVOQUA WATER TECHNOLOGIES WARWICK RI USA +1(0)1-800-832-8002			
NUMBER 48-487-R	DMS REFERENCE ####	SHEET OF 1 1	REV -