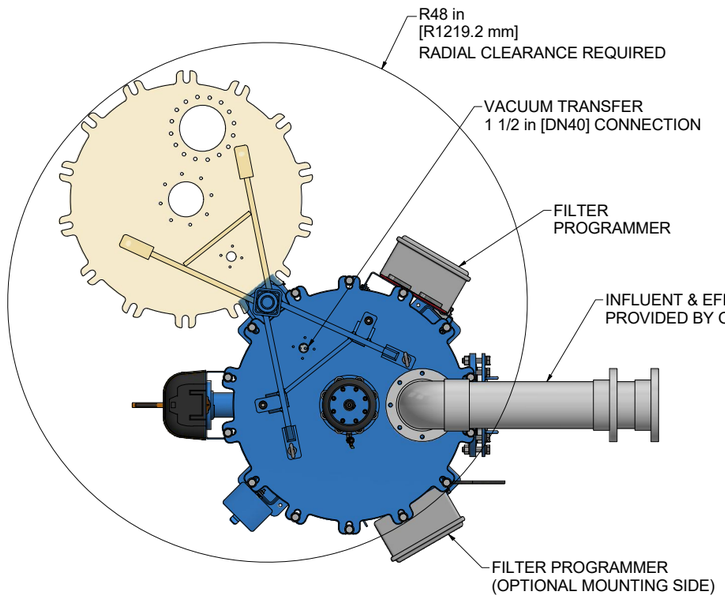


NOTE: DIMENSIONS FOR REFERENCE ONLY, NOT FOR CONSTRUCTION UNLESS CERTIFIED BY NEPTUNE BENSON.

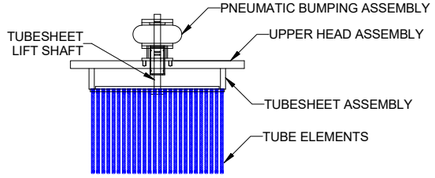


UPPER HEAD AND ELEMENT DETAIL

| MARK | QTY. | DESCRIPTION | PART # | REMARKS |
|---|---|---|---|---|
| 1 | 1 | DEFENDER FILTER SP-41-48-1038-R | SP-41-48-1038-R | |
| 2 | 1 | AUTOMATIC FILTER PROGRAMMER MODEL : RMF 12 | MICRORMF | SHIP LOOSE |
| 3 | 1 | VACUUM TRANSFER UNIT | VACUUM | SHIP LOOSE |
| 4 | 1 | FILTER /REGULATOR 1/2" NPT CONNECTION | 1000-5527 | SHIP LOOSE |
| 5 | 1 | GAUGE PANEL KIT | 1000-8245 | SHIP LOOSE |
| 6 | 1 | VACUUM TRANSFER PLUMBING KIT | 1000-5821 | NOT SHOWN SHIP LOOSE |
| 7 | 1 | DEFENDER DRAIN VALVE 4" LEVER | 1000-7321 | SHIP LOOSE |

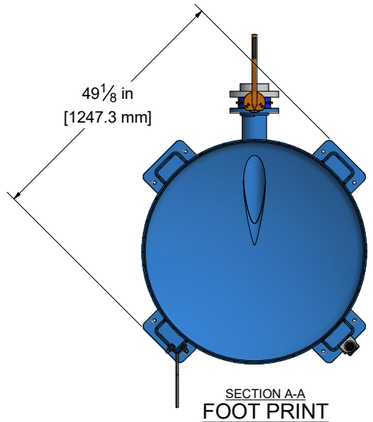


SECTION A-A
FOOT PRINT

NOTES:

1. FILTER TANK IS TO BE CONSTRUCTED OF HIGH QUALITY A36 CARBON STEEL, UPPER HEAD THICKNESS = 1 1/2" (38.1mm), LOWER HEAD THICKNESS = 5/16" (7.93mm) & SHELL THICKNESS = 1/4" (6.35mm).
2. INTERIOR OF TANK IS LINED WITH FLEXSOL 3000. EXTERIOR IS COATED WITH 5-8 MILS OF HIGH SOLIDS ENAMEL. NO WELDING OR EXTREME HEAT IS TO BE APPLIED TO TANK AFTER LINING OR COATING PROCESS IS DONE.
3. ELECTRICAL REQUIREMENTS: 120VAC-10-60Hz, 15 AMP CIRCUIT PROTECTION.
4. LOCATE ALL ELECTRICAL ITEMS IN A NON-HAZARDOUS LOCATION.
5. ELECTRICAL CONNECTIONS ARE THE RESPONSIBILITY OF THE CUSTOMER.
6. MEDIA QUANTITIES ARE INDICATED FOR INFORMATIONAL PURPOSES ONLY.
7. ALL PNEUMATIC TUBING SUPPLIED BY POOL CONTRACTOR.
8. DRAIN VALVE MUST BE A BUTTERFLY VALVE AND INSTALLED DIRECTLY ON THE BOTTOM TANK HEAD.
9. DESIGN PRESSURE IS 50 PSI (344.73 kpa). HYDROSTATICALLY TESTED TO 75 PSI (517.11 kpa).
10. THIS PRECOAT FILTER UTILIZES TUBE ELEMENTS AND THE EFFECTIVE FILTRATION AREA REPRESENTS THE UNCOATED AREA.

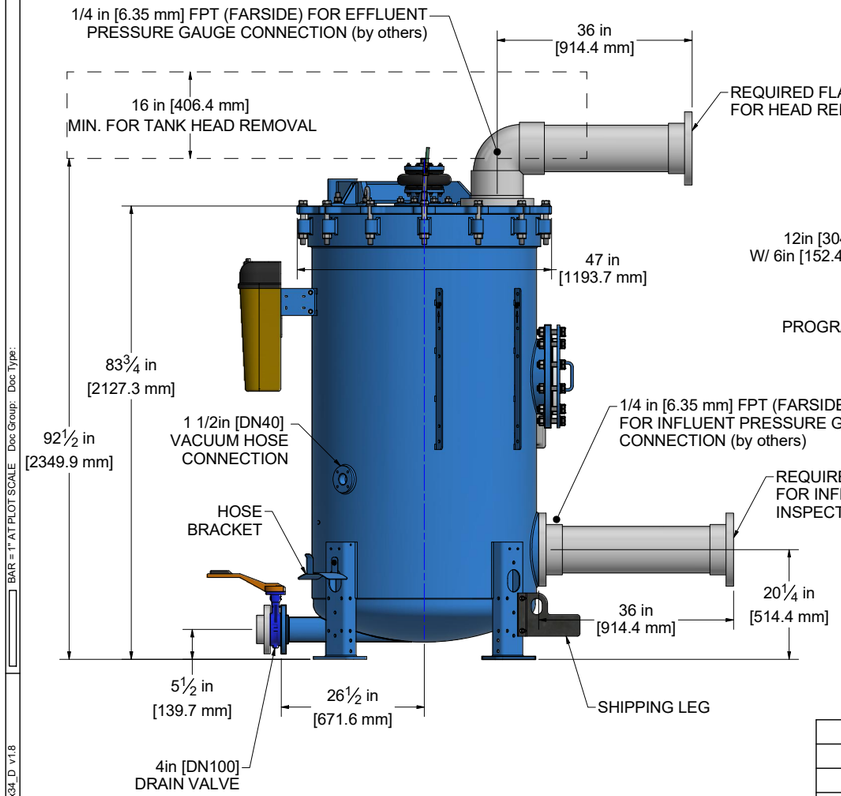


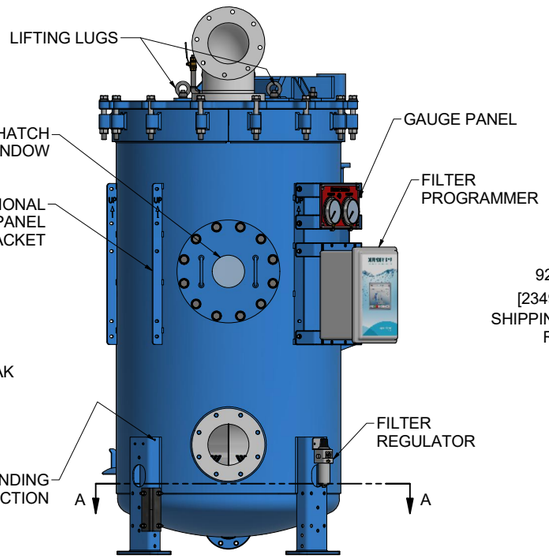


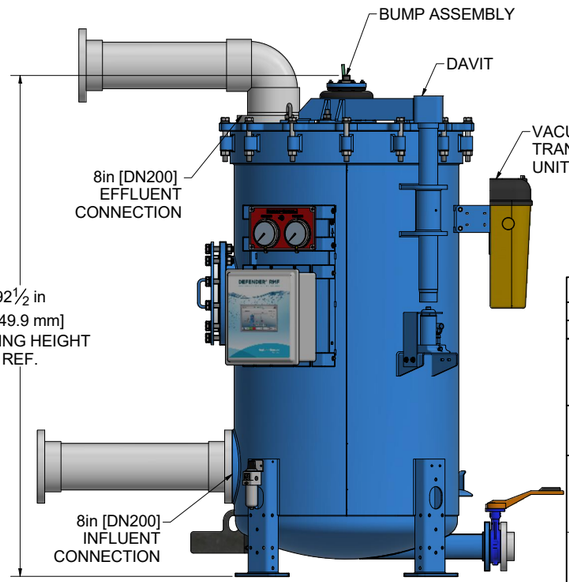


## FILTER DATA

SYSTEM FLOW RATE = 408-1141 GPM
FILTER AREA = 543 SQ.FT
FILTRATION RATE = .75-2.1 GPM/SQ.FT
NUMBER OF TUBES = 1038

UNIT WEIGHT - DRY : 2,350 LBS
UNIT CAPACITY : 441 GALS
OPERATING WEIGHT : 6,019 LBS
4 LEGS PER TANK
CONCRETE BEARING PRESSURE =30 PSI

## MEDIA REQUIREMENTS

PERLITE : 64 LBS (7.68 CU.FT.)

## NOTES

IMPERIAL CONNECTIONS

FLANGES CONFORM TO ANSI B16.5, CLASS 150

TANKS ARE SHIPPED WITH LEGS IN THE COLLAPSED POSITION TO REDUCE OVERALL HEIGHT AND ASSIST TANK ACCESS. TANK MUST BE INSTALLED WITH LEGS IN EXTENDED POSITION.

INFLUENT, EFFLUENT, & DRAIN CONNECTIONS ARE DRILLED FOR METRIC AND IMPERIAL FLANGE BOLT PATTERNS

CUSTOMER IS TO CONFIRM THERE ARE NO INTERFERENCES IN THE FILTER ROOM THAT WOULD INHIBIT THE ROTATIONAL SWING OF THE HEAD REQUIRED FOR GENERAL FILTER MAINTENANCE

**SPECIAL NOTES:**
NONE
NONE

| REV | DESCRIPTION | DATE | DWN | CKD | APPD | ECN |
|---|---|---|---|---|---|---|
| - | - | - | - | - | | |

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: INT DATE MM/DD/YY
CKD BY: INT DATE MM/DD/YY
APPD BY: DATE
MGD BY:
REF:
SCALE: NTS

TITLE: PROJECT NAME
POOL NAME
CLIENT: CLIENT NAME

EVOQUA WATER TECHNOLOGIES
EVOQUA WATER TECHNOLOGIES
WARWICK RI USA
+1(0)1-800-832-8002

| PROJECT | PART NUMBER | DMS REFERENCE | SHEET | REV |
|---|---|---|---|---|
| JOB# | SP-41-48-1038-R | #### | 1 OF 1 | |

BAR = 1" AT PLOT SCALE Doc Group: Doc Type:
STD:22x34_D v1.8