





STD:22x34_D v4.4 BAR = 1" AT PLOT SCALE

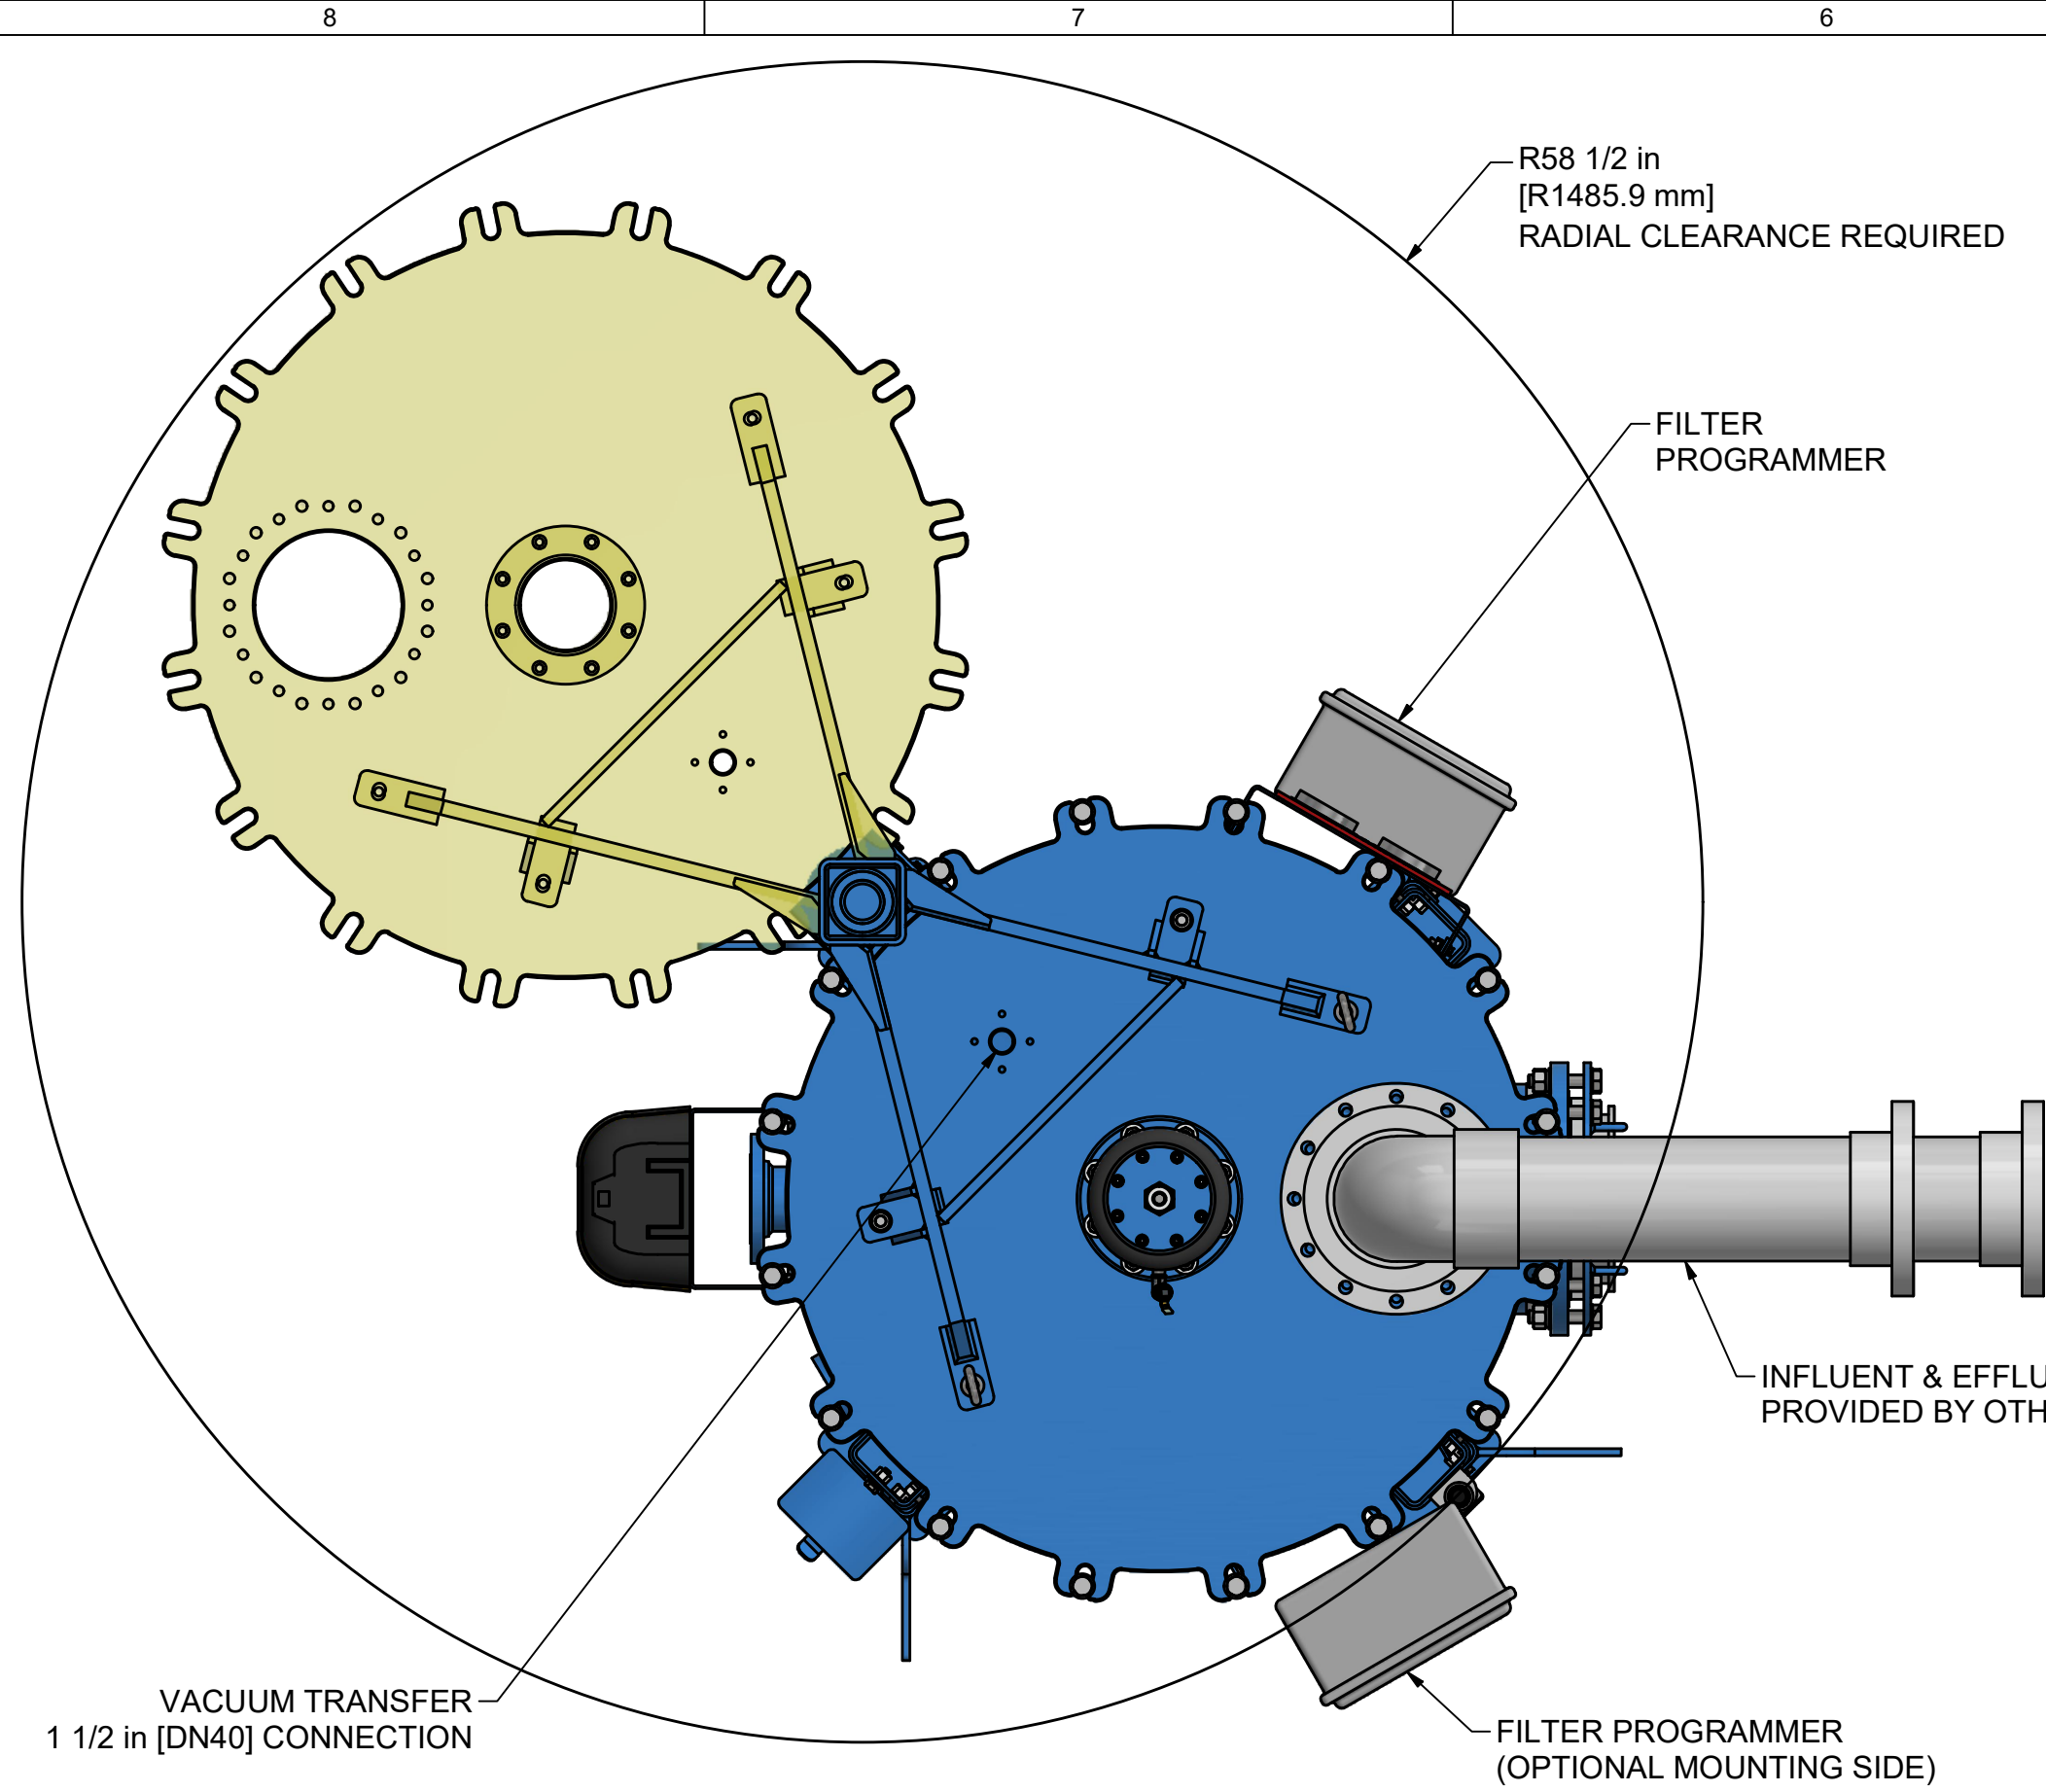

NOTE: DIMENSIONS FOR REFERENCE ONLY, NOT FOR CONSTRUCTION UNLESS CERTIFIED BY XYLEM NEPTUNE BENSON.

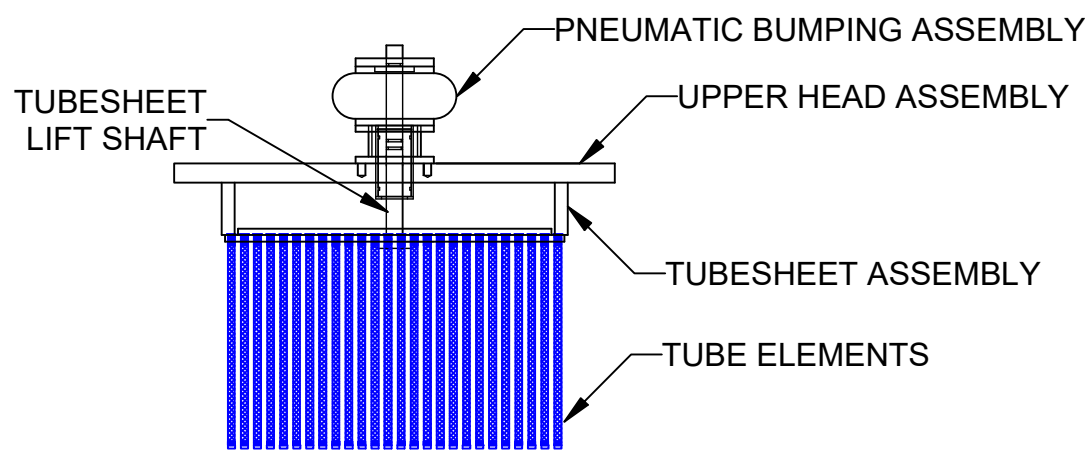

UPPER HEAD AND ELEMENT DETAIL

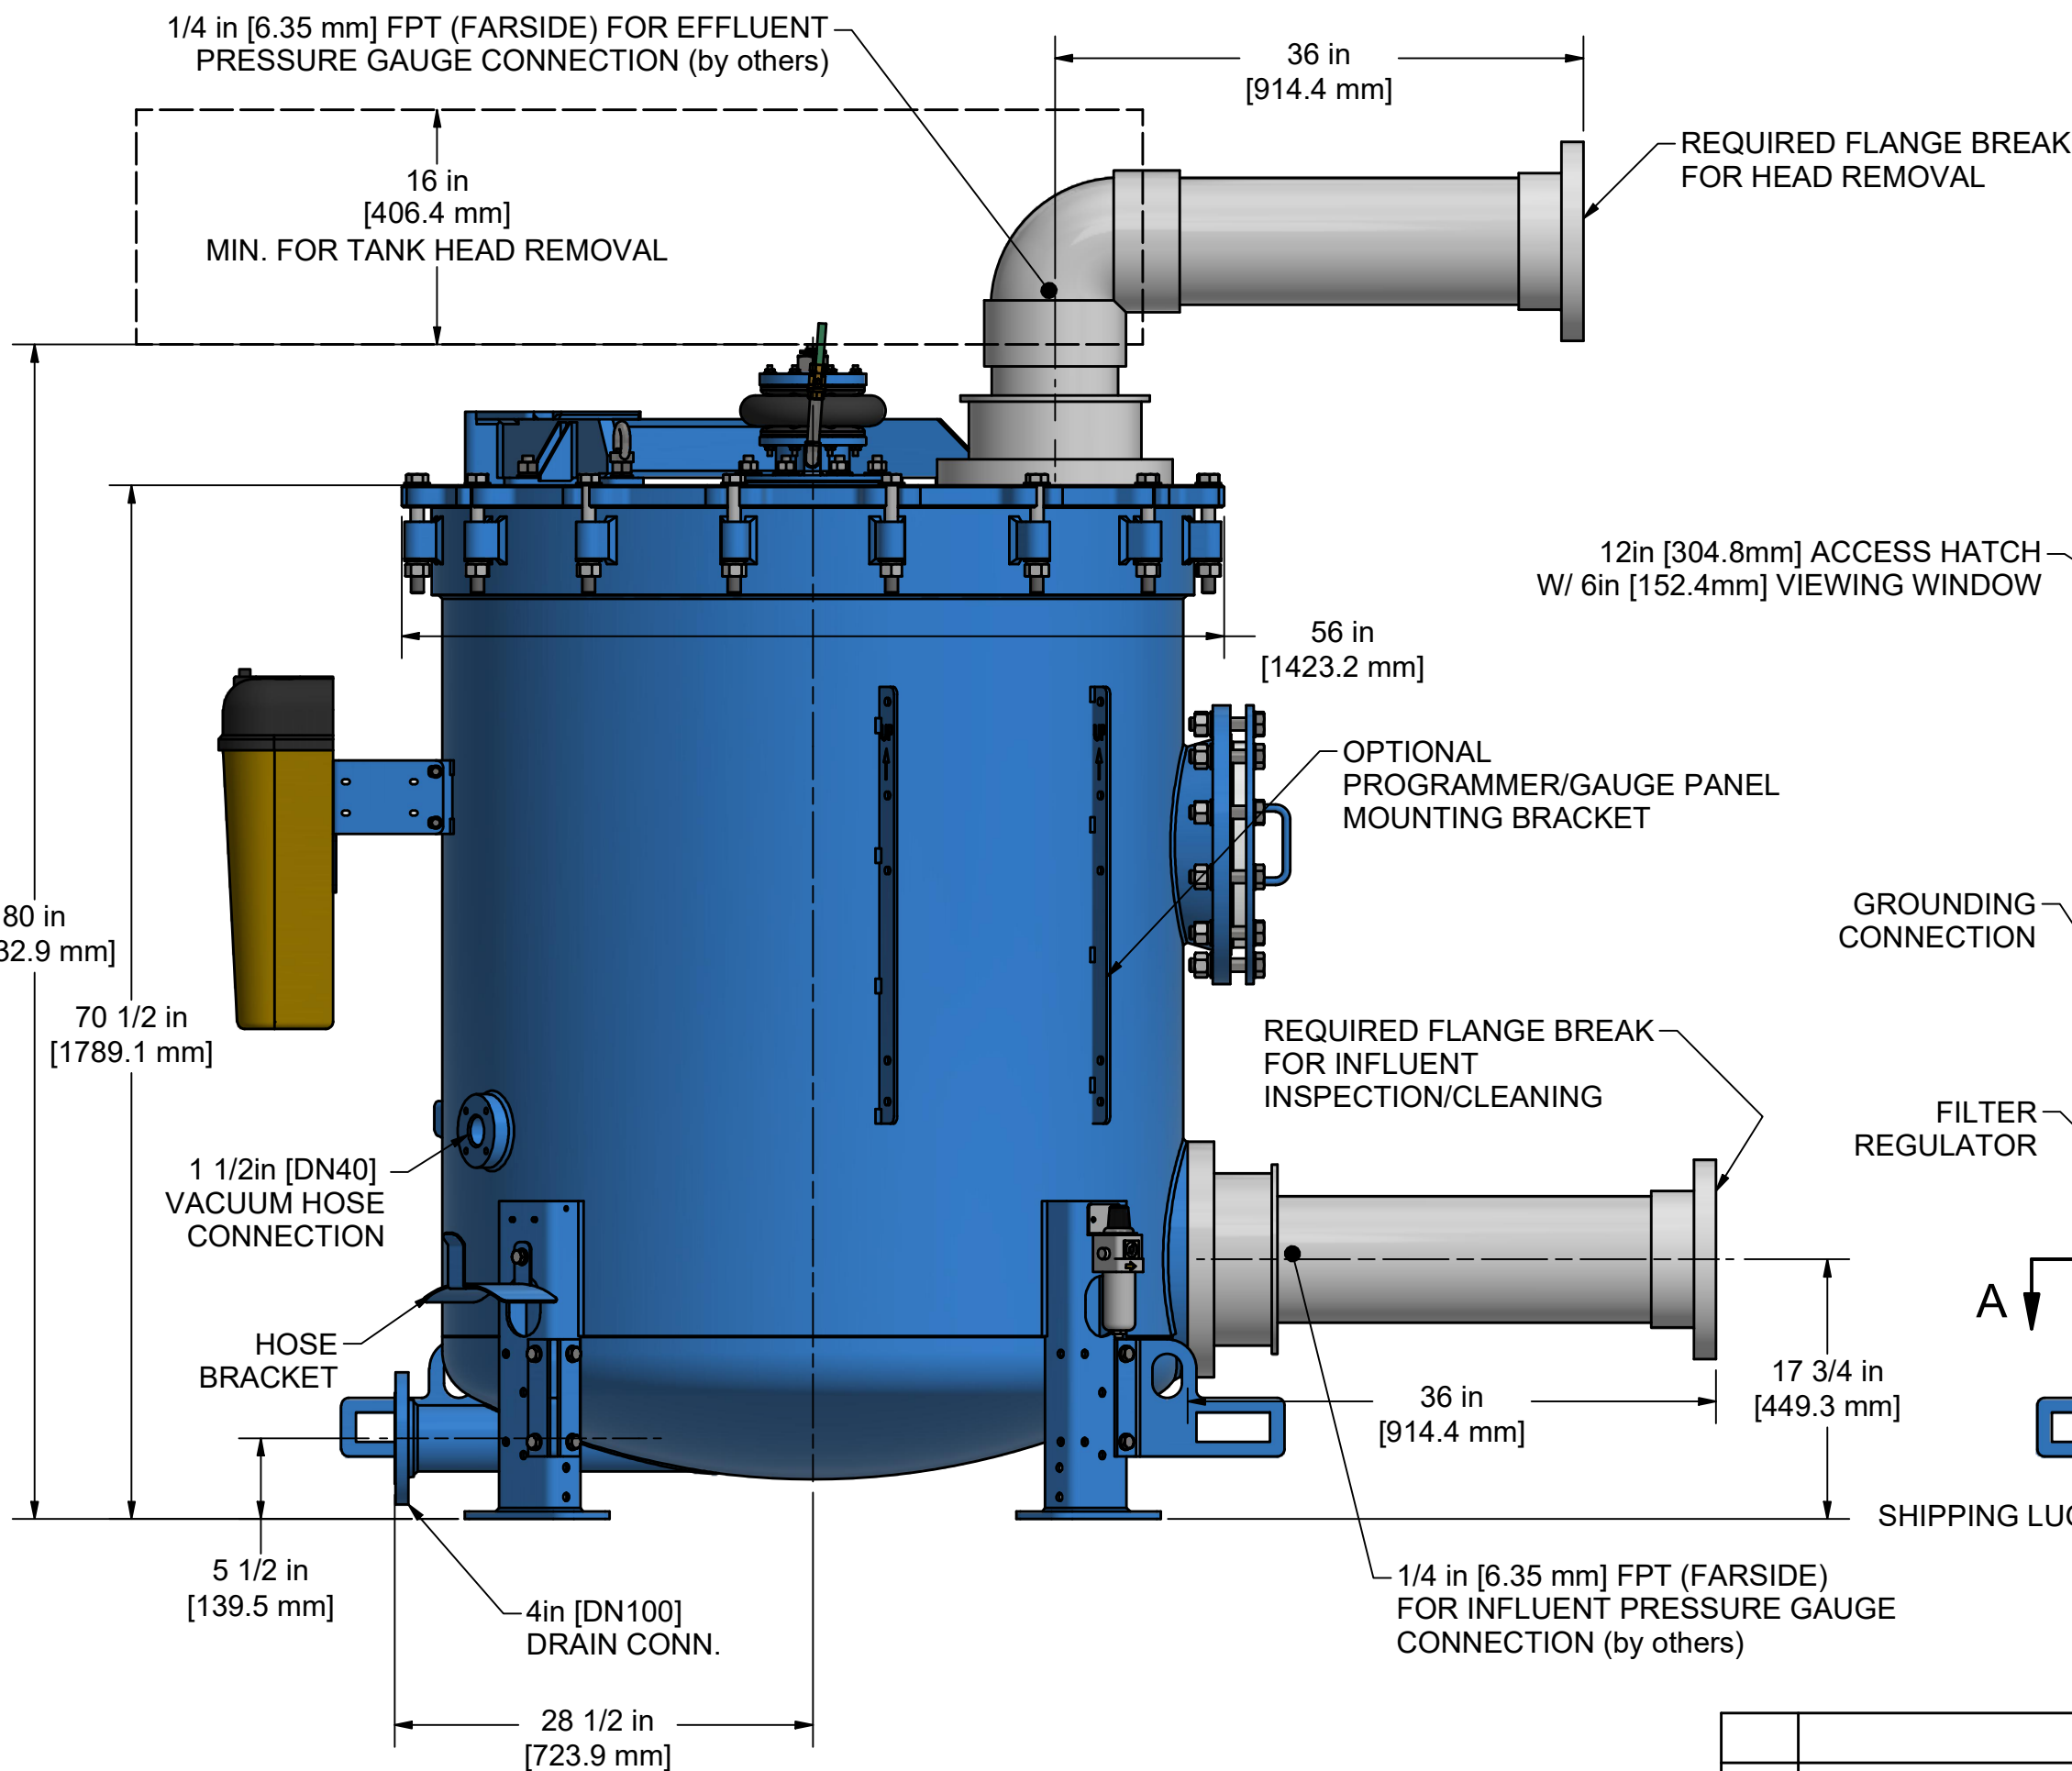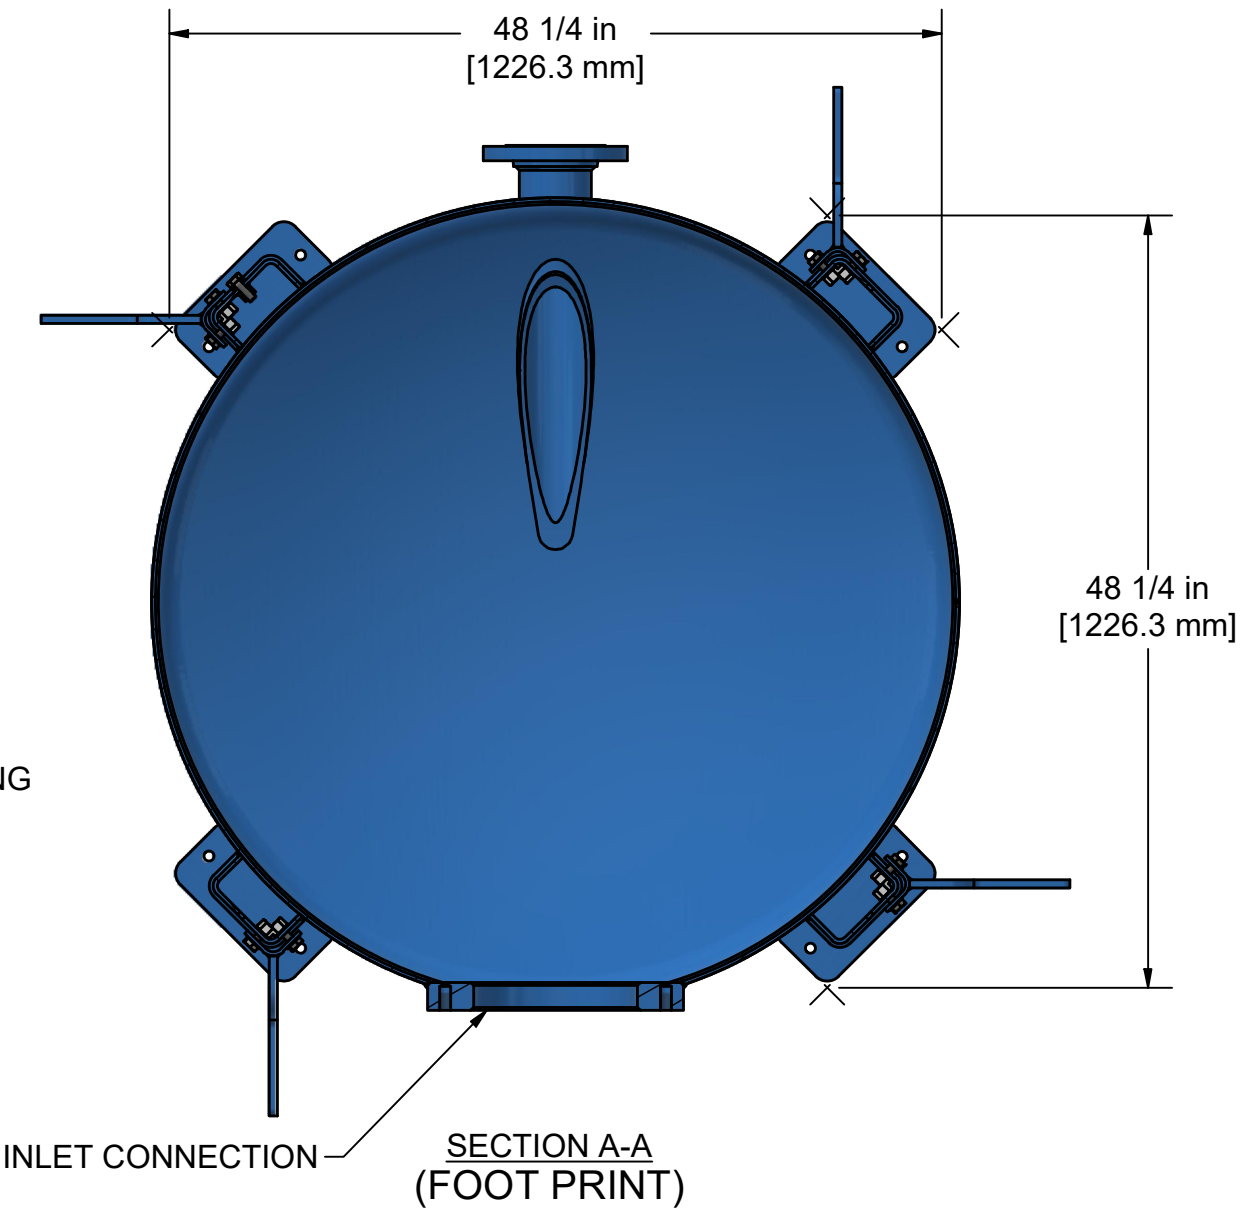

REQUIRED FLANGE BREAK FOR HEAD REMOVAL

OPTIONAL PROGRAMMER/GAUGE PANEL MOUNTING BRACKET


REQUIRED FLANGE BREAK FOR INFLUENT INSPECTION/CLEANING

GROUNDING CONNECTION

FILTER REGULATOR

SHIPPING LUGS

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN
-	-		DYMNYR	INIT		
-	-		DYMNYR	INIT	-	-

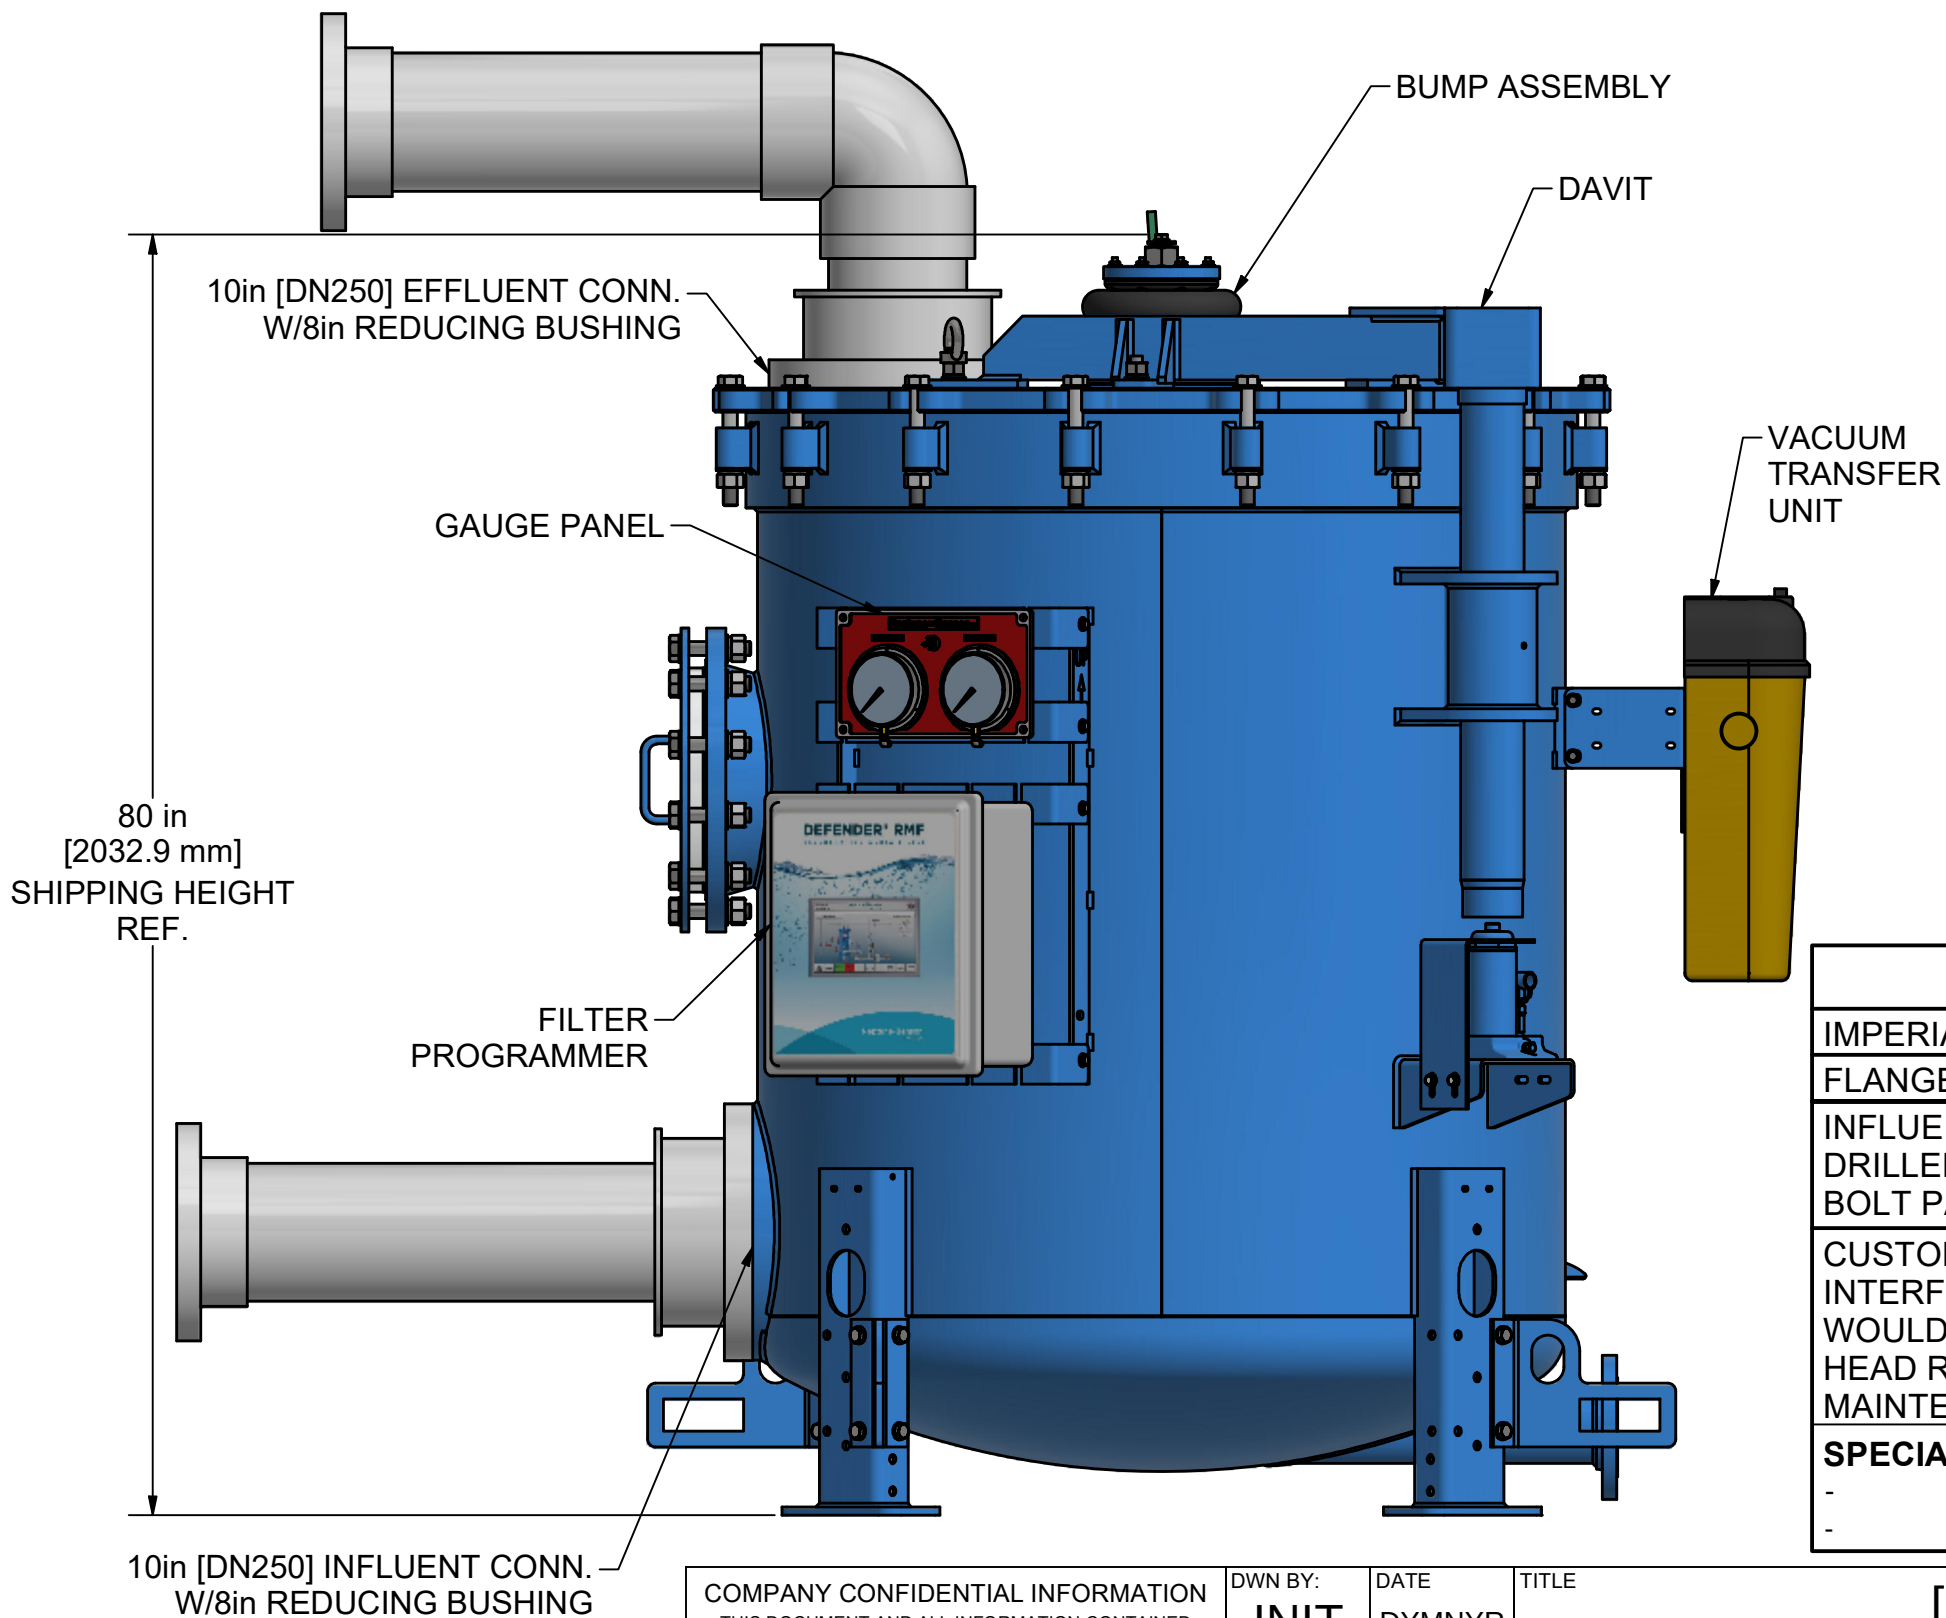

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM ARE THE PROPERTY OF EVOQUA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVOQUA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVOQUA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVOQUA OR DESTROYED, AS INSTRUCTED BY EVOQUA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY: INIT
CKD BY: INIT
APPD BY: DATE
MGD BY: SCALE
NA NTS
PART NUMBER SP-50-36-1698

DATE DYMNYR
DATE DYMNYR
DATE
SCALE
NTS
PROJ/PROD NUMBER -
CODE Z-GA01
FILE/DRAWING NUMBER V113860454
SHEET 1 OF 1
REV -

TITLE
CLIENT
[PROJECT NAME]
[POOL NAME]
[CLIENT NAME]
EVOQUA WATER TECHNOLOGIES
WARWICK RI USA
+1 800-832-8002

FILTER DATA	
SYSTEM FLOW RATE = 500-1400 GPM	
FILTER AREA = 667 SQ.FT	
FILTRATION RATE = .75-2.1 GPM/SQ.FT	
NUMBER OF TUBES = 1698	
UNIT WEIGHT - DRY : 3,540 LBS	
UNIT CAPACITY : 545 GALS	
OPERATING WEIGHT : 8,159 LBS	
4 LEGS PER TANK	
CONCRETE BEARING PRESSURE = 42 PSI	
MEDIA REQUIREMENTS	
PERLITE : 79 LBS (8.9 CU.FT.)	

NOTES
IMPERIAL CONNECTIONS
FLANGES CONFORM TO ANSI B16.5, CLASS 150
INFLUENT & EFFLUENT CONNECTIONS ARE DRILLED FOR METRIC AND IMPERIAL FLANGE BOLT PATTERNS
CUSTOMER IS TO CONFIRM THERE ARE NO INTERFERENCES IN THE FILTER ROOM THAT WOULD INHIBIT THE ROTATIONAL SWING OF THE HEAD REQUIRED FOR GENERAL FILTER MAINTENANCE
SPECIAL NOTES: 10" X 8" REDUCING BUSHINGS

- NOTES:
- FILTER TANK IS TO BE CONSTRUCTED OF HIGH QUALITY A36 CARBON STEEL, UPPER HEAD THICKNESS = 1 1/2" (38.1mm), LOWER HEAD THICKNESS = 13/32" (10.31mm) & SHELL THICKNESS = 1/4" (6.35mm).
 - INTERIOR OF TANK IS LINED WITH FLEXSOL 3000. EXTERIOR IS COATED WITH 5-8 MILS OF HIGH SOLIDS ENAMEL. NO WELDING OR EXTREME HEAT IS TO BE APPLIED TO TANK AFTER LINING OR COATING PROCESS IS DONE.
 - ELECTRICAL REQUIREMENTS: 120VAC-10-60Hz, 15 AMP CIRCUIT PROTECTION.
 - LOCATE ALL ELECTRICAL ITEMS IN A NON-HAZARDOUS LOCATION.
 - ELECTRICAL CONNECTIONS ARE THE RESPONSIBILITY OF THE CUSTOMER.
 - MEDIA QUANTITIES ARE INDICATED FOR INFORMATIONAL PURPOSES ONLY.
 - ALL PNEUMATIC TUBING SUPPLIED BY POOL CONTRACTOR.
 - DRAIN VALVE MUST BE A BUTTERFLY VALVE AND INSTALLED ON THE DRAIN FLANGE.
 - DESIGN PRESSURE IS 50 PSI (344.73 kpa). HYDROSTATICALLY TESTED TO 75 PSI (517.11 kpa).

MARK	QTY.	DESCRIPTION	PART #	REMARKS
1	1	DEFENDER FILTER SP-50-36-1698	SP-50-36-1698	
2	1	AUTOMATIC FILTER PROGRAMMER MODEL : RMF 12	MICRORMF	SHIP LOOSE
3	1	VACUUM TRANSFER UNIT	VACUUM	SHIP LOOSE
4	1	FILTER /REGULATOR 1/2" NPT CONNECTION	1000-5527	SHIP LOOSE
5	1	GAUGE PANEL KIT	1000-8245	SHIP LOOSE
6	1	VACUUM TRANSFER PLUMBING KIT	1000-5821	NOT SHOWN
7	1	DEFENDER DRAIN VALVE 4" LEVER	1000-7321	SHIP LOOSE
8	2	BUSHING REDUCER ASSY 10" X 8"	1000-5875	SHIP LOOSE