


1. FILTER TANK IS TO BE CONSTRUCTED OF HIGH QUALITY A36 CARBON STEEL, UPPER HEAD THICKNESS = 1 1/2" (38.1mm), LOWER HEAD THICKNESS = 13/32" (10.31mm) & SHELL THICKNESS = 1/4" (6.35mm).
2. INTERIOR OF TANK IS LINED WITH FLEXSOL 3000. EXTERIOR IS COATED WITH 5-8 MILS OF HIGH SOLIDS ENAMEL. NO WELDING OR EXTREME HEAT IS TO BE APPLIED TO TANK AFTER LINING OR COATING PROCESS IS DONE.
3. ELECTRICAL REQUIREMENTS: 120VAC-10-60Hz, 15 AMP CIRCUIT PROTECTION.
4. LOCATE ALL ELECTRICAL ITEMS IN A NON-HAZARDOUS LOCATION.
5. ELECTRICAL CONNECTIONS ARE THE RESPONSIBILITY OF THE CUSTOMER.
6. MEDIA QUANTITIES ARE INDICATED FOR INFORMATIONAL PURPOSES ONLY.
7. ALL PNEUMATIC TUBING SUPPLIED BY POOL CONTRACTOR.
8. DRAIN VALVE MUST BE A BUTTERFLY VALVE AND INSTALLED ON THE DRAIN FLANGE.
9. DESIGN PRESSURE IS 50 PSI (344.73 kpa). HYDROSTATICALLY TESTED TO 75 PSI (517.11 kpa).

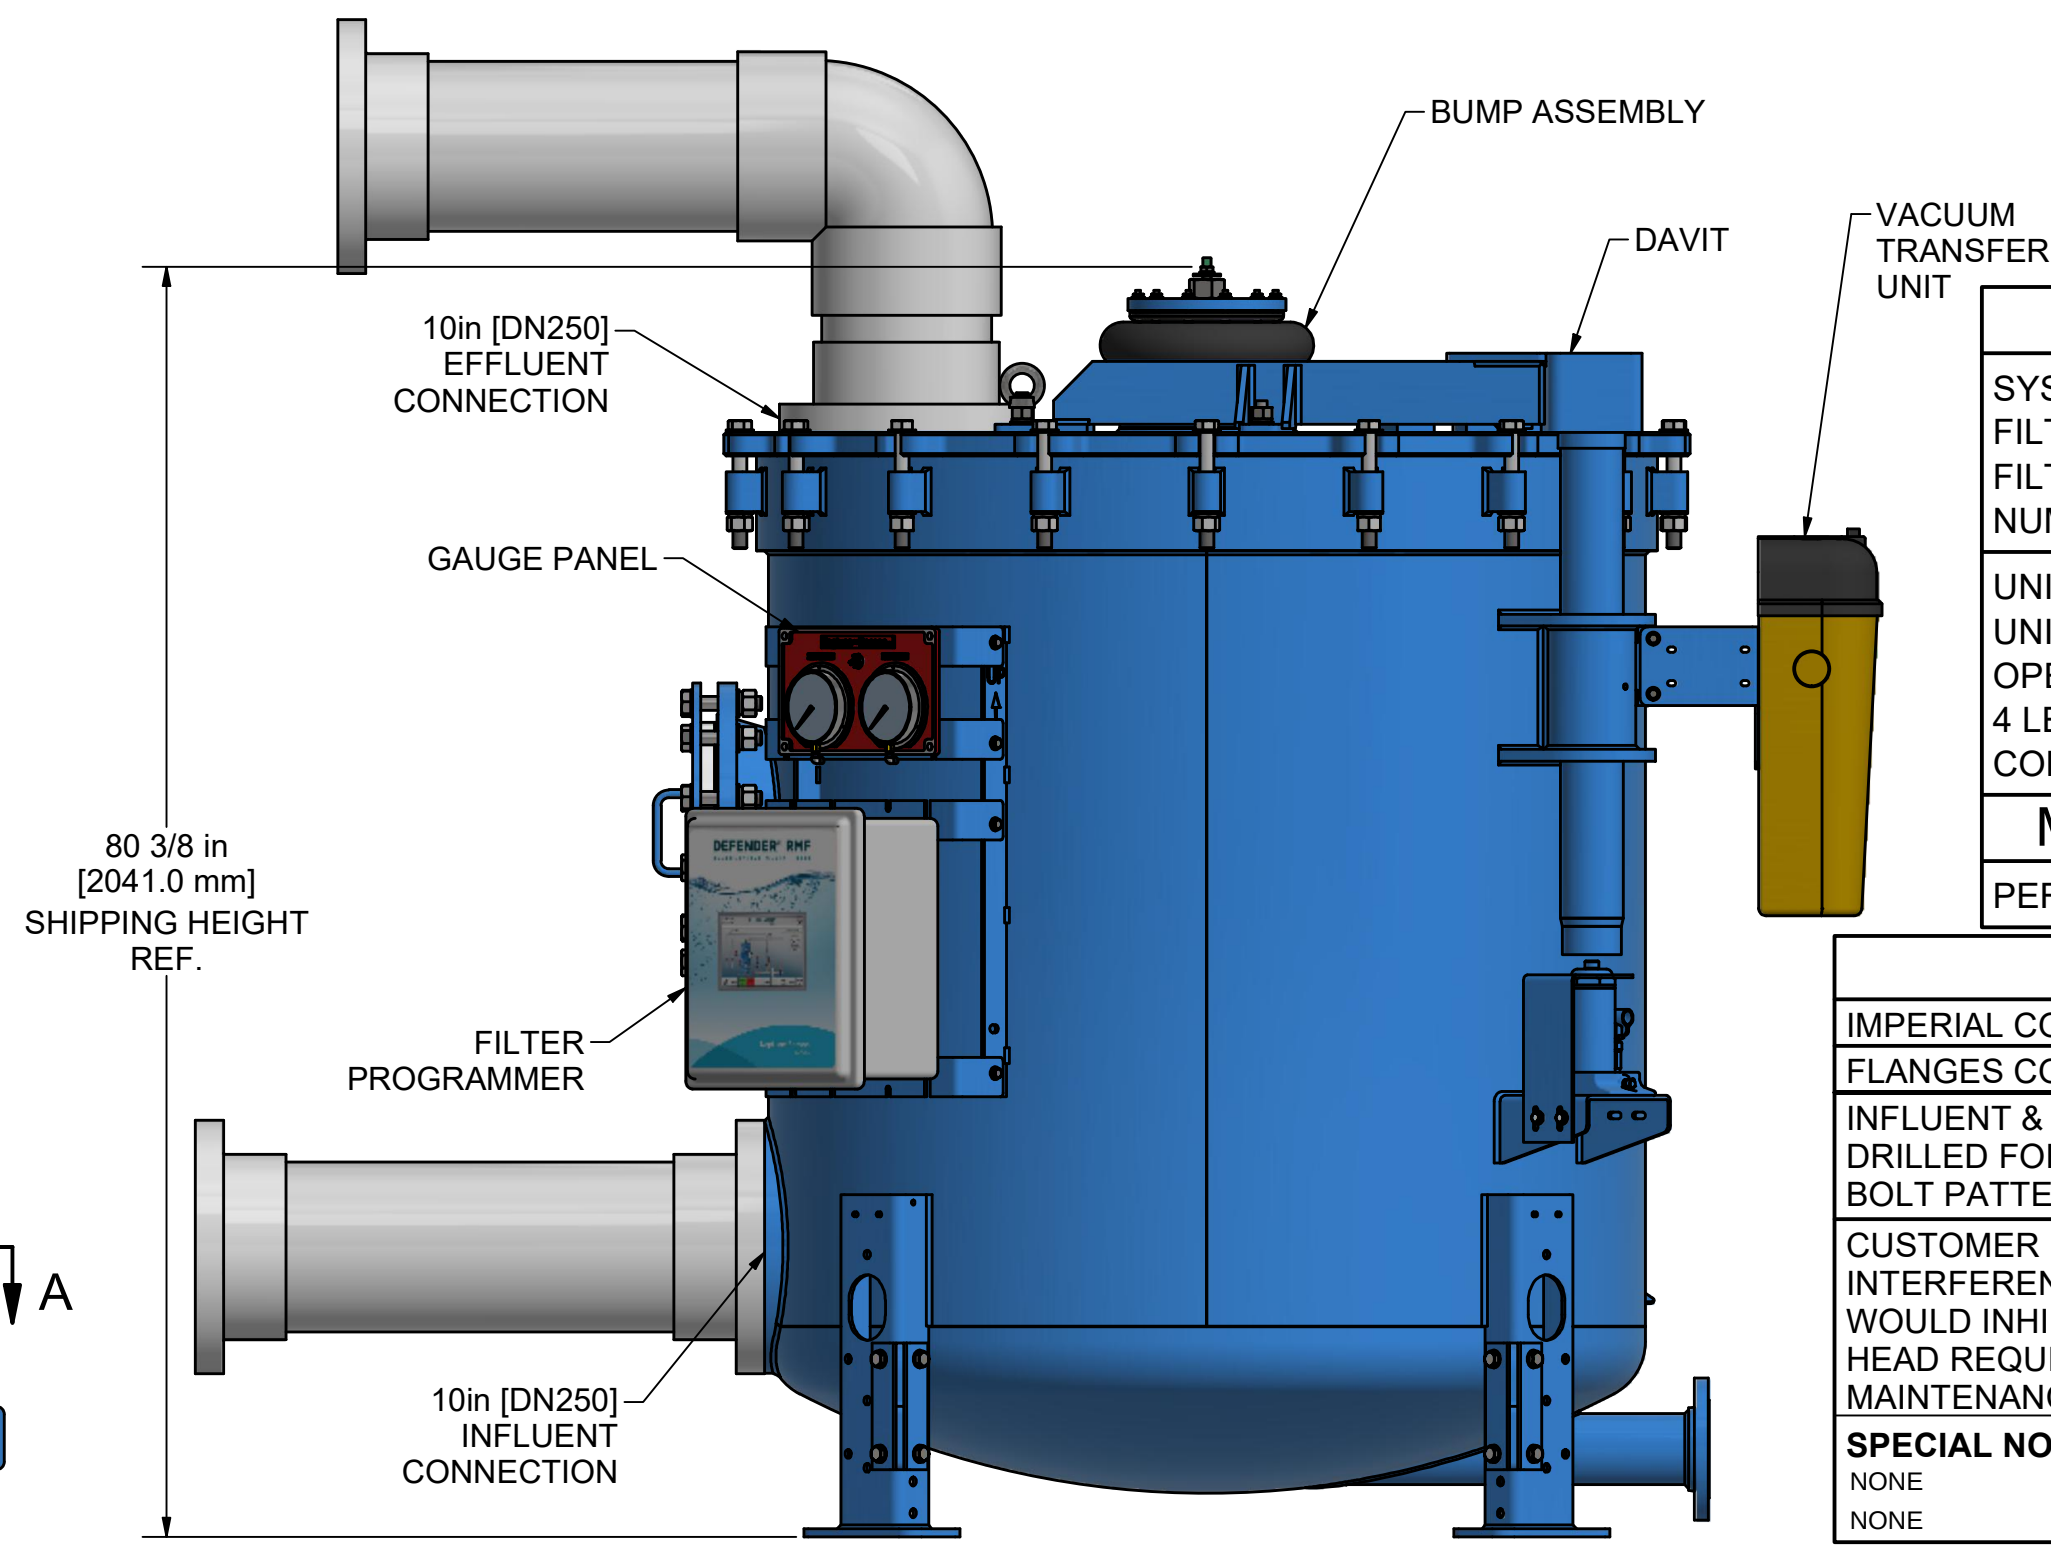

MARK		2		1	
QTY.		DESCRIPTION		PART #	REMARKS
1	1	DEFENDER FILTER SP-55-36-2076		SP-55-36-2076	
2	1	AUTOMATIC FILTER PROGRAMMER MODEL : RMF 12		MICROMF	SHIP LOOSE
3	1	VACUUM TRANSFER UNIT		VACUUM	SHIP LOOSE
4	1	FILTER /REGULATOR 1/2" NPT CONNECTION		1000-5527	SHIP LOOSE
5	1	GAUGE PANEL KIT		1000-8245	SHIP LOOSE
6	1	VACUUM TRANSFER PLUMBING KIT		1000-5821	NOT SHOWN SHIP LOOSE
7	1	DEFENDER DRAIN VALVE 4" LEVER		1000-7321	SHIP LOOSE


FILTER DATA
SYSTEM FLOW RATE = 611-1712 GPM FILTER AREA = 815 SQ.FT FILTRATION RATE = .75 - 2.1 GPM/SQ.FT NUMBER OF TUBES = 2076
UNIT WEIGHT - DRY : 4,029 LBS UNIT CAPACITY : 652 GALS OPERATING WEIGHT : 9,564 LBS 4 LEGS PER TANK CONCRETE BEARING PRESSURE = 49 PSI
MEDIA REQUIREMENTS
PERLITE : 98 LBS (11.0 CU.FT.)

NOTES
IMPERIAL CONNECTIONS
FLANGES CONFORM TO ANSI B16.5, CLASS 150
INFLUENT & EFFLUENT CONNECTIONS ARE DRILLED FOR METRIC AND IMPERIAL FLANGE BOLT PATTERNS
CUSTOMER IS TO CONFIRM THERE ARE NO INTERFERENCES IN THE FILTER ROOM THAT WOULD INHIBIT THE ROTATIONAL SWING OF THE HEAD REQUIRED FOR GENERAL FILTER MAINTENANCE
SPECIAL NOTES: NONE NONE

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN

COMPANY CONFIDENTIAL INFORMATION

THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN CONCEPTS AND THOSE ARISING THEREFROM ARE THE PROPERTY OF EVQVQA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSE FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED OR REPRODUCED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVQVQA. ALL PATENT RIGHTS ARE RESERVED IN THIS DOCUMENT AND ANY PATENTS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVQVQA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES MUST BE RETURNED TO EVQVQA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DOWN BY:	DATE	TITLE PROJECT NAME POOL NAME CLIENT CLIENT NAME  evoQUA WATER TECHNOLOGIES EVOQUA WATER TECHNOLOGIES WARWICK RI USA +1 800-832-8002				
CKD BY:	DATE					
APPD BY:	DATE					
MSD BY:	SCALE					
NA	NTS	PART NUMBER SP-55-36-2076				
		PROJ/PROD NUMBER #####	CODE Z-GA01	FILE/DRAWING NUMBER V113922366	SHEET OF	REV