
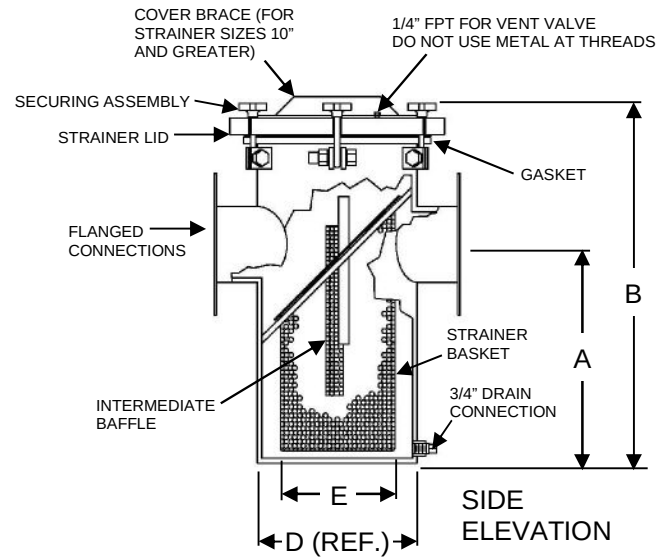


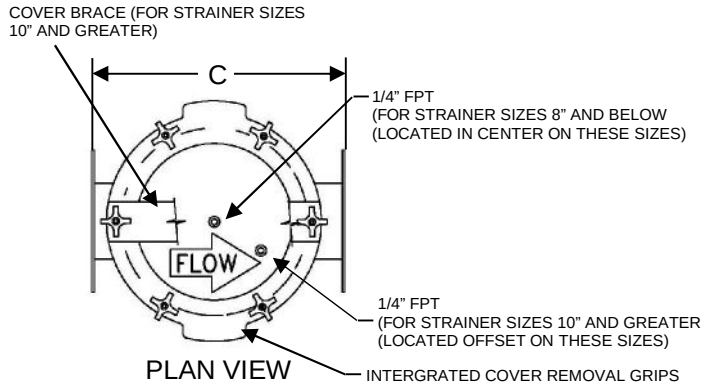

STRAINER BASKET

(1) " REQ'D w/ SPARE BASKET(S)

| STRAINER SIZE | STRAINER PART NUMBER | S.S. BASKET PART NUMBER | OPEN AREA OF PIPE (SQ.IN.) | OPEN AREA OF BASKET (SQ.IN.) | RATIO OF OPEN AREA | DIMENSIONS (INCHES) |    |    |        |        | MAX. FLOW RATE (GPM) | APPROX. WEIGHT (LBS) |
|---------------|----------------------|-------------------------|----------------------------|------------------------------|--------------------|---------------------|----|----|--------|--------|----------------------|----------------------|
|               |                      |                         |                            |                              |                    | A                   | B  | C  | D      | E      |                      |                      |
| 3"            | 1001-4098            | 1000-8395               | 7                          | 117                          | 16.7:1             | 8 1/2               | 18 | 18 | 9 1/8  | 5 3/4  | 125                  | 45                   |
| 4"            | 1000-6474            | 1000-8395               | 13                         | 117                          | 9.0:1              | 8 1/2               | 18 | 18 | 9 1/8  | 5 3/4  | 215                  | 45                   |
| 6"            | 1000-6476            | 1000-8397               | 28                         | 210                          | 7.5:1              | 13 1/4              | 26 | 20 | 11 1/4 | 7 1/2  | 488                  | 75                   |
| 8"            | 1000-6478            | 1000-8397               | 50                         | 210                          | 4.2:1              | 12 1/4              | 26 | 20 | 11 1/4 | 7 1/2  | 854                  | 80                   |
| 10"           | 1000-6480            | 1000-8399               | 79                         | 515                          | 6.5:1              | 21                  | 36 | 26 | 16 1/2 | 11 3/4 | 1344                 | 155                  |
| 12"           | 1000-6482            | 1000-8399               | 113                        | 515                          | 4.6:1              | 20                  | 36 | 26 | 16 1/2 | 11 3/4 | 1901                 | 170                  |
| 14"           | 1000-6484            | 1000-8400               | 154                        | 694                          | 4.5:1              | 22                  | 39 | 30 | 18 1/2 | 14     | 2295                 | 230                  |
| 16"           | 1000-6486            | 1000-8401               | 192                        | 833                          | 4.3:1              | 22                  | 39 | 32 | 20 1/2 | 16     | 3012                 | 320                  |

Strainer body shall be constructed of T316 material not less than 1/8" in thickness. Flanged connections are constructed of T316 stainless steel pipe & welded flanges. Interior and exterior of strainer body, including flanged connections, shall have a bead blasted finish.

Strainer lid shall be 1" thick transparent acrylic machined to eliminate sharp edges and house securing assemblies. Lid shall be grooved to house rubber gasket. Lid shall be seated with a 1/8" thick, full faced 40 durometer neoprene rubber gasket. Strainer lids on units with 10" connections and larger shall include a stainless steel cross brace. Lids shall have integrated cover removal grips.

Basket shall be Type 316 stainless frame and mesh with 5/32" perforations and not less than 52% open area. Open area of basket shall be no less than 4 times greater than the influent connection. Strainer basket shall have a welded intermediate baffle to reduce cleaning frequency. Basket handle shall be 1/8" in thickness.