
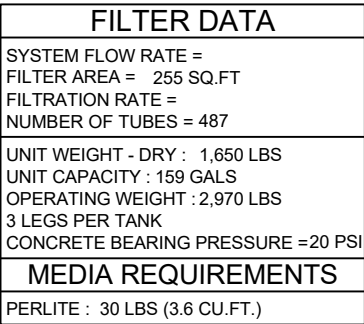






NOTES
IMPERIAL CONNECTIONS
FLANGES CONFORM TO ANSI B16.5, CLASS 150
TANKS ARE SHIPPED WITH LEGS IN THE COLLAPSED POSITION TO REDUCE OVERALL HEIGHT AND ASSIST TANK ACCESS. TANK MUST BE INSTALLED WITH LEGS IN EXTENDED POSITION.
INFLUENT, EFFLUENT, & DRAIN CONNECTIONS ARE DRILLED FOR METRIC AND IMPERIAL FLANGE BOLT PATTERNS
CUSTOMER IS TO CONFIRM THERE ARE NO INTERFERENCES IN THE FILTER ROOM THAT WOULD INHIBIT THE ROTATIONAL SWING OF THE HEAD REQUIRED FOR GENERAL FILTER MAINTENANCE
SPECIAL NOTES:

3		2		1	
MARK	QTY.	DESCRIPTION		PART #	REMARKS
1	1	DEFENDER FILTER SP-27-48-487-R		SP-27-48-487-R	
2	1	AUTOMATIC FILTER PROGRAMMER MODEL : RMF 12		MICRORMF	SHIP LOOSE
3	1	VACUUM TRANSFER UNIT		VACUUM	SHIP LOOSE
4	1	FILTER /REGULATOR 1/2" NPT CONNECTION		1000-5527	NOT SHOWN SHIP LOOSE
5	1	GAUGE PANEL KIT		1000-8245	SHIP LOOSE
6	1	VACUUM TRANSFER PLUMBING KIT		1000-5821	SHIP LOOSE
7	1	DEFENDER DRAIN VALVE 3" LEVER		1000-7320	SHIP LOOSE
8	2	BUSHING REDUCER ASSY 6"X4"		1000-5877	SHIP LOOSE

NOTES:

1. FILTER TANK IS TO BE CONSTRUCTED OF HIGH QUALITY A36 CARBON STEEL, UPPER HEAD THICKNESS = 1 1/2" (38.1mm), LOWER HEAD THICKNESS = 5/16" (7.93mm) & SHELL THICKNESS = 1/4" (6.35mm).
2. INTERIOR OF TANK IS LINED WITH FLEXSOL 3000. EXTERIOR IS COATED WITH 5-8 MILS OF HIGH SOLIDS ENAMEL. NO WELDING OR EXTREME HEAT IS TO BE APPLIED TO TANK AFTER LINING OR COATING PROCESS IS DONE.
3. ELECTRICAL REQUIREMENTS: 120VAC-10-60Hz, 15 AMP CIRCUIT PROTECTION.
4. LOCATE ALL ELECTRICAL ITEMS IN A NON-HAZARDOUS LOCATION.
5. ELECTRICAL CONNECTIONS ARE THE RESPONSIBILITY OF THE CUSTOMER.
6. MEDIA QUANTITIES ARE INDICATED FOR INFORMATIONAL PURPOSES ONLY.
7. ALL PNEUMATIC TUBING SUPPLIED BY POOL CONTRACTOR.
8. DRAIN VALVE MUST BE A BUTTERFLY VALVE AND INSTALLED DIRECTLY ON THE BOTTOM TANK HEAD.
9. DESIGN PRESSURE IS 50 PSI (344.73 kpa). HYDROSTATICALLY TESTED TO 75 PSI (517.11 kpa).
10. THIS PRECOAT FILTER UTILIZES TUBE ELEMENTS AND THE EFFECTIVE FILTRATION AREA REPRESENTS THE

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN

COMPANY CONFIDENTIAL INFORMATION
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN, INCLUDING THE DESIGN AND NAME, AND THOSE ARISING THEREFROM ARE THE PROPERTY OF EVQVQA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSES OF THE DESIGN AND NAME AND MUST NOT BE DISCLOSED, REPRODUCED OR COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN PERMISSION OF EVQVQA AND/OR ITS AFFILIATES. IF RESERVED, THIS DOCUMENT AND DERIVATIVE WORKS THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVQVQA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, MUST BE RETURNED TO EVQVQA AND/OR ANALYSEES MUST BE RETURNED TO EVQVQA OR DESTROYED, AS INSTRUCTED BY EVQVQA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY:	DATE
CKD BY:	DATE
APPD BY:	DATE
MGD BY:	
REF:	
SCALE:	NTS

TITLE				
CLIENT				
 evoQUA WATER TECHNOLOGIES EVOQUA WATER TECHNOLOGIES WARWICK RI USA +1(0)1-800-832-8002				
PROJECT	PART NUMBER	DMS REFERENCE	SHEET OF	REVISION