
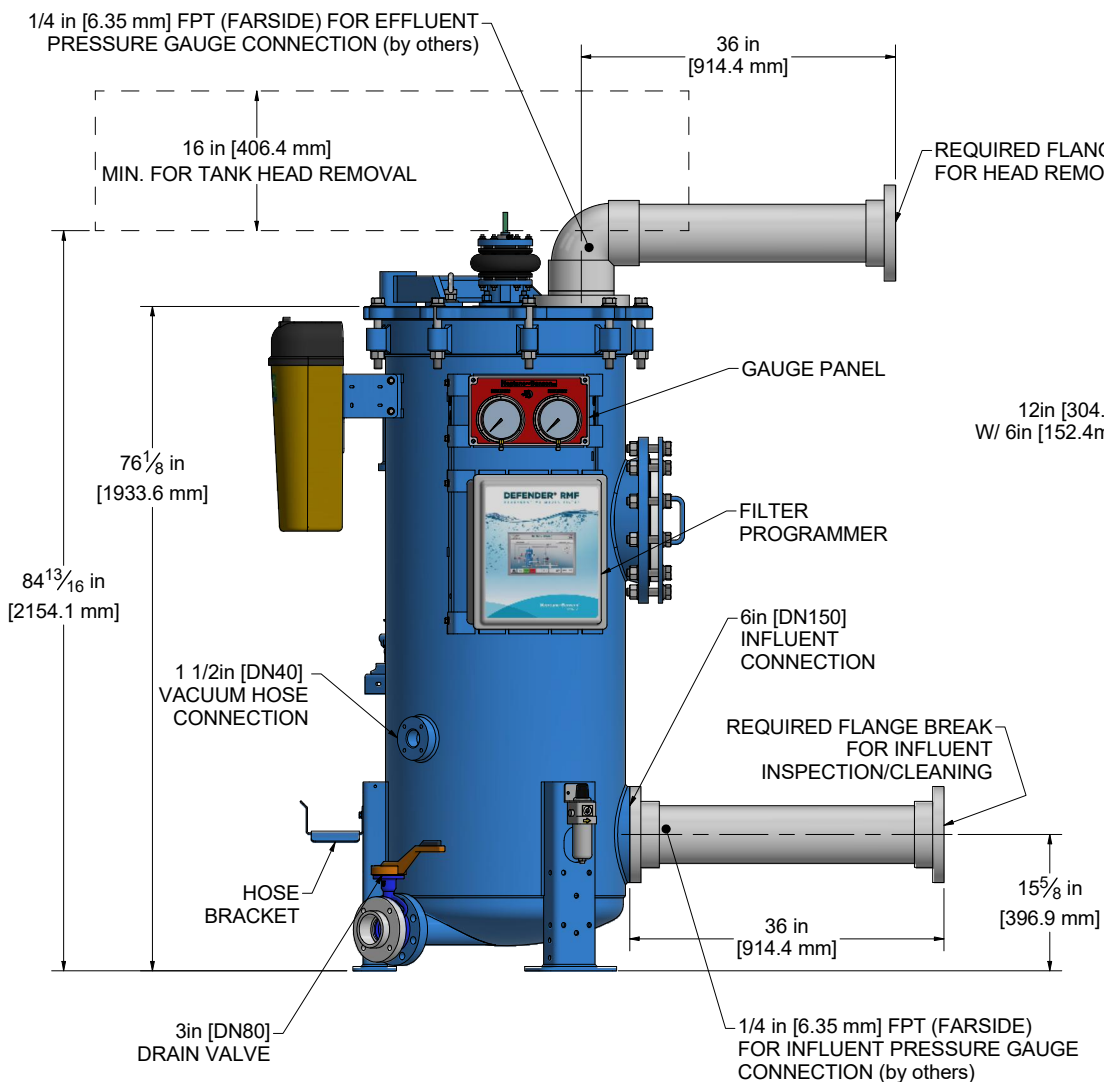
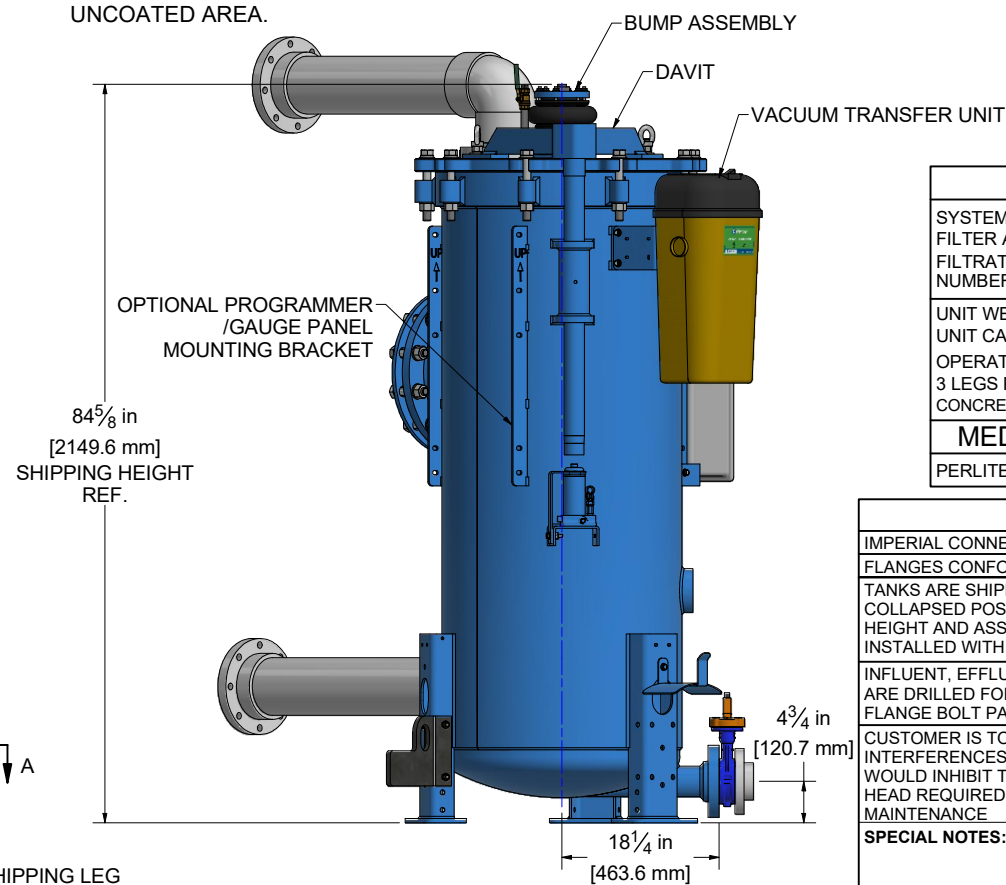
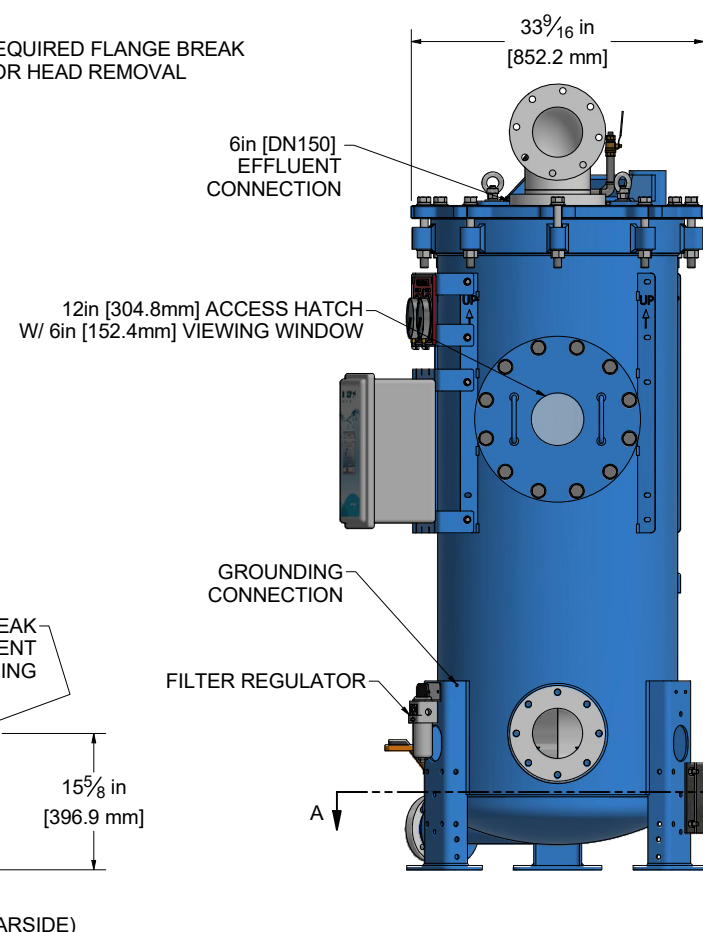


NOTES:

1. FILTER TANK IS TO BE CONSTRUCTED OF HIGH QUALITY A36 CARBON STEEL, UPPER HEAD THICKNESS = 1 1/2" (38.1mm), LOWER HEAD THICKNESS = 5/16" (7.93mm) & SHELL THICKNESS = 1/4" (6.35mm).
2. INTERIOR OF TANK IS LINED WITH FLEXSOL 3000. EXTERIOR IS COATED WITH 5-8 MILS OF HIGH SOLIDS ENAMEL. NO WELDING OR EXTREME HEAT IS TO BE APPLIED TO TANK AFTER LINING OR COATING PROCESS IS DONE.
3. ELECTRICAL REQUIREMENTS: 230VAC-10-50Hz, 10 AMP CIRCUIT PROTECTION.
4. LOCATE ALL ELECTRICAL ITEMS IN A NON-HAZARDOUS LOCATION.
5. ELECTRICAL CONNECTIONS ARE THE RESPONSIBILITY OF THE CUSTOMER.
6. MEDIA QUANTITIES ARE INDICATED FOR INFORMATIONAL PURPOSES ONLY.
7. ALL PNEUMATIC TUBING SUPPLIED BY POOL CONTRACTOR.
8. DRAIN VALVE MUST BE A BUTTERFLY VALVE AND INSTALLED DIRECTLY ON THE BOTTOM TANK HEAD.
9. DESIGN PRESSURE IS 50 PSI (344.73 kpa). HYDROSTATICALLY TESTED TO 75 PSI (517.11 kpa).
10. THIS PRECOAT FILTER UTILIZES TUBE ELEMENTS AND THE EFFECTIVE FILTRATION AREA REPRESENTS THE UNCOATED AREA.

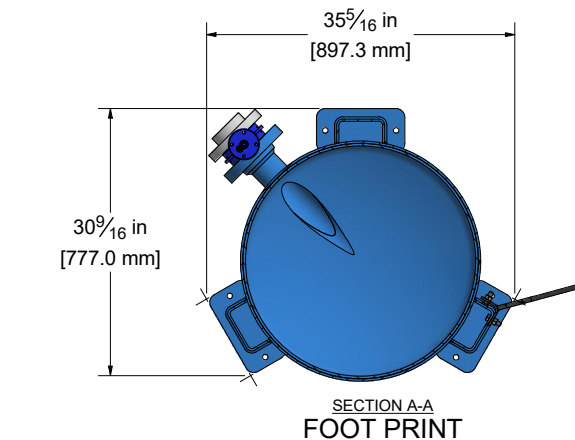

FILTER DATA
SYSTEM FLOW RATE = FILTER AREA = 23.7 m² FILTRATION RATE = NUMBER OF TUBES = 487
UNIT WEIGHT - DRY : 749 kg UNIT CAPACITY : .602 m³ OPERATING WEIGHT :1348 kg 3 LEGS PER TANK CONCRETE BEARING PRESSURE =1.4kg/cm²
MEDIA REQUIREMENTS
PERLITE : 13.61kg (3.6 cu.ft.)

NOTES	
IMPERIAL CONNECTIONS	
FLANGES CONFORM TO ANSI B16.5, CLASS 150	
TANKS ARE SHIPPED WITH LEGS IN THE COLLAPSED POSITION TO REDUCE OVERALL HEIGHT AND ASSIST TANK ACCESS. TANK MUST BE INSTALLED WITH LEGS IN EXTENDED POSITION.	
INFLUENT, EFFLUENT, & DRAIN CONNECTIONS ARE DRILLED FOR METRIC AND IMPERIAL FLANGE BOLT PATTERNS	
CUSTOMER IS TO CONFIRM THERE ARE NO INTERFERENCES IN THE FILTER ROOM THAT WOULD INHIBIT THE ROTATIONAL SWING OF THE HEAD REQUIRED FOR GENERAL FILTER MAINTENANCE	
SPECIAL NOTES:	

REV	DESCRIPTION	DATE	DWN	CKD	APPD	ECN

COMPANY CONFIDENTIAL INFORMATION

THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN ARE UNCLASSIFIED AND NOT FOR DISSEMINATION THEREFROM ARE THE PROPERTY OF EVQVQA AND/OR ITS AFFILIATES AND ARE SUBMITTED IN CONFIDENCE. THEY MAY BE USED ONLY FOR THE EXPRESS PURPOSES FOR WHICH THEY ARE PROVIDED AND MUST NOT BE DISCLOSED, REPRODUCED, COPIED IN ANY FORM, INCLUDING IN ELECTRONIC FORMAT, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF EVQVQA. ALL PATENT RIGHTS ARE RESERVED. THIS DOCUMENT AND ALL INFORMATION THEREOF ARE PROTECTED UNDER APPLICABLE COPYRIGHT LAWS. UPON DEMAND OF EVQVQA, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ATTACHMENTS MUST BE RETURNED TO EVQVQA OR DESTROYED, AS INSTRUCTED BY EVQVQA. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS.

DWN BY:	DATE
CKD BY:	DATE
APPD BY:	DATE
MGD BY:	
REF:	
SCALE: NTS	

TITLE				
CLIENT				
 evoQUA WATER TECHNOLOGIES EVOQUA WATER TECHNOLOGIES WARWICK RI USA +1(0)1-800-832-8002				
PROJECT	PART NUMBER	DMS REFERENCE	SHEET OF	REVISION