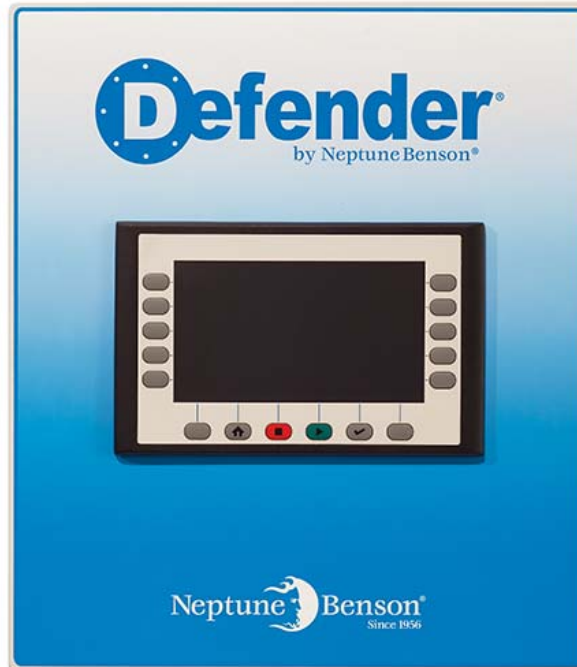


RMF PROGRAMMER

**RMF System Controller**

- ✓ The automatic controller shall provide total control of the system's filtration and regeneration cycles, and provide all necessary equipment interlocks and timing mechanisms to execute the filter program.
- ✓ The controller shall contain at least two microprocessors that will monitor all functions of the system.
- ✓ The controller shall also control the operation of the following functions:

Standard Features

- Bump cycle – manual or automatic; with or without security interlock for data logging
- Precoating of the filter elements
- Stopping and starting of the main recirculation pump
- Opening and closing of pneumatically operated valves
- Vacuum transfer system
- Heater cool down delay
- Auxiliary contacts to interlock UV lamps, chemical control, or other equipment
- 7 inch Hi-Res LCD Screen with Tactile Feedback Membrane
- Step-by-step animated graphics
- Last Bump™ and Bump-n-Go™ Features
- Remote Operation via browser or phone
- Off Site Real-Time Status
- Email on change of condition
- Data logging of process
- Differential Pressure Monitoring and Bump Control
- Automatic maintenance reminders
- Exporting of process data logs to .csv Excel™ files
- Modbus Communications for PLC connectivity
- Nema 4X / IP66 approved / UL Listed
- Electrical Requirements: 120VAC-1Ø-60Hz, 15 amp Circuit Protection (CP)/230VAC-1Ø-50Hz, 10 amp CP

ONE REQ'D PER FILTER