


DT-68 detections in Nanomia and Resomia

All 24 specimens, including three with unresolved collection depths

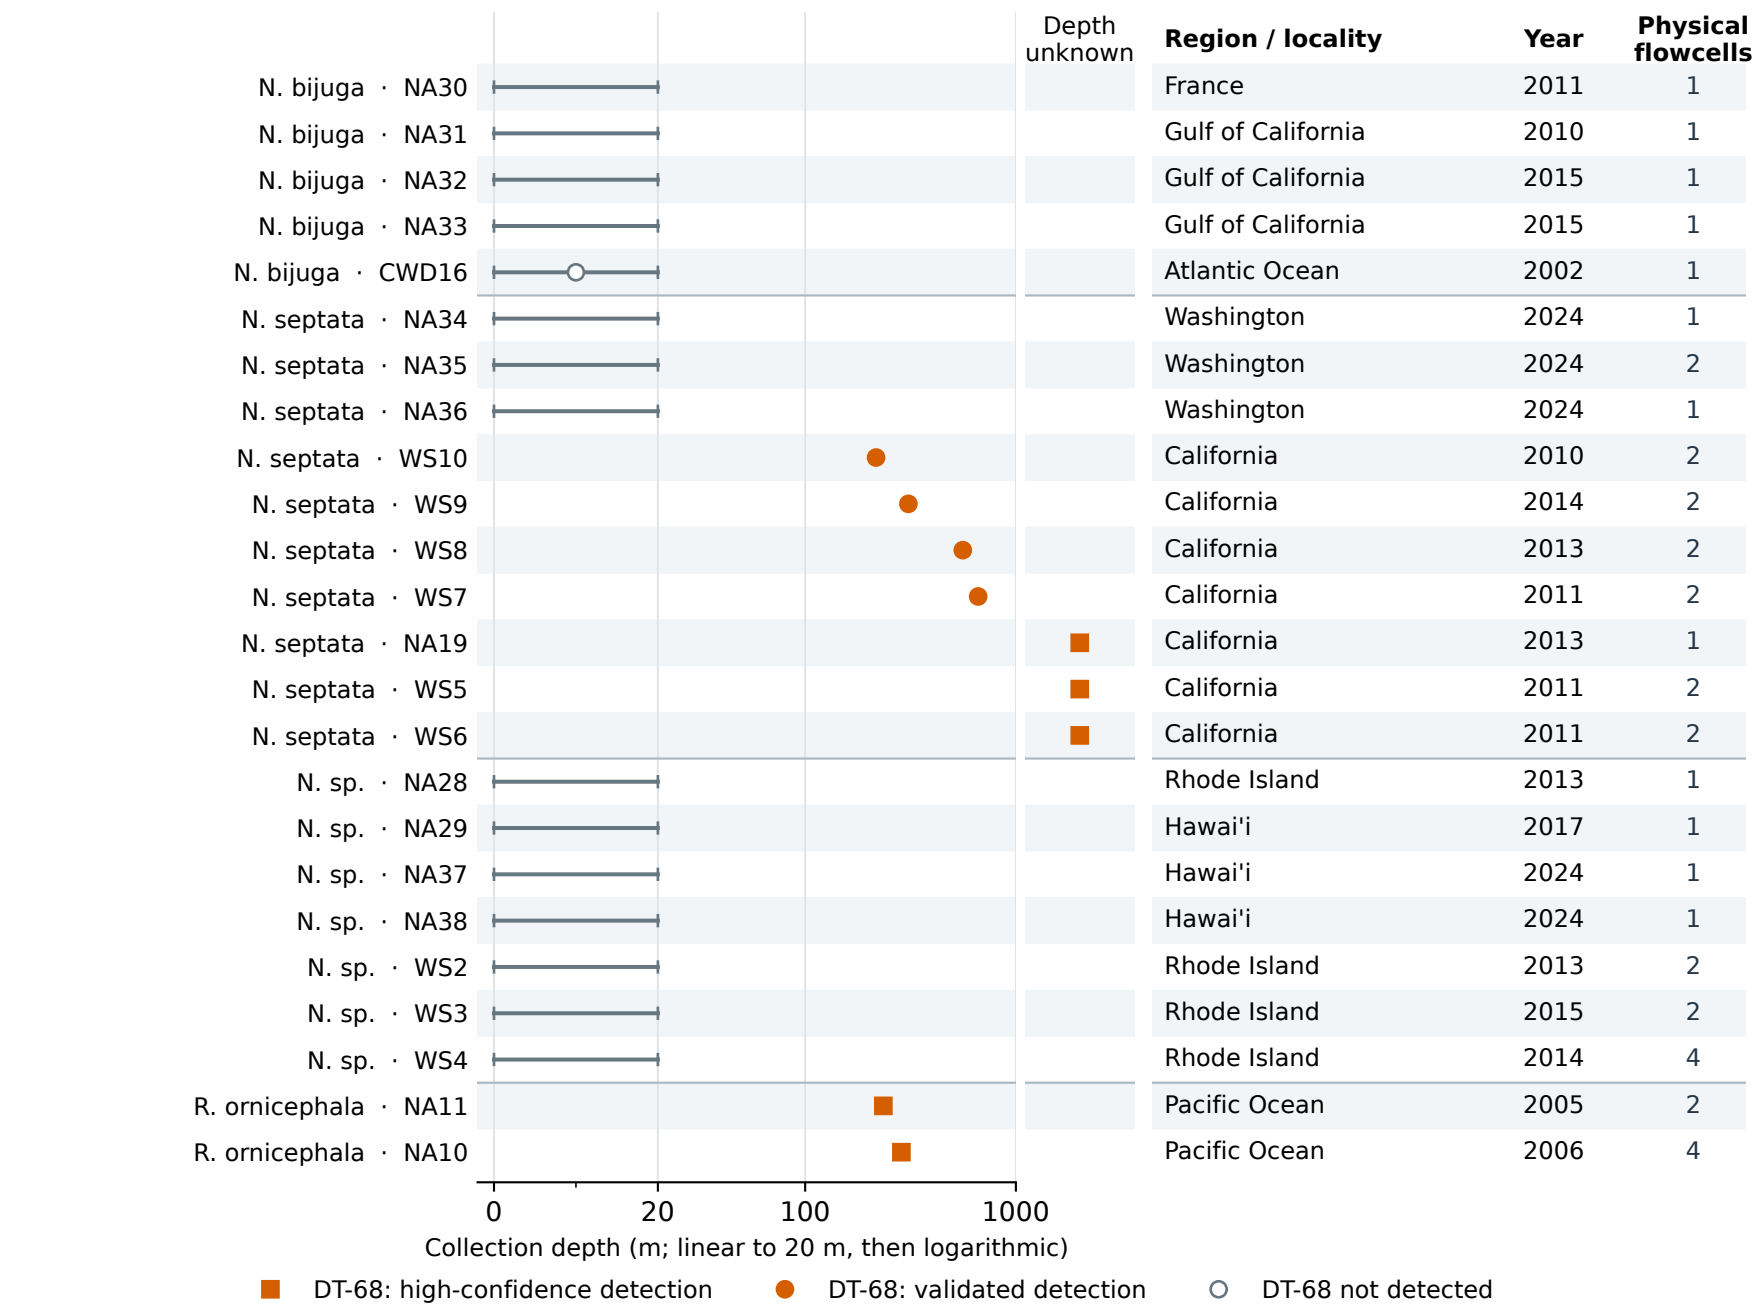

Both detection grades satisfy read-mapping criteria; high-confidence detections also satisfy same-library assembly criteria. Depth intervals have no imputed midpoint. All libraries are shown; flowcell-based inference requires one physical flowcell.