



Dry Inoculum

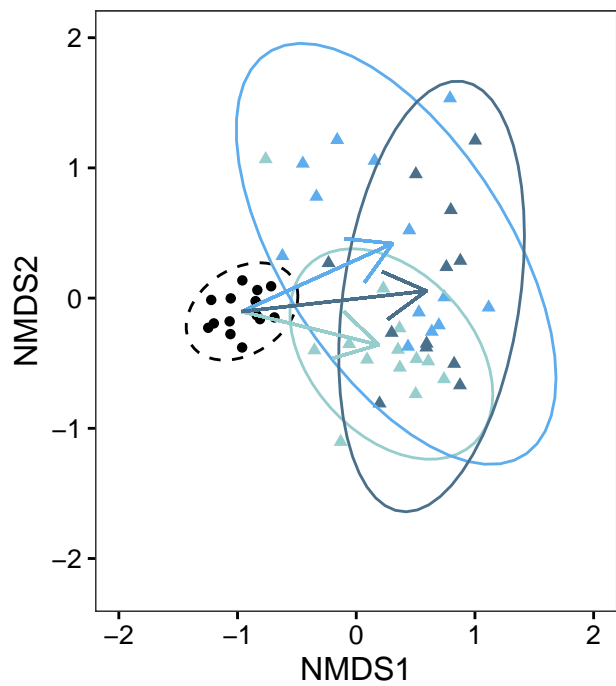

Moderate Inoculum

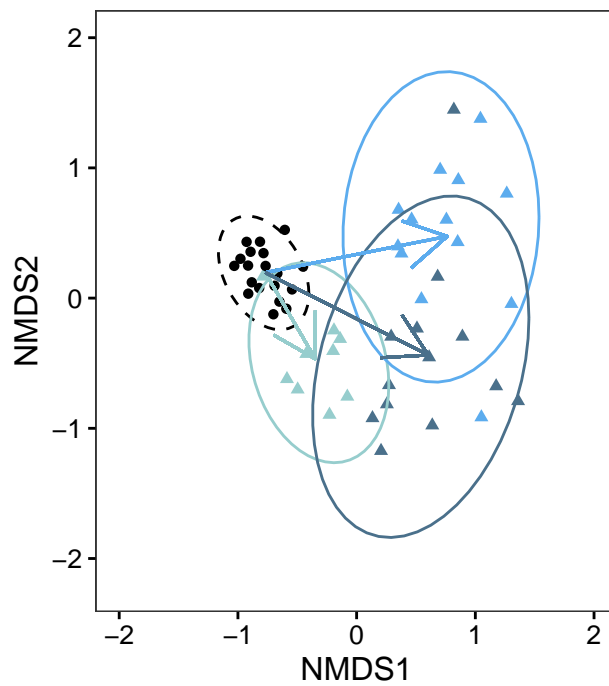

factor(TimePoint)

● T0

▲ T1

factor(Water.T0.T1)


● T0

● Low

● Moderate

● High

Wet Inoculum

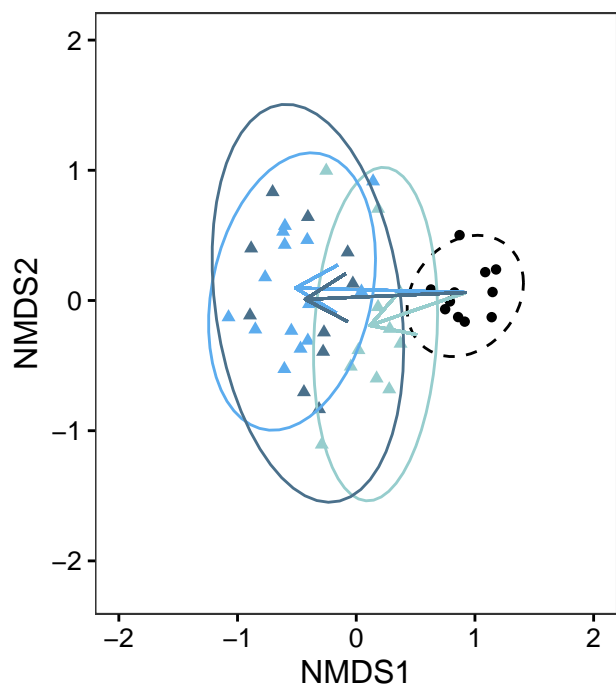

Control

