



VENTILATION SYSTEM POST-CLEAN REPORT



Site Name: King Edward House Floor 3

Date of clean: 29/10/2025

Site Address: New St, Birmingham, B2 4QJ



GDT Envirocare, 44 Clos Mancheldowne, Barry, CF62 5AB
VAT No: 433714507 COMPANY No: 11048398





EXTRACT & SUPPLY AIR SYSTEM CLEANING

Introduction

Duct and air vent cleaning is a process of removing dust, dirt, debris, and other contaminants from the ducts and vents and air handling units in your building. This process is important for maintaining good indoor air quality and preventing health problems. It can also help improve the efficiency of your heating and cooling system by reducing the amount of dust that accumulates on the components.

The process of duct and vent cleaning involves using specialized equipment to remove dust, dirt, and other debris from the ducts, vents and AHU's. This includes vacuuming out the interior of the system, as well as using brushes and air compressors to dislodge any stubborn particles. The technician will then use a high-powered vacuum to collect all the debris that has been removed.

Summary

Internally, all accessible ducting has now been cleaned to BESA TR19 standards and will be due next on 29th of October 2026.

Advisories

Nothing to note.



GDT Envirocare, 44 Clos Mancheldowne, Barry, CF62 5AB
VAT No: 433714507 COMPANY No: 11048398





ENVIROCARE

SITE NAME: KEH FLOOR 3
START TIME: 08:00
END TIME: 16:00

JOB DATE: 29/10/2025
STAFF ON SITE: GARETH, BILLY, RAMZI,
KEVIN & STEFFAN

ITEM	POST-CLEAN INFO	COMMENTS
1	Has the system been fully cleaned?	YES
2	If no to above, reason(s) why and ways to achieve full clean:	-
3	Do additional access doors need to be fitted?	NO
4	Current cleaning frequency:	12 MONTHS
5	Recommended new cleaning frequency:	-

VENTILATION SYSTEM PRE & POST CLEAN ELCOMETER READINGS

TEST LOCATION	PRE-CLEAN THICKNESS IN MICRONS	POST-CLEAN THICKNESS IN MICRONS
SUPPLY DUCTING	294	6
SUPPLY DUCTING	355	11
SUPPLY DUCTING	267	8
SUPPLY DUCTING	314	7
EXTRACT DUCTING	406	10
EXTRACT DUCTING	359	8
EXTRACT DUCTING	382	11
EXTRACT DUCTING	337	9
VENTS	411	12
VENTS	295	6



GDT Envirocare, 44 Clos Mancheldowne, Barry, CF62 5AB
VAT No: 433714507 COMPANY No: 11048398





VENTS	326	14
HRU	205	13
HRU	198	7
HRU	221	10



GDT Envirocare, 44 Clos Mancheldowne, Barry, CF62 5AB
VAT No: 433714507 COMPANY No: 11048398





(1) Ducting before

Created: Fri, 10/31/2025



(2) Ducting after

Created: Fri, 10/31/2025



(3) Ducting before

Created: Fri, 10/31/2025



(4) Ducting after

Created: Fri, 10/31/2025



(5) Ducting before

Created: Fri, 10/31/2025



(6) Ducting after

Created: Fri, 10/31/2025



(7) Ducting before

Created: Fri, 10/31/2025



(8) Ducting after

Created: Fri, 10/31/2025



(9) Ducting before

Created: Fri, 10/31/2025



(10) Ducting after

Created: Fri, 10/31/2025



(11) Ducting before

Created: Fri, 10/31/2025



(12) Ducting after

Created: Fri, 10/31/2025




(13) Ducting before

Created: Fri, 10/31/2025



(14) Ducting after

Created: Fri, 10/31/2025

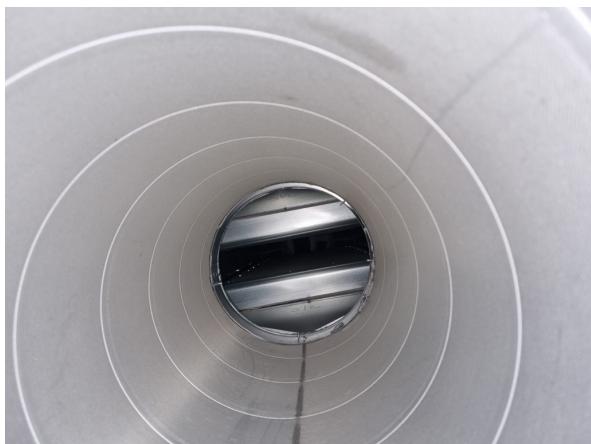

(15) Ducting before

Created: Fri, 10/31/2025



(16) Ducting after

Created: Fri, 10/31/2025



(17) Ducting before

Created: Fri, 10/31/2025



(18) Ducting after

Created: Fri, 10/31/2025



(19) Ducting before

Created: Fri, 10/31/2025



(20) Ducting after

Created: Fri, 10/31/2025



(21) Ducting before

Created: Fri, 10/31/2025



(22) Ducting after

Created: Fri, 10/31/2025



(23) HRU before

Created: Fri, 10/31/2025



(24) HRU after

Created: Fri, 10/31/2025

Company: GDT Envirocare
Contact: Gareth Thorning
Phone: 07946468349
Email: info@gdt-envirocare.com

Title: KEH Floor 3
Created: Fri, 10/31/2025
No. Items: 26



(25) Working photo

Created: Fri, 10/31/2025



(26) Working photo

Created: Fri, 10/31/2025



ENVIROCARE

FRESH AIR AND KITCHEN
EXTRACT CLEANING
CONTRACTOR

Certificate of Compliance

This is to certify that all accessible ductwork has been cleaned, degreased and decontaminated at:

.....King Edward House Floor 3.....

from:29-10-25.....

until:29-10-26.....

The above works are compliant with the guidance standards as recommended in B&ES TR/19, kitchen extraction systems and match legislation fire standards (RRFSO). Also Building Insurance Compliance requirements.

For and behalf of

GDT ENVIROCARE



Gareth Thorning –
managing director



GDT Envirocare, Clos Mancheldowne, Barry, CF62 5AB. Tel: 07946468349
E-mail: gareth.thorning@gdt-envirocare.com Web: www.gdt-envirocare.com