




With Batch norm
Test Loss: 0.629

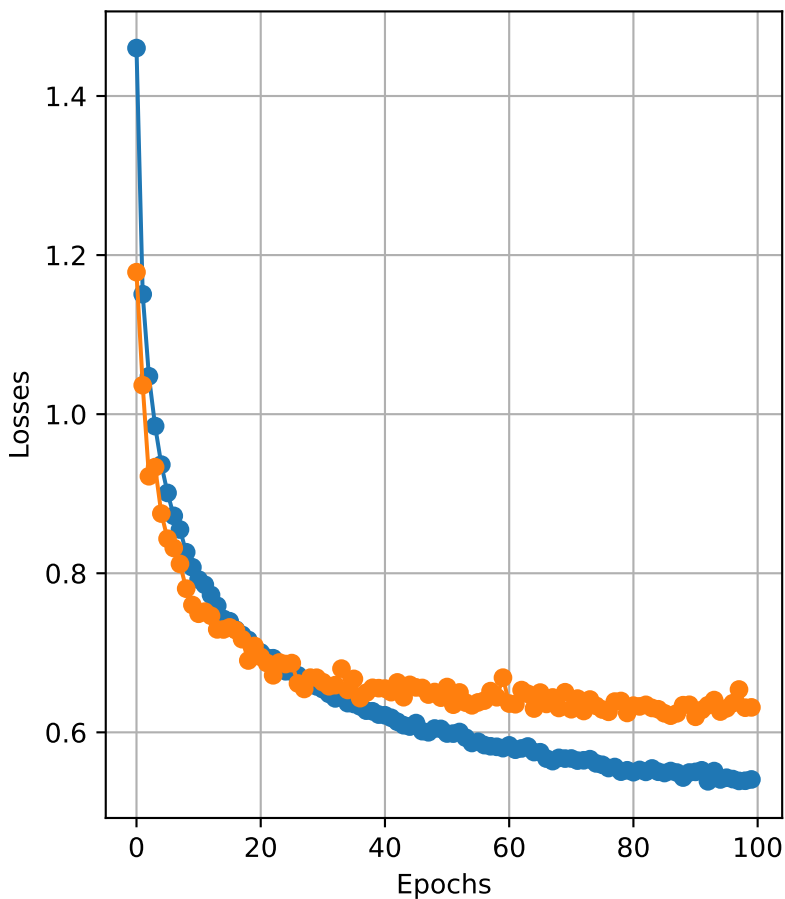

With Batch norm
Test Acc: 78.850

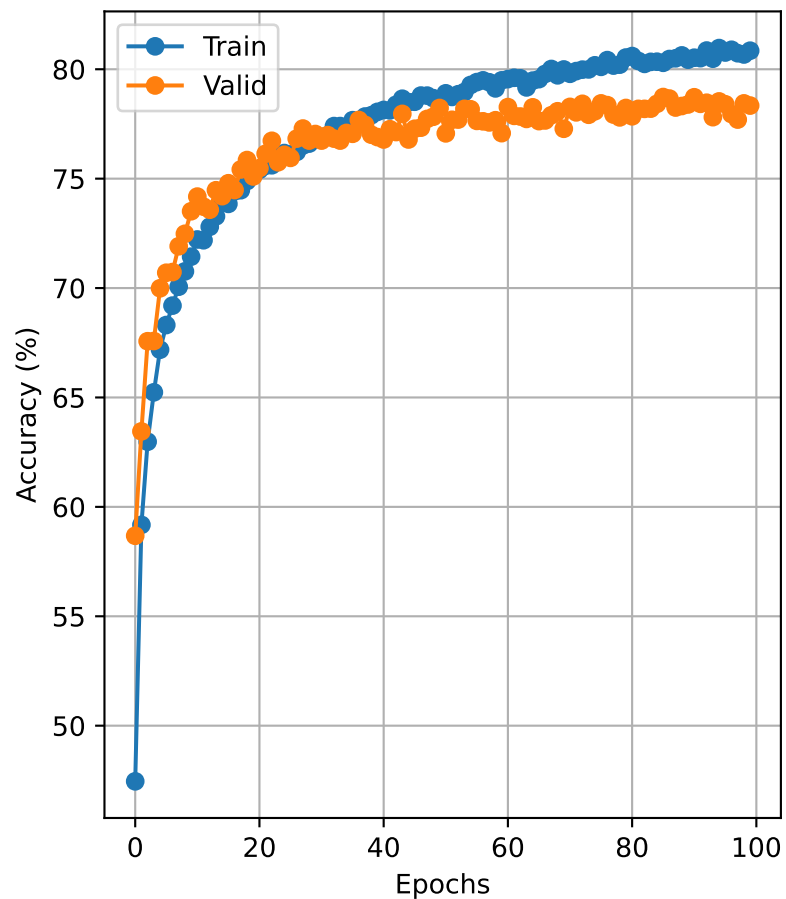

Without Batch norm
Test Loss: 0.710

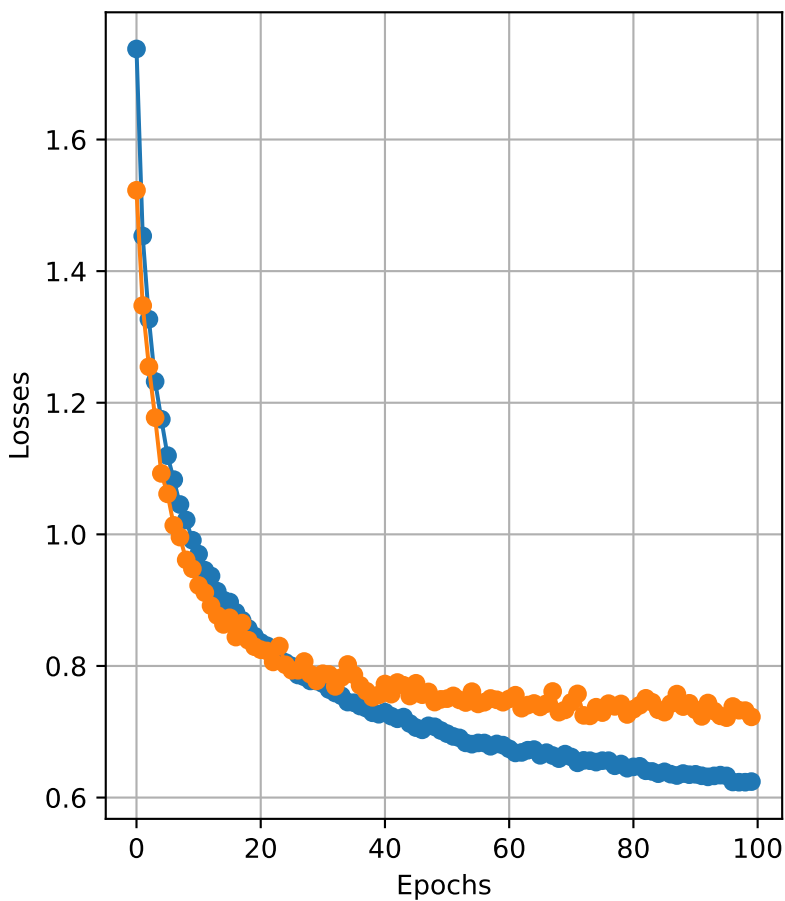

Without Batch norm
Test Acc: 75.720

