


# Lead in School Water Supplies, 2022

Initial Draw Results, >1 ppb

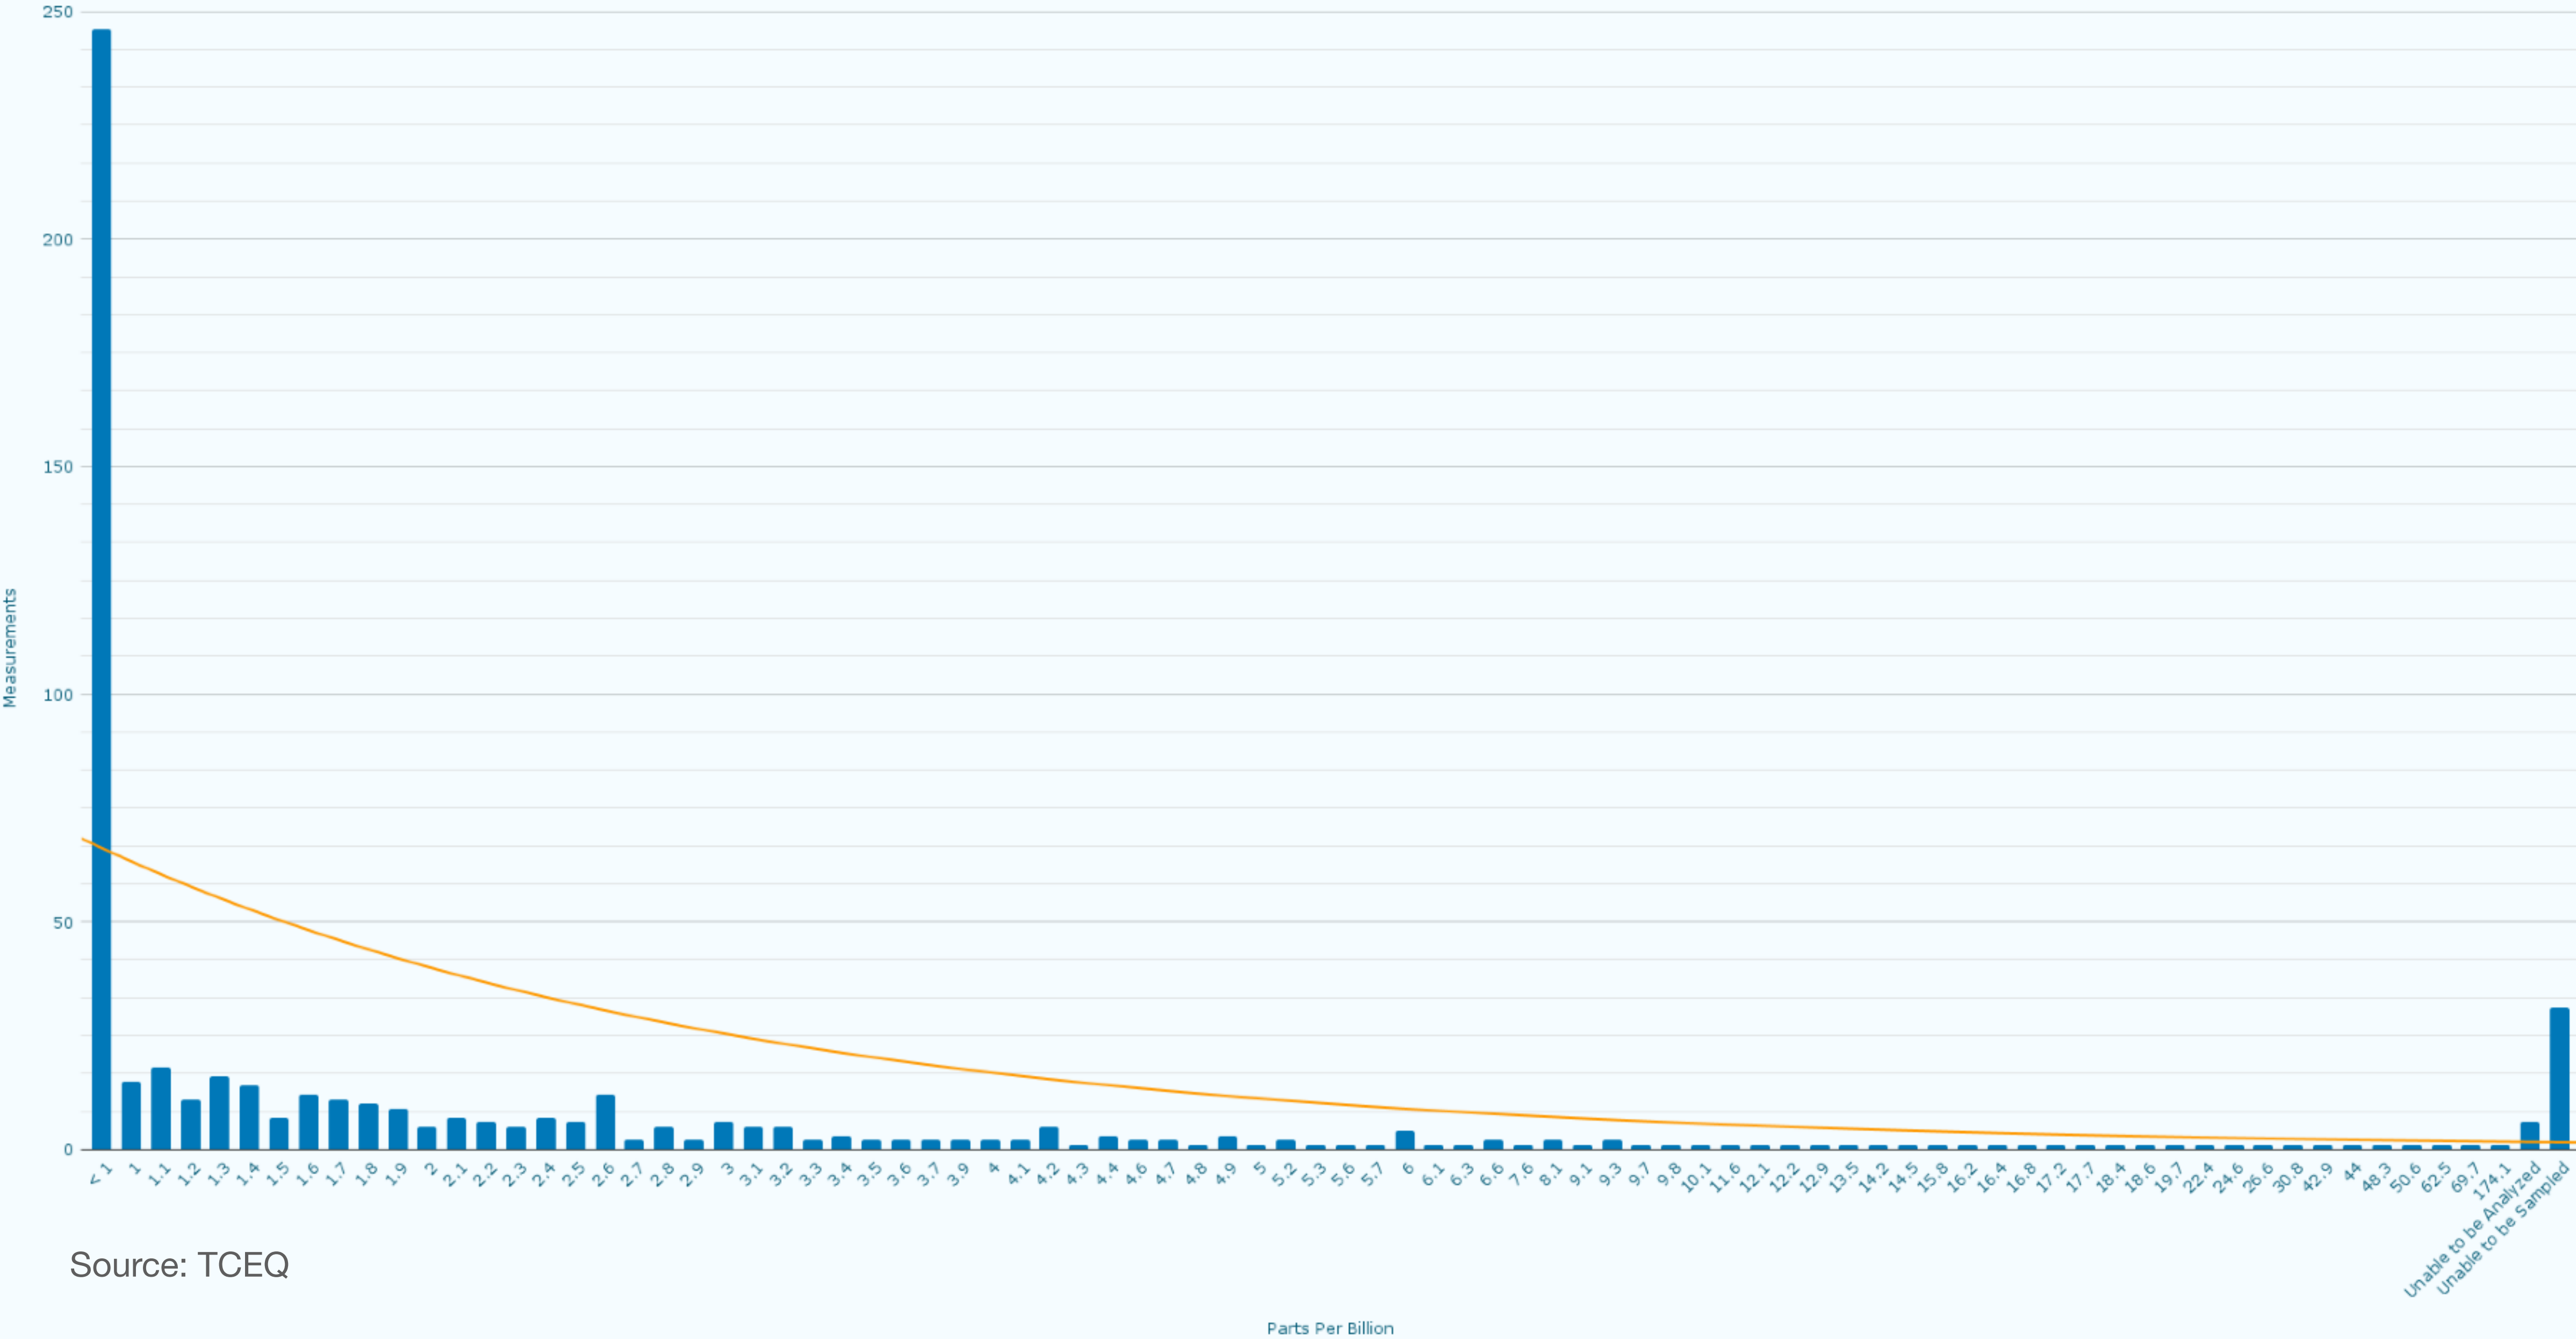

Source: TCEQ

# Lead in School Water Supplies, 2022

Initial Draw Results, >1 ppb

