
GENERAL NOTES

1. VALVE TO FAIL OPEN UPON LOSS OF POWER.
2. PURGE PUMP WILL RUN WHEN PRESSURE DROPS TO 2 PSIG.
3. PIPING BETWEEN REACTOR AND CONDENSER TO BE CLASS 1.

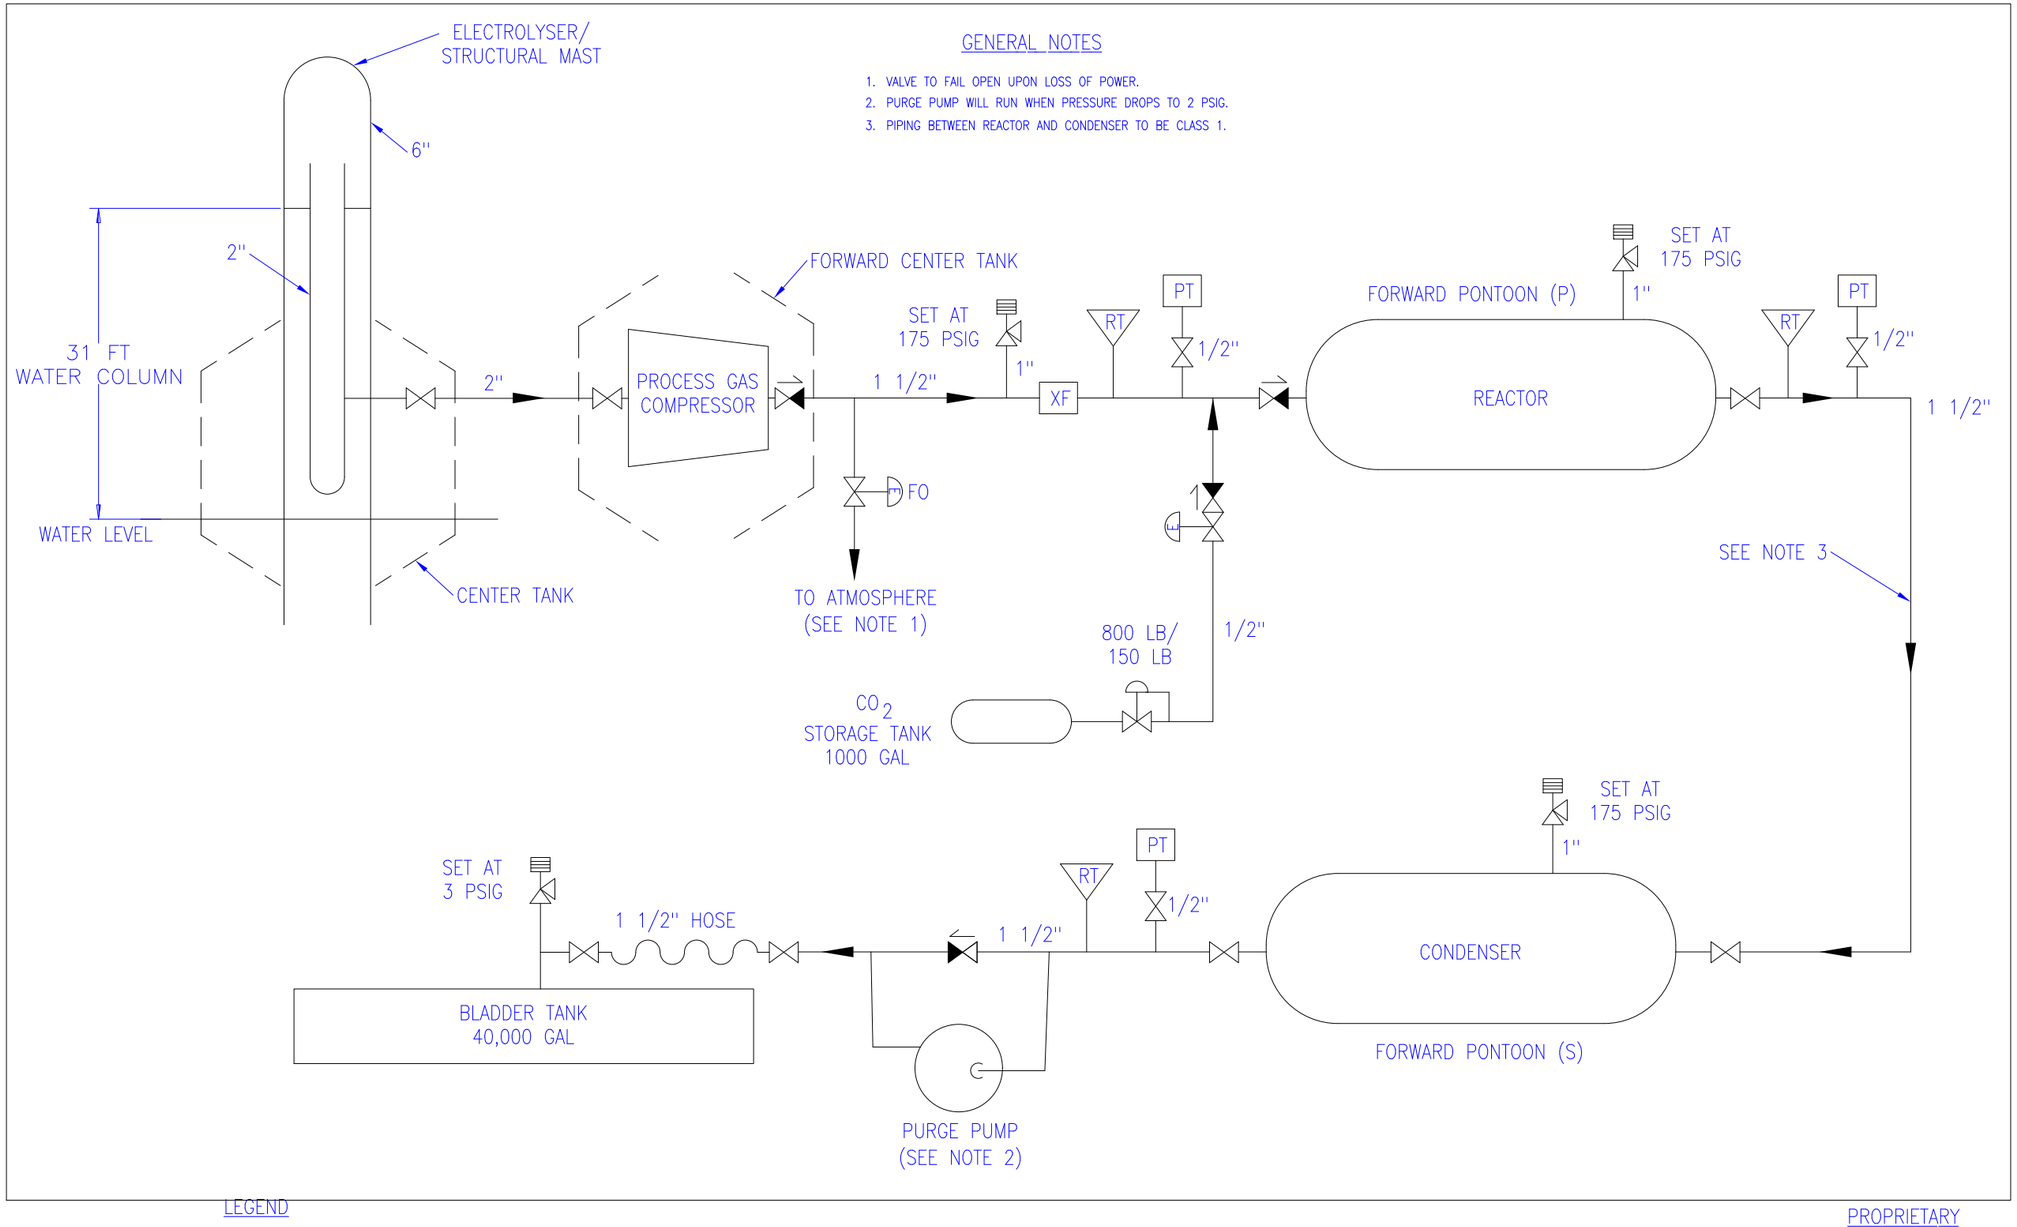

LEGEND

- GLOBE VALVE
- GLOBE STOP CHECK VALVE
- PT — PRESSURE TRANSDUCER
- XF — REMOTE READING FLOW METER
- RT — RESISTANCE TYPE THERMOMETER
- PRESSURE REDUCING VALVE
- E — ELECTRICALLY OPERATED CONTROL VALVE
- PRESSURE RELIEF VALVE

PROPRIETARY

DO NOT DISTRIBUTE WITHOUT PERMISSION.

REGULATORY BODY		
ABS		
USCG		
USPH		
OWNER APPROVALS		DATE
CHECKED		
APPROVED		
REVISED		
● DO NOT SCALE DRAWING		
APPRVD		
CHKD		
DRAWN	SCOTT	10/14/04

NDI ENGINEERING COMPANY
RESEARCH AND CONSULTING ENGINEERS
100 GROVE ROAD
THOROFARE, NJ 08086

SHIP: OGP-X "Herman Behrens"

LOCATION:

DRAWING TITLE: ETHANOL PIPING DIAGRAM
OCEAN GYPSY

SIZE	DRAWING NO.	REV
F	1157-001-03	–

SCALE: NONE SHEET 1 OF 1