


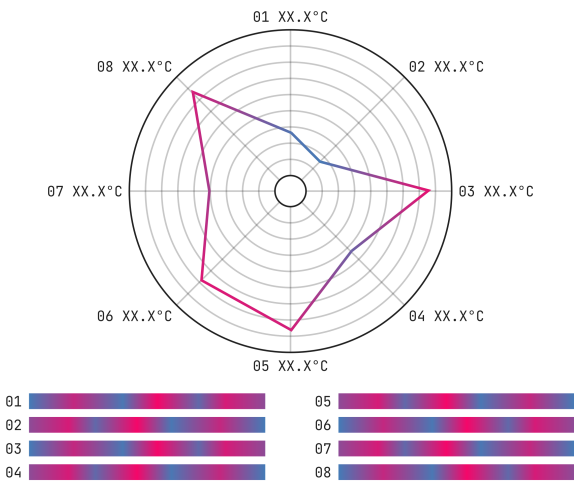
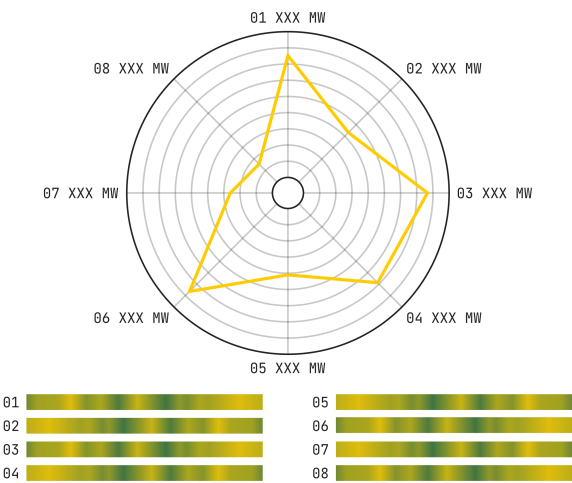


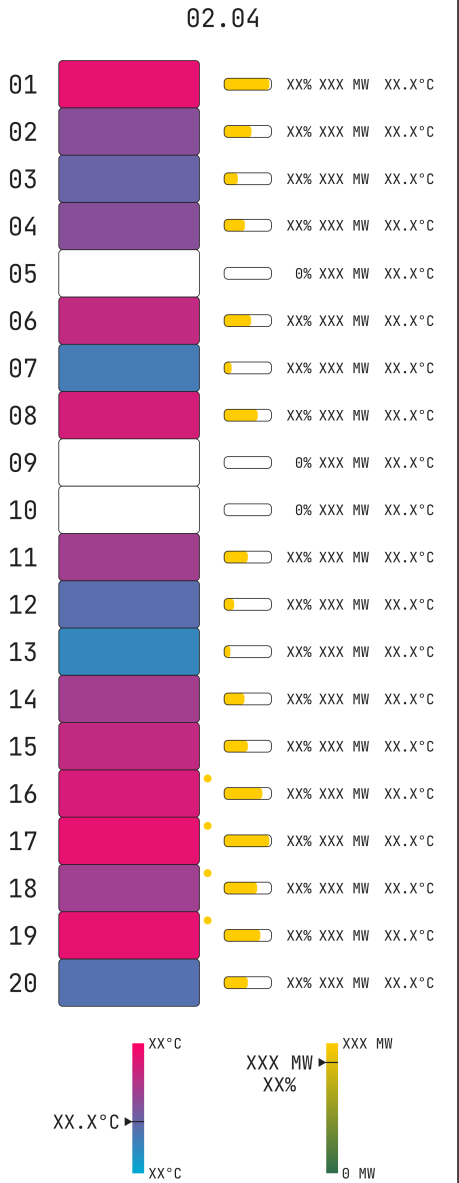

Sala = XX.X°C
HVAC = XX.X°C
PCal = XX.X°C

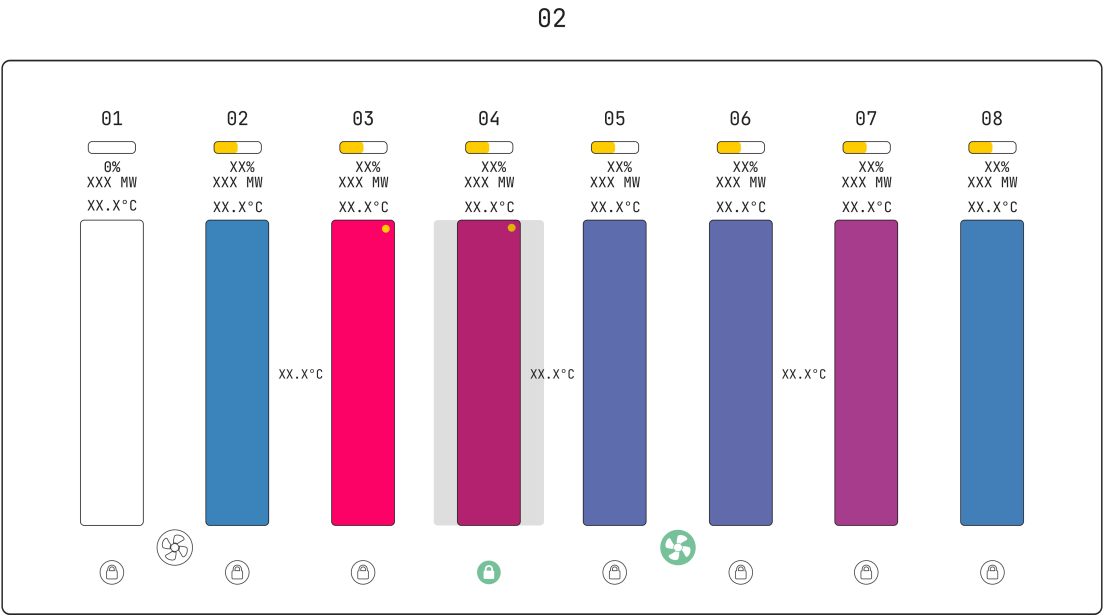

Total = XXX MW
IT = XXX MW
HVAC = XXX kW

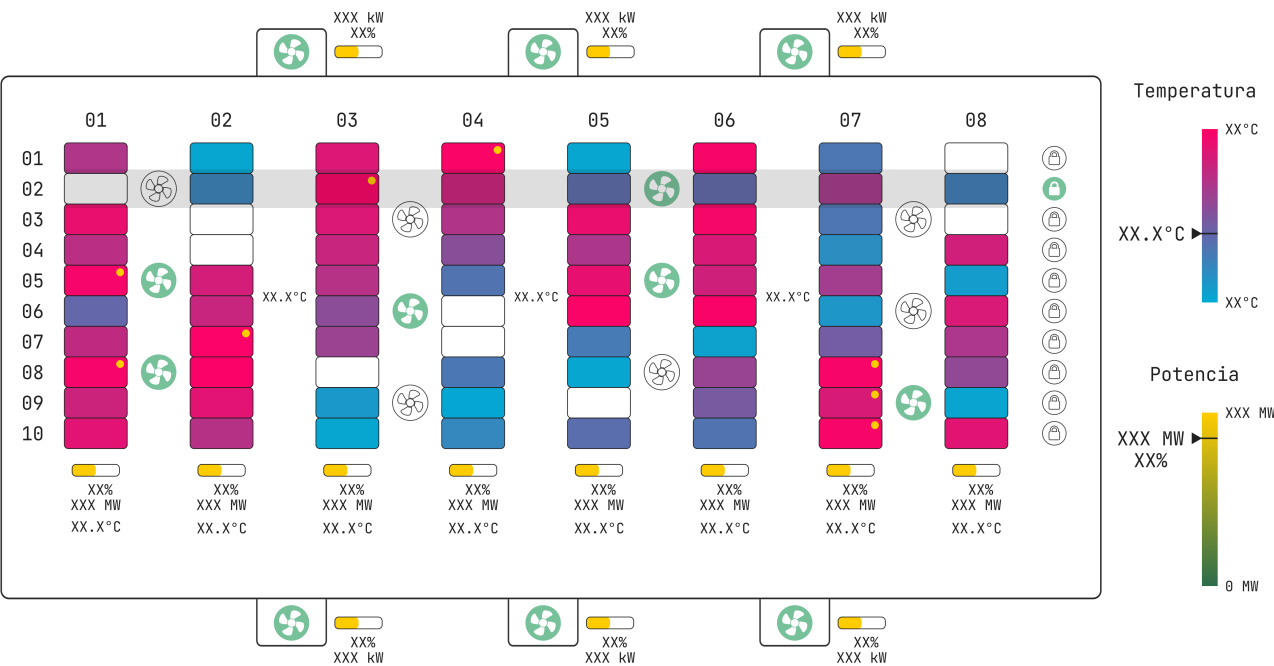

x1/10



PELIGRO WILL ROBINSON!!!