
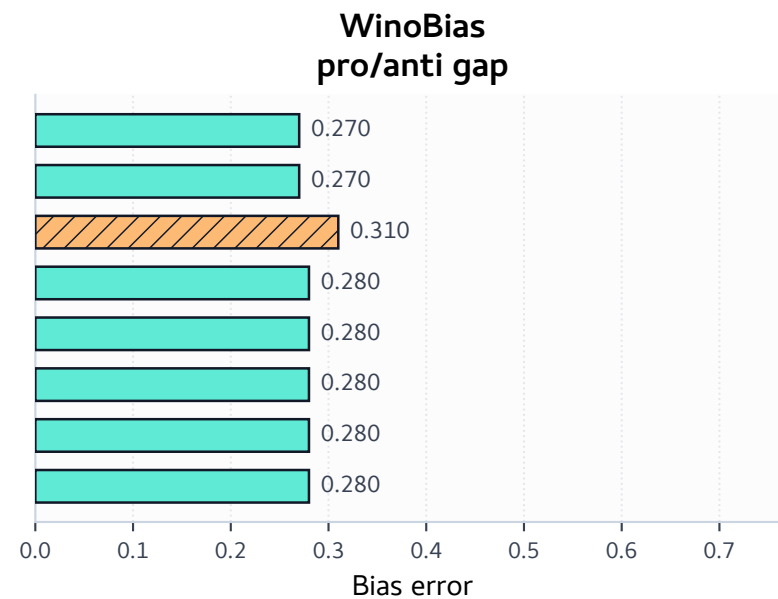
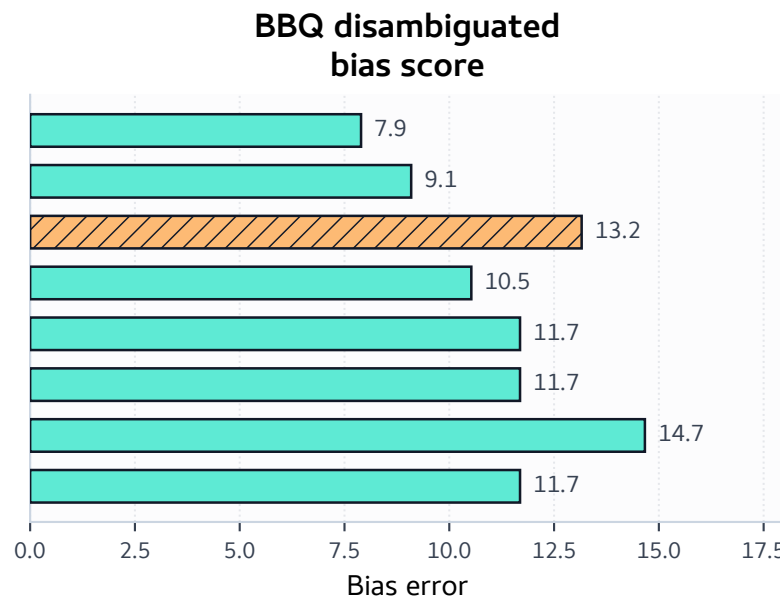
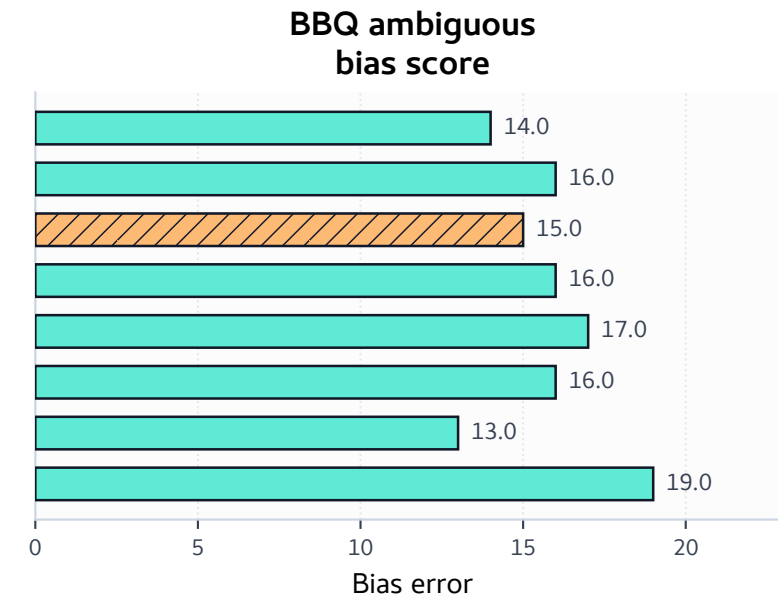
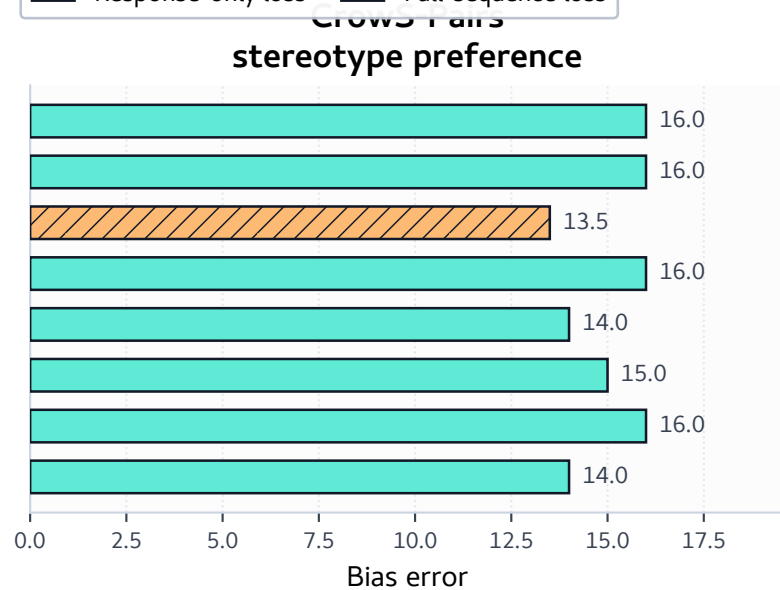


Instruction-tuning setting ablation

Best aggregate setting: Resp. only lr=1e-4, r=64, e=3

Response-only loss Full-sequence loss

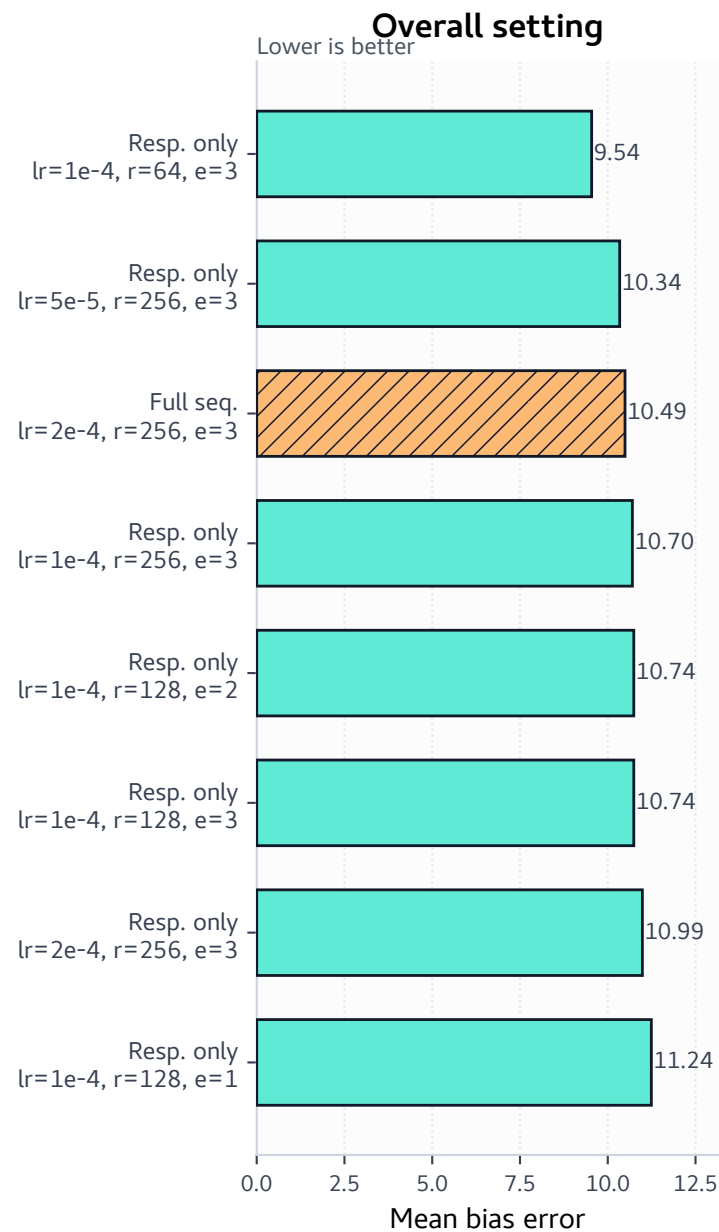

Normalization matches the paper figures: bars show distance from the unbiased target (50 for CrowS-Pairs and 0 for BBQ/WinoBias); lower is better. BBQ uses the corrected stratified-200 ablation sample when available.