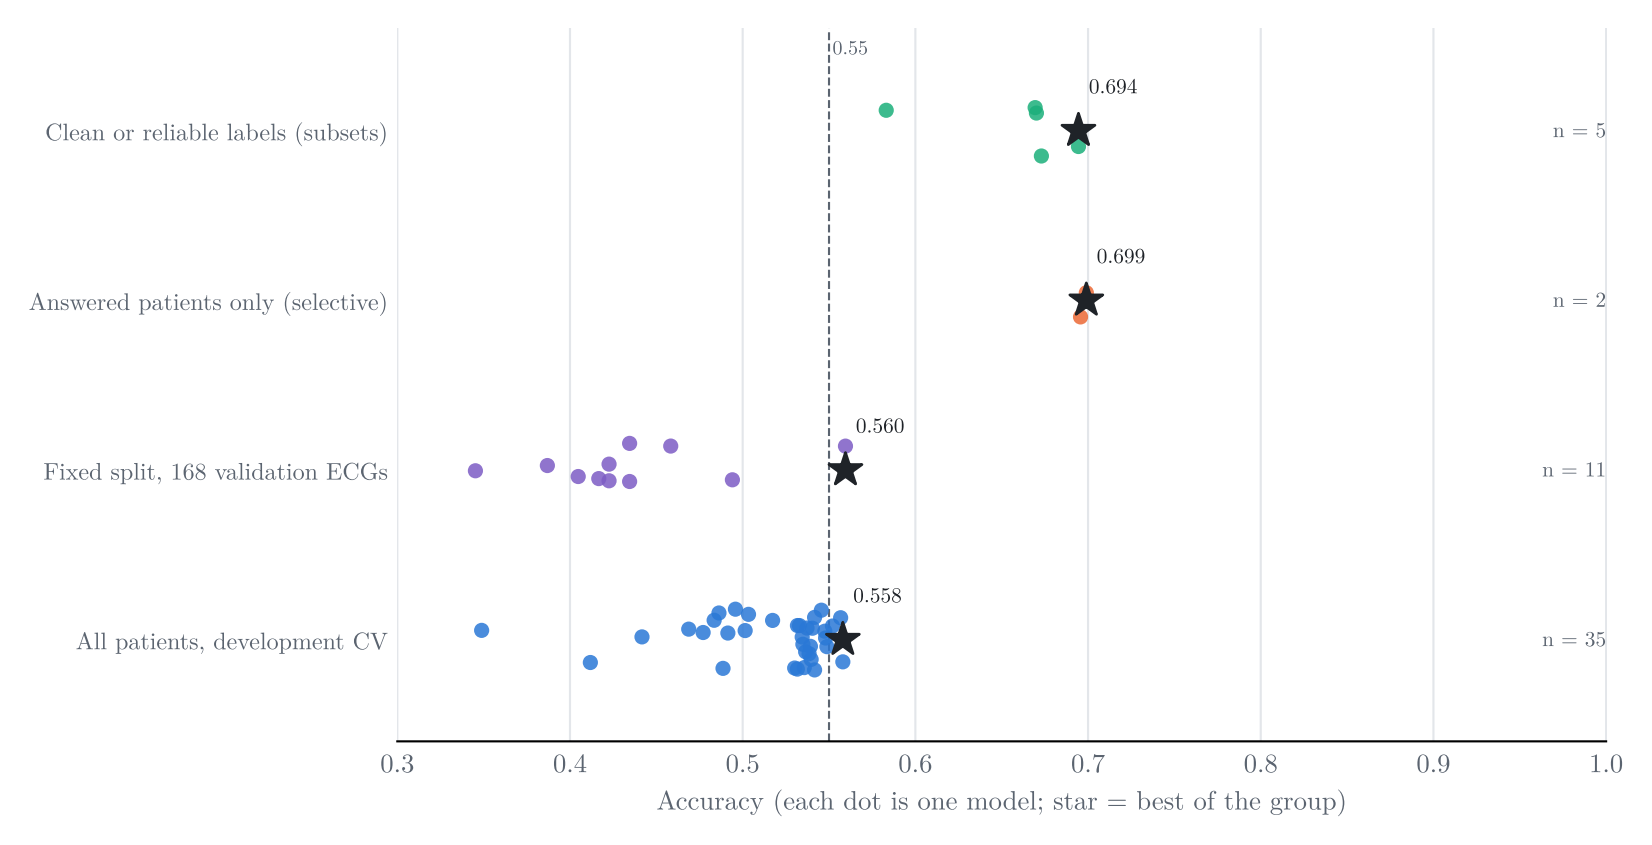
0.55
0.694
0.699
0.560
0.558
Clean or reliable labels (subsets)
Answered patients only (selective)
Fixed split, 168 validation ECGs
All patients, development CV
n = 5
n = 2
n = 11
n = 35
0.3
0.4
0.5
0.6
0.7
0.8
0.9
1.0
Accuracy (each dot is one model; star = best of the group)