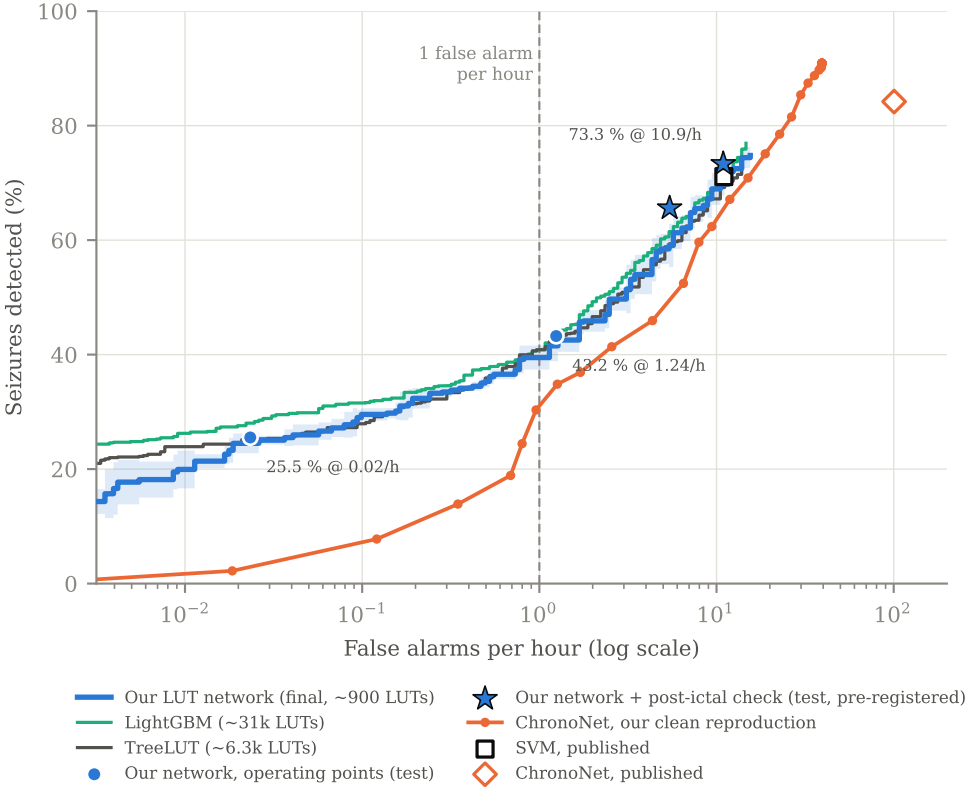
100
80
60
40
20
0
Seizures detected (%)
1 false alarm
per hour
73.3 % @ 10.9/h
43.2 % @ 1.24/h
25.5 % @ 0.02/h
10^{-2}
10^{-1}
10^{0}
10^{1}
10^{2}
False alarms per hour (log scale)
Our LUT network (final, ~900 LUTs)
LightGBM (~31k LUTs)
TreeLUT (~6.3k LUTs)
Our network, operating points (test)
Our network + post-ictal check (test, pre-registered)
ChronoNet, our clean reproduction
SVM, published
ChronoNet, published