


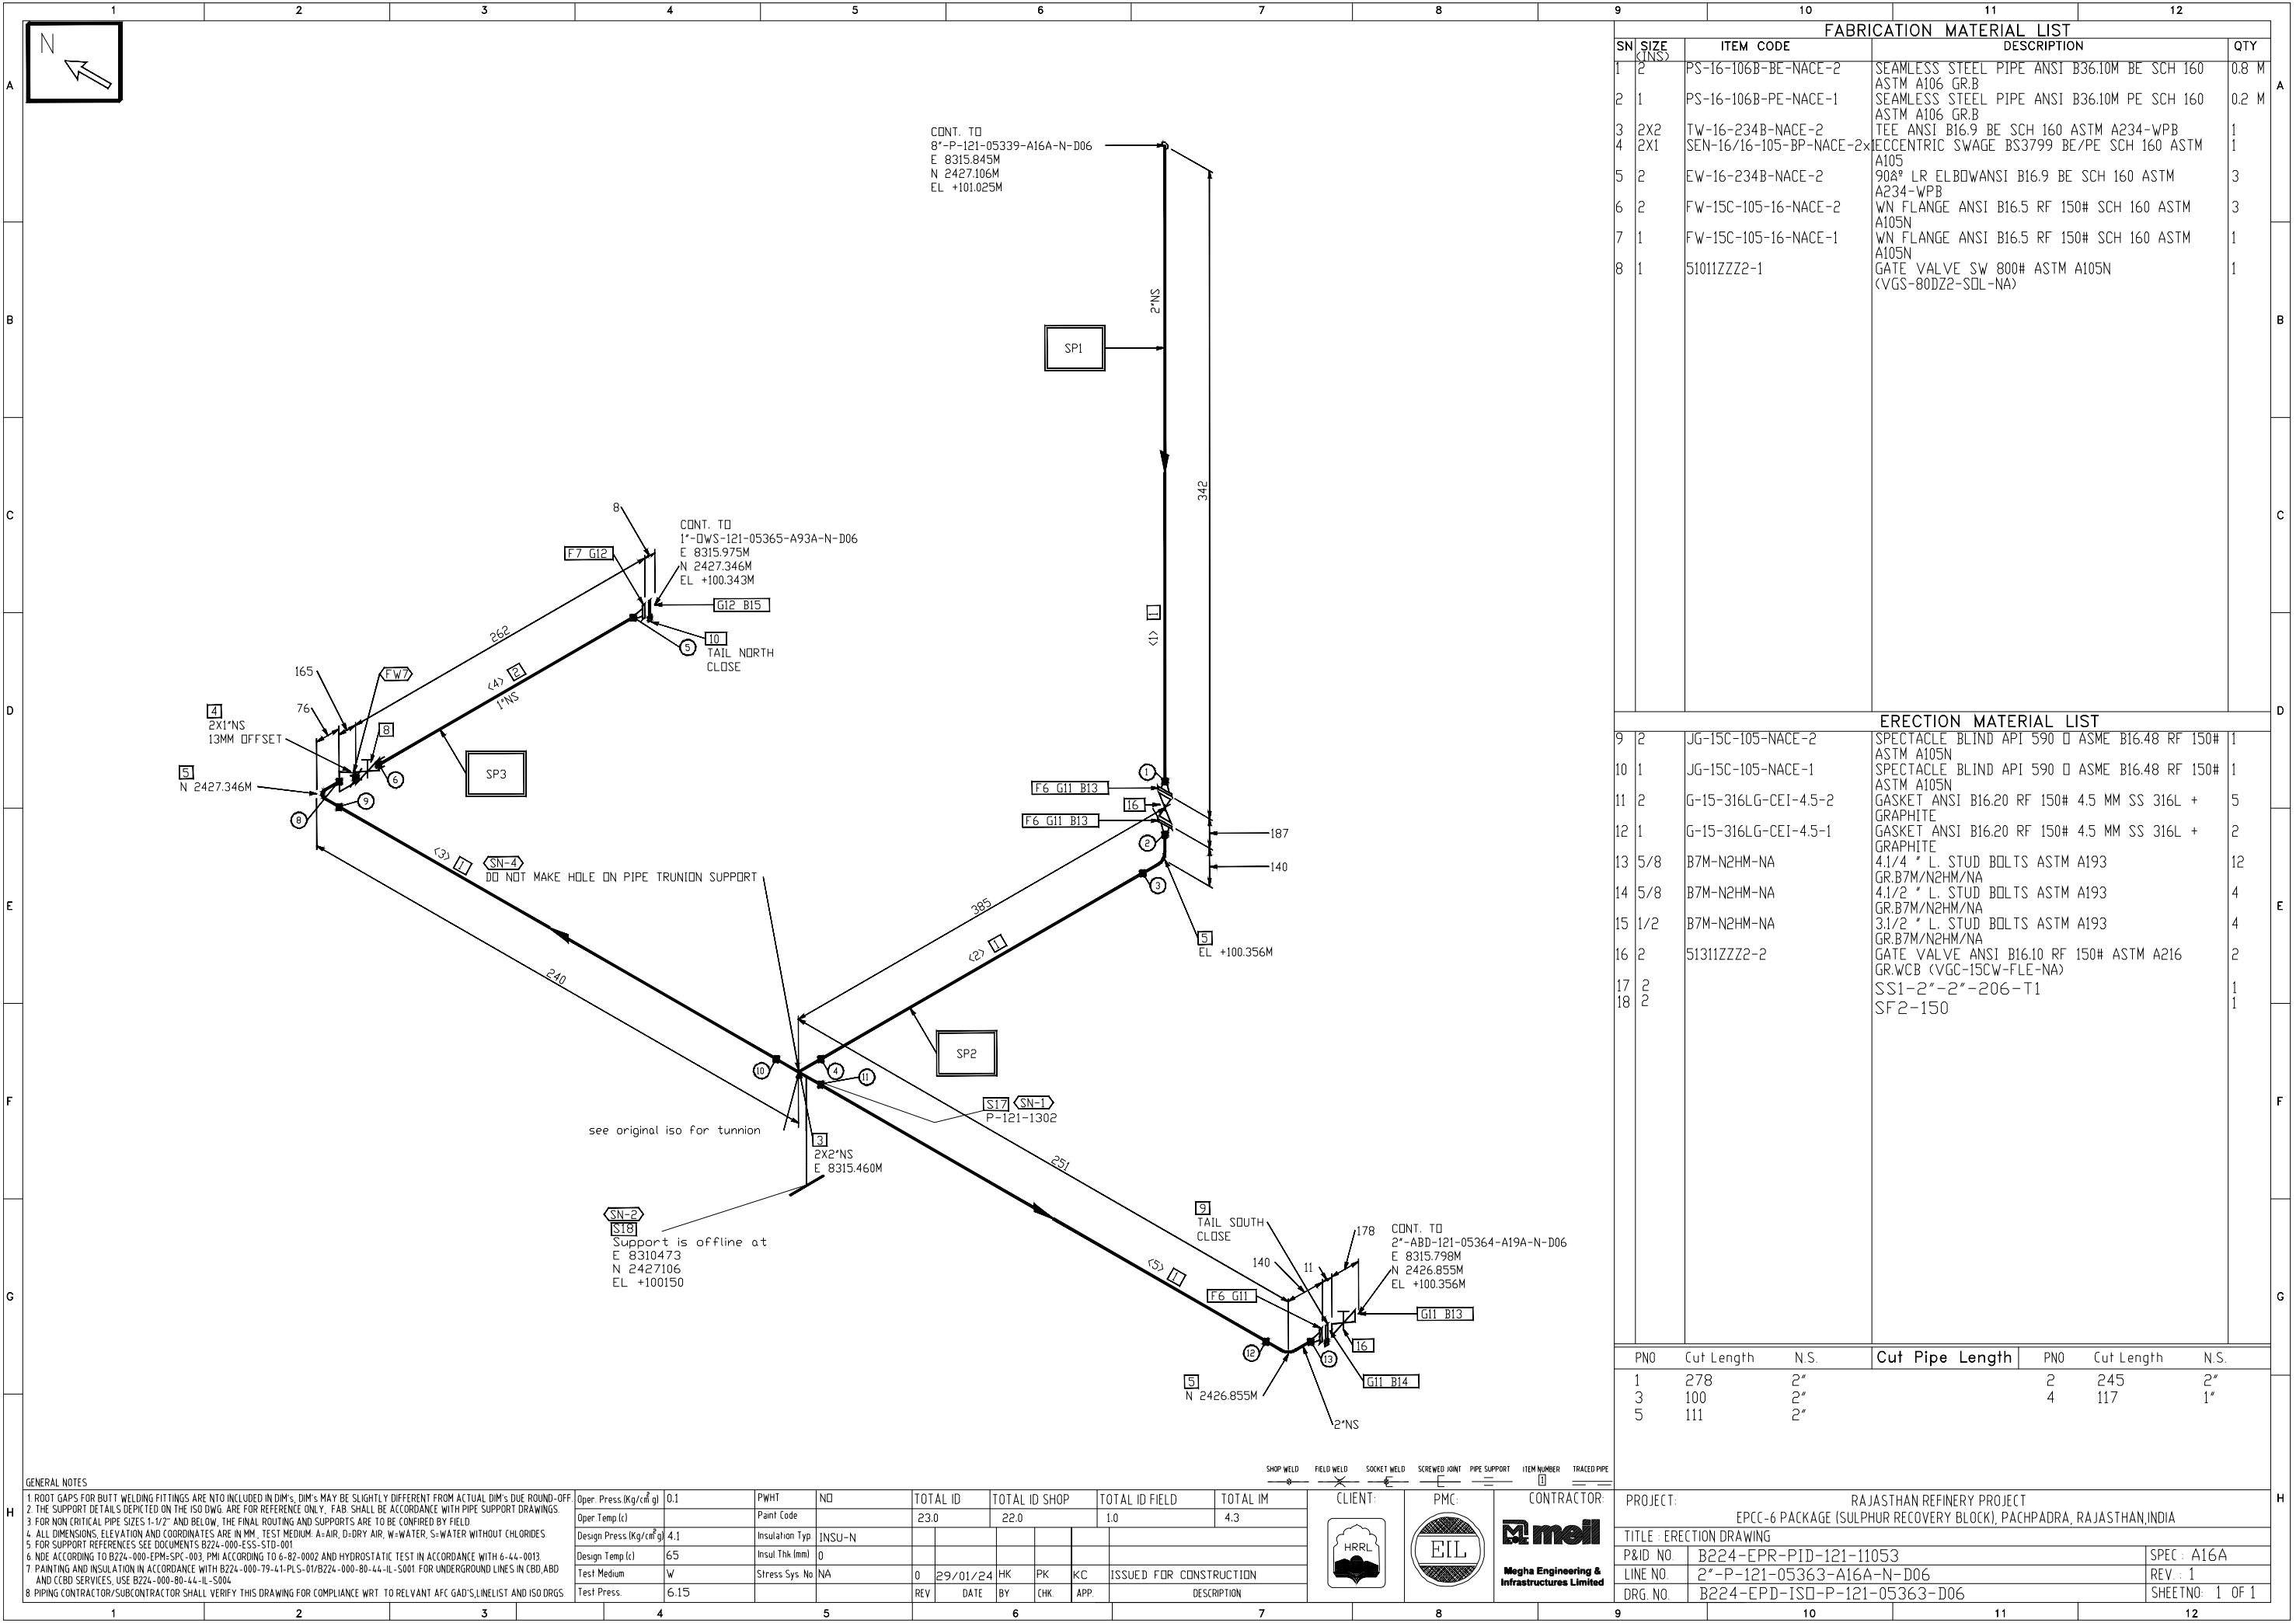

FABRICATION MATERIAL LIST			
SN	SIZE (INS)	ITEM CODE	DESCRIPTION
1	2	PS-16-106B-BE-NACE-2	SEAMLESS STEEL PIPE ANSI B36.10M BE SCH 160 ASTM A106 GR.B
2	1	PS-16-106B-PE-NACE-1	SEAMLESS STEEL PIPE ANSI B36.10M PE SCH 160 ASTM A106 GR.B
3	2X2	TW-16-234B-NACE-2	TEE ANSI B16.9 BE SCH 160 ASTM A234-WPB
4	2X1	SEN-16/16-105-BP-NACE-2	ECCENTRIC SWAGE BS3799 BE/PE SCH 160 ASTM A105
5	2	EW-16-234B-NACE-2	90° LR ELBOW ANSI B16.9 BE SCH 160 ASTM A234-WPB
6	2	FW-15C-105-16-NACE-2	WN FLANGE ANSI B16.5 RF 150# SCH 160 ASTM A105N
7	1	FW-15C-105-16-NACE-1	WN FLANGE ANSI B16.5 RF 150# SCH 160 ASTM A105N
8	1	51011ZZZ2-1	GATE VALVE SW 800# ASTM A105N (VGS-80DZ2-SDL-NA)

ERECTION MATERIAL LIST			
9	2	JG-15C-105-NACE-2	SPECTACLE BLIND API 590 D ASME B16.48 RF 150# ASTM A105N
10	1	JG-15C-105-NACE-1	SPECTACLE BLIND API 590 D ASME B16.48 RF 150# ASTM A105N
11	2	G-15-316LG-CEI-4.5-2	GASKET ANSI B16.20 RF 150# 4.5 MM SS 316L + GRAPHITE
12	1	G-15-316LG-CEI-4.5-1	GASKET ANSI B16.20 RF 150# 4.5 MM SS 316L + GRAPHITE
13	5/8	B7M-N2HM-NA	4 1/4 " L. STUD BOLTS ASTM A193 GR.B7M/N2HM/NA
14	5/8	B7M-N2HM-NA	4 1/2 " L. STUD BOLTS ASTM A193 GR.B7M/N2HM/NA
15	1/2	B7M-N2HM-NA	3 1/2 " L. STUD BOLTS ASTM A193 GR.B7M/N2HM/NA
16	2	51311ZZZ2-2	GATE VALVE ANSI B16.10 RF 150# ASTM A216 GR.WCB (VGC-15CW-FLE-NA)
17	2		SS1-2"-2"-206-T1
18	2		SF2-150

PNO	Cut Length	N.S.	Cut Pipe Length	PNO	Cut Length	N.S.
1	278	2"		2	245	2"
3	100	2"		4	117	1"
5	111	2"				

GENERAL NOTES

1. ROOT GAPS FOR BUTT WELDING FITTINGS ARE NOT INCLUDED IN DIM'S. DIM'S MAY BE SLIGHTLY DIFFERENT FROM ACTUAL DIM'S DUE TO ROUND-OFF.

2. THE SUPPORT DETAILS DEPICTED ON THE ISO DWG. ARE FOR REFERENCE ONLY. FAB. SHALL BE ACCORDANCE WITH PIPE SUPPORT DRAWINGS.

3. FOR NON CRITICAL PIPE SIZES 1-1/2" AND BELOW, THE FINAL ROUTING AND SUPPORTS ARE TO BE CONFIRMED BY FIELD.

4. ALL DIMENSIONS, ELEVATION AND COORDINATES ARE IN MM. TEST MEDIUM: A=AIR, D=DRY AIR, W=WATER, S=WATER WITHOUT CHLORIDES.

5. FOR SUPPORT REFERENCES SEE DOCUMENTS B224-000-EPS-003, PMI ACCORDING TO 6-82-0002 AND HYDROSTATIC TEST IN ACCORDANCE WITH 6-44-0013.

6. NDE ACCORDING TO B224-000-EPM-SPC-003, PMI ACCORDING TO 6-82-0002 AND HYDROSTATIC TEST IN ACCORDANCE WITH 6-44-0013.

7. PAINTING AND INSULATION IN ACCORDANCE WITH B224-000-79-41-PLS-01/B224-000-80-44-IL-S001 FOR UNDERGROUND LINES IN CBD, ABD AND CBO SERVICES. USE B224-000-80-44-IL-S004.

8. PIPING CONTRACTOR/SUBCONTRACTOR SHALL VERIFY THIS DRAWING FOR COMPLIANCE WRT. TO RELVANT AFC GAD'S, LINE LIST AND ISO DRGS.

Oper. Press (Kg/cm ² g)	0.1	PWHT	NO	TOTAL ID	TOTAL ID SHOP	TOTAL ID FIELD	TOTAL IM
Oper. Temp (c)		Paint Code		23.0	22.0	1.0	4.3
Design Press (Kg/cm ² g)	4.1	Insulation Typ	INSU-N				
Design Temp (c)	65	Insul Thk (mm)	0				
Test Medium	W	Stress Sys. No	NA				
Test Press.	6.15						

CLIENT: HRRL

PMC: EIL

CONTRACTOR: Megha Engineering & Infrastructures Limited

0	29/01/24	HK	PK	KC	ISSUED FOR CONSTRUCTION
REV	DATE	BY	CHK	APP	DESCRIPTION

PROJECT: RAJASTHAN REFINERY PROJECT

EPCC-6 PACKAGE (SULPHUR RECOVERY BLOCK), PACHPADRA, RAJASTHAN, INDIA

TITLE: ERECTION DRAWING

P&ID NO.	B224-EPR-PID-121-11053	SPEC:	A16A
LINE NO.	2"-P-121-05363-A16A-N-D06	REV:	1
DRG. NO.	B224-EPD-ISO-P-121-05363-D06	SHEET NO:	1 OF 1