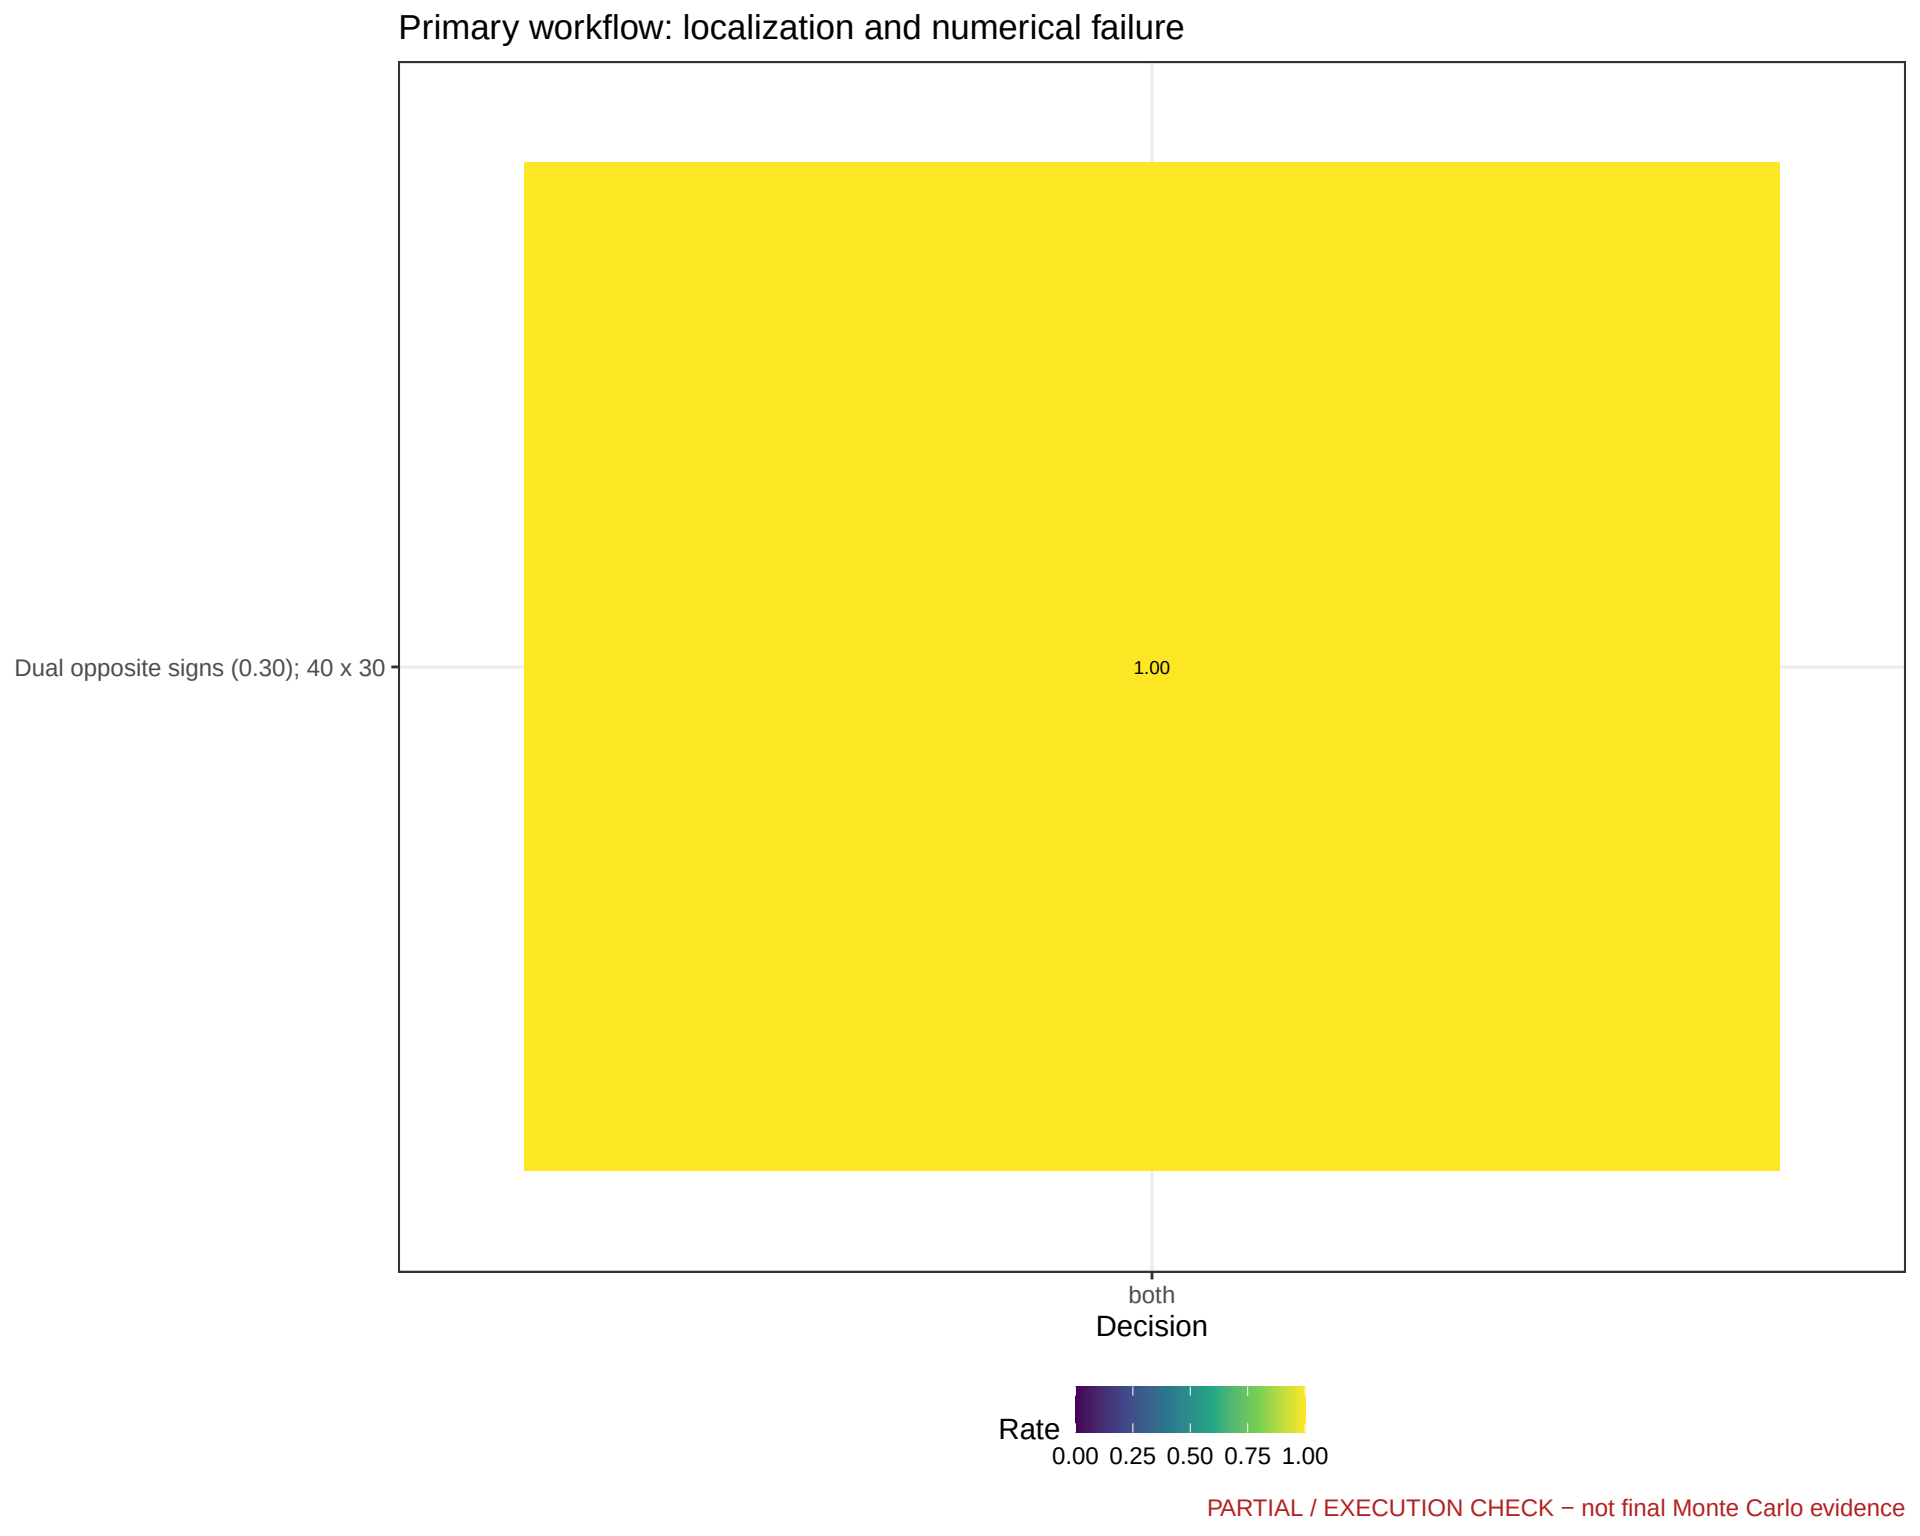
Primary workflow: localization and numerical failure
Dual opposite signs (0.30); 40 x 30
1.00
both
Decision
Rate
0.00 0.25 0.50 0.75 1.00
PARTIAL / EXECUTION CHECK − not final Monte Carlo evidence