


ATLAS OT SCOUT

From bounded evidence to a reviewable OT inventory

A dedicated Android field instrument for safe, evidence-led assessment of one industrial site.

P0-WATER • PASSIVE FIRST • OFFLINE CASE APP

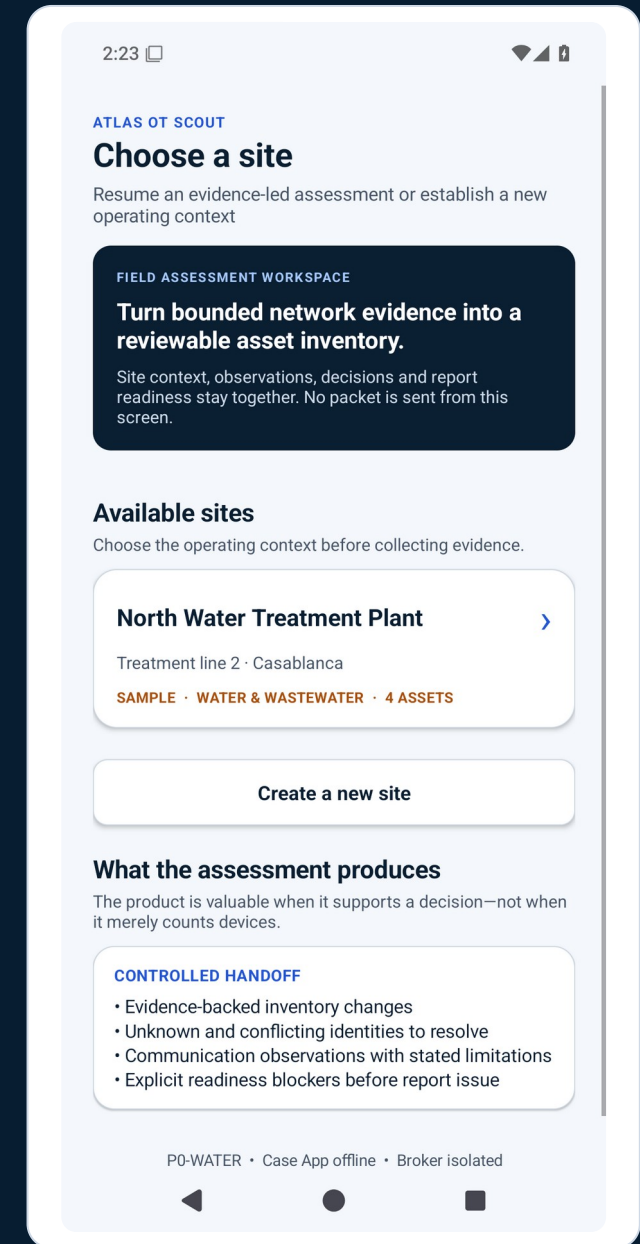


A device count is not a defensible handoff

Industrial teams need to know what changed, what remains uncertain, and how every claim was established.

The decision burden


- Reconcile observed identities with the customer record
- Keep evidence provenance attached to every asset
- Expose unresolved review and approval gaps

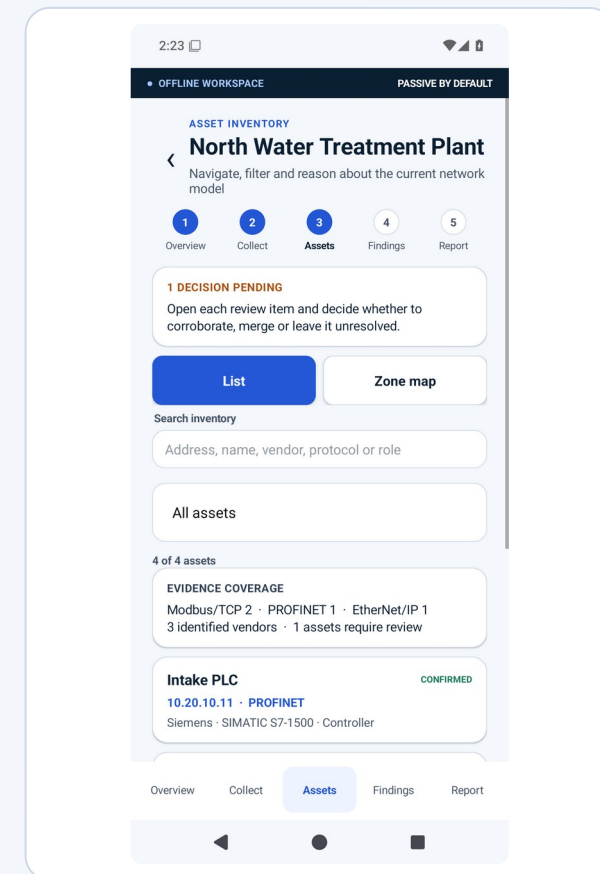

The assessment advances through five explicit decisions

Each stage produces a reviewable output and keeps the operator inside the authorized scope.

- 1 Overview** Establish site context
- 2 Collect** Choose least intrusive evidence
- 3 Assets** Review observations
- 4 Findings** State evidence and limits
- 5 Report** Expose readiness blockers

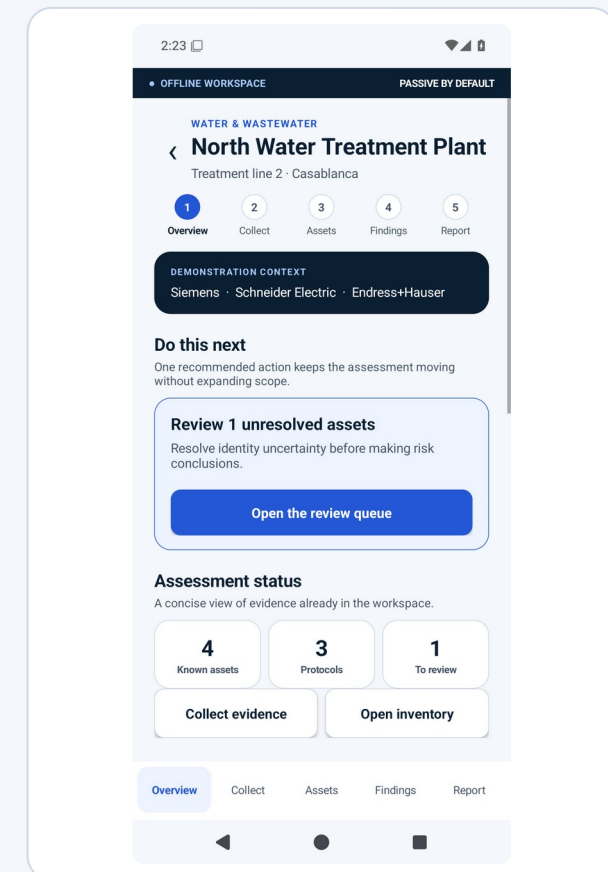


Passive evidence is the default

Start with the evidence gap, then choose the least intrusive method that can close it.

0 packets transmitted by imported capture analysis

- Analyze customer-supplied PCAP / PCAPNG
- Observe an approved SPAN / TAP interface
- Escalate only for one named identity gap

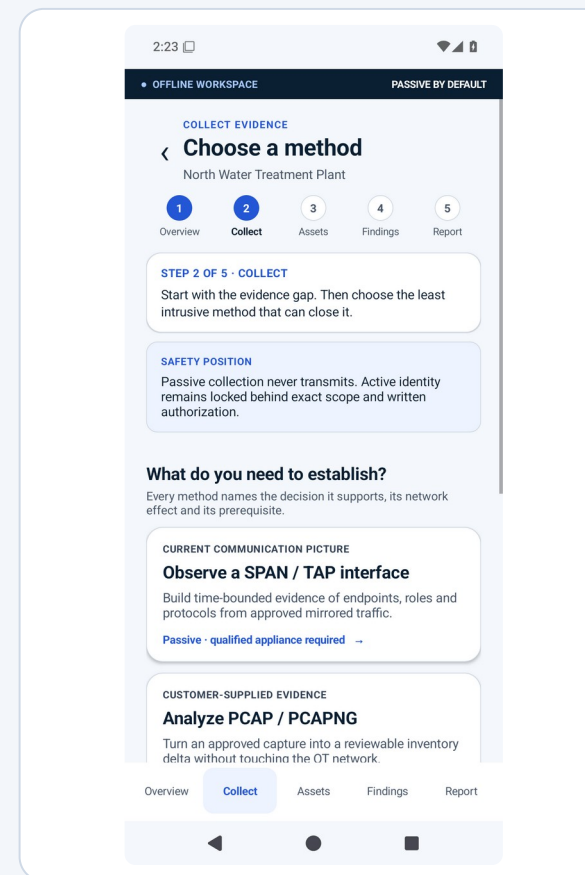


Traffic becomes reviewable observations

Protocol and endpoint evidence never mutates inventory until the assessor makes an explicit decision.

ANALYST DECISION

**Accept supported observations.
Leave ambiguous identities
unresolved.**

The raw source, hash, protocol, endpoint, role inference and confidence remain attached for later review.

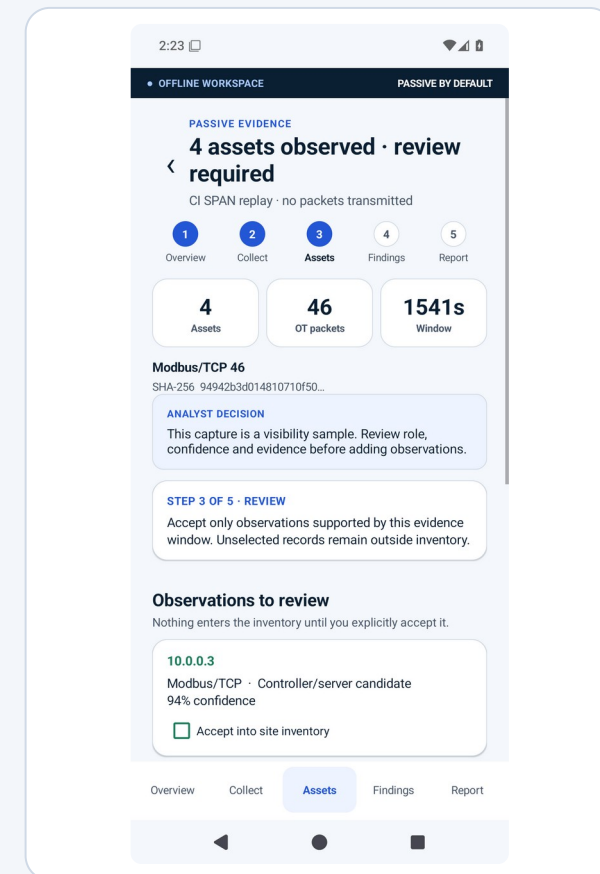

One request, one target, one authorization

The PoC exposes one bounded Modbus identity operation — never a subnet, port, unit-ID or vulnerability sweep.

2:23

AUTHORIZED ACTIVE CHECK

< Identify one Modbus device

North Water Treatment Plant

1 Work order

Case reference

P0-WATER-001

Process area

Treatment line 2

2 Exact target and scope

Target controller IPv4

10.0.2.2

Authorized IPv4 scope (CIDR)

10.0.2.0/24

Modbus unit ID

1

ACTIVE LIMITS

1 identity request · TCP/502 · 1.5 s timeout · no register reads or writes

3 Authorization

I confirm written operational and security authorization for this target, scope and time window.

☐

2:23

AUTHORIZED ACTIVE CHECK

< Identify one Modbus device

North Water Treatment Plant

1 Work order

Case reference

P0-WATER-001

Process area

Treatment line 2

2 Exact target and scope

Target controller IPv4

192.0.2.5

Authorized IPv4 scope (CIDR)

10.0.2.0/24

Modbus unit ID

1

ACTIVE LIMITS

1 identity request · TCP/502 · 1.5 s timeout · no register reads or writes

3 Authorization

I confirm written operational and security authorization for this target, scope and time window.

☒


Target is outside the authorized CIDR. The app will not expand

Fail closed

- Signed, expiring, one-use grant
- Exact target and CIDR
- Blocked before transmission

Inventory keeps evidence and uncertainty visible

Search and filter by zone, protocol, vendor, confidence and review state — then trace each asset back to evidence.

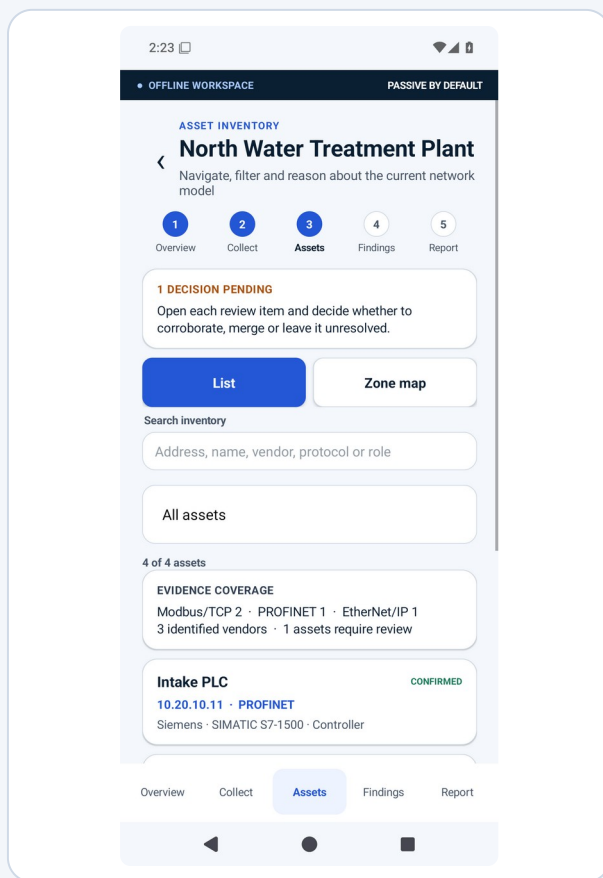

The useful questions


- Which expected records are corroborated?
- Which observed assets remain unidentified?
- Where do evidence sources conflict?
- What must be reviewed before handoff?

Incomplete work remains visibly blocked

Report readiness separates supported local case data from missing approval, reviewer and production-export controls.

- ✓ **Site context**
- ✓ **Evidence-backed inventory**

- ! **Observation review**
- ! **Signed authorization record**
- ! **Independent reviewer**

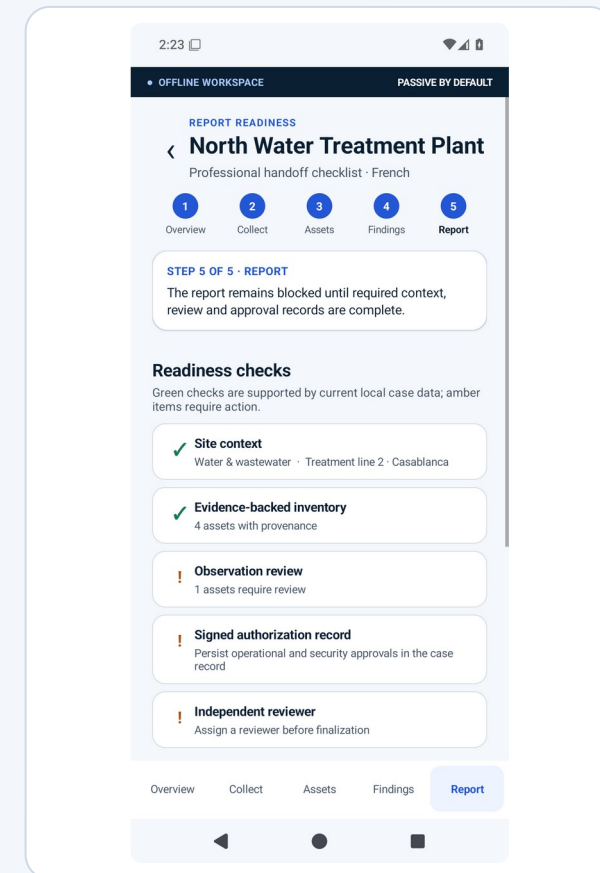

Automated emulation is strong evidence — within a stated boundary

The current proof covers application behavior, broker isolation and controlled testbeds; physical qualification remains a release gate.

PROVEN IN CI

- Android API 29 and API 35 journeys
- Passive protocol fixtures and capture boundary
- PyModbus, Modbus-TK and Conpot outcomes

PHYSICAL QUALIFICATION REQUIRED

- Samsung model and locked appliance image
- USB Ethernet, TAP and production traffic
- Real PLC firmware and packet-loss limits

One segment. One bounded question. One reviewable handoff.

- 1 Select one authorized water-sector segment
- 2 Compare Atlas with the current inventory workflow
- 3 Measure corrections, unresolved identities and review effort

Witness the method. Review the evidence. Decide whether the workflow earns a field trial.