



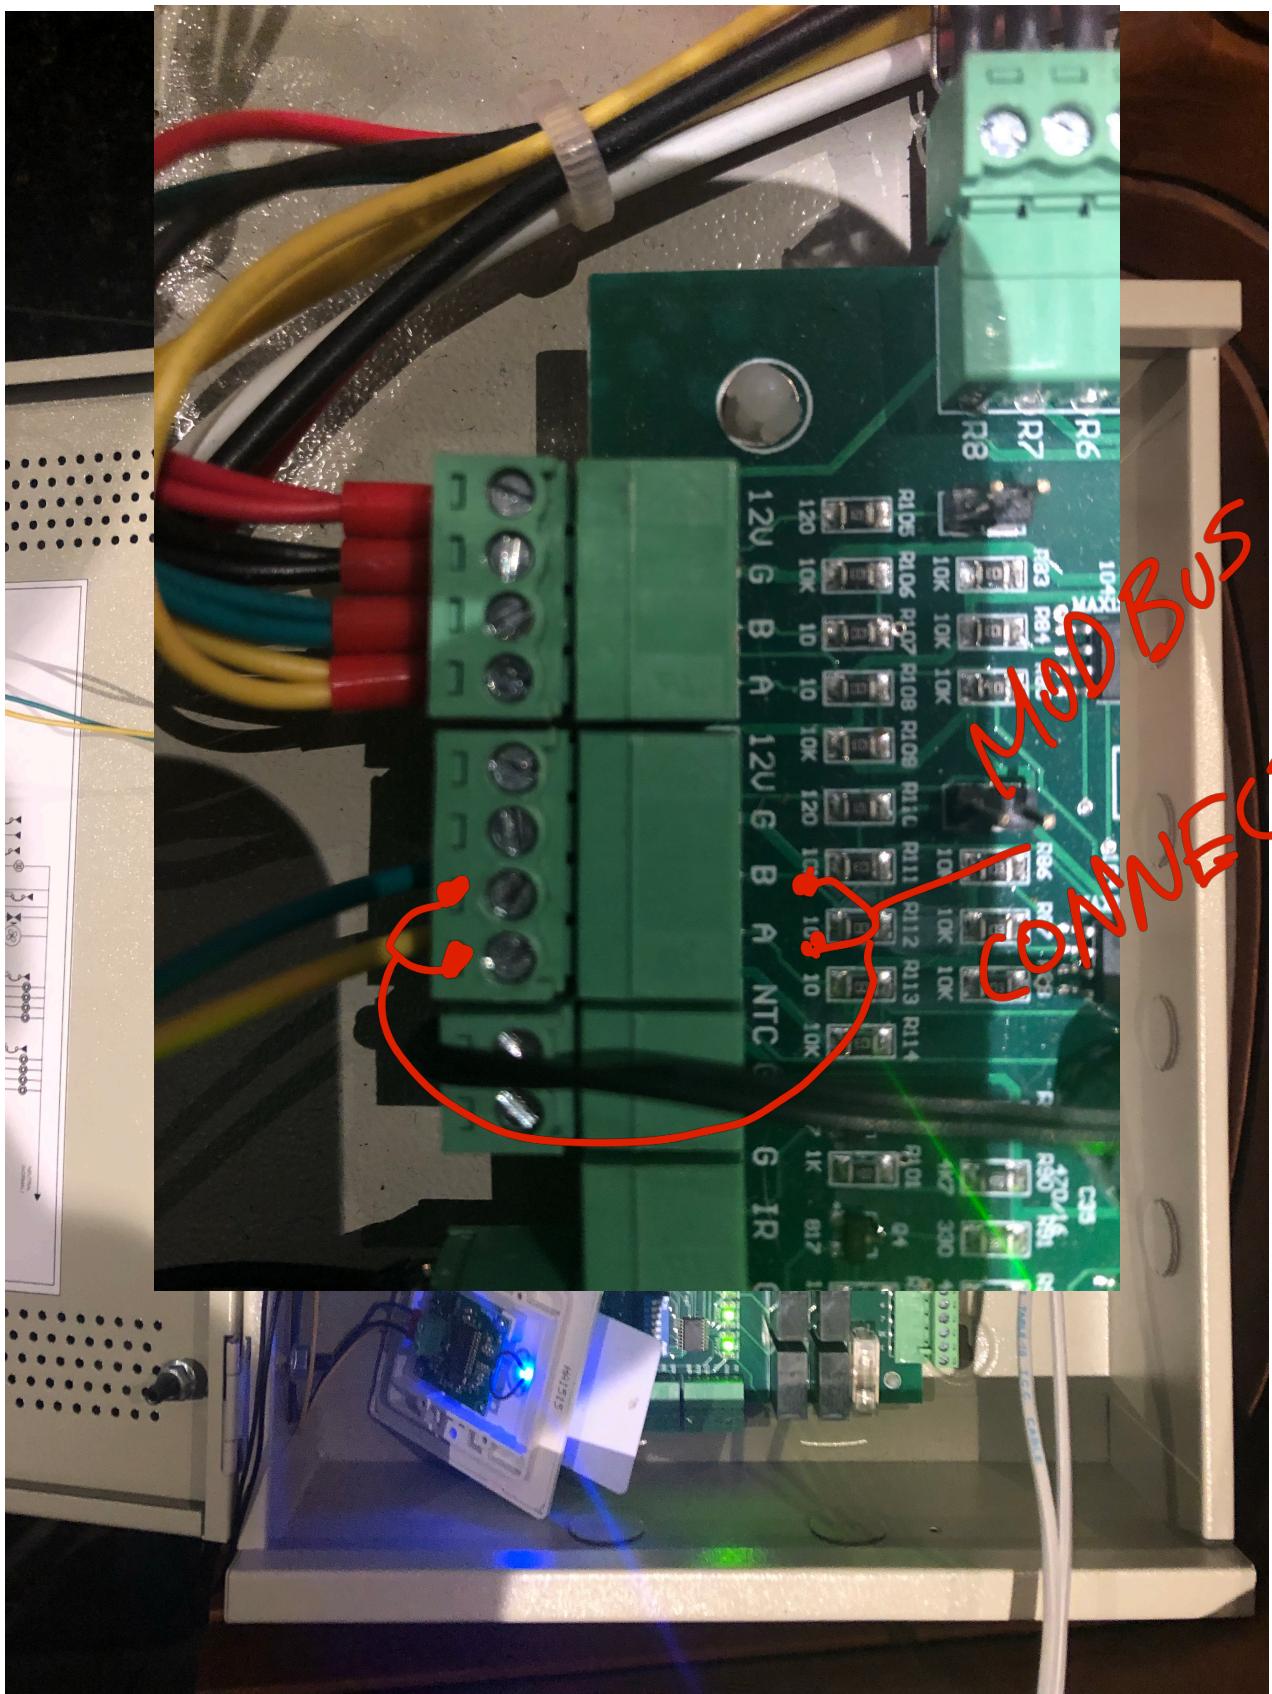


# Modbus connection Points

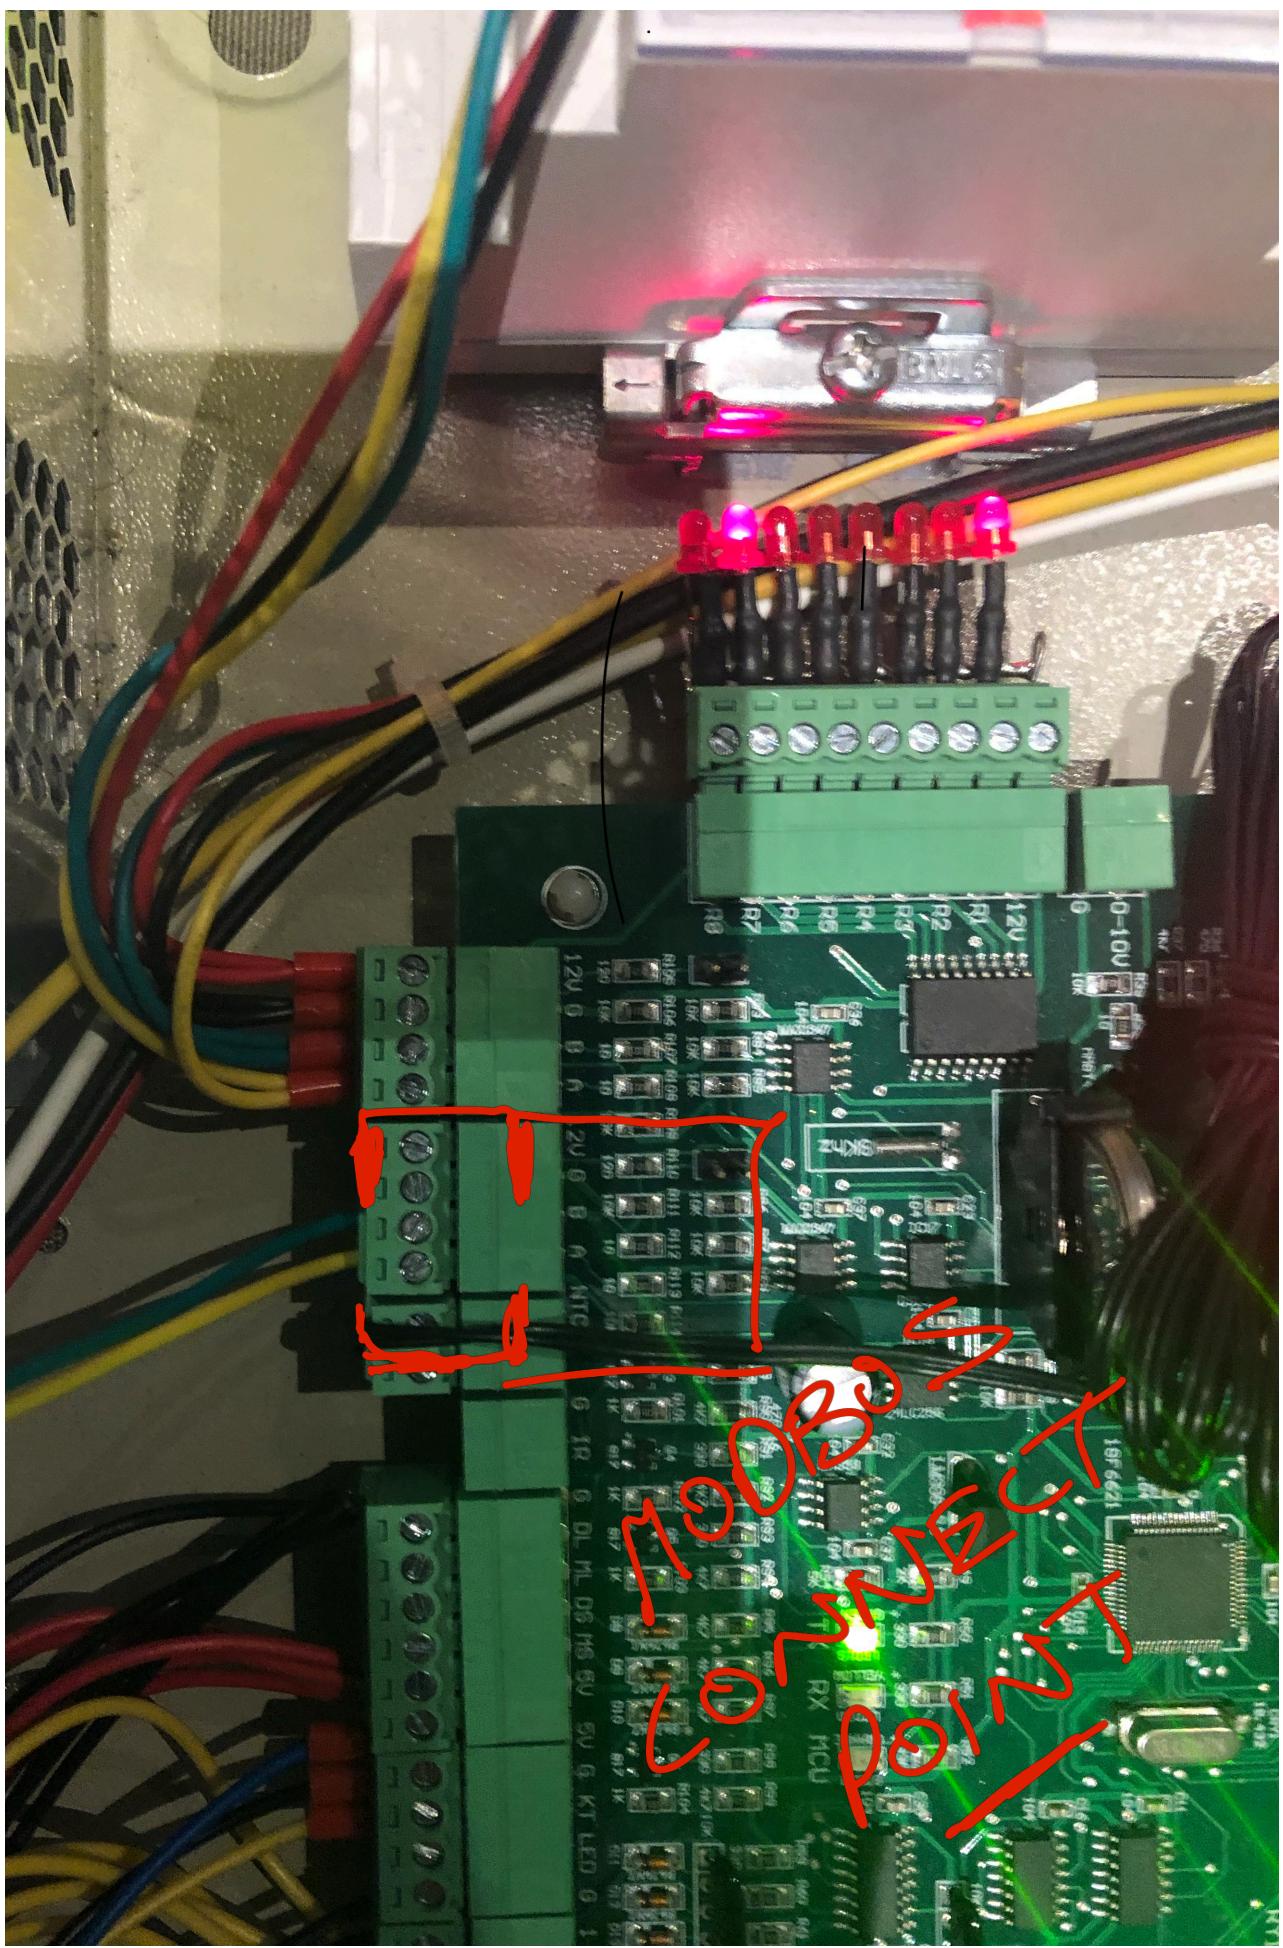

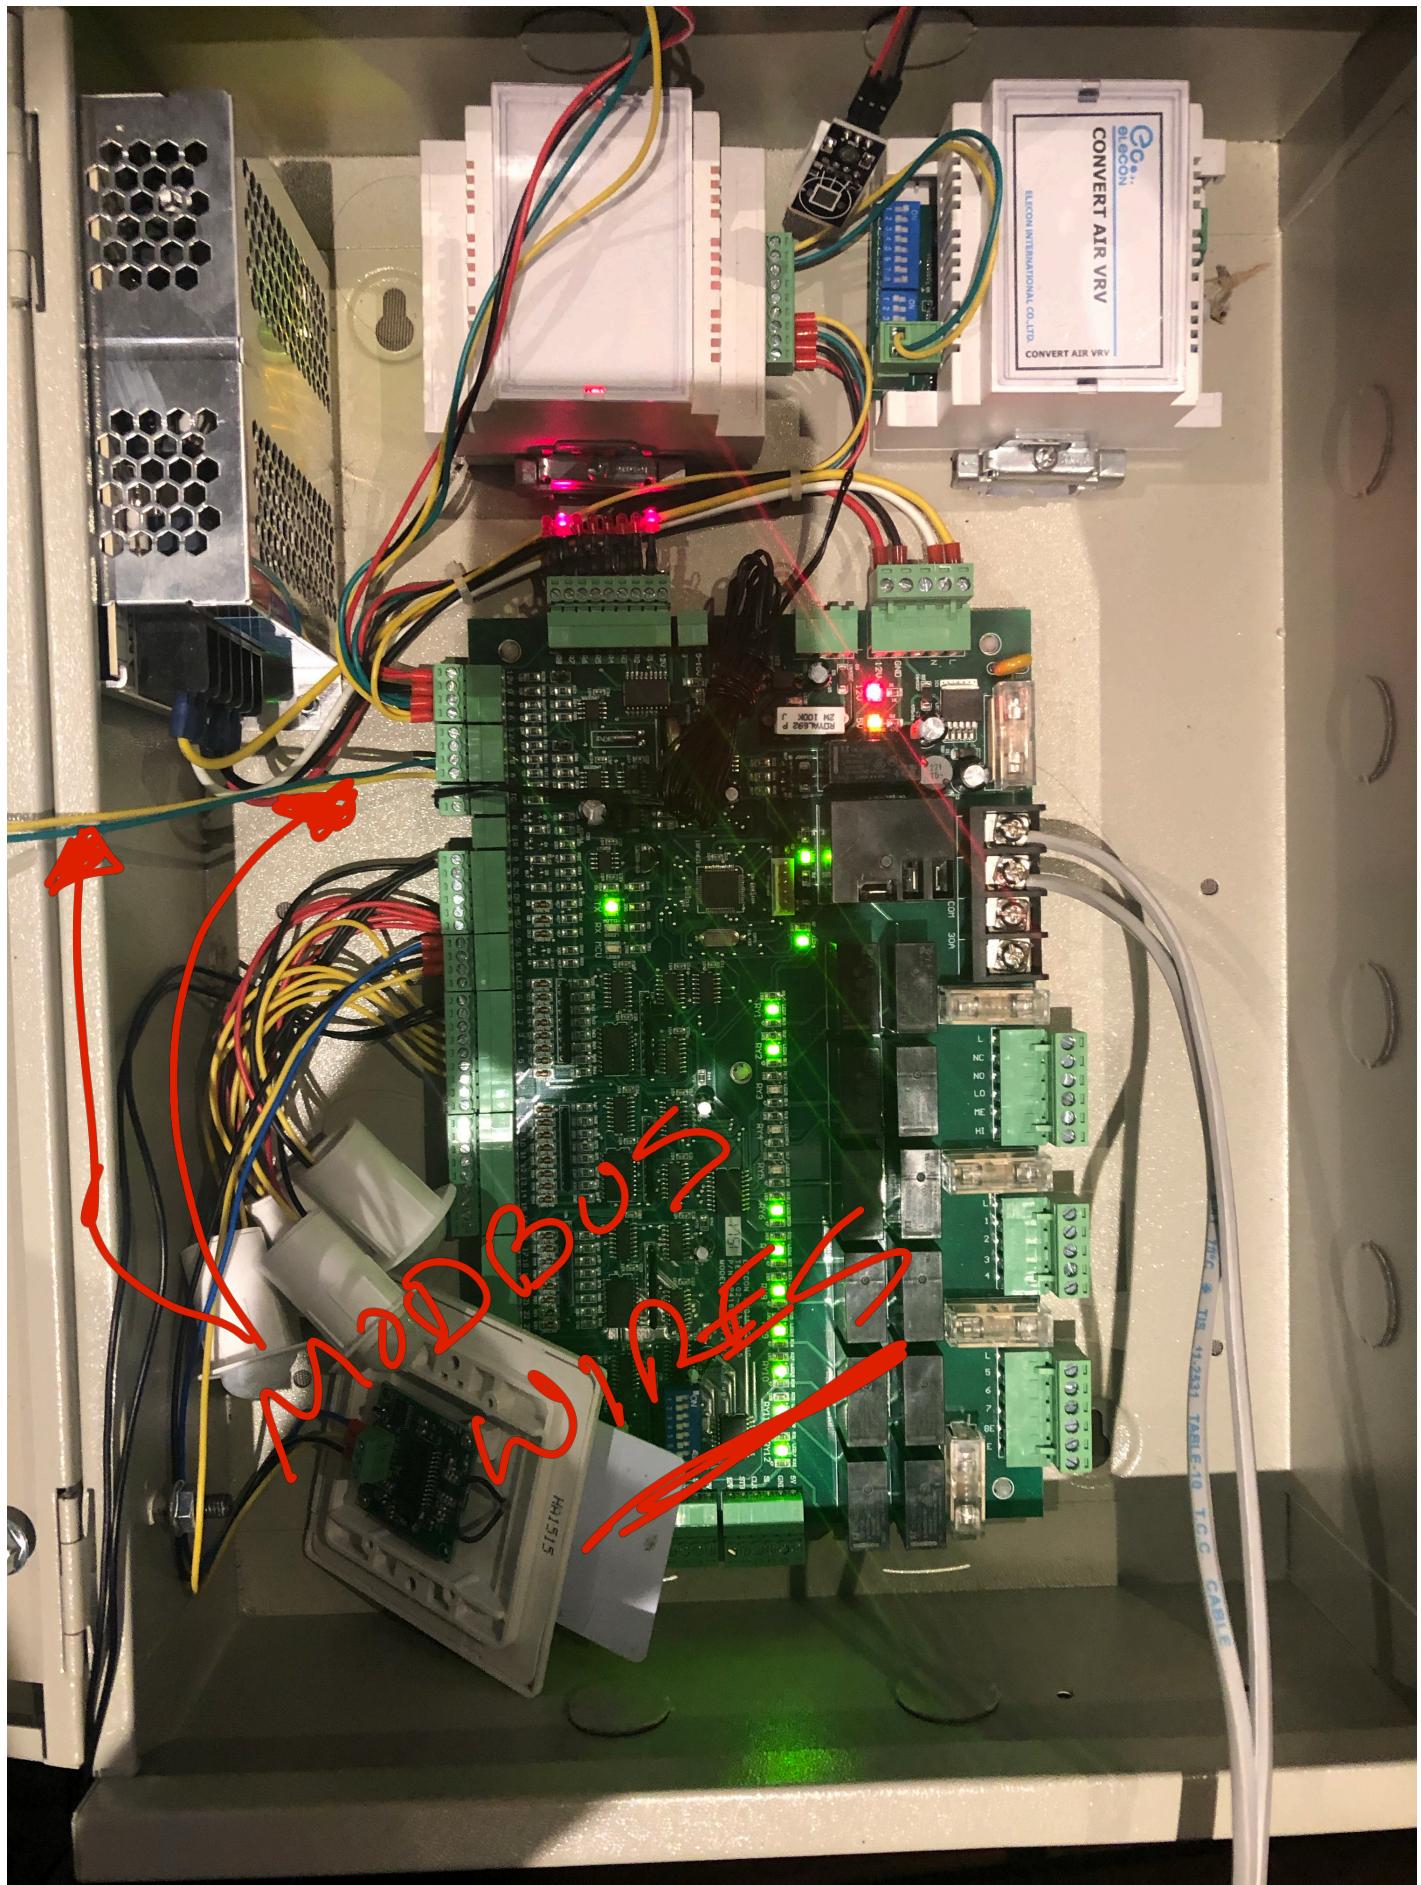



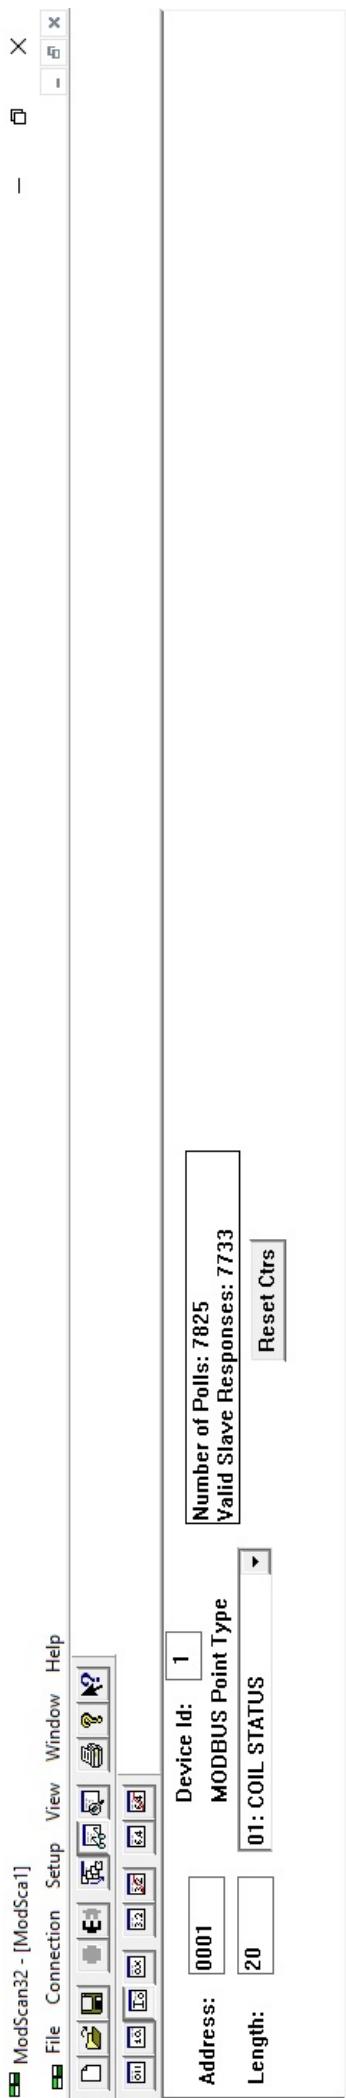

ModScan32 - [ModScan1]

File Connection Setup View Window Help

Address: 0001 Length: 34

MODBUS Point Type 03: HOLDING REGISTER ▾

Device Id: 1 Number of Polls: 4009  
Valid Slave Responses: 3962

Reset Ctrs

```

40001: < 1> Main Board ID
40002: < 2> Fan Speed 0=Off,1=Low,2=Med,3=High
40003: < 25> Temp Setting
40004: < 29> Temp Read Read Only
40005: < 0> Temp Read Point Read Only
40006: < 67> Humidity Read Read Only
40007: < 9> Humidity Read Point Read Only
40008: < 0> Spare
40009: < 0> Spare
40010: < 5> Temperature Compensate
40011: < 1> Fan Speed Insert Card
40012: < 25> Temperature Insert Card
40013: < 1> Fan Speed Remove Card
40014: < 16> Temperature Remove Card
40015: < 32> Temperature Set Max
40016: < 16> Temperature Set Min
40017: < 5> Timer Fan Turn On
40018: < 5> Timer Fan Turn Off
40019: < 45> Card Delay Removed
40020: < 2> Option Out
40021: < 3> Show Display
40022: < 5> Motion Time Checking
40023: < 20> Temperature Limit
40024: < 5> Timer For Entry Door
40025: < 40> Humidity Min
40026: < 80> Humidity Max
40027: < 1> Function Humidity Min
40028: < 2> Function Humidity Max
40029: < 20> Humidity Compensate
40030: < 0>
40031: < 0>
40032: < 0>
40033: < 0>
40034: < 0>

```

Polls: 4009    Resps: 3962

12:17 AM    ENG    2019-01-28

ModScan32 - (COMM8)

File Connection Setup View Window Help

Address: 0001 Length: 34

MODBUS Point Type 03: HOLDING REGISTER ▾

Device Id: 1 Number of Polls: 4009  
Valid Slave Responses: 3962

Reset Ctrs

