



TEE CONNECTION DETAIL 36"øx16"ø TEE AND 16" GATE VALVE WD-2775-2 WD-2775-2C 3/8"=1'-0"

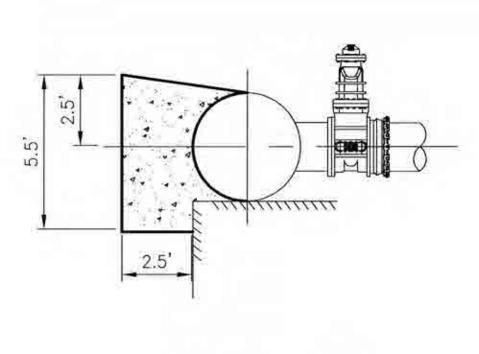



NOTES:

- 1. REFER TO NOTES ON DRAWING WD-2775-2.
- 2. DIP PIPE FLANGES SHALL CONFORM TO ANSI B16.1 CLASS 125, STEEL PIPE FLANGE TO AWWA C-207 CLASS E.
- 3. FOR STEEL PIPE COATING AND LINING SEE SPECIFICATION 09 97 72. FOR GASKETS, BOLTS, AND IFJ'S SEE SPECIFICATION 26 42 40.
- 4. SFWD TO PROVIDE AND CONTRACTOR TO INSTALL 54"x36" TEE AND 36" GV VALVE FABRICATED UNDER CONTRACT WD-2817.
- CONTRACTOR SHALL COORDINATE WITH CITY REPRESENTATIVE FOR PICKING UP 54"x36" TEE AND 36" GV.

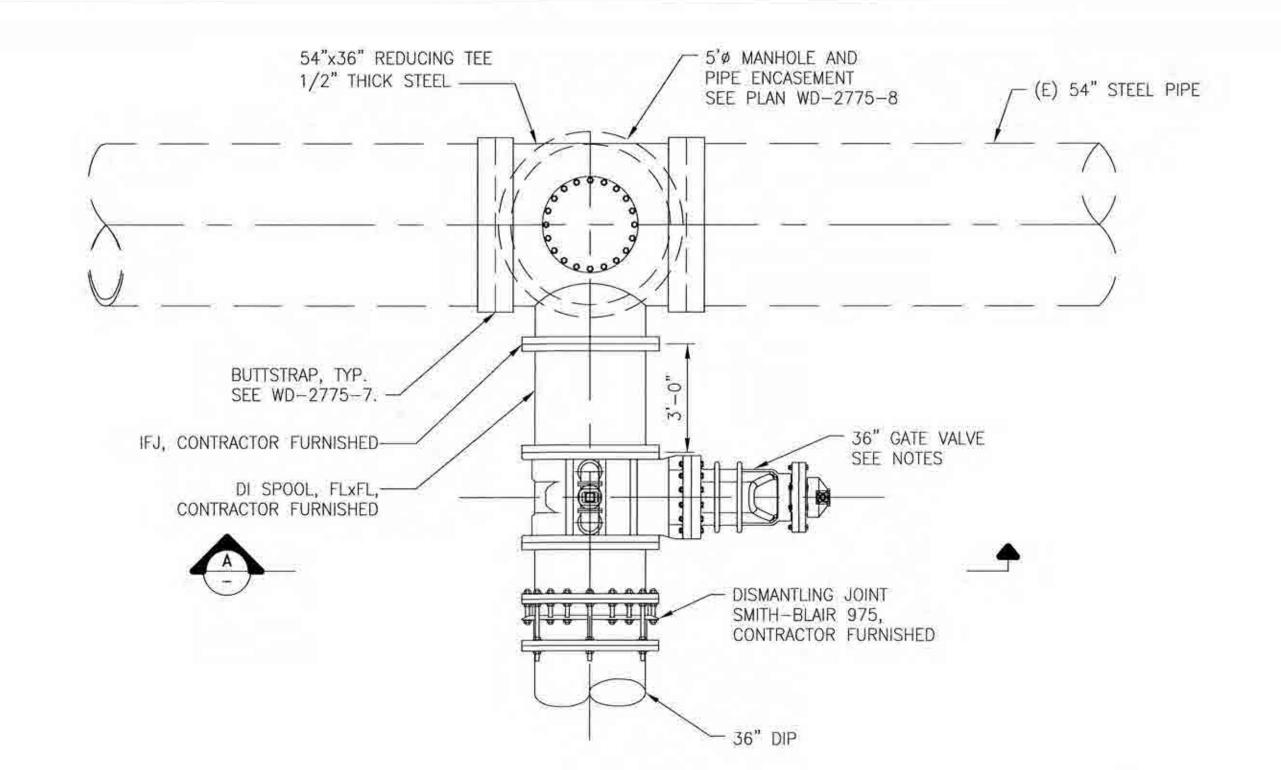

TEE CONNECTION DETAIL 54"øx36"ø TEE AND 36"ø GATE VALVE 3/8"=1'-0"



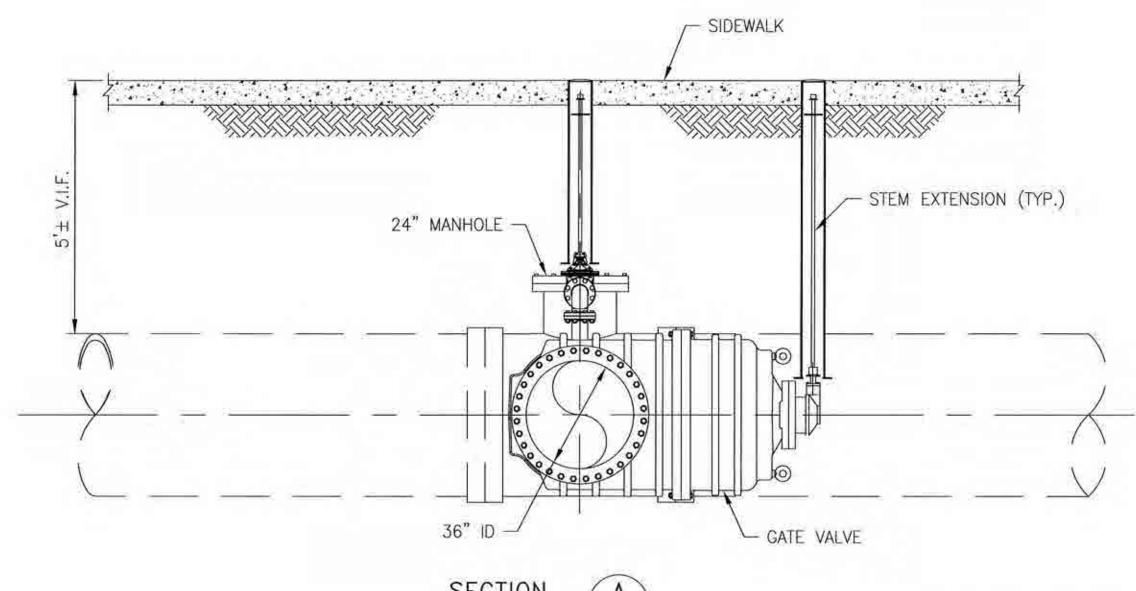

SECTION 3/8"=1'-0"

FOR THE SOLE USE OF THE DOCUMENT RECIPIENT - DO NOT CITE, COPY, OR CIRCULATE WITHOUT THE EXPRESSED PERMISSION OF THE SFPUC.

Rogalli

C 47898

10-26-2018

REFERENCES GATE BOOK PAGES, PLANS, SURVEY NOTES, ETC, USED CCSF 2013 NAVD88

ENGINEERING MANAGEMENT BUREAU INSTALLATION OF 16-INCH AND 36-INCH, AND RELOCATION C 8-INCH DUCTILE IRON WATER MAINS AT VARIOUS LOCATIONS

REVISIONS

ON 19TH AVENUE FROM HOLLOWAY AVENUE TO LINCOLN WAY INSTALLATION OF 54-INCH x 36-INCH TEE AND 36-INCH GATE VALVE

WATER CONTRACT NO. WD-2775

CITY AND COUNTY OF SAN FRANCISCO

PUBLIC UTILITIES COMMISSION

INFRASTRUCTURE DIVISION

CONTRACT NO. 2652J

BYU / RT AS SHOWN RT OCT 2018 WD-2775-10 E-31378

CONTRACT No. PLAN APPROVAL DATE PROJECT ID POST MILES TOTAL PROJECT DISTRICT COUNTY ROUTE 04-0G3501 0400000325 SF R0.94/4.05

PLOT: EXTEND SCALE: 1:1 BORDER:

22,34

22,34
COLOR: No.
RED 0.70MM
YELLOW 0.20MM
GREEN 0.25MM
CYAN 0.40MM
BLUE 0.50MM
MAGENTAO.20MM
WHITE 0.35MM
GRAY 0.15MM
9 0.15MM
10 1.00MM
100 0.70MM
210 0.60MM

FILE: Q:\CUW2600111\WD-2775\100%\WD-2775.DWG 10/26/2018 1:20 PM