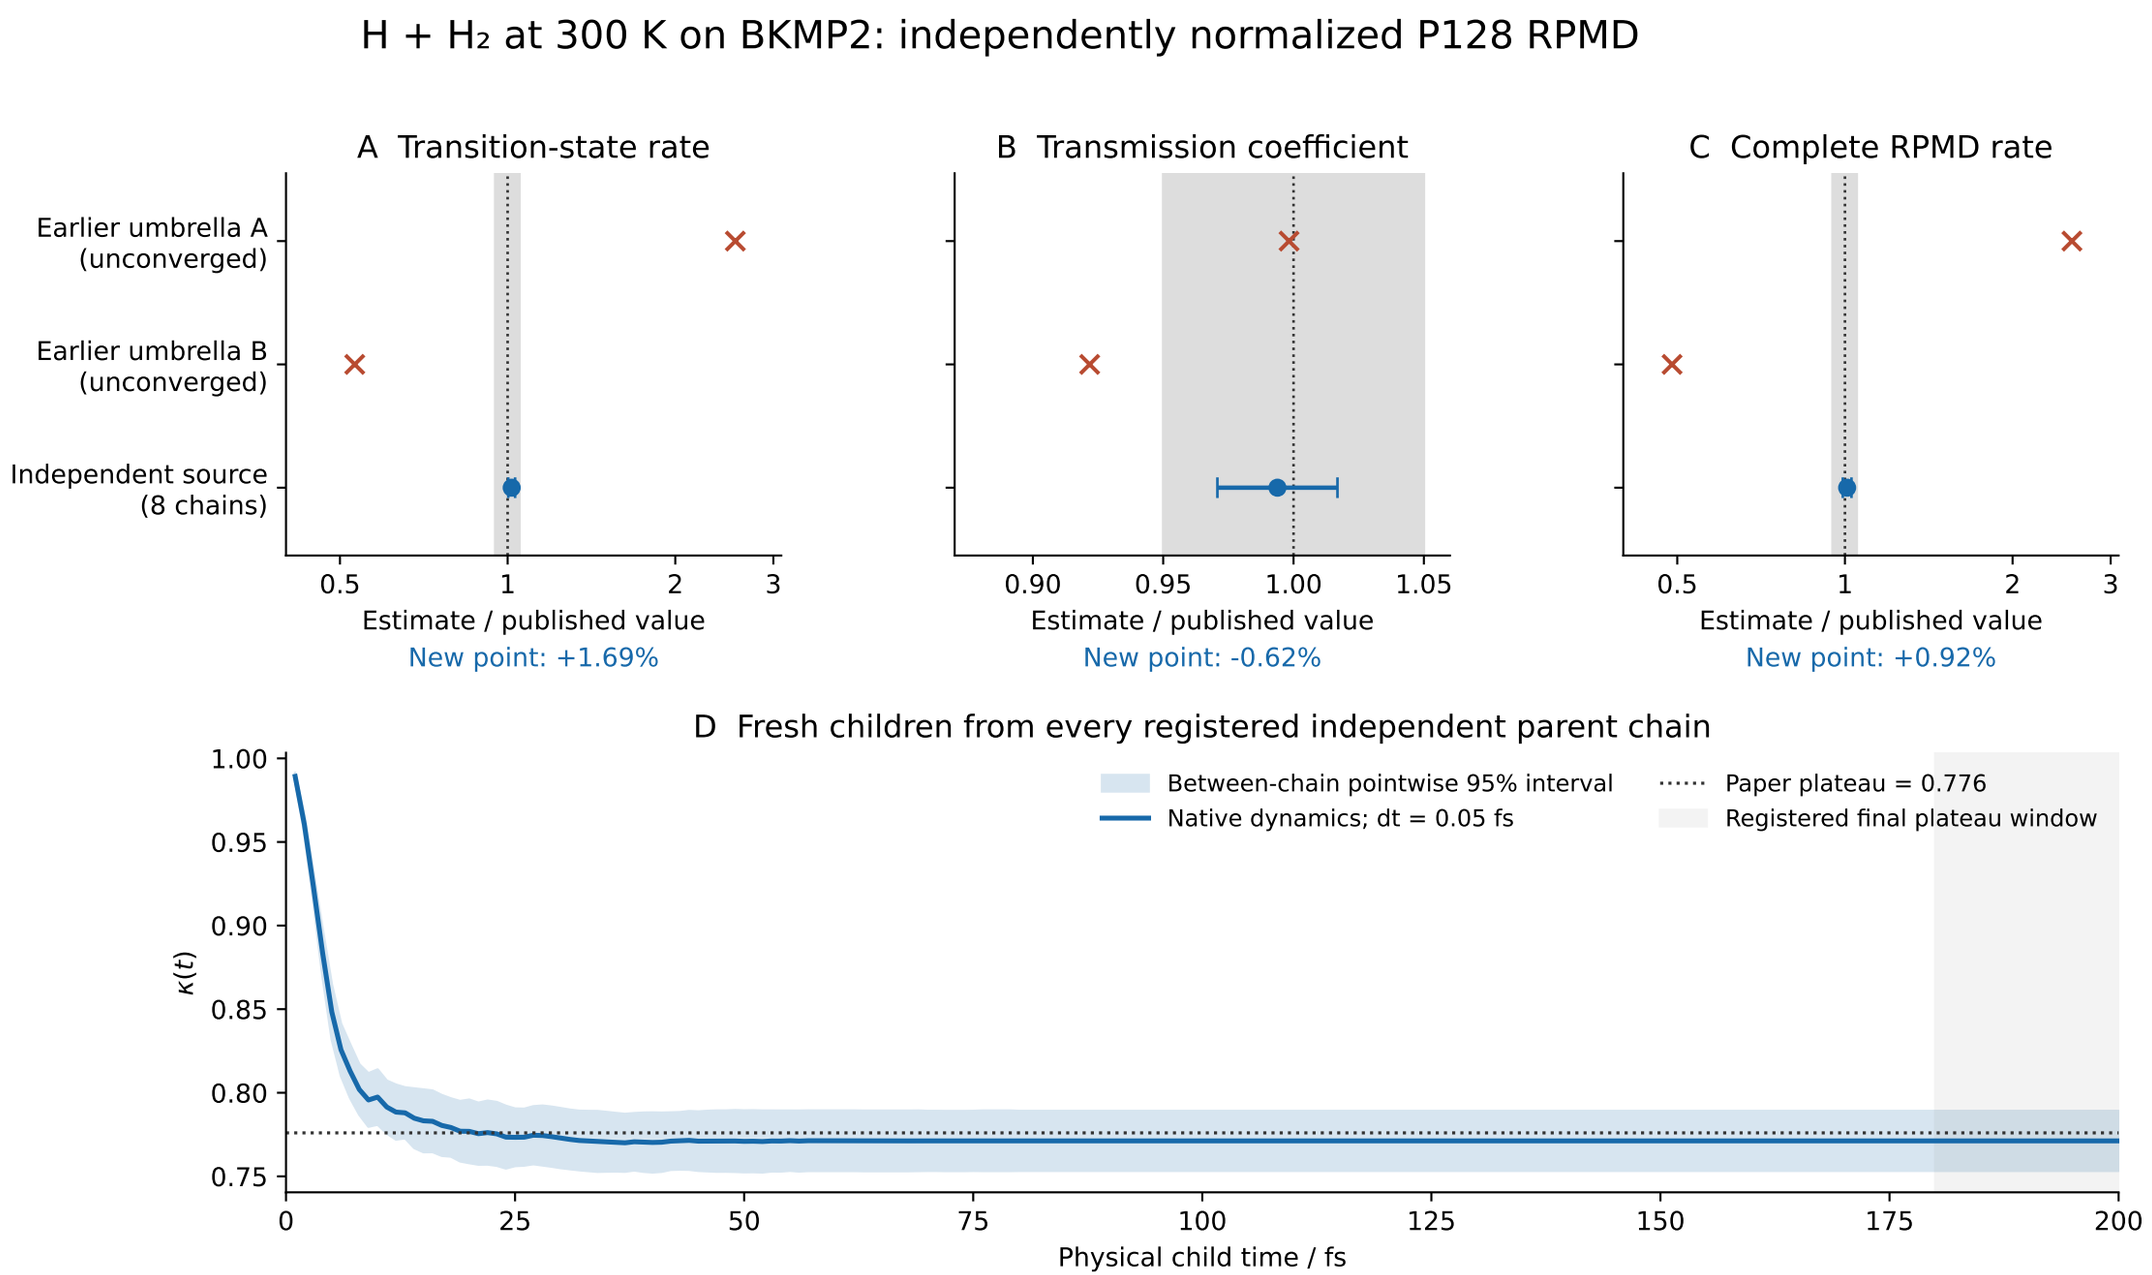

Full rate: 1.96786e-16 [1.93294e-16, 2.0034e-16] cm³ molecule⁻¹ s⁻¹ (95%). Registered fixed-P rate gates: PASS.

Transmission 95% relative half-width: 2.32%; registered limit: 3.00%.

New intervals use complete independent chains; the full-rate interval retains partition–transmission covariance.

Gray bands in A–C denote the paper's approximately ±5% precision, not a reconstructed confidence interval.

Earlier points failed sampling convergence; their unreliable bootstrap intervals are not used here. Separate bead/domain controls remain separate evidence.