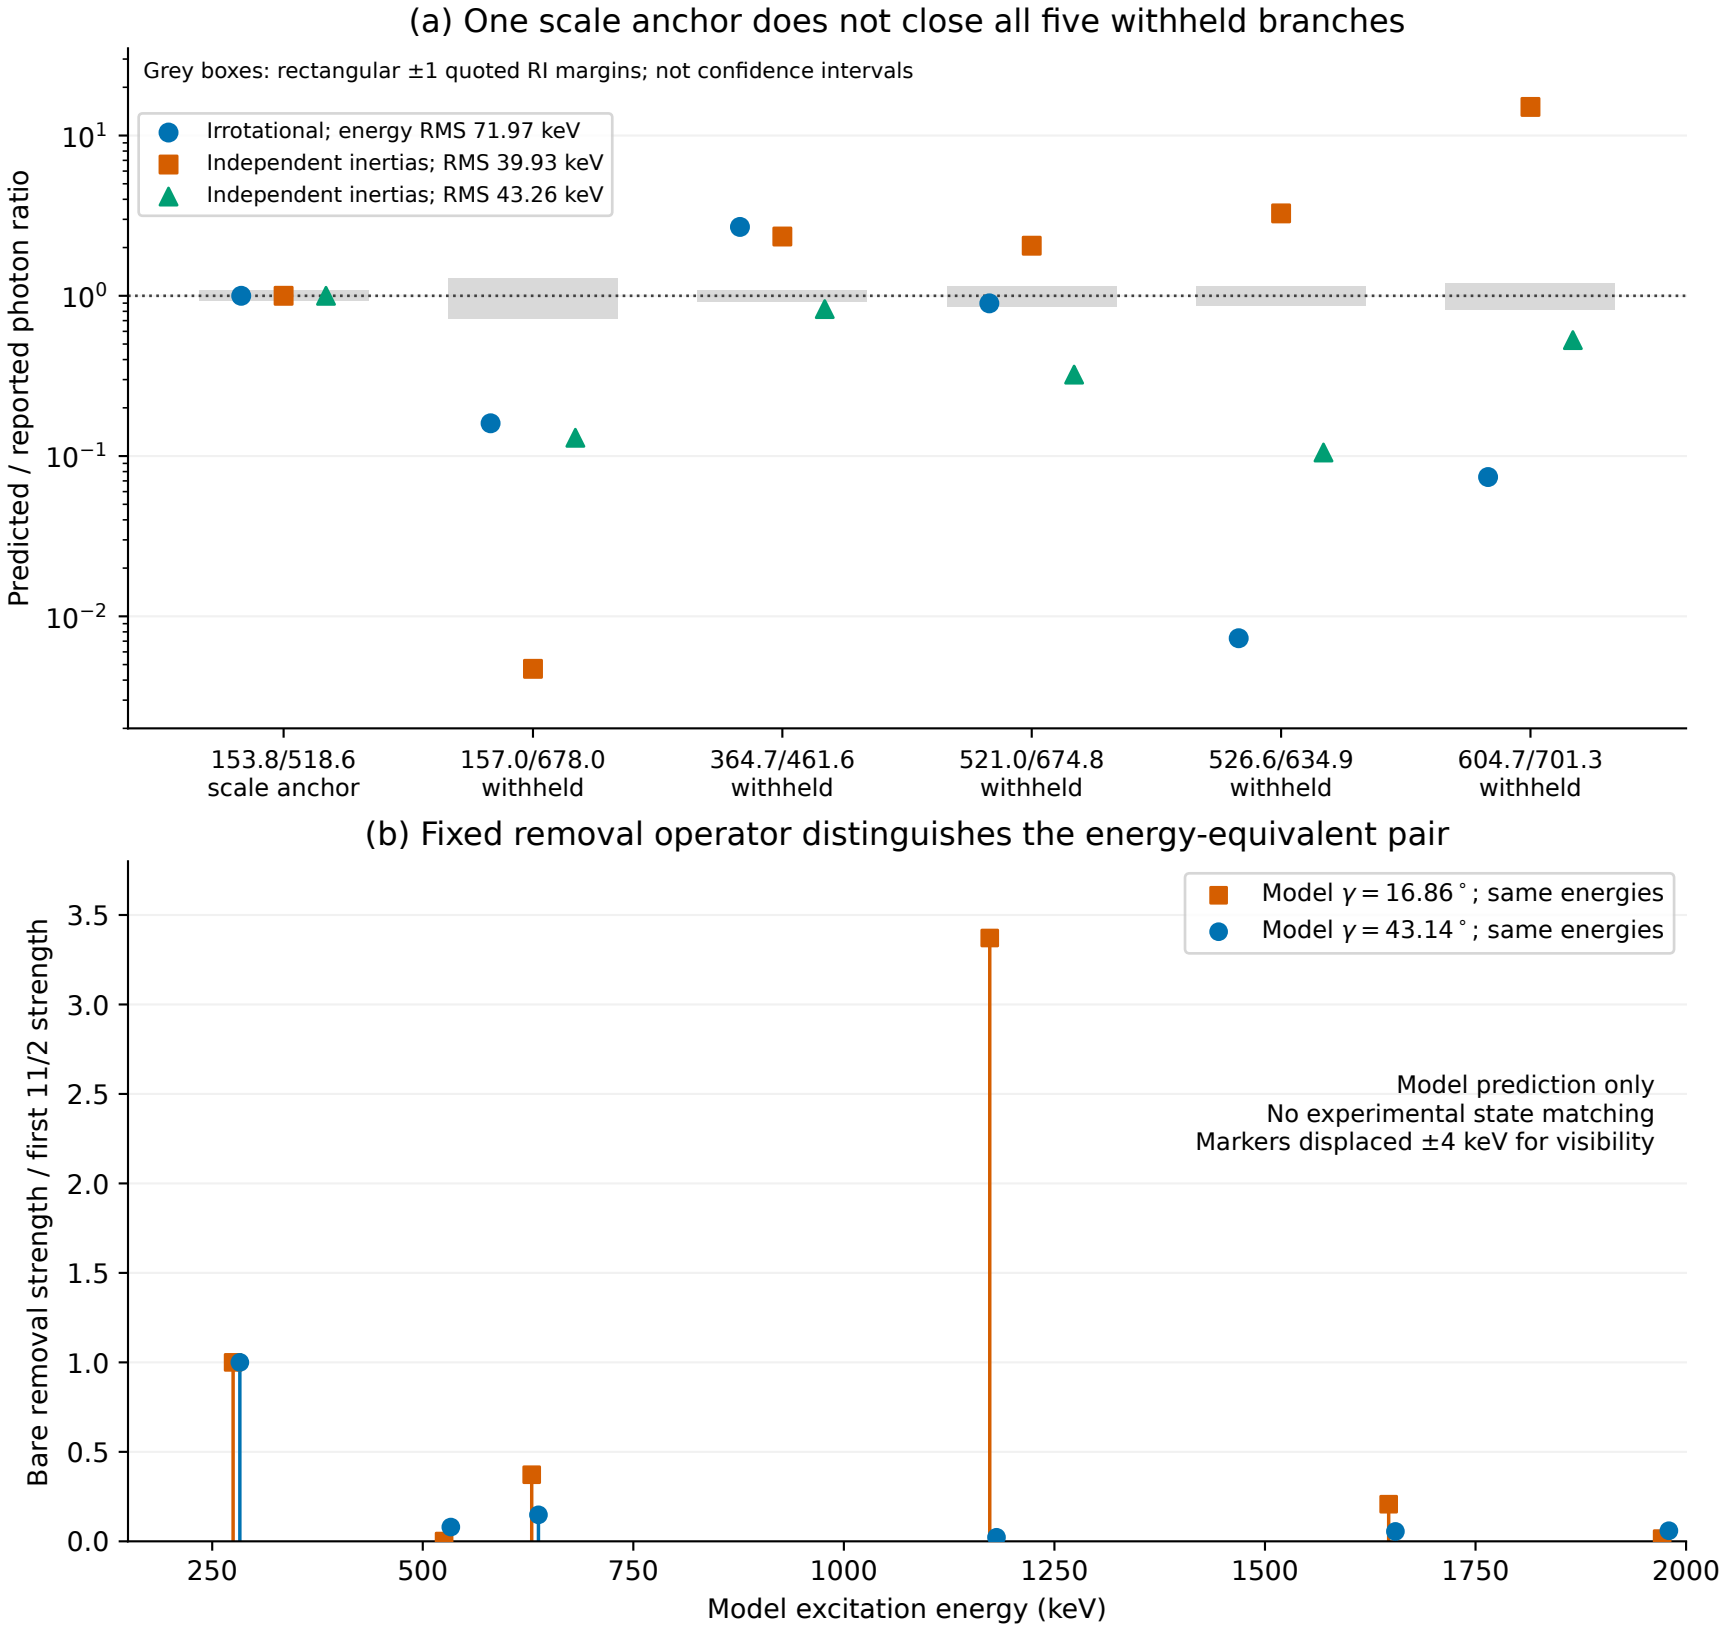
(a) One scale anchor does not close all five withheld branches
Grey boxes: rectangular ±1 quoted RI margins; not confidence intervals
Irrotational; energy RMS 71.97 keV
Independent inertias; RMS 39.93 keV
Independent inertias; RMS 43.26 keV
Predicted / reported photon ratio
$10^{1}$
$10^{0}$
$10^{-1}$
$10^{-2}$
153.8/518.6
scale anchor
157.0/678.0
withheld
364.7/461.6
withheld
521.0/674.8
withheld
526.6/634.9
withheld
604.7/701.3
withheld
(b) Fixed removal operator distinguishes the energy-equivalent pair
Model $\gamma = 16.86^\circ$; same energies
Model $\gamma = 43.14^\circ$; same energies
Model prediction only
No experimental state matching
Markers displaced ±4 keV for visibility
Bare removal strength / first 11/2 strength
0.0
0.5
1.0
1.5
2.0
2.5
3.0
3.5
250
500
750
1000
1250
1500
1750
2000
Model excitation energy (keV)