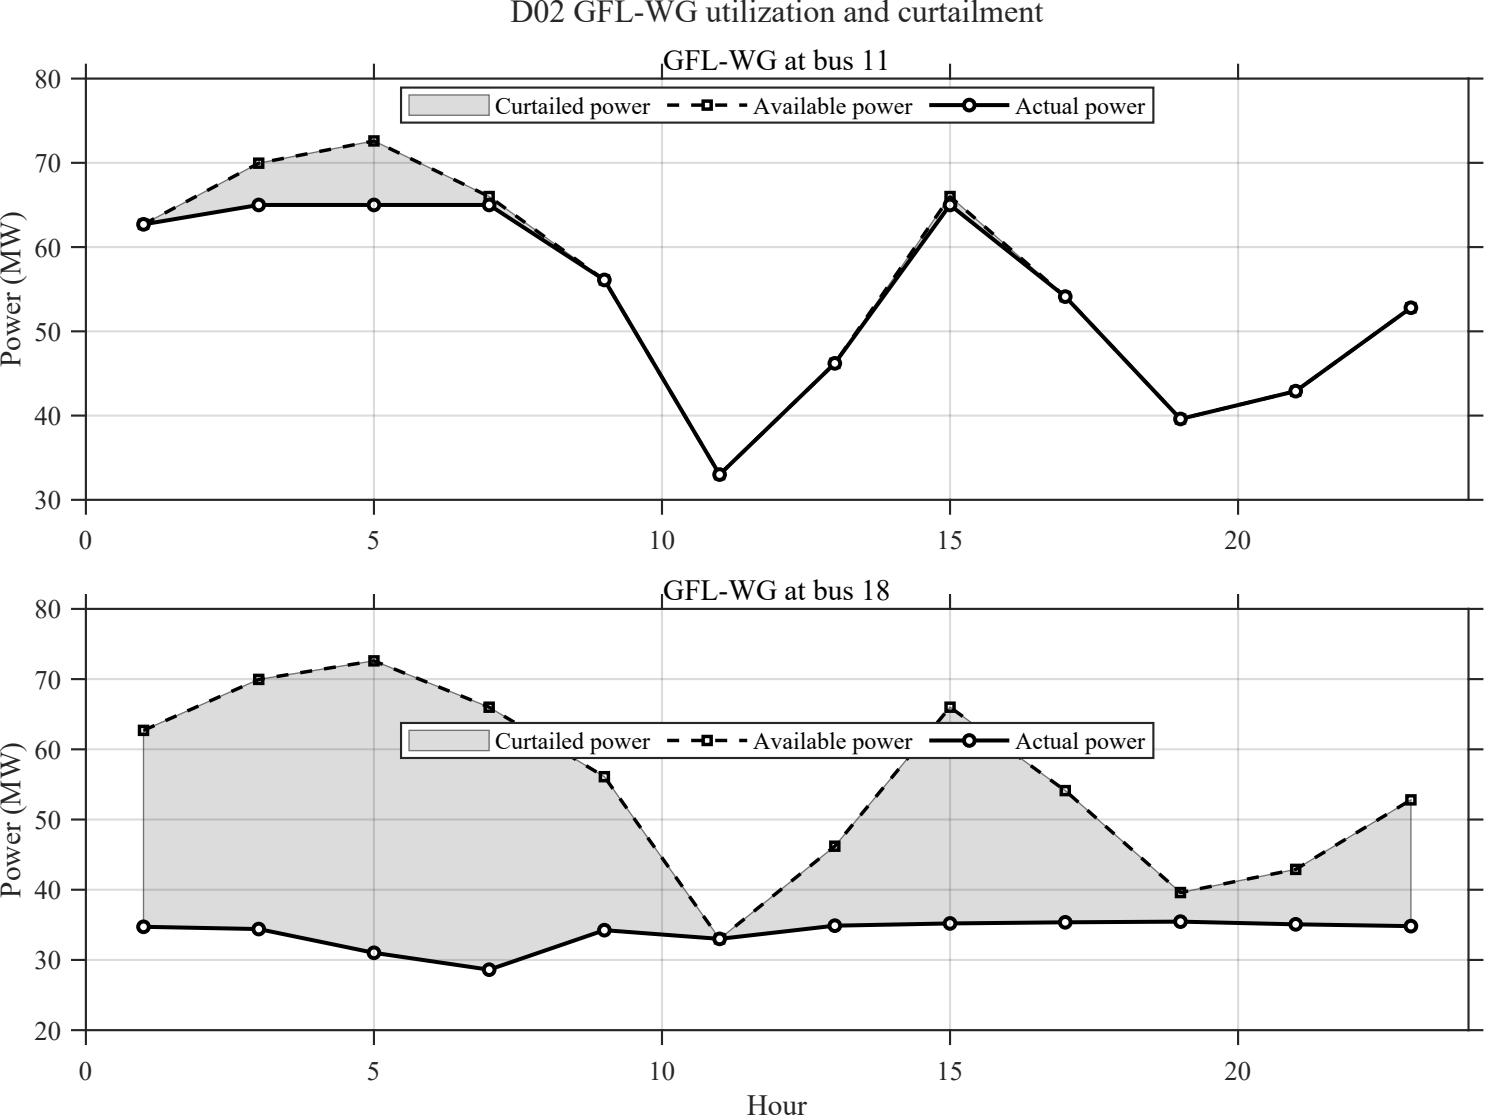
D02 GFL-WG utilization and curtailment
GFL-WG at bus 11
Curtailed power
Available power
Actual power
Power (MW)
80
70
60
50
40
30
0
5
10
15
20
GFL-WG at bus 18
Curtailed power
Available power
Actual power
Power (MW)
80
70
60
50
40
30
20
0
5
10
15
20
Hour