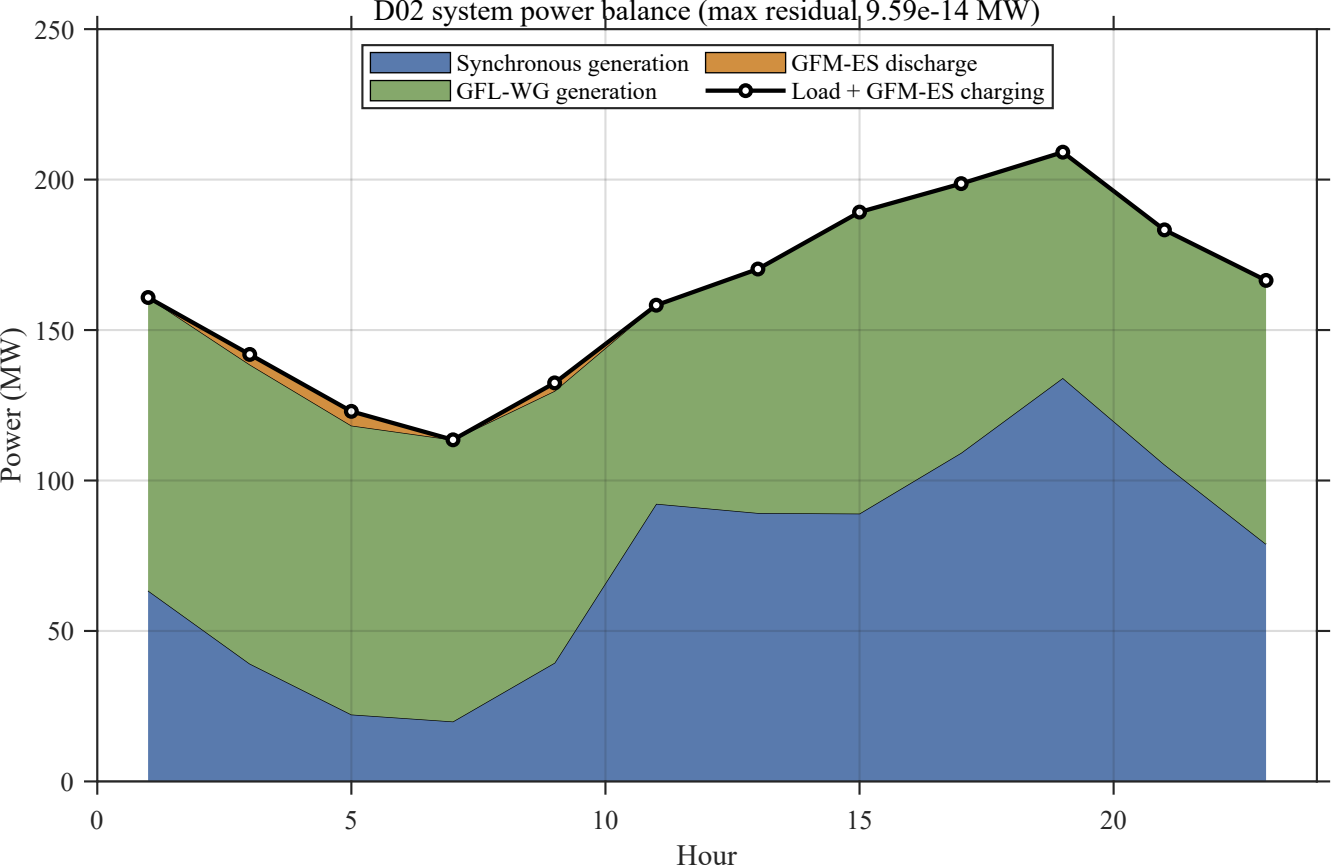
D02 system power balance (max residual 9.59e-14 MW)
Synchronous generation
GFM-ES discharge
GFL-WG generation
Load + GFM-ES charging
Power (MW)
Hour
0
50
100
150
200
250
0
5
10
15
20