


Enrolled On Time Specification Test

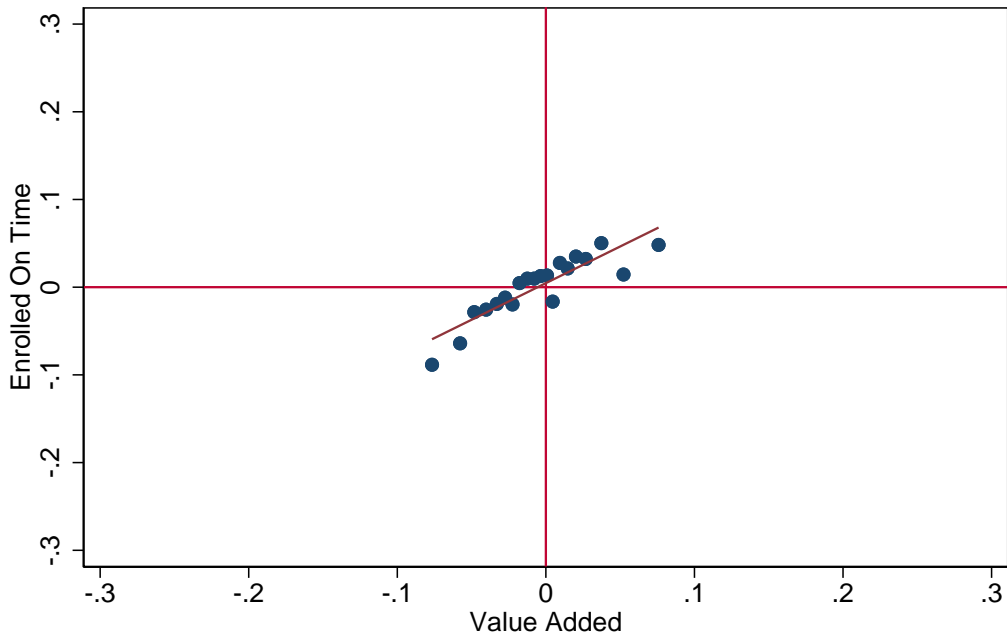

Slope (Standard Error) = 0.835 (0.083)