


Enrolled On Time 2-Year Specification Test

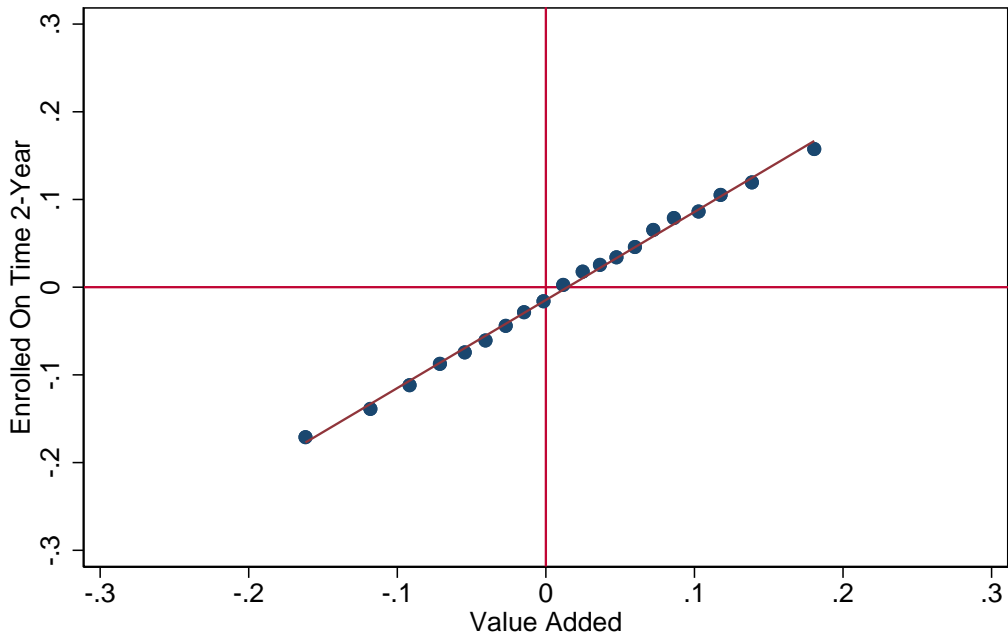

Slope (Standard Error) = 1.004 (0.006)