


Enrolled On Time Specification Test

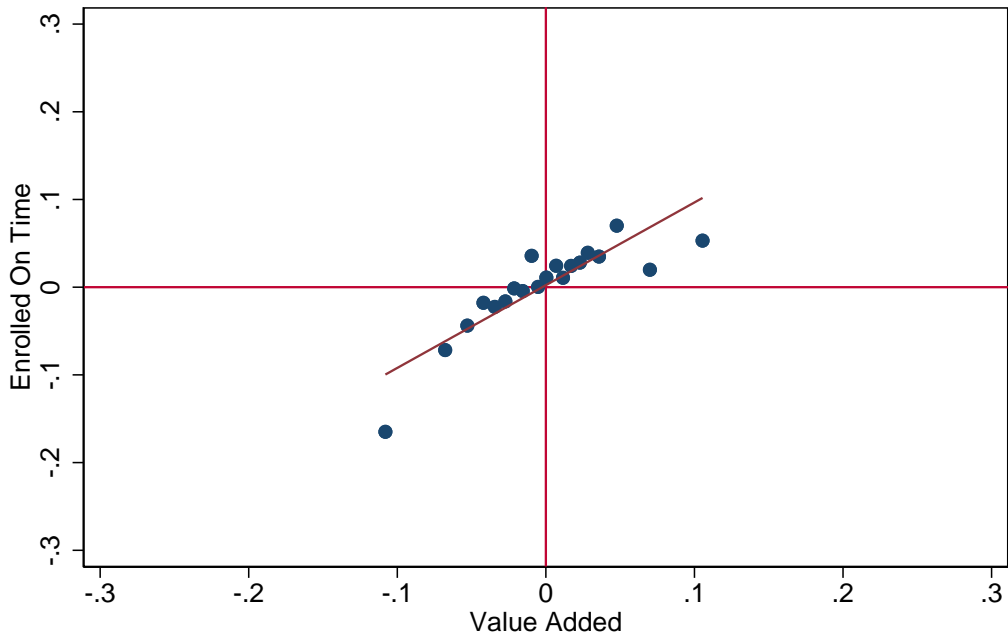

Slope (Standard Error) = 0.943 (0.070)