


Enrolled On Time 4-Year Specification Test

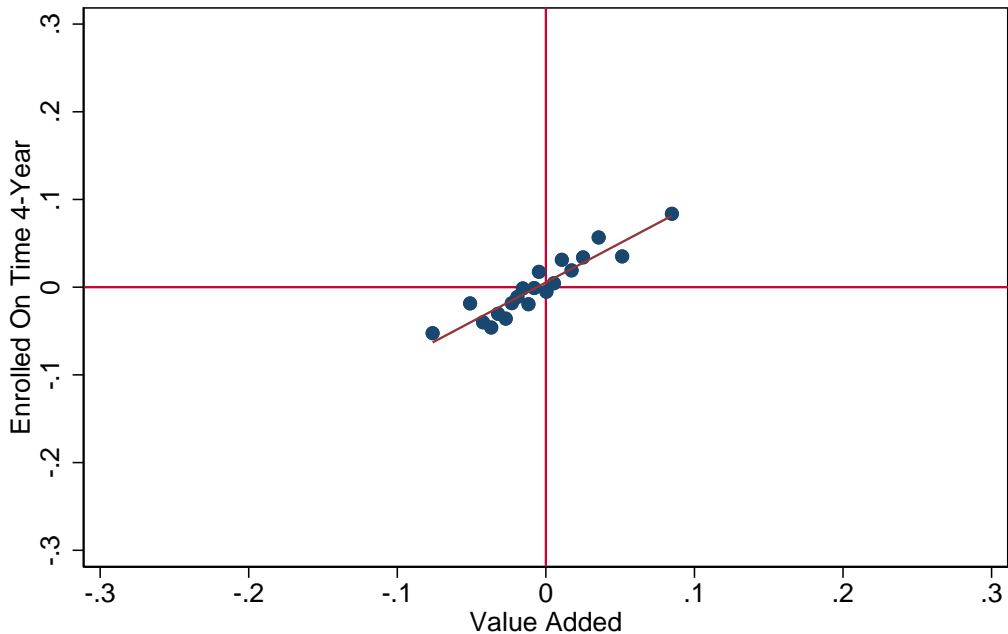

Slope (Standard Error) = 0.897 (0.073)