


Enrolled On Time Specification Test

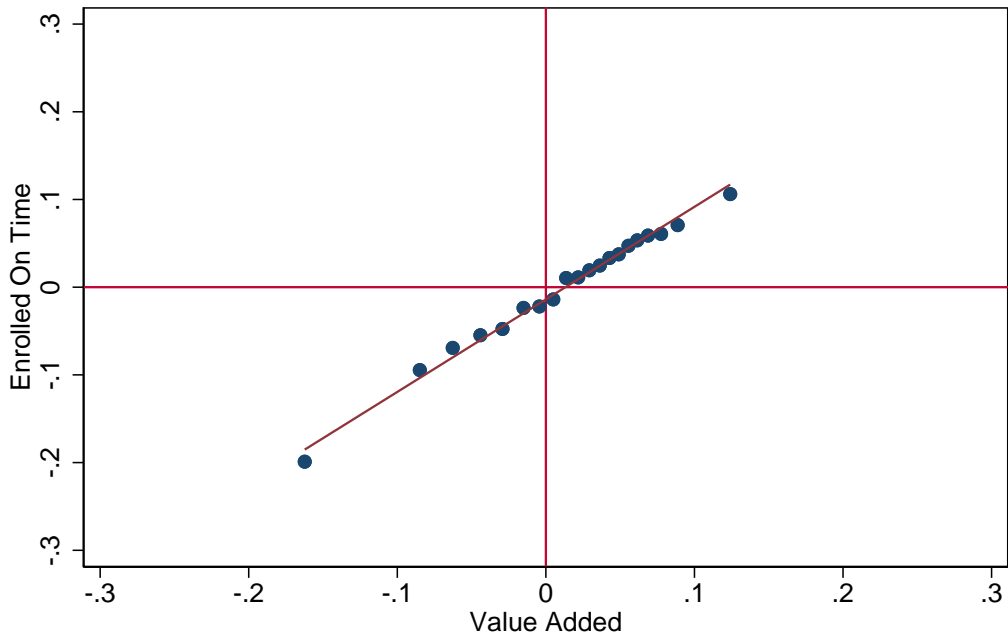

Slope (Standard Error) = 1.055 (0.011)