

DETAIL GENERAL NOTES:

- A. STRUCTURAL COMPONENTS SHALL BE INSTALLED PER CODE AND AHJ REQUIREMENTS.
 - B. CONDUCTORS MUST BE LISTED FOR WET LOCATIONS.(THWM).

DETAIL KEYNOTES;

1. PROVIDE A MINIMUM OF 24" FROM TOP OF BASE TO FINISHED GHADE WHEN BASE IS WITHIN 5' OF A PARKING STALL. PROVIDE A MINIMUM OF 6" IN ALL OTHER LOCATIONS.

SITE NORMAL POWER PHOTOMETRIC CALC					
CALCULATION POINT NAME	AVG	MAX	MIN	Avg/Min	Max/Min
Site NW Driveway 1	1.1 fc	3.6 fc	0.2 fc	4.9	15.8
Site W Driveway 2	1.3 fc	3.5 fc	0.5 fc	2.9	7.7
Site S Parking	0.7 fc	1.2 fc	0.2 fc	4.5	8.1
Site E Parking	4.8 fc	8.1 fc	1.4 fc	3.5	5.9
Site NE Parking	5.2 fc	9.4 fc	1.5 fc	3.5	6.3
Site N Parking 1	2.4 fc	7.2 fc	0.7 fc	3.7	10.7
Site N Parking 2	5.8 fc	8.2 fc	3.6 fc	1.6	2.3
Site N Driveway	3.2 fc	9.6 fc	1.7 fc	1.9	5.7
Site NW Driveway 2	7.2 fc	14.4 fc	0.9 fc	8.0	16.1
Site S Driveway	3.3 fc	11.7 fc	0.7 fc	4.6	16.5
Site Walkway	5.4 fc	9.9 fc	3.1 fc	1.8	3.3
Site NW Parking 1	2.7 fc	6.4 fc	0.4 fc	6.9	16.3
Site NW Parking 2	4.6 fc	11.5 fc	0.7 fc	7.0	17.6
Site NW CAR DETAIL	3.3 fc	6.8 fc	0.8 fc	4.4	9.1
Site W Parking 1	7.1 fc	11.1 fc	3.7 fc	1.9	3.0
Site W Driveway 1	4.0 fc	7.8 fc	1.8 fc	2.3	4.5
Site W Parking 2	1.8 fc	4.5 fc	0.7 fc	2.6	6.5
Site W Parking 3	1.0 fc	3.4 fc	0.2 fc	4.2	13.7
Site W Driveway 3	1.1 fc	2.7 fc	0.2 fc	4.6	11.6
Site W Parking 4	2.7 fc	5.5 fc	0.8 fc	3.4	7.1
Site W Driveway 4	5.4 fc	8.2 fc	2.8 fc	2.0	3.0
Site W Parking 5	6.3 fc	10.7 fc	2.6 fc	2.5	4.2
Site E Driveway	4.2 fc	10.2 fc	0.9 fc	4.9	11.8
Site NE Driveway	3.3 fc	9.6 fc	1.0 fc	3.4	9.8

GENERAL SHEET NOTES

- A. VALUES SHOWN INDICATE ESTIMATED ILLUMINATION LEVEL AT GRADE IN FOOT-CANDLES.
- B. REFERENCE THE LIGHT FIXTURE SCHEDULE FOR COMPLETE MANUFACTURER, MODEL, AND PERFORMANCE INFORMATION.

STAMP:

**NOT FOR
CONSTRUCTION**

Design Professional's electronic or digital seal or signature is effective only as to that version of this document as originally published by Design Professional. Design Professional is not responsible for any subsequent modification, corruption, or unauthorized use of such a seal or signature. If there is any conflict between this stamp and any seal or signature placed on this document, the seal or signature placed on this document shall prevail.

Hillside

architecturepllc

CRASH CHAMPION

303 AUTOSHOW AVE.
SURPRISE, AZ 85388

PREPARED FOR:

CRASH

CHAMPION

LRG INVESTORS

303 AUTOSHOW AVE.
SURPRISE, AZ 85388

REVISIONS


Project No.: 24
Drawn By:
Reviewed By:
Date: 11/04/
0 2.7 5.3 10.7 21.3

SCALE: 3/32" = 1'-0"

004

SITE PLAN - NORMAL POWER PHOTOMETRIC

E-103

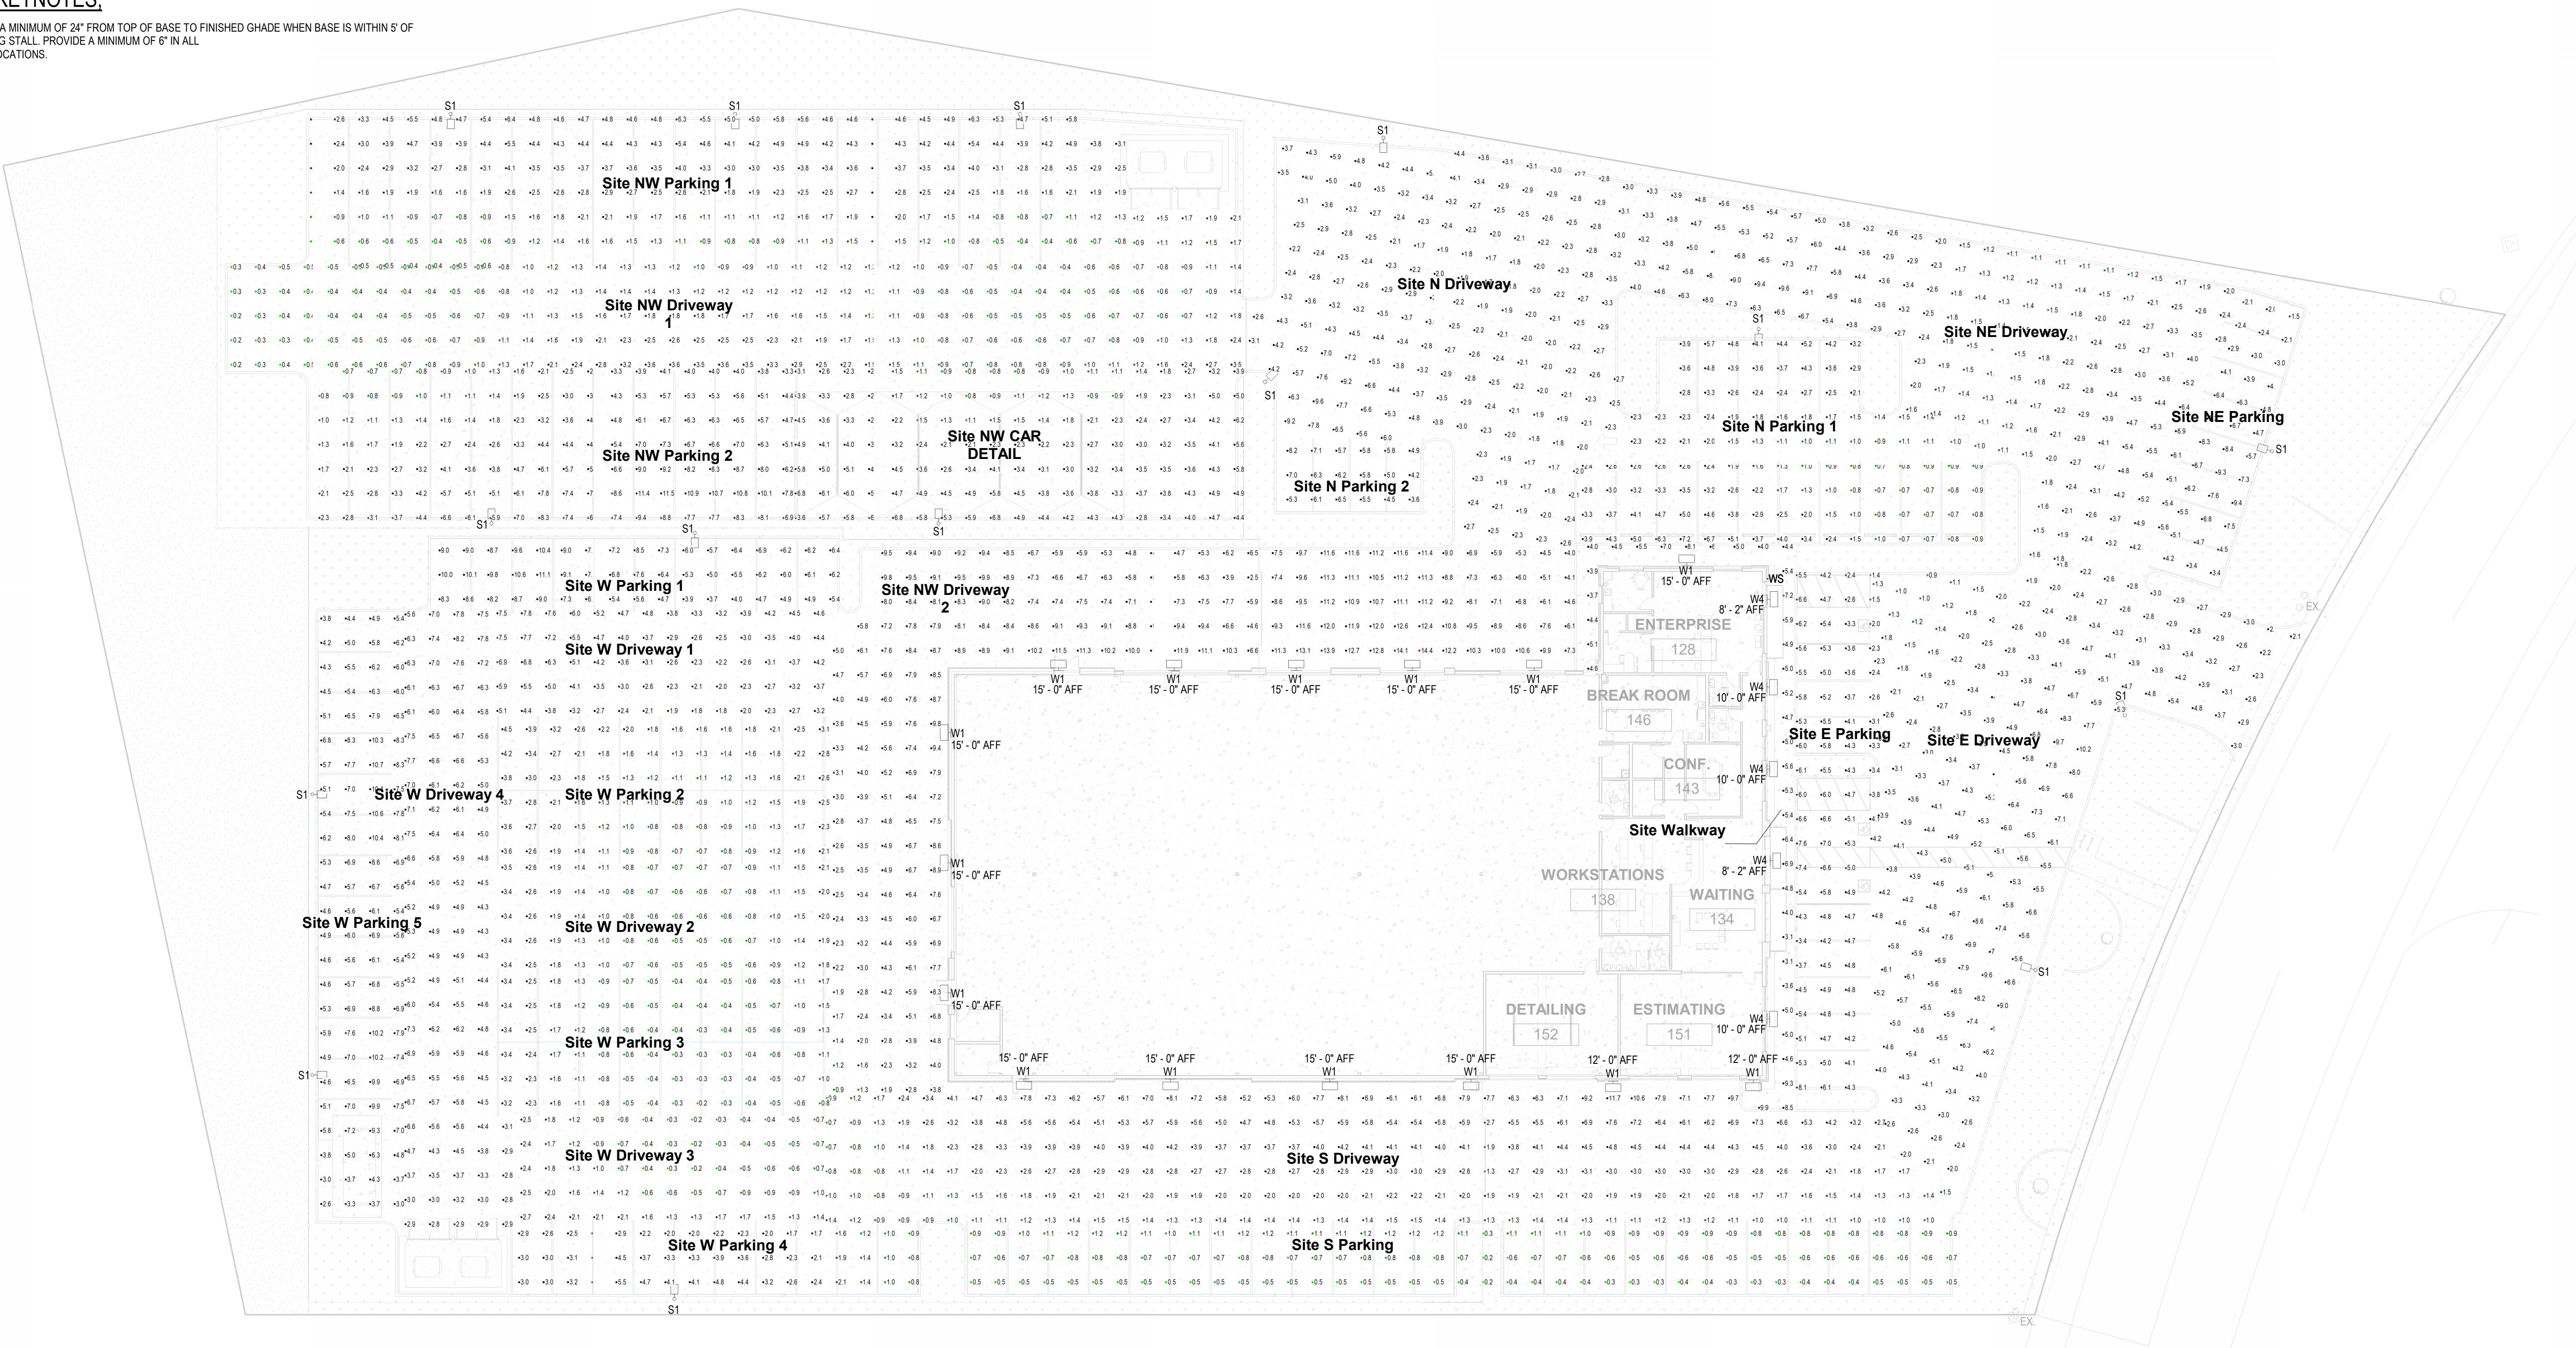

**1 SITE NORMAL POWER PHOTOMETRIC PLAN
3/64" = 1'-0"**